Important notes for electrical contractor


All directional light fittings to be angled by electrical contractor onto product/ displays/ artwork/ tables/ other in accordance with the lighting drawing/ any designer or client instructions. This must be carried out in advance of the final lighting commissioning/ any programming visit by the lighting consultant/ dimming engineer. Into Lighting do not carry out any works at high level.

Where DMX control is shown on the lighting layout the DMX control cabling should be wired in a daisy-chain using Belden 9841 cable, the maximum cable length from the source of the DMX output to the furthest DMX driver is 250m. A maximum of 32 DMX units can be connected to each DMX universe. If you have any questions about how to wire the DMX signal cable please contact Into on 0845 873 7013 or at technical@into.co.uk

Important note for emergency lighting design and specification

Where Into Lighting drawings show layouts for emergency lighting these are provisional layouts to help ensure sympathetic integration into the architecture and general lighting scheme. It is the responsibility of the mechanical and electrical consultant/ contractor to ensure that the emergency lighting scheme and specification meets with BS5266 and any local requirements. Where Into Lighting drawings do not show provisional layouts for emergency lighting it is the responsibility of the mechanical and electrical consultant/ contractor to provide the layout and specification.

It is the responsibility of the installing electrical contractor/ consultant to ensure the appropriate specification, supply and install of fire and/or acoustic hoods / down lights where required. The specification should meet with the specific site requirements, be fully compatible with any down lights specified and be installed in accordance with the manufacturers guidelines.

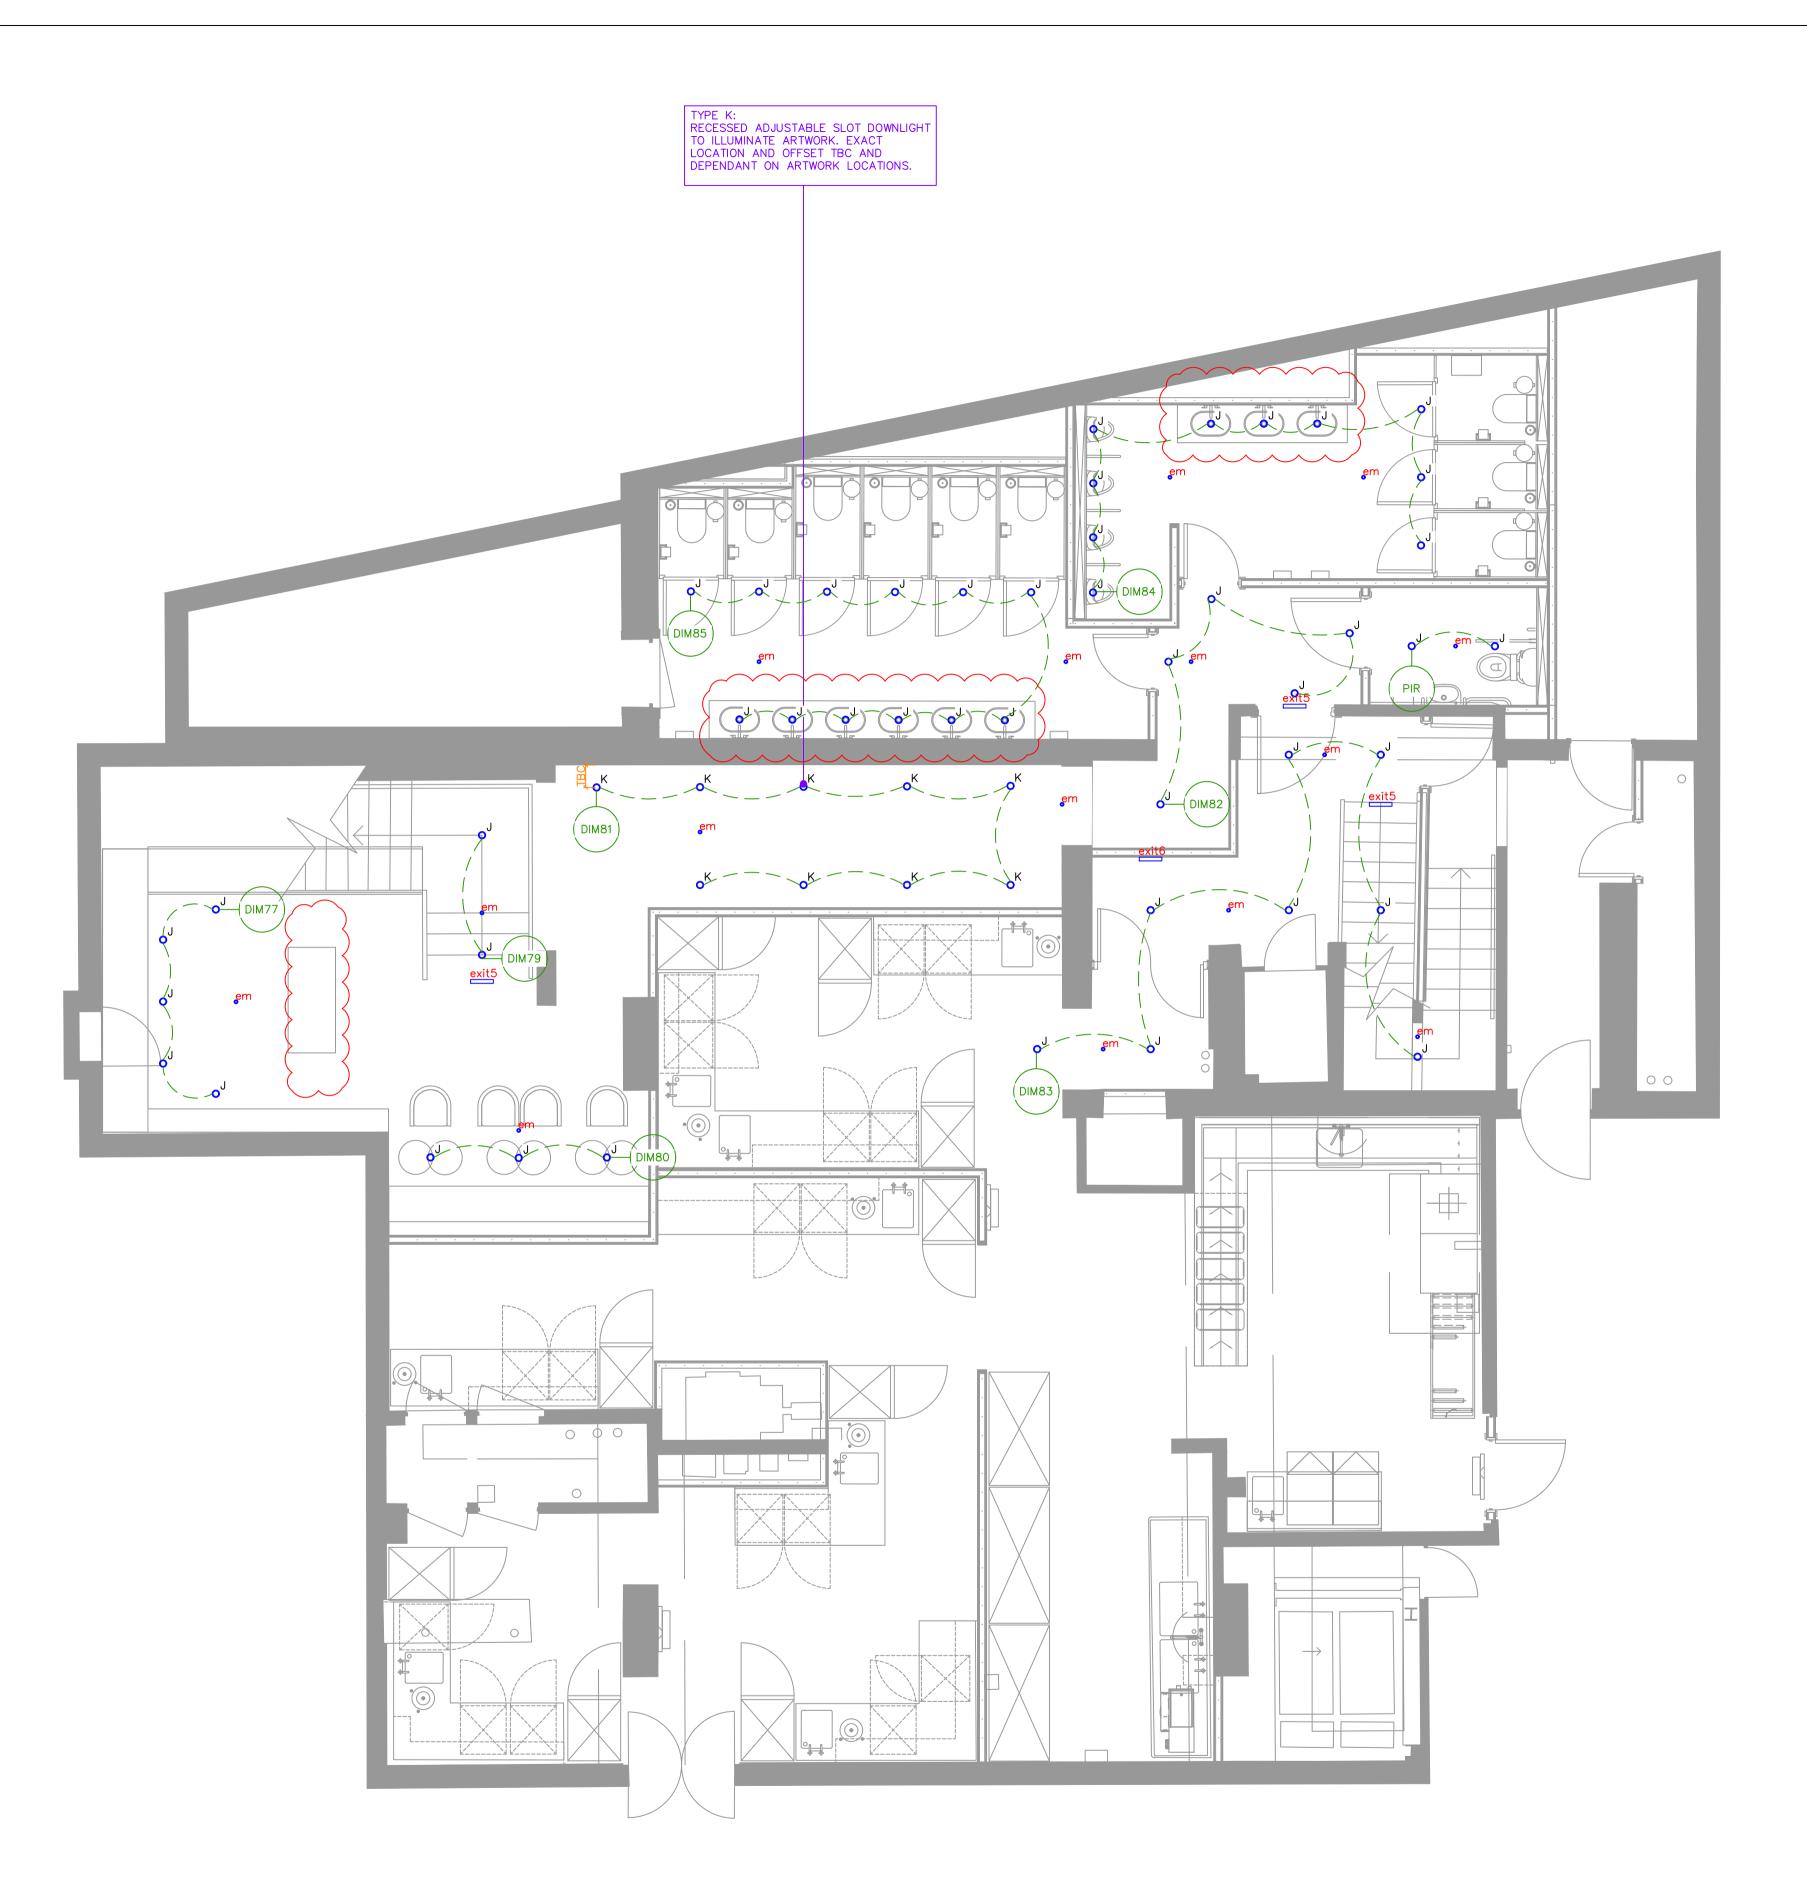

INTO LIGHTING LEGEND
J RECESSED ADJUSTABLE O DOWNLIGHT C/W 250MA 9W LED
• RECESSED ADJUSTABLE SLOT DOWNLIGHT C/W 250MA 9W LED
RECESSED EMERGENCY ROUTE LIGHT C/W 3W LED 3HOUR EMERGENCY BATTERY PACK
exit5 SIGN C/W LED 3HOUR EMERGENCY BATTERY PACK – ARROW UP
SEMI-RECESSED EMERGENCY EXIT SIGN C/W LED 3HOUR EMERGENCY BATTERY PACK - ARROW RIGHT
Symbols in key are not to scale
PROPOSED FOR PLANNING
REV C REVISIONS CLOUDED IN RED
REV B NEW RCP / GENERAL REVISIONS
Project Title
STREAT MARKETS LTD, CENTRE POINT, LINK BUILDING, W1
Drawing Title PROPOSED LIGHTING LAYOUT FOR PLANNING — BASEMENT RCP
Date 26.10.18Drawn JPScale 1:50 @ A1ProjectNumberRevision
12561 C04 C
4 O'Meara Street London SE1 1TE T: +44 (0) 845 873 7013 F: +44 (0) 845 873 7018
E: email@into.co.uk This drawing and all associated documents issued for the purposes of design information remain the intellectual property of Into Lighting Limited. This drawing and all associated documents or information developed from their contents may not be distributed to unauthorised parties without prior consent from Into Lighting Limited. In the event that this
occurs, Into Lighting Limited reserve the right to retrieve a design fee. The positions shown on this drawing represent design intent, any queries should be checked with the design team. All dimensions must be checked on site Do not scale from this drawing