

Cooper Associates

Consulting Structural Engineers




CA4735.02

April 2018

6 Bartholomew Place
London EC1A 7HH
Telephone 020 7606 0192
post@engcooper.com
www.engcooper.com

44 Goldhurst Terrace, London NW6 3HT.

Flood Risk Assessment.

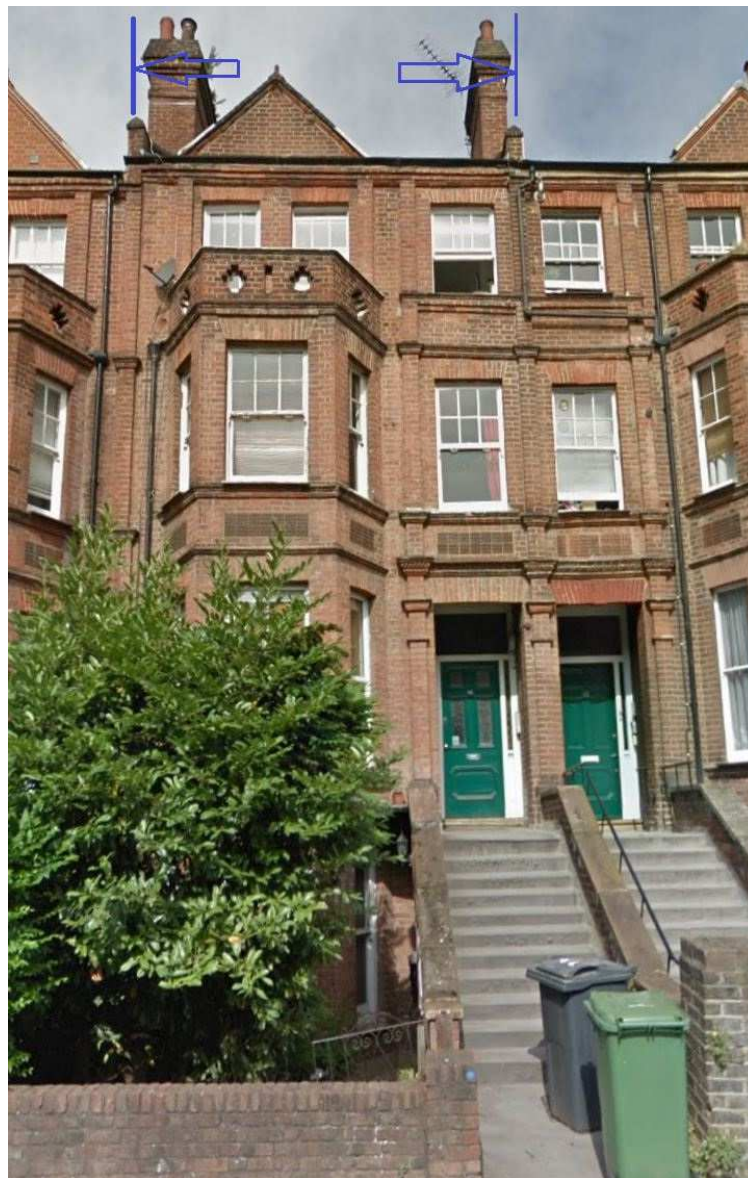

It is intended to construct a basement level below this four story terraced house, that is currently converted into flats.

The British Geological Survey maps show that the property is founded on 'London Clay Formation'. This agrees with our experience of trial holes in the area, including foundation works at other properties in this road

Bore holes in the area (provided by the British Geological Survey) show that London Clay will be found below the property.

A borehole carried out at the site and presented as appendix C as part of the BIA prepared by Solid Geometry Structural Engineers, shows that below approximately 1 metre depth of Made Ground, clay was found for the full depth of the 5.75 m deep borehole. No water was found in the borehole. This is as expected as clay is normally considered to be an impermeable material

Although detailed landscaping and surface treatment has yet to be designed, it is expected that there will be some marginal increase in the area of hardstanding at the front and the rear of the property. As the existing building is already embedded in the London Clay, the construction of a basement will not have an impact on the water flow across the site. A schedule of areas at the end of this written section shows the increase in impermeable area to be only 3.36 m² or about 13.5%.

The new hardstanding - primarily the areas of the new lightwells to the front and rear of the basement, will be drained by a designed rain water drainage system and so the water will be controlled in a more controlled manner than currently exists.

Photographs on sheet 6 of this report, shows that the property has a woodland area to the rear and so the marginal increase in hardstanding will have no impact to the rear of the property.

Both foul and rainwater drainage will be routed via the existing drain run, using a pump where necessary. The drainage design will be compliant with Camden's Planning Policy and the National Planning Policy Framework.

Information from the environmental agency (Page 10 below) shows that the property is at a very low risk of flooding from rivers or seas.

The risk of flooding from surface water in the surrounding area is considered to be very low (page 12). The risk from Reservoirs is considered to be very low (page 13).

Although the Environment Agency has published the above and appended information, the London Borough of Camden have published records of surface water flooding - which we have reproduced on page 10. This shows that Goldhurst Terrace was flooded in 1975 and in 2002. As a result, the risk of surface flooding cannot be entirely ruled out.

The property is however in a Local Flood Risk Zone and a critical drainage zone, as illustrated in the attached flood and drainage risk map.

The occupants of the development can mitigate any residual risk by using the Flood Warning Service subscribing to the Floodline Warning Direct and listening to the available information (www.gov.uk/sign-up-for-flood-warnings).

Escape from the front and rear of the property can be achieved via a fixed ladder in the front lightwell and via a fixed spiral staircase in the lightwell to the rear of the property.

The lower ground floor level will be closed in times of flooding and the internal access from the basement to the ground floor can be utilised should an evacuation be necessary. Safe refuge is also provided on the upper floors of the building should this be necessary.

Flood resilience measures will be incorporated into the design of the lower ground floor to prevent the ingress of water. This will include concrete ground slabs and appropriate waterproofing methods etc. Page 14 illustrates a typical waterproofing method. Page 15 indicates a typical pumping detail.

Mitigation against the ingress of any surface water from the street to the basement level will be incorporated in the detailed design surface water drainage strategy. This will include fitting non-return valves to the foul and surface

water system to prevent sewers surcharging into the dwelling should the outlet become submerged under extreme floor conditions.

Flood resilient building materials and fittings will be used. All service ducts / gaps etc., to accommodate utilities such as gas, electricity and telephone cables to the lower ground floor level, will be sealed with silicone.

This FRA meets the requirements of the EAs Flood Risk Standing Advice for Minor Extensions in Flood Zones 2 and 3; the external footprint is less than 250sqm (the property is in Flood Zone 1).

Report prepared by

Eur Ing **Martin Cooper**, BSc, CEng, MICE, MStructE.

Cooper Associates.

KOKORELIA**ARCHITECTS**

Project: 44 Goldhurst Terrace
Date: 14.09.2018
Title: Change in Impermeable Area

Calculation of existing impermeable area:

Front area: 4.36sqm
Rear terraced area: 14.56 sqm
Concert platform at north east corner: 6 sqm (to be removed during the works)

Calculation of proposed impermeable area:


Front area lightwell: 4.36sqm (as existing)
New rear terraced area: 9.36 sqm
Rear extension and lightwell: 14.62 sqm

Increase of impermeable area due to the works: 3.36 sqm




Above (across left hand boundary) and Below (view down the garden) – woodland area to the rear of the property.




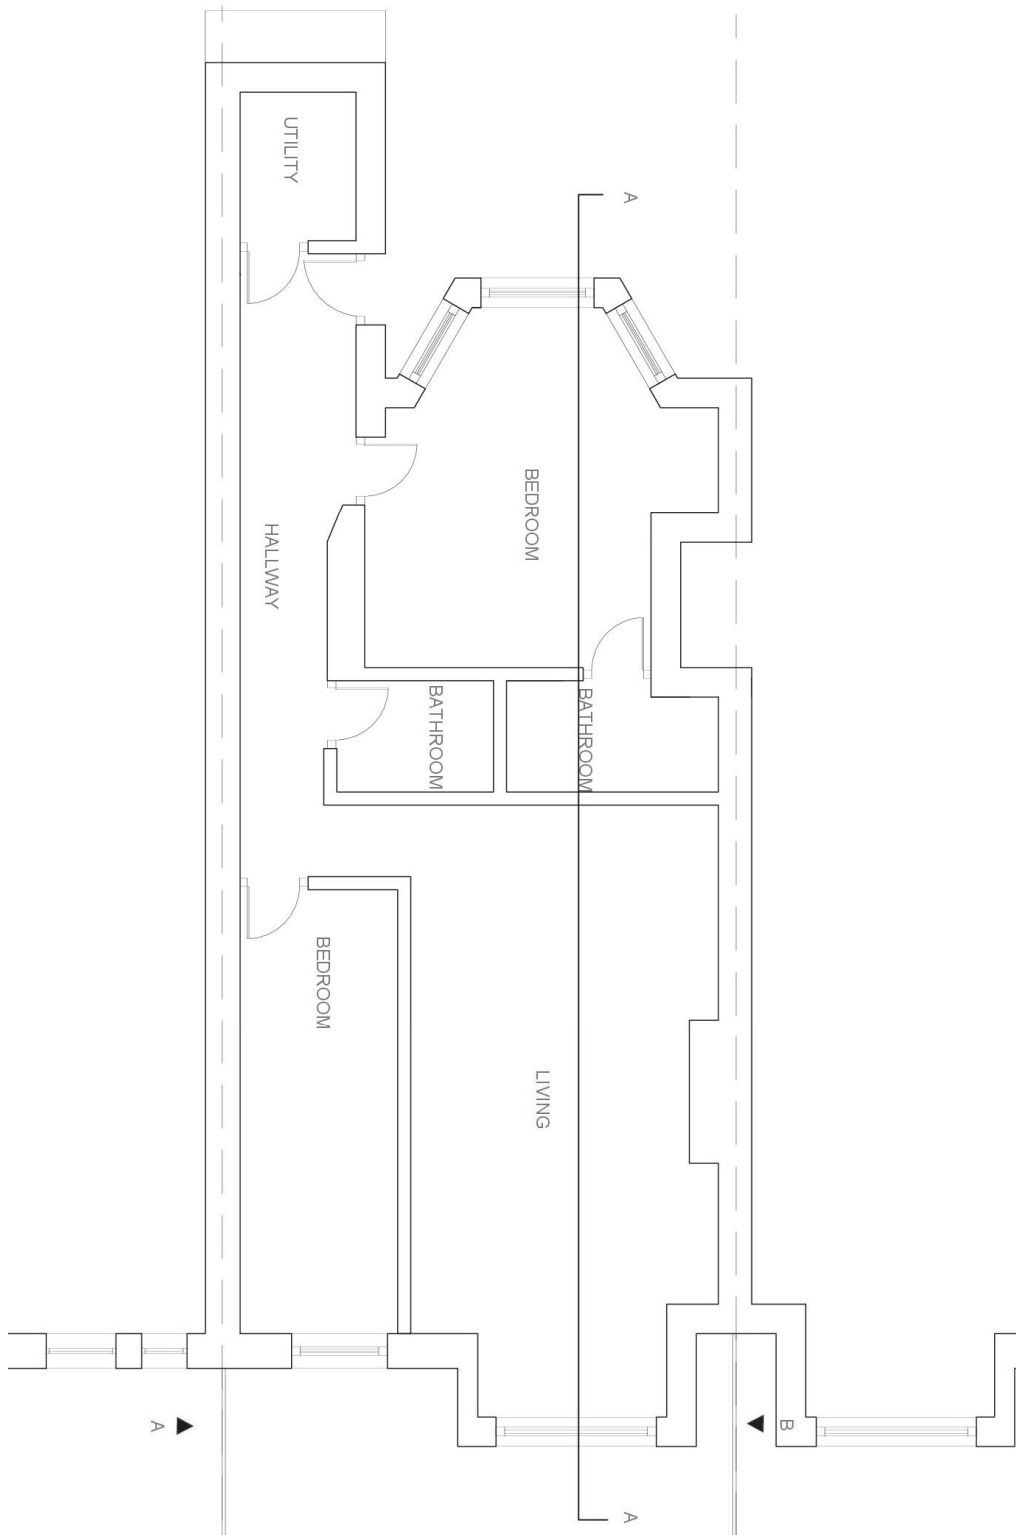

Existing Ground Floor Plan

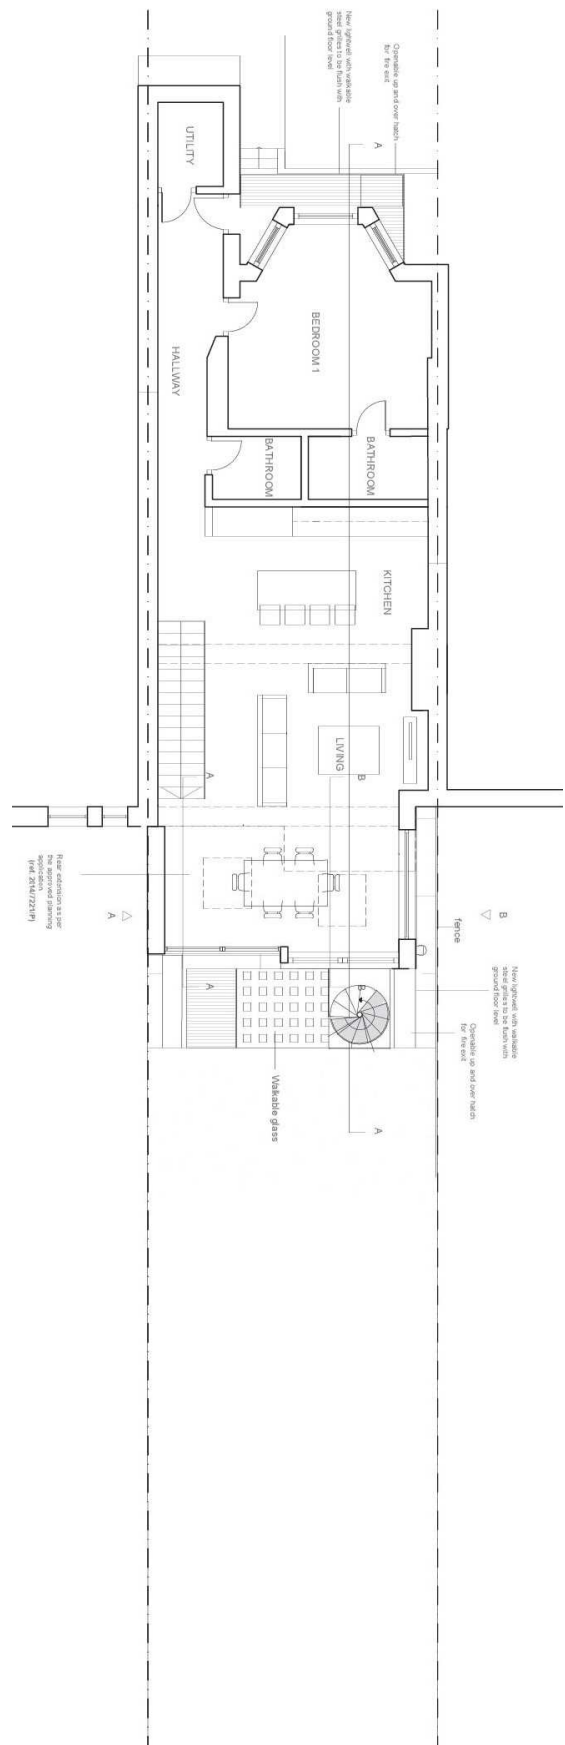

Proposed ground floor with garden

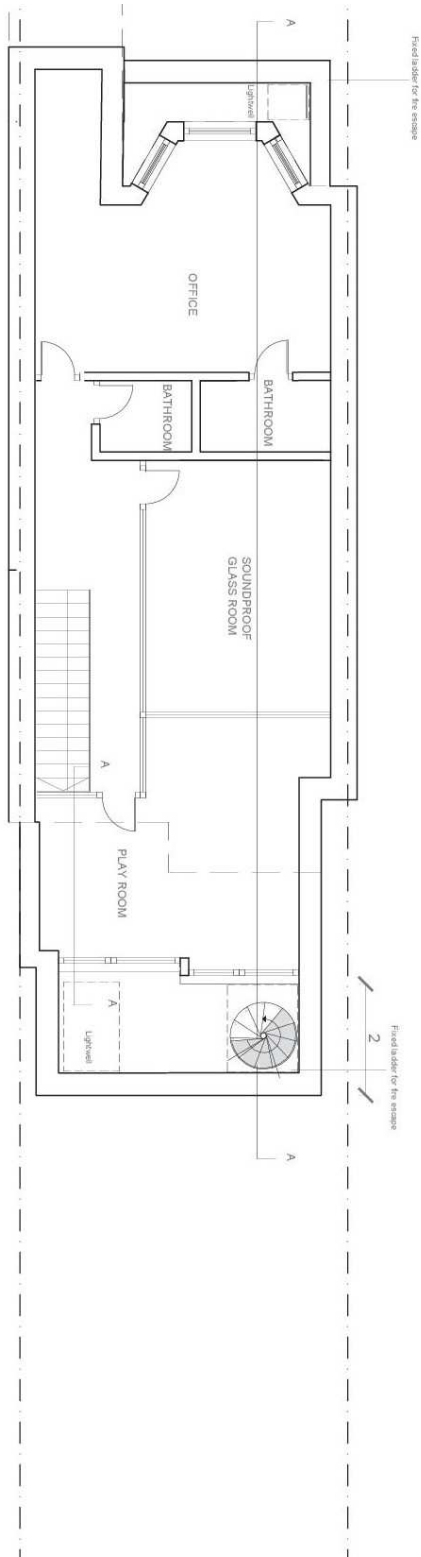

Proposed basement

Flood map for planning

Your reference
44 Goldhurst

Location (easting/northing)
526233/184320

Created
24 Apr 2018 9:13

Your selected location is in flood zone 1, an area with a low probability of flooding.

This means:


- you don't need to do a flood risk assessment if your development is smaller than 1 hectare and not affected by other sources of flooding
- you may need to do a flood risk assessment if your development is larger than 1 hectare or affected by other sources of flooding or in an area with critical drainage problems

Notes

The flood map for planning shows river and sea flooding data only. It doesn't include other sources of flooding. It is for use in development planning and flood risk assessments.

This information relates to the selected location and is not specific to any property within it. The map is updated regularly and is correct at the time of printing.

The Open Government Licence sets out the terms and conditions for using government data.
<https://www.nationalarchives.gov.uk/doc/open-government-licence/version/3/>

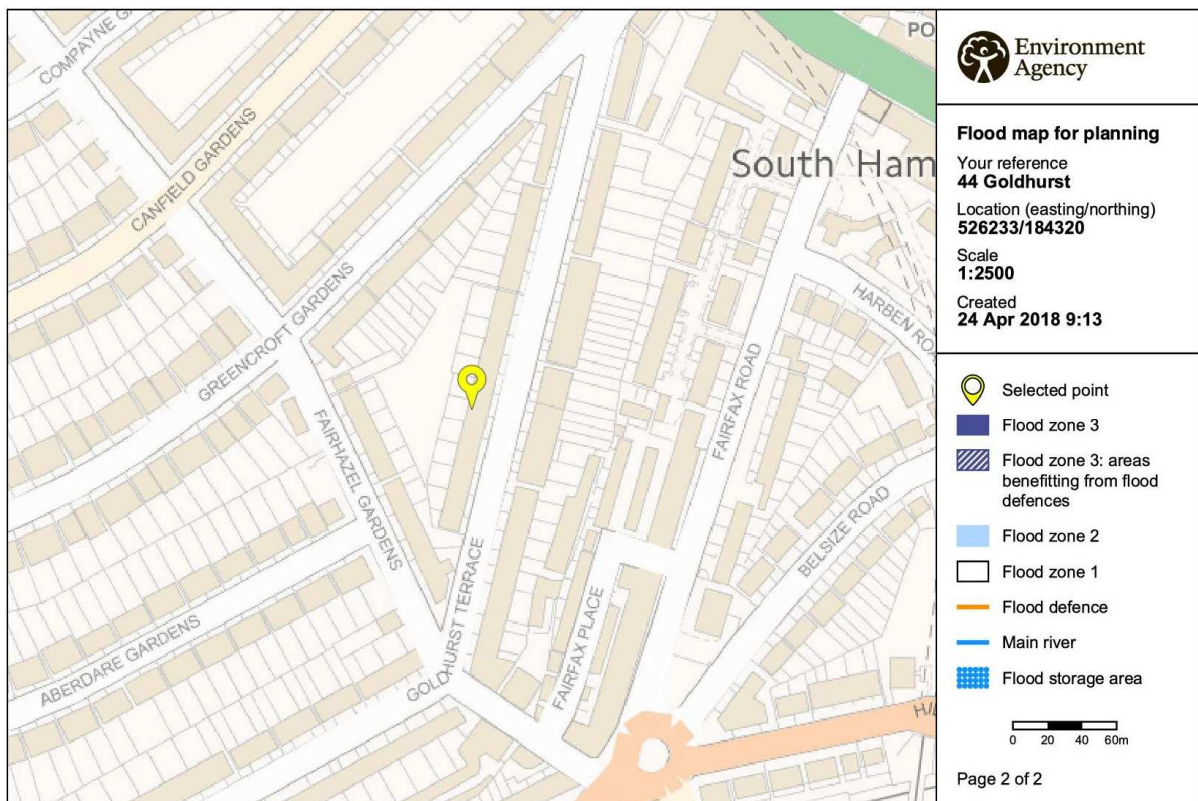


© Environment Agency copyright and / or database rights 2018. All rights reserved. © Crown Copyright and database right 2018. Ordnance Survey licence number 100024198.

Streets at risk of surface water flooding


| | | | |
|-------------------------------|---------------|--------------------------|---------------|
| Abbey Road | 1975 | Jeffreys Street | 2002 |
| Aberdare Gardens | 1975 | Kelly Street | 1975 and 2002 |
| Achilles Road | 2002 | Kentish Town Road | 1975 |
| Adamson Road | 2002 | Kidderpore Gardens | 1975 |
| Agamemnon Road | 2002 | Kilburn High Road | 1975 |
| Ajax Road | 2002 | Kilburn Priory | 1975 |
| Aldred Road | 2002 | Kingdon Road | 2002 |
| Arkwright Road | 1975 and 2002 | Kingsgate Road | 1975 |
| Arkwright Road | 1975 and 2002 | Lady Margaret Road | 2002 |
| Avenue Road | 2002 | Lambolle Road | 1975 |
| Belsize Lane | 1975 and 2002 | Lancaster Drive | 2002 |
| Belsize Park Gardens | 1975 | Lancaster Grove | 1975 and 2002 |
| Belsize Road | 1975 and 2002 | Langland Gardens | 1975 |
| Boundary Road | 1975 | Lowfield Road | 1975 |
| Broadhurst Gardens | 1975 | Lyncroft Gardens | 2002 |
| Broomsleigh Street | 1975 | Lyndurst Gardens | 1975 |
| Bullbarrow, Abbey Road Estate | 1975 | Mansfield Road | 1975 |
| Canfield Gardens | 1975 and 2002 | Maygrove Road | 1975 |
| Cannon Hill | 1975 and 2002 | Menelik Road | 2002 |
| Caversham Road | 2002 | Messina Avenue | 1975 |
| Chalcot Gardens | 1975 | Mill Lane | 1975 and 2002 |
| Chesterford Gardens | 2002 | Nassington Road | 2002 |
| Cotleigh Road | 1975 | Oak Village | 1975 |
| Dennington Park Road | 1975 and 2002 | Ornan Road | 2002 |
| Edis Street | 1975 | Pandora Road | 1975 and 2002 |
| Egbert Street | 1975 | Park End | 1975 |
| Fairfax Road | 2002 | Parkhill Road | 1975 and 2002 |
| Fairhazel Gardens | 1975 and 2002 | Parliament Hill | 2002 |
| Fellows Road | 1975 | Platt's Lane | 1975 and 2002 |
| Femcroft Avenue | 1975 | Primrose Hill Road | 1975 and 2002 |
| Finchley Road | 2002 | Prince of Wales Road | 2002 |
| Fleet Road | 2002 | Princess Road | 1975 |
| Fordwych Road | 1975 | Priory Road | 2002 |
| Frognaal Gardens | 1975 | Priory Terrace | 1975 |
| Gaisford Street | 2002 | South End Road | 2002 |
| Glenhurst Avenue | 2002 | South Hill Park | 2002 |
| Gloucester Avenue | 1975 | South Hill Park Gardens | 2002 |
| Goldhurst Terrace | 1975 and 2002 | Sumatra Road | 1975 and 2002 |
| Gospel Oak Estate | 1975 | Swains Lan | 1975 |
| Greencroft Gardens | 1975 and 2002 | Tanza Road | 2002 |
| Hampstead Lane N6 | 1975 | Templewood Avenue | 2002 |
| Harben Road | 2002 | Templewood Gardens | 2002 |
| Harley Road | 1975 | Wending, Haverstock Road | 2002 |
| Hawley Road | 1975 | West End Lane | 2002 |
| Heath Street | 1975 | Westbere Road | 2002 |
| Hemstal Road | 1975 | Willow Road | 1975 and 2002 |
| Highgate Road | 1975 | Winchester Road | 1975 |
| Hillfield Road | 1975 and 2002 | Windmill Hill | 1975 |
| Holmdale Road | 1975 and 2002 | Woodchurch Road | 2002 |
| Ingestre Road | 2002 | Woodsome Road | 1975 |
| Inglewood Road | 2002 | York Rise | 1975 |

Source: Floods in Camden, Report of the Floods Scrutiny Panel, London Borough of Camden 2003, Appendix 4, Flooded Roads in Camden 1975 and 2002.

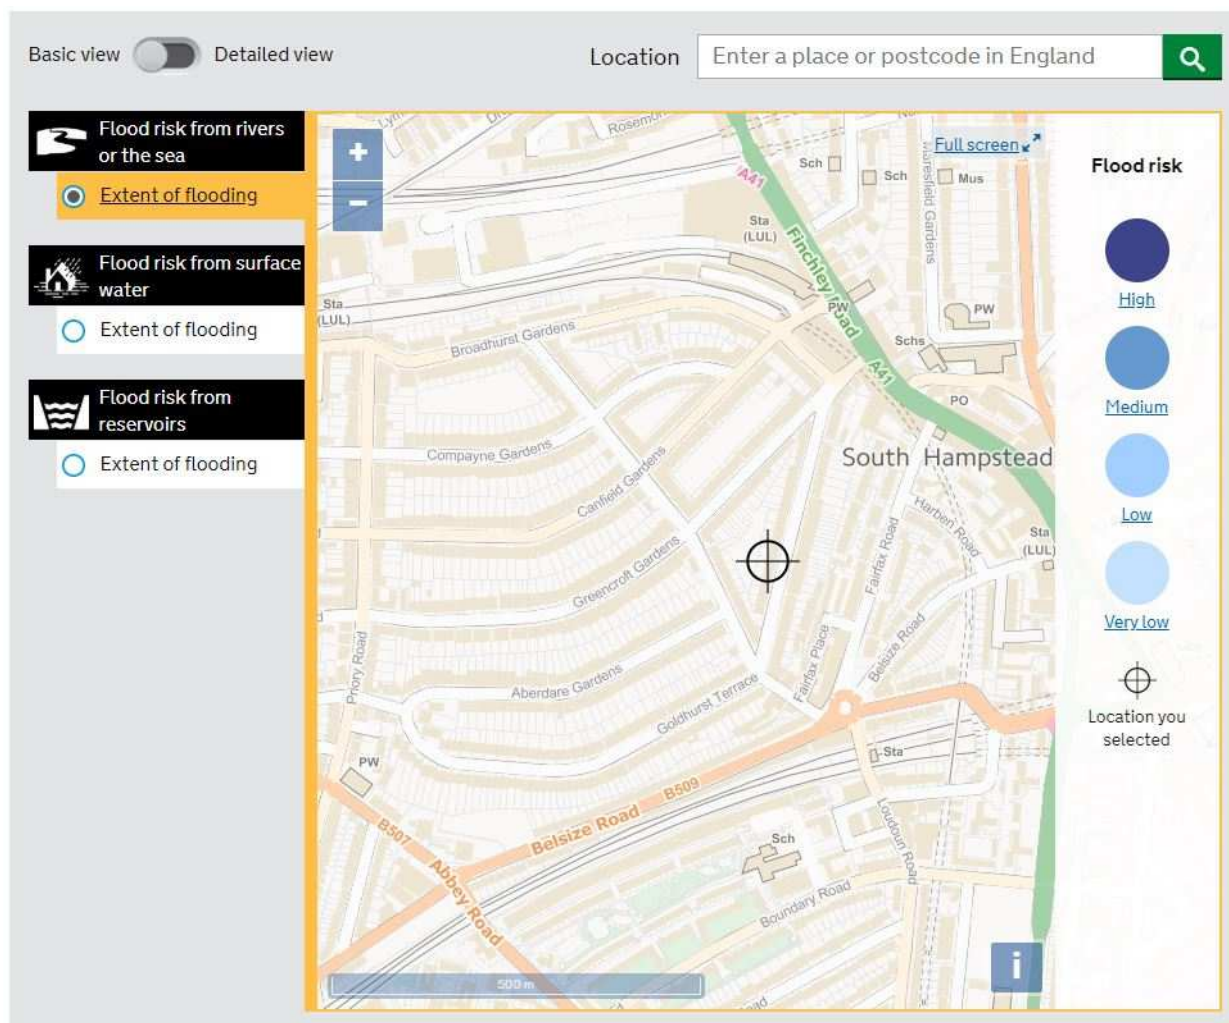


Flood risk from rivers or the sea

Very low risk means that each year this area has a chance of flooding of less than 0.1%. This takes into account the effect of any flood defences in the area. These defences reduce but do not completely stop the chance of flooding as they can be overtopped, or fail.

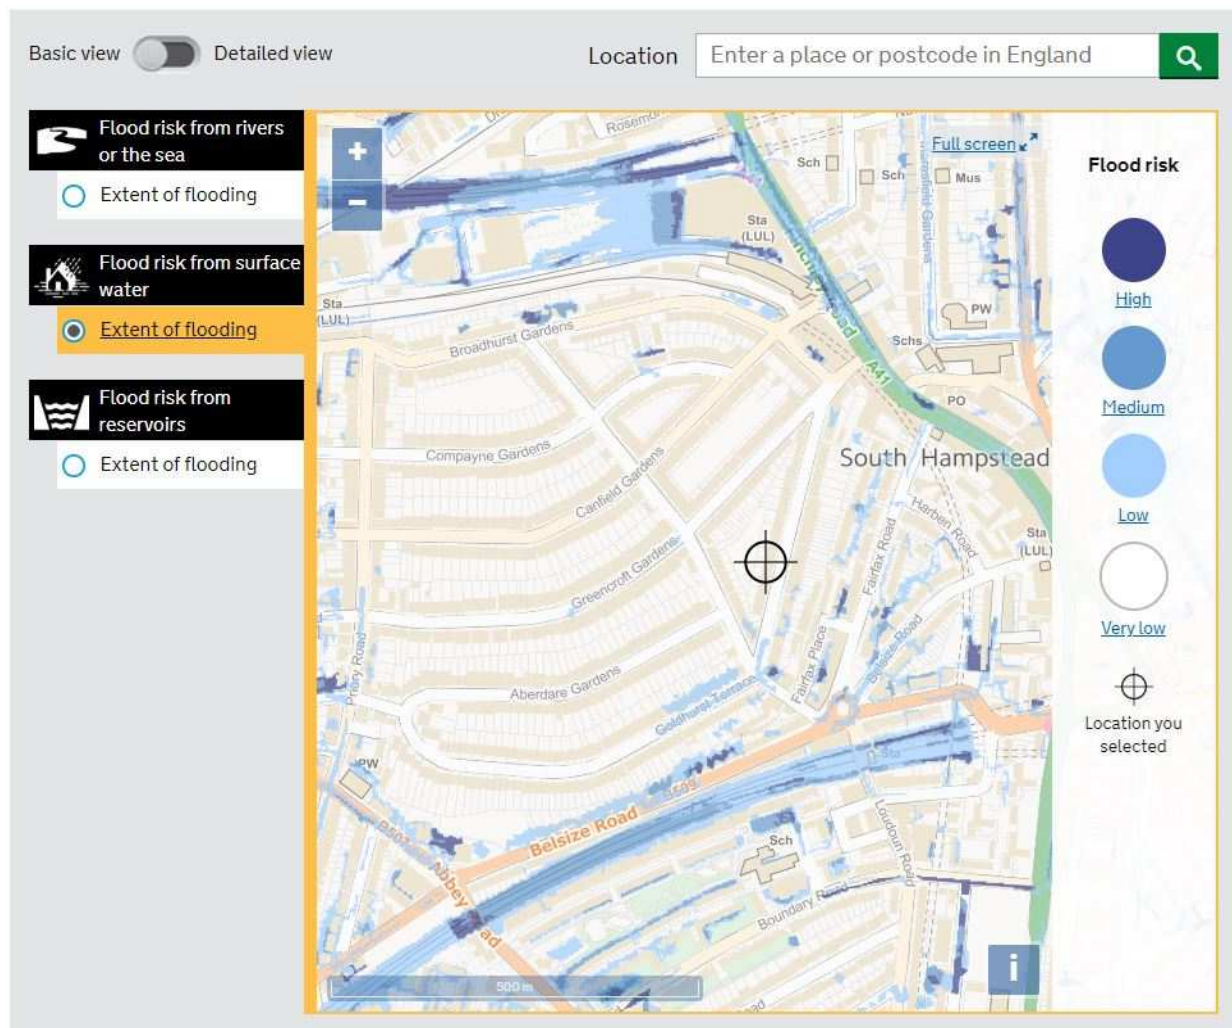


Flood risk from surface water

Very low risk means that each year this area has a chance of flooding of less than 0.1%. Flooding from surface water is difficult to predict as rainfall location and volume are difficult to forecast. In addition, local features can greatly affect the chance and severity of flooding.

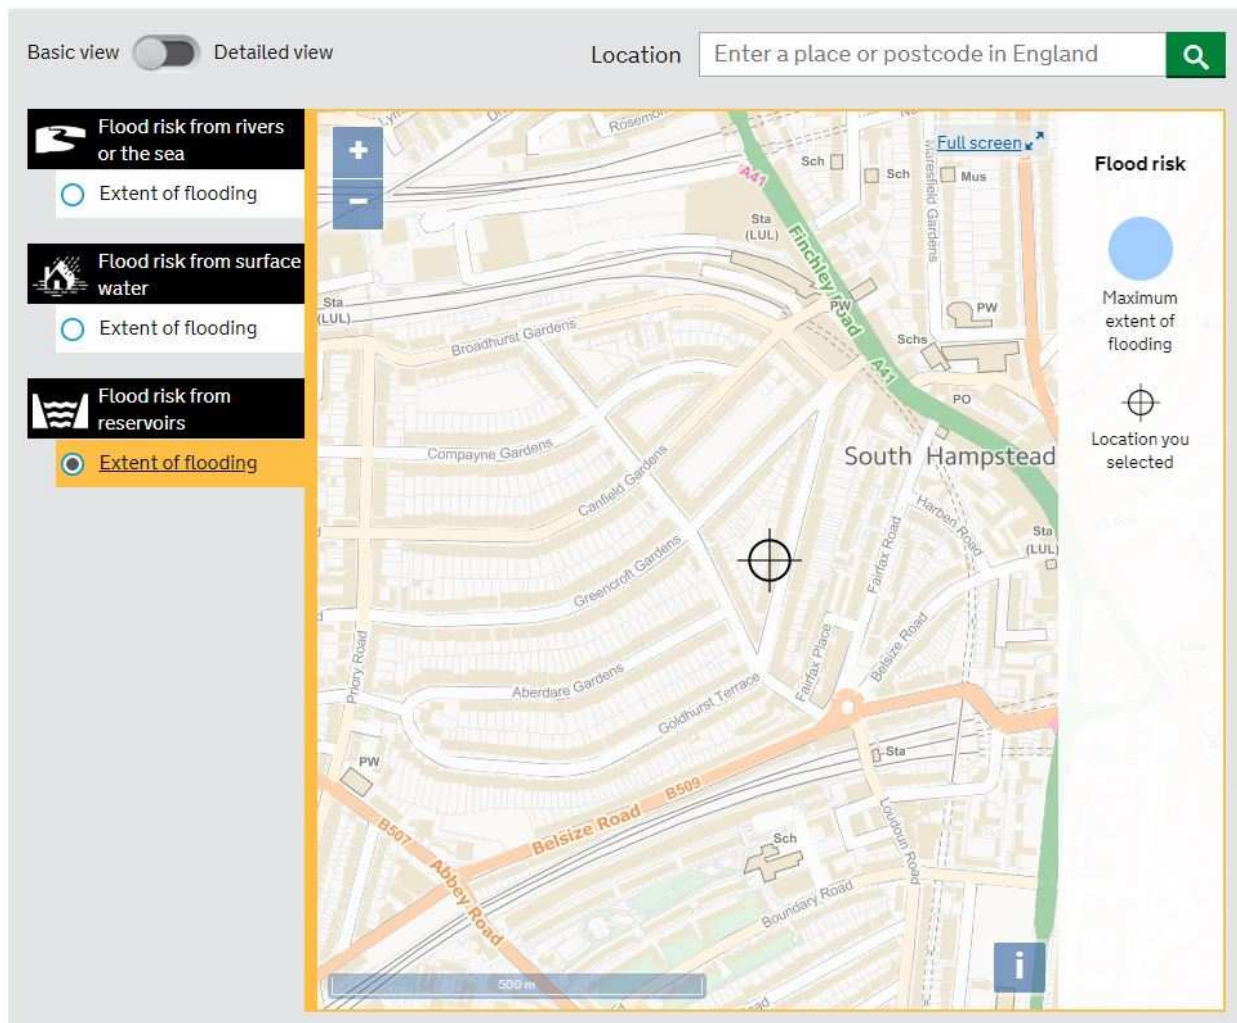


Flood risk from reservoirs

If a location is at risk, flooding from reservoirs is extremely unlikely. There has been no loss of life in the UK from reservoir flooding since 1925.

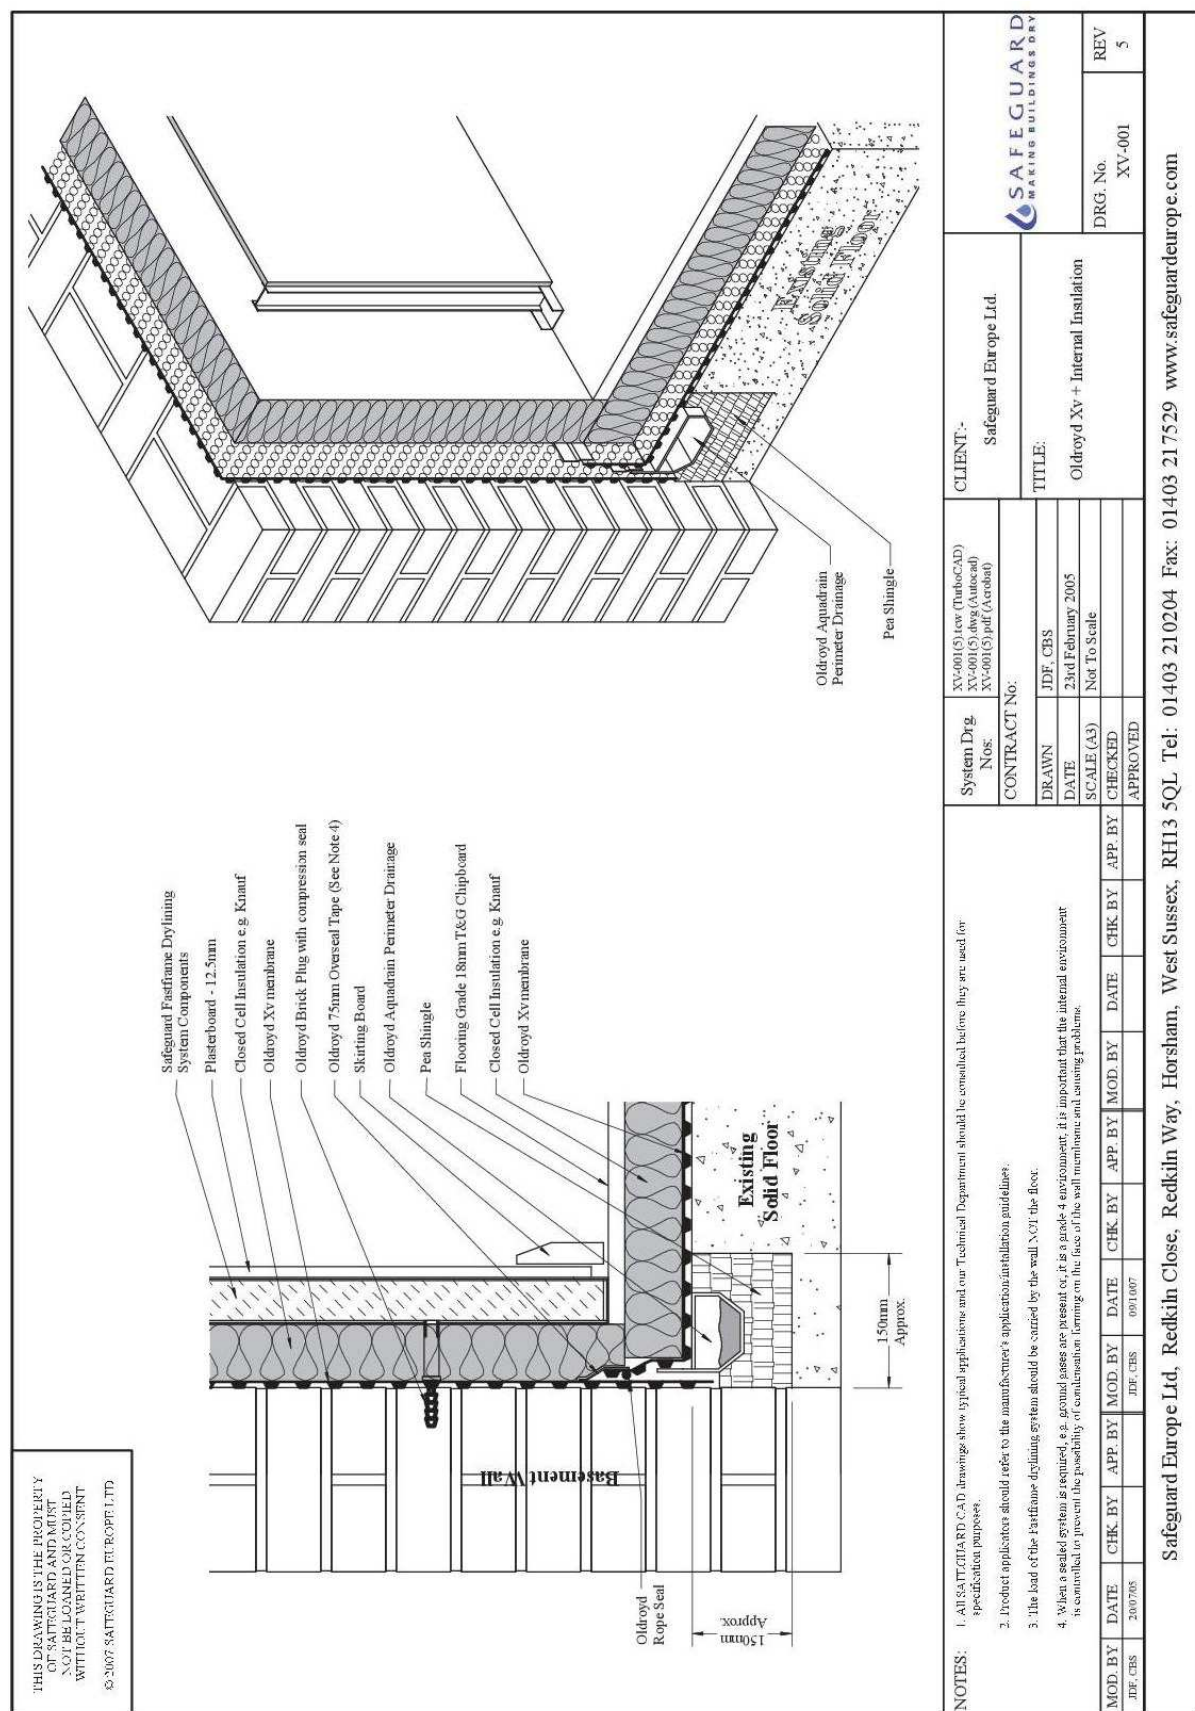

Typical waterproofing detail

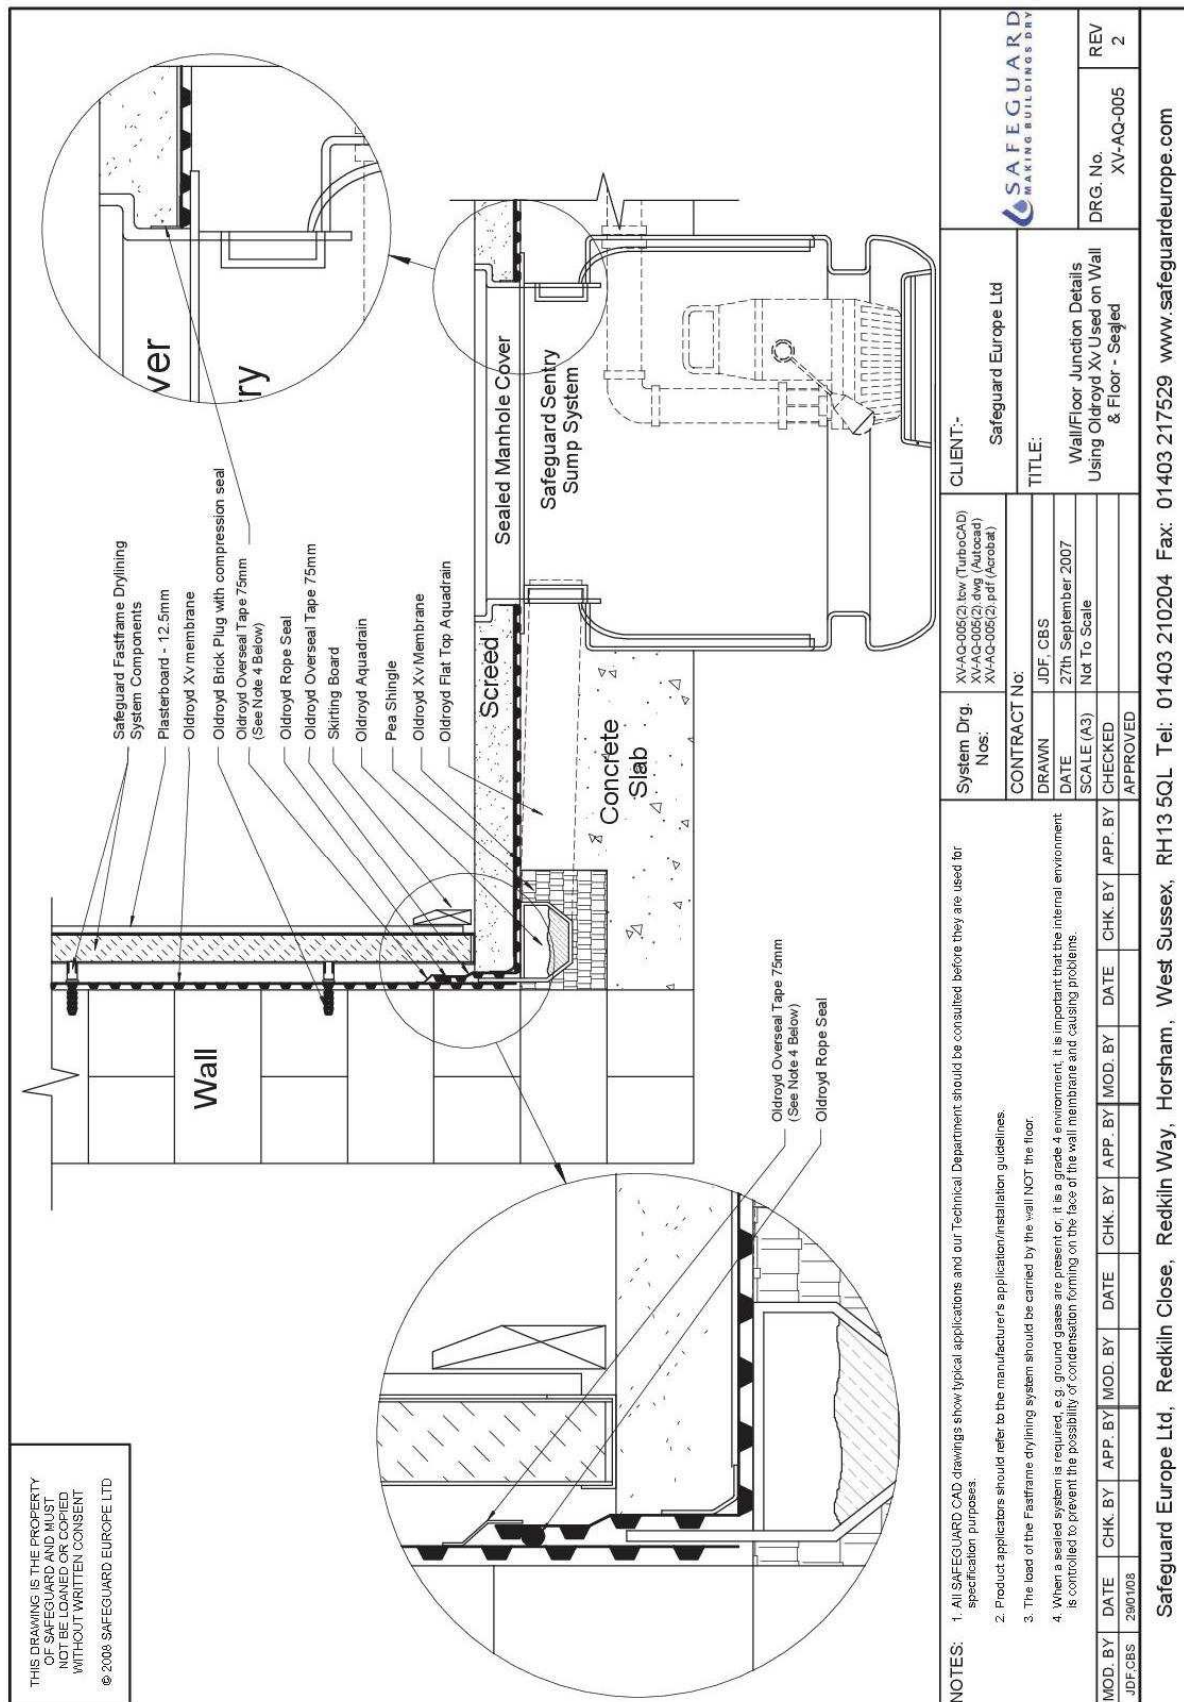

Typical pump detail