

# **68 HEATH STREET, LONDON**

## **PLANNING COMPLIANCE REVIEW**

Report 18048.PCR.01

For:

**Skinsmiths**

**WeWork, Waterhouse Square**

**138 Holborn**

**London EC1N 2SW**

First Issue date: 22/08/2018					
Revision History					
Report 18048.PCR.01					
A		D			
B		E			
C		F			
Written by:		Checked by:		Approved by:	
Daniel Green MIOA Acoustic Consultant		Aidan Tolkien AMIOA Acoustic Consultant		Kyriakos Papanagiotou MIOA Managing Director	
<p><b>Disclaimer</b></p> <p>KP Acoustics Ltd. has used reasonable skill and care to complete this technical document, within the terms of its brief and contract with the resources devoted to it by agreement with the client. We disclaim any responsibility to the client and others in respect of any matters outside the stated scope. This report is confidential to the client and we accept no responsibility to third parties to whom this report, or any part thereof, is made known. KP Acoustics Ltd. accepts no responsibility for data provided by other bodies and no legal liability arising from the use by other persons of data or opinions contained in this report.</p> <p>KP Acoustics Ltd. 2018</p>					

## Contents

1.0	INTRODUCTION .....	1
2.0	SITE SURVEYS .....	1
2.1	Site Description .....	1
2.2	Environmental Noise Survey Procedure .....	1
2.3	Measurement Positions .....	2
2.4	Equipment .....	3
3.0	RESULTS.....	3
3.1	Noise Survey.....	3
4.0	NOISE ASSESSMENT GUIDANCE.....	4
4.1	BS4142: 2014 “ <i>Methods for rating and assessing industrial and commercial sound</i> ” .....	4
4.2	Local Authority Guidance.....	5
4.3	Noise Emissions Criterion .....	5
5.0	NOISE IMPACT ASSESSMENT .....	5
5.1	Proposed Plant Installations .....	5
5.2	Objective Overview .....	6
5.3	BS8233 Assessment .....	7
6.0	CONCLUSION.....	8

### List of Attachments

18048. TH1	Environmental Noise Time History
18048. SP1	Indicative Site Plan
Appendix A	Glossary of Acoustics Terminology
Appendix B	Acoustic Calculations

## **1.0 INTRODUCTION**

KP Acoustics has been commissioned by Skinsmiths, WeWork, Waterhouse Square, 138 Holborn, London EC1N 2SW, to undertake an environmental noise survey at 68 Heath Street, London, NW3 1DN. The background noise levels measured will be used to determine daytime and night-time noise emission criteria the proposed plant unit installation in agreement with the planning requirements of The London Borough of Camden.

This report presents the overall methodology and results from the environmental survey, followed by calculations to demonstrate the feasibility of the plant unit installation to satisfy the emissions criterion at the closest noise-sensitive receiver. Mitigation measures will be outlined as appropriate.

## **2.0 SITE SURVEYS**

### **2.1 Site Description**

The site is bounded by Heath Street to the West, and commercial and residential properties to all other elevations. Entrance to the site is located on Heath Street. Initial inspection of the site revealed that the background noise profile at the monitoring location was typical of an urban cityscape environment, with the dominant source being road traffic noise from the surrounding roads, as well as low level noise from neighbouring plant unit installations.

### **2.2 Environmental Noise Survey Procedure**

A noise survey was undertaken on site as shown in Figure 2.1. The choice of the position was based both on accessibility and on collecting representative noise data in relation to the nearest noise sensitive receiver relative to the proposed plant installation, which has been identified as the First Floor Flat located directly above the Ground Floor commercial unit.

Continuous automated monitoring was undertaken for the duration of the survey between 11:13 on 14/08/2018 and 09:28 on 15/08/2018.


Weather conditions were generally dry with light winds and therefore suitable for the measurement of environmental noise. The measurement procedure complied with ISO 1996-2:2007 Acoustics '*Description, measurement and assessment of environmental noise - Part 2: Determination of environmental noise levels*'.

**2.3 Measurement Positions**

Measurement positions are as described within Table 2.1 and shown within Figure 2.1.

	Description
<b>Noise Measurement Position 1 (MP.1)</b>	The meter was installed within a small yard area to the rear of the property. A correction of 3dB has been applied as the microphone was installed in a non-free field position
<b>Noise Sensitive Receiver 1 (NSR.1)</b>	First Floor residential window on the rear of the 68 Heath Street

**Table 2.1 Measurement position and description**

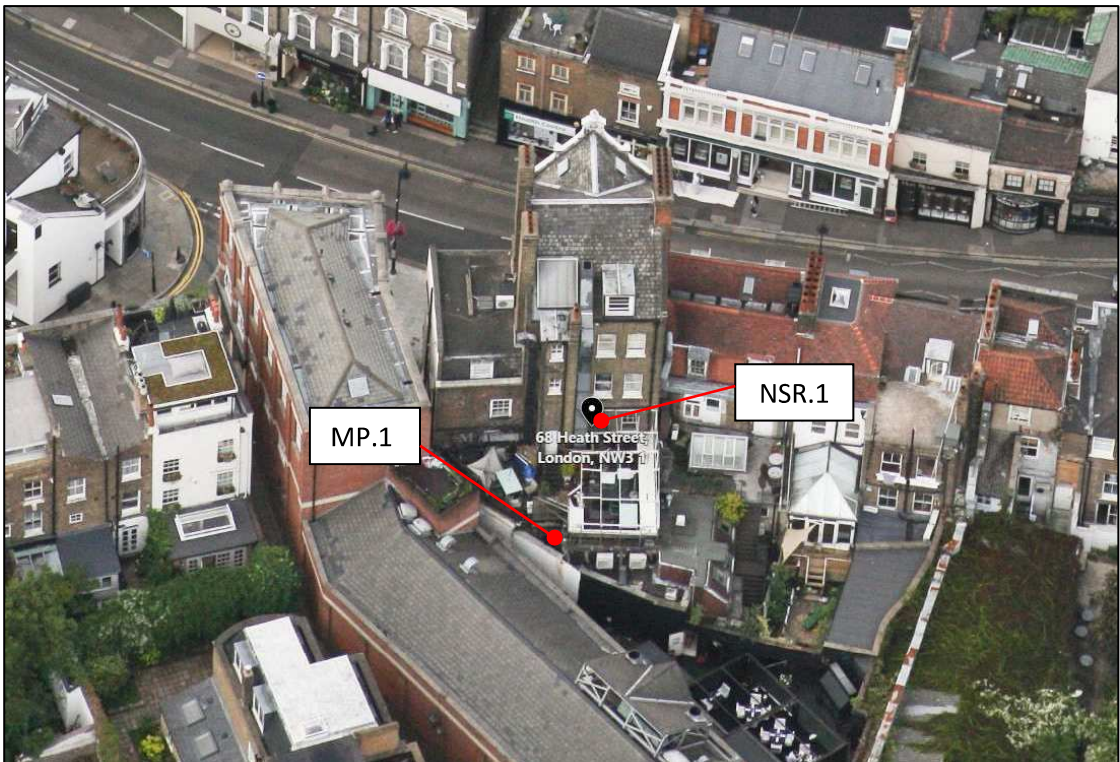

**Figure 2.1 – Site Measurement position (Image Source: Bing Maps)**

**2.4 Equipment**

The equipment calibration was verified before and after use and no abnormalities were observed. The equipment used is described within Table 2.2.

Measurement instrumentation
Svantek Type 958A Class 1 Sound Level Meter
Svantek 2v12L free-field microphone
B&K Type 4231 Class 1 Calibrator
Svantek External windshield

**Table 2.2 Measurement instrumentation**

**3.0 RESULTS**

**3.1 Noise Survey**

The  $L_{Aeq: 5min}$ ,  $L_{Amax: 5min}$ ,  $L_{A10: 5min}$  and  $L_{A90: 5min}$  acoustic parameters were measured throughout the duration of the survey. Measured levels are shown as a time history in Figure 18048.TH1.

Minimum background noise levels and logarithmically averaged  $L_{Aeq}$  levels are shown in Table 3.1 for daytime and night-time.

	Minimum background noise level $L_{A90}$ dB(A)	Average ambient noise level $L_{Aeq}$ dB(A)
<b>Daytime 07:00-23:00</b>	37	51
<b>Night-time 23:00-07:00</b>	34	45
<b>Operating Hours 09:00-18:00</b>	44	51

**Table 3.1 Minimum background noise levels and average ambient noise levels**

## 4.0 NOISE ASSESSMENT GUIDANCE

### 4.1 BS4142: 2014 “Methods for rating and assessing industrial and commercial sound”

British Standard BS4142:2014 ‘Methods for rating and assessing industrial and commercial sound’ describes a method for rating and assessing sound of an industrial and/or commercial nature, which includes:

- Sound from industrial and manufacturing processes
- Sound from fixed installations which comprise mechanical and electrical plant and equipment
- Sound from the loading and unloading of goods and materials at industrial and/or commercial premises, and
- Sound from mobile plant and vehicles that is an intrinsic part of the overall sound emanating from premises or processes.

This Standard compares the noise levels in terms of a  $L_{Aeq}$  for a one-hour period during the daytime (07:00 – 23:00 hours) and a fifteen-minute period during the night-time (23:00 – 07:00 hours) due to the noise source, the “Specific Noise Level”, with the existing background noise level in terms of an  $L_{A90}$  when the noise source is not operating.

The resultant background sound level is subtracted from the Rating Level to obtain an initial estimate of the impact.

- Typically, the greater this difference, the greater the magnitude of the impact.
- A difference of around +10 dB or more is likely to be an indication of a significant adverse impact, depending on the context.
- A difference of around +5 dB could be an indication of an adverse impact, depending on the context.

The lower the rating level is relative to the measured background sound level, the less likely it is that there will be an adverse impact. Where the rating level does not exceed the background sound level, this is an indication of the specific sound having a low impact, depending on the context.

The initial estimate of the impact may then be modified by taking consideration of the context in which the sound occurs.

**4.2 Local Authority Guidance**

The criterion of The London Borough of Camden for noise emissions of new plant in this instance is as follows:

*“The proposed plant and machinery shall be operated so as to ensure that any noise generated is “not audible” outside the nearest noise sensitive premises. To demonstrate inaudibility, you will need to provide calculations that show that the plant noise level is 10dBA below the lowest background level (LA90 (15minutes)) 1m from the nearest noise sensitive window, over the proposed operating hours.”*

**4.3 Noise Emissions Criterion**

As the proposed plant installations would only be operational during the operating hours of the commercial unit, the criterion has been set as shown in Table 4.1 in order to comply with the above requirements.

Note that demonstrating compliance with the Local Authority’s guidance would inherently result in a low magnitude of impact with regards to the plant installation negatively affecting the amenity of the closest receiver, as per the guidance contained in BS4142:2014.

	<b>Operating Hours (09:00 to 18:00)</b>
Noise criterion at nearest residential receiver (10dB below minimum L <sub>A90</sub> )	34 dB(A)

**Table 4.1: Proposed Noise Emissions Criterion**

**5.0 NOISE IMPACT ASSESSMENT**

**5.1 Proposed Plant Installations**

It is understood that the proposed plant installation is comprised of the following units:

- 1 No. Toshiba AOYG45LBT8 Air Conditioning Unit
- 1 No. Fujitsu UTZ-BD025(B)(C) Energy Recovery Ventilator (AHU)

The proposed installation location for the air conditioning unit and AHU intake and extract will be the small rear yard area to the rear of the building, at the same position as Noise Monitoring Position 1 shown in Figure 2.1. It should be noted that the AHU will be installed internally, with the intake and extract being ducted to the external environment in the rear yard area.



The closest noise sensitive receiver to the proposed installation location has been identified as being a residential window on the First Floor of 68 Heath Street, located approximately 8 metres from the proposed plant installation location. Please note that the proposed air conditioning unit and air handling unit intake and extract would be completely out of line of site of the receiving window due to screening from the building envelope.

The sound pressure levels at 1 metre as provided by the manufacturer for the units are shown in Table 5.1.

Unit	Sound Pressure Level (dB) in each Frequency Band at 1m							
	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz
Toshiba AOYG45LBT8	64	62	60	54	51	48	40	34
Fujitsu UTZ-BD025(B)(C) Outlet*	58	50	43	36	30	26	20	13
Fujitsu UTZ-BD025(B)(C) Inlet*								

**Table 5.1 Manufacturers Sound Pressure Levels at 1m**

\*Sound pressure level at 1.5m

## 5.2 Objective Overview

Taking all acoustic corrections into consideration, the noise level contribution expected at the closest residential window from the air conditioning unit installation would be as shown in Table 5.2. Detailed calculations are shown in Appendix B.

Receiver	Criterion	Noise Level at 1m From the Closest Noise Sensitive Window
First Floor Window of a residential property on the rear façade of 68 Heath Street	34dB(A)	30dB(A)

**Table 5.2: Predicted noise level and criterion at nearest noise sensitive location**

As shown in Appendix B and Table 5.2, transmission of noise to the nearest sensitive windows due to the effects of the plant installations satisfies the emissions criterion of BS4142:2014 and the Local Authority.

**5.3 BS8233 Assessment**

The highest value of 30dB(A) is to be considered externally at 1m from the receiving window. Windows may be closed or partially closed leading to further attenuation, as follows.

Further calculations have been undertaken to assess whether the noise emissions from the plant unit installation would be expected to meet the recognised British Standard recommendations, in order to further ensure the amenity of nearby noise sensitive receivers.

British Standard 8233:2014 '*Sound insulation and noise reduction for buildings – Code of Practice*' gives recommendations for acceptable internal noise levels in residential properties. Assuming worst case conditions, of the closest window being for a bedroom, BS8233:2014 recommends 35dB(A) for internal resting/sleeping conditions during daytime hours.

With a calculated external level of 30dB(A), the residential window itself would not need to provide any additional attenuation in order for the recommended internal noise conditions to be achieved. According to BS8233:2014, even a partially open window offers 10-15dB attenuation, thus leading to a further reduced interior noise level.

Receiver	Design Range – <i>For resting/sleeping conditions in a bedroom during daytime, in BS8233:2014</i>	Noise Level at Receiver (due to plant installation)
First Floor residential property of 68 Heath Street	35dB(A)	20dB(A)

**Table 5.4 Noise levels and criteria inside nearest residential space**

Predicted levels are shown in Table 5.4, with detailed calculations shown in Appendix B. It can therefore be stated that, as well as complying with the requirements of The London Borough of Camden, the noise emissions from the plant unit installation would be expected to comfortably meet the most stringent recommendations of BS8233: 2014.

## 6.0 CONCLUSION

An environmental noise survey has been undertaken at 68 Heath Street, London, NW3 1DN, by KP Acoustics Ltd between 11:13 on 14/08/2018 and 09:28 on 15/08/2018. The results of the survey have enabled criteria to be set for noise emissions.

Using manufacturer noise data, noise levels are predicted at the nearby noise sensitive receivers for compliance with current requirements.

Calculations show that noise emissions from the proposed air conditioning unit installation would meet the requirements of The London Borough of Camden. The proposed plant installation would result in a low magnitude of impact and an indication of low adverse impact on the closest residential receiver, in accordance with BS4142:2014.

Further calculations have been undertaken with regards to the relevant British Standard and it has been ensured that the amenity of nearby residential receivers will be protected.

68 Heath Street, London  
Environmental Noise Time History  
From 14 August 2018 To 15 August 2018



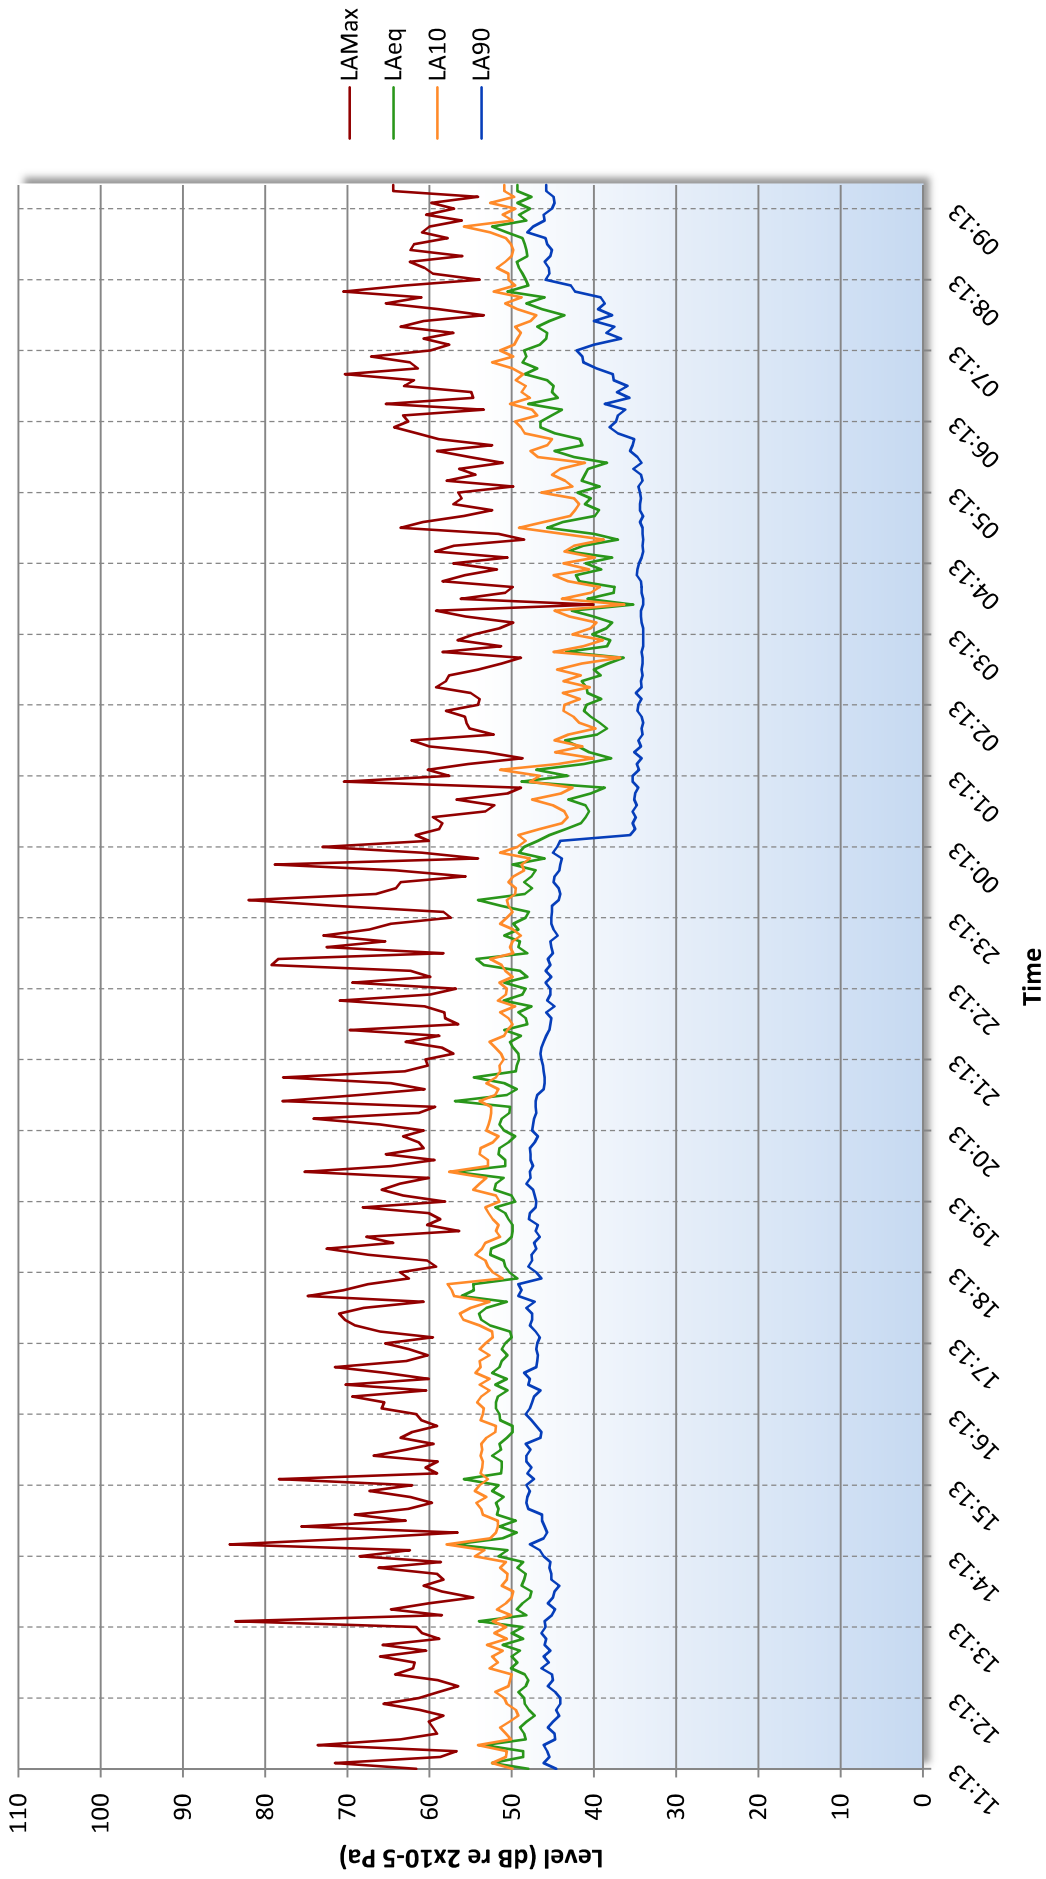


Figure 18048.TH1

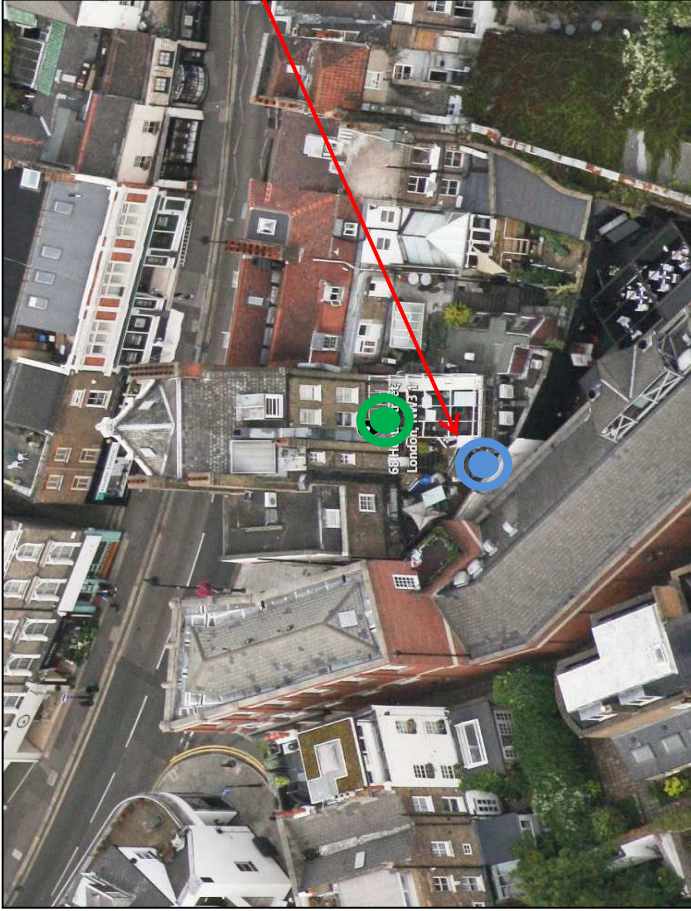

Rear Yard Area

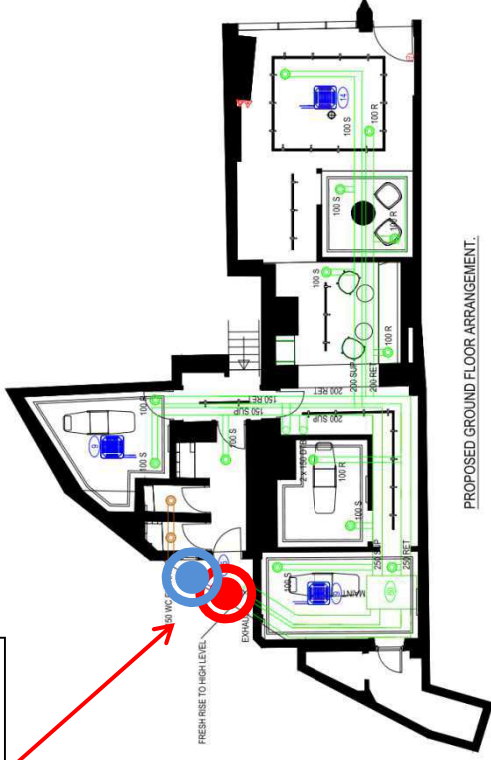

● Plant Installation Location  
● Noise Survey Location  
● Closest Noise Sensitive Receiver

**Date:** 21 August 2018

**FIGURE 18048.SP1**

**Title:**  
 Site plan showing noise monitoring position, closest noise sensitive receiver and proposed plant unit location.  
 (Image Source: Bing Maps)



## GENERAL ACOUSTIC TERMINOLOGY

### Decibel scale - dB

In practice, when sound intensity or sound pressure is measured, a logarithmic scale is used in which the unit is the 'decibel', dB. This is derived from the human auditory system, where the dynamic range of human hearing is so large, in the order of  $10^{13}$  units, that only a logarithmic scale is the sensible solution for displaying such a range.

### Decibel scale, 'A' weighted - dB(A)

The human ear is less sensitive at frequency extremes, below 125Hz and above 16Khz. A sound level meter models the ears variable sensitivity to sound at different frequencies. This is achieved by building a filter into the Sound Level Meter with a similar frequency response to that of the ear, an A-weighted filter where the unit is dB(A).

### $L_{eq}$

The sound from noise sources often fluctuates widely during a given period of time. An average value can be measured, the equivalent sound pressure level  $L_{eq}$ . The  $L_{eq}$  is the equivalent sound level which would deliver the same sound energy as the actual fluctuating sound measured in the same time period.

### $L_{10}$

This is the level exceeded for no more than 10% of the time. This parameter is often used as a "not to exceed" criterion for noise.

### $L_{90}$

This is the level exceeded for no more than 90% of the time. This parameter is often used as a descriptor of "background noise" for environmental impact studies.

### $L_{max}$

This is the maximum sound pressure level that has been measured over a period.

### Octave Bands

In order to completely determine the composition of a sound it is necessary to determine the sound level at each frequency individually. Usually, values are stated in octave bands. The audible frequency region is divided into 11 such octave bands whose centre frequencies are defined in accordance with international standards. These centre frequencies are: 16, 31.5, 63, 125, 250, 500, 1000, 2000, 4000, 8000 and 16000 Hertz.

Environmental noise terms are defined in BS7445, *Description and Measurement of Environmental Noise*.

## APPLIED ACOUSTIC TERMINOLOGY

### Addition of noise from several sources

Noise from different sound sources combines to produce a sound level higher than that from any individual source. Two equally intense sound sources operating together produce a sound level which is 3dB higher than a single source and 4 sources produce a 6dB higher sound level.

### Attenuation by distance

Sound which propagates from a point source in free air attenuates by 6dB for each doubling of distance from the noise source. Sound energy from line sources (e.g. stream of cars) drops off by 3dB for each doubling of distance.

### Subjective impression of noise

Hearing perception is highly individualised. Sensitivity to noise also depends on frequency content, time of occurrence, duration of sound and psychological factors such as emotion and expectations. The following table is a guide to explain increases or decreases in sound levels for many scenarios.

Change in sound level (dB)	Change in perceived loudness
1	Imperceptible
3	Just barely perceptible
6	Clearly noticeable
10	About twice as loud

### Transmission path(s)

The transmission path is the path the sound takes from the source to the receiver. Where multiple paths exist in parallel, the reduction in each path should be calculated and summed at the receiving point. Outdoor barriers can block transmission paths, for example traffic noise. The effectiveness of barriers is dependent on factors such as its distance from the noise source and the receiver, its height and construction.

### Ground-borne vibration

In addition to airborne noise levels caused by transportation, construction, and industrial sources there is also the generation of ground-borne vibration to consider. This can lead to structure-borne noise, perceptible vibration, or in rare cases, building damage.

### Sound insulation - Absorption within porous materials

Upon encountering a porous material, sound energy is absorbed. Porous materials which are intended to absorb sound are known as absorbents, and usually absorb 50 to 90% of the energy and are frequency dependent. Some are designed to absorb low frequencies, some for high frequencies and more exotic designs being able to absorb very wide ranges of frequencies. The energy is converted into both mechanical movement and heat within the material; both the stiffness and mass of panels affect the sound insulation performance.

## APPENDIX B

### 68 Heath Street, London

#### PLANT NOISE EMISSIONS CALCULATIONS

	Frequency, Hz								dB(A)
	63	125	250	500	1k	2k	4k	8k	
<b>Air Conditioning Unit Installation</b>									
Toshiba AOYG45LBT8 (Sound Pressure Level @1m)	64	62	60	54	51	48	40	34	
Correction due to surface reflections (1), dB	3	3	3	3	3	3	3	3	
Minimum attenuation due to building envelope, dB	-9	-11	-14	-17	-18	-18	-18	-18	
Minimum attenuation provided by distance (8m), dB	-18	-18	-18	-18	-18	-18	-18	-18	
<b>Total Sound Pressure Level at Receiver From Toshiba AOYG45, dB</b>	<b>40</b>	<b>36</b>	<b>31</b>	<b>22</b>	<b>18</b>	<b>15</b>	<b>7</b>	<b>1</b>	<b>27</b>
<b>Air Handling Unit - Noise Emissions from Air Exhaust Outlet</b>									
Fujitsu UTZ-BD025(B)(C) (Sound Pressure Level at 1.5m- Inlet)	58	50	43	36	30	26	20	13	
Sound Pressure Level Correction for 1 meter	2	2	2	2	2	2	2	2	
Attenuation due to duct length (4m), dB	0	0	0	-1	-1	-1	-1	-1	
Attenuation due to duct bends (1), dB	0	0	0	0	-2	-4	-6	-6	
Correction due to surface reflections (1), dB	3	3	3	3	3	3	3	3	
Directivity correction, dB	0	0	0	0	-11	-11	-11	-11	
Minimum attenuation due to building envelope, dB	-9	-11	-14	-17	-18	-18	-18	-18	
Minimum attenuation provided by distance (8m), dB	-18	-18	-18	-18	-18	-18	-18	-18	
<b>Total Noise Emissions from Fujitsu UTZ-BD025(B)(C) Exhaust Outlet, dB</b>	<b>35</b>	<b>25</b>	<b>15</b>	<b>5</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>14</b>
<b>Air Handling Unit - Noise Emissions from Air Supply Inlet</b>									
Fujitsu UTZ-BD025(B)(C) (Sound Pressure Level at 1.5m- Inlet)	58	50	43	36	30	26	20	13	
Sound Pressure Level Correction for 1 meter	2	2	2	2	2	2	2	2	
Attenuation due to duct length (4m), dB	0	0	0	-1	-1	-1	-1	-1	
Attenuation due to duct bends (1), dB	0	0	0	0	-2	-4	-6	-6	
Correction due to surface reflections (1), dB	3	3	3	3	3	3	3	3	
Directivity correction, dB	0	0	0	0	-11	-11	-11	-11	
Minimum attenuation provided by distance (8m), dB	-18	-18	-18	-18	-18	-18	-18	-18	
<b>Total Noise Emissions from Fujitsu UTZ-BD025(B)(C) Air Supply Inlet, dB</b>	<b>44</b>	<b>36</b>	<b>29</b>	<b>22</b>	<b>2</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>26</b>
<b>Sound Pressure Level at Receiver due to All Units, dB</b>	<b>46</b>	<b>39</b>	<b>33</b>	<b>25</b>	<b>18</b>	<b>15</b>	<b>9</b>	<b>5</b>	<b>30</b>