





Input 1: 3 strings of 16 P600 Optimisers and 32 295W Monocrystalline solar panels

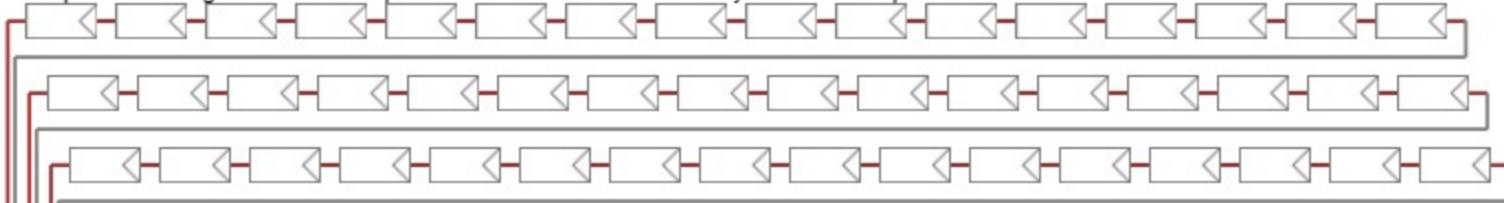

Input 1: 1 string of 15 P600 Optimisers and 30 295W Monocrystalline solar panels



Input 2: 1 string of 13 P600 Optimisers and 26 295W Monocrystalline solar panels



## International Hall Solar PV Schematic and Procedures



**UT Power**  
INTELLIGENT ENERGY

DC isolators inbuilt

AC isolators

### EMERGENCY SHUTDOWN PROCEDURE

Rotate AC Isolator to Off Position

Rotate DC Isolator to Off Position

To Restore Power

Rotate DC Isolator to On Position

Rotate AC Isolator to On Position

Earthing is by EEBADS all devices from inverter isolator & MCB are earthed back to MET

T: 0116 366 7981 • F: 0116 290 2008  
info@utilitytrade.com • www.utilitytrade.com

The Grid