


NOTES

- ALL SUPPLY AIR DUCTWORK WITHIN FALSE CEILING TO BE INSULATED WITH 25mm THICK FIBREGLASS GUILT FOIL, FOLDS SECURED WITH WIRE NETTING.
- ALL SUPPLY AIR GRILLES TO BE ONE-WAY FIXED BLADE (300x300).
- ALL EXTRACT GRILLES TO BE ECOGRATE TYPE.
- ACAS TO BE SUPPLIED FREE ISSUE.
1. No. CARTRIDGE 50-80 DOB PACKAGED HEAT PUMP WITH FOLLOWING ACCESSORIES:
- 1. OFF ROOF CURB.
 - 1. OFF ECONOMIZER ASSEMBLY.
 - 1. OFF TOWNTOWN THERMIST.
 - 2. OFF THERMOSTAT CIRCUITS.
 - 1. OFF THERMOSTAT, HY. OF AT 0.7.
 - 1. OFF 500-1000 HPH 15 A2 TT.
- BUILDERSWORK SCHEDULE:
1. 410x440x1000 OPENING (SEE DETAIL 3).
 2. REMOVAL AND RE-INSTATEMENT OF FALSE CEILING TO FACILITATE DUCTWORK INSTALLATION.
 3. 330x330 OPENING ABOVE DOOR.
 4. 150x150 OPENING AT HIGH LEVEL.
 5. 150x150 OPENING AT HIGH LEVEL.
 6. 600x500 OPENING AT HIGH LEVEL.
 7. 600x500 OPENING AT HIGH LEVEL (2 OFF).
 8. 150x150 OPENING AT HIGH LEVEL (2 OFF).
 9. 1000x500 OPENING AT HIGH LEVEL.
 10. ALL OPENINGS TO BE MADE GOOD AND WEATHERED BY SHOPFITTER.
 11. OFF LOADING AND POSITIONING OF HEAT PUMP ON ROOF BY SHOPFITTER.
 12. ALL LOUVER OPENINGS TO BE PROVIDED WITH TIMBER FRAME.
 13. SHOPFITTER WORK TO BE ALTERED TO SUIT EXHAUST LOUVER.
 14. EXHAUST LOUVER TO BE PAINTED TO SUIT SHOP SIGN.
 15. DOOR UNDER OPENING 14.8 TO BE CUT DOWN TO 6'-0" CLEAR OPENING.
 16. 330x330 OPENING AT HIGH LEVEL.

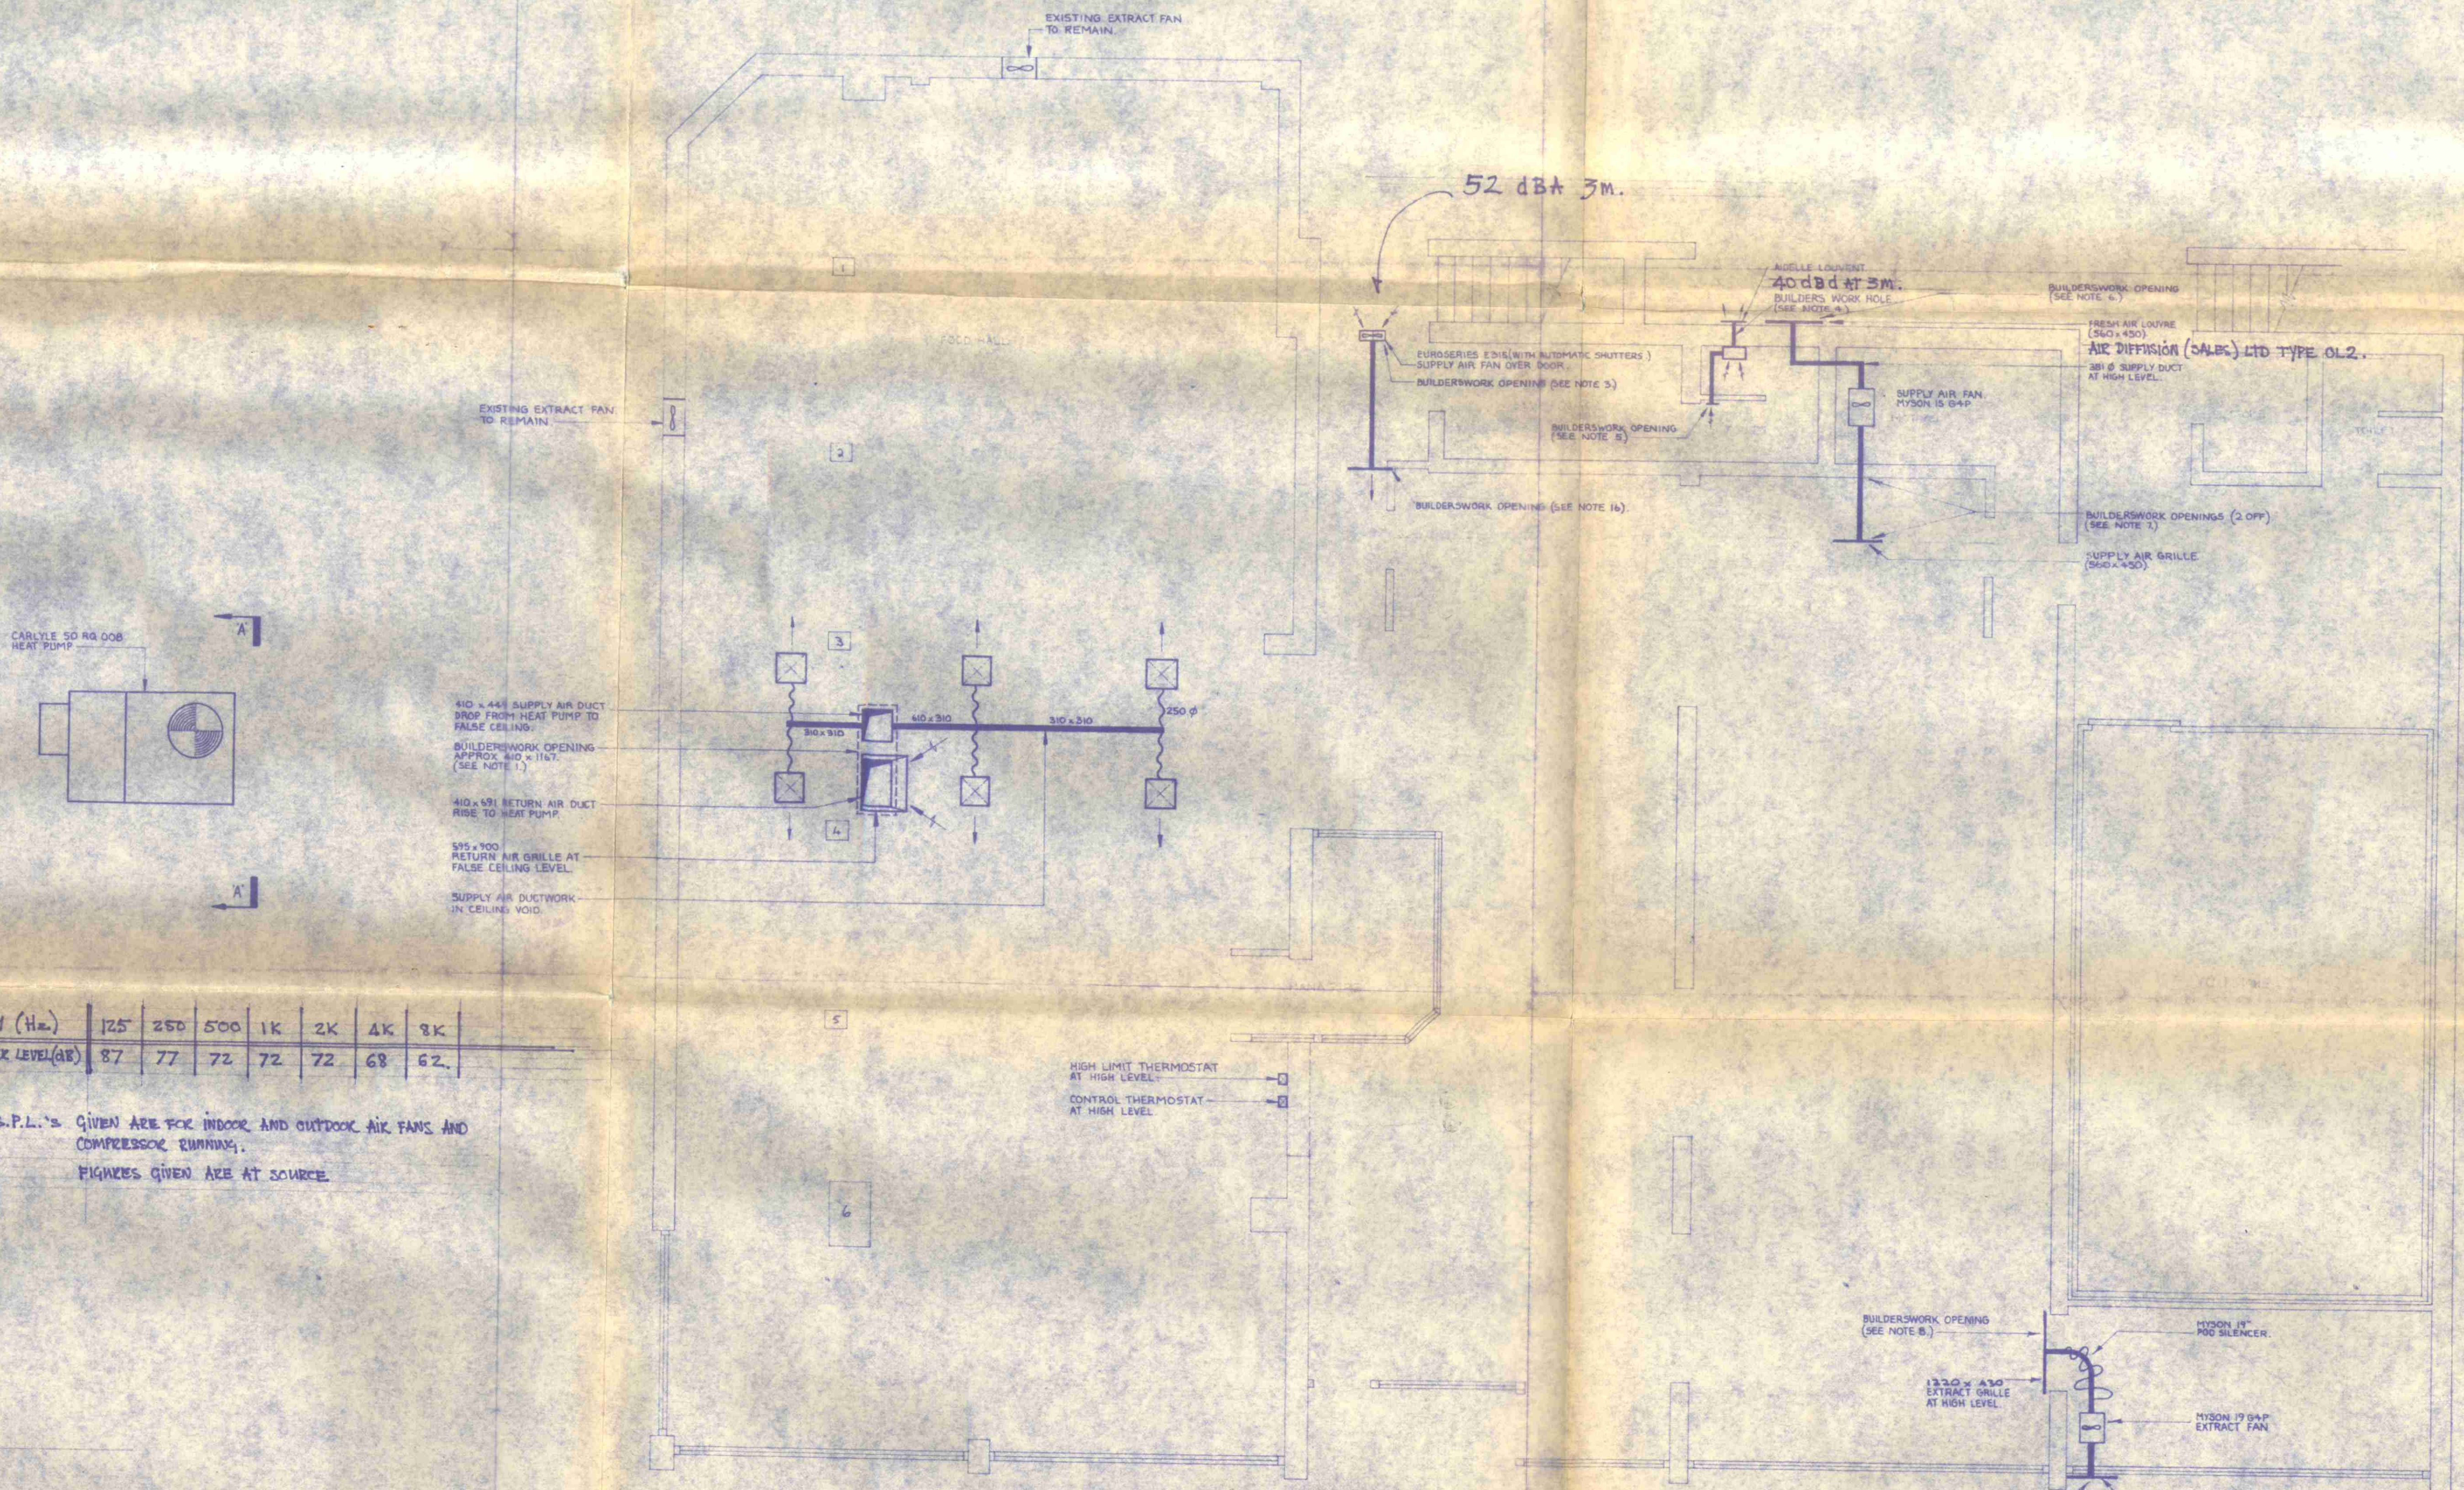


FREQUENCY (Hz)	125	250	500	1K	2K	4K	8K
SOUND POWER LEVEL (dB)	87	77	72	72	72	68	62


NOTE: S.P.L.'s GIVEN ARE FOR INDOOR AND OUTDOOR AIR FANS AND COMPRESSOR RUNNING.
FIGURES GIVEN ARE AT SOURCE.

FREQUENCY Hz	125	250	500	1K	2K	4K
SOUND POWER LEVEL dB	65	63	61	60	58	49

NOTE: S.P.L.'s AT 3M.

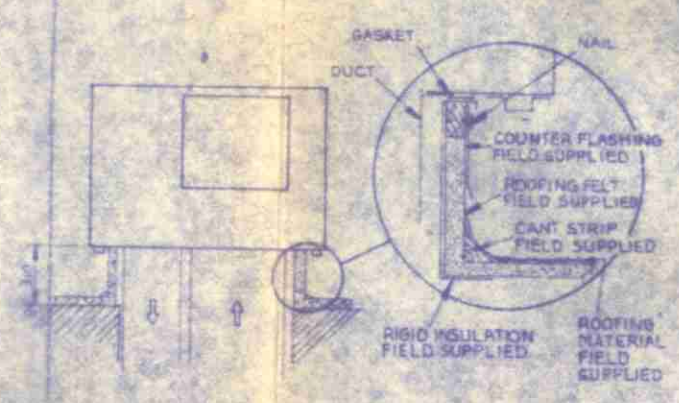

Section A-A

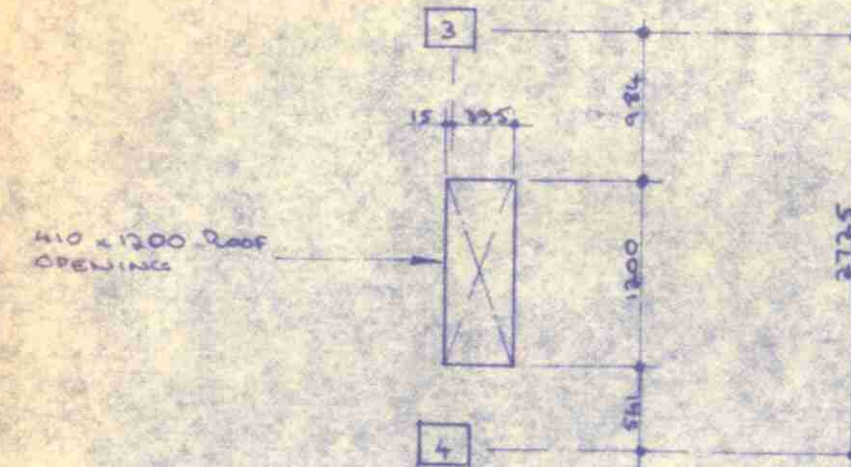

DETAIL B

26 OCT 1983
LONDON BOROUGH OF CAMDEN
TOWN AND COUNTRY PLANNING ACTS
PLANS APPROVED
ON BEHALF OF THE COUNCIL

CTP/H8/11K/AC/36338.

DATE	BY	DESCRIPTION	REV
22.4.83	M.B.	GENERAL HEAT PUMP LAYOUT MODIFICATIONS; BUILDERSWORK DETAILS ADDED.	A

REVISIONS

Client: Béjam Freezer Food Centres Ltd.

Site Location: Béjam Freezer Food Centre, 12-20, Winchester Road, Swiss Cottage, London NW3

AIR CONDITIONING & ALLIED SERVICES
7-11 COUCHING STREET, WATLINGTON OXON OX9 5QG
Tel: WATLINGTON (0494 161) 2129/0

Proposed Layout of Heating / Cooling and Ventilation System

Drawn: S.S.	Checked:	Approved:
Date: 31st March 83	Scale: 1:50	
Issue:	ORG No:	Q83-058 2 B