


- Notes
- 1- This drawing is not for construction
 - 2- All Dimension are in millimeters
 - 3- Dimensions are not to be scaled directly from drawings
 - 4- All dimensions are to be checked on site and the Architect is to be inform of any discrepancies before construction commences
 - 5- All references to drawings refer to current revision of that drawing
 - 6- The Copyright of this drawing belongs to ArchPL Ltd.




- Existing Wall
- Wall/partition to be removed
- Proposed wall/partition



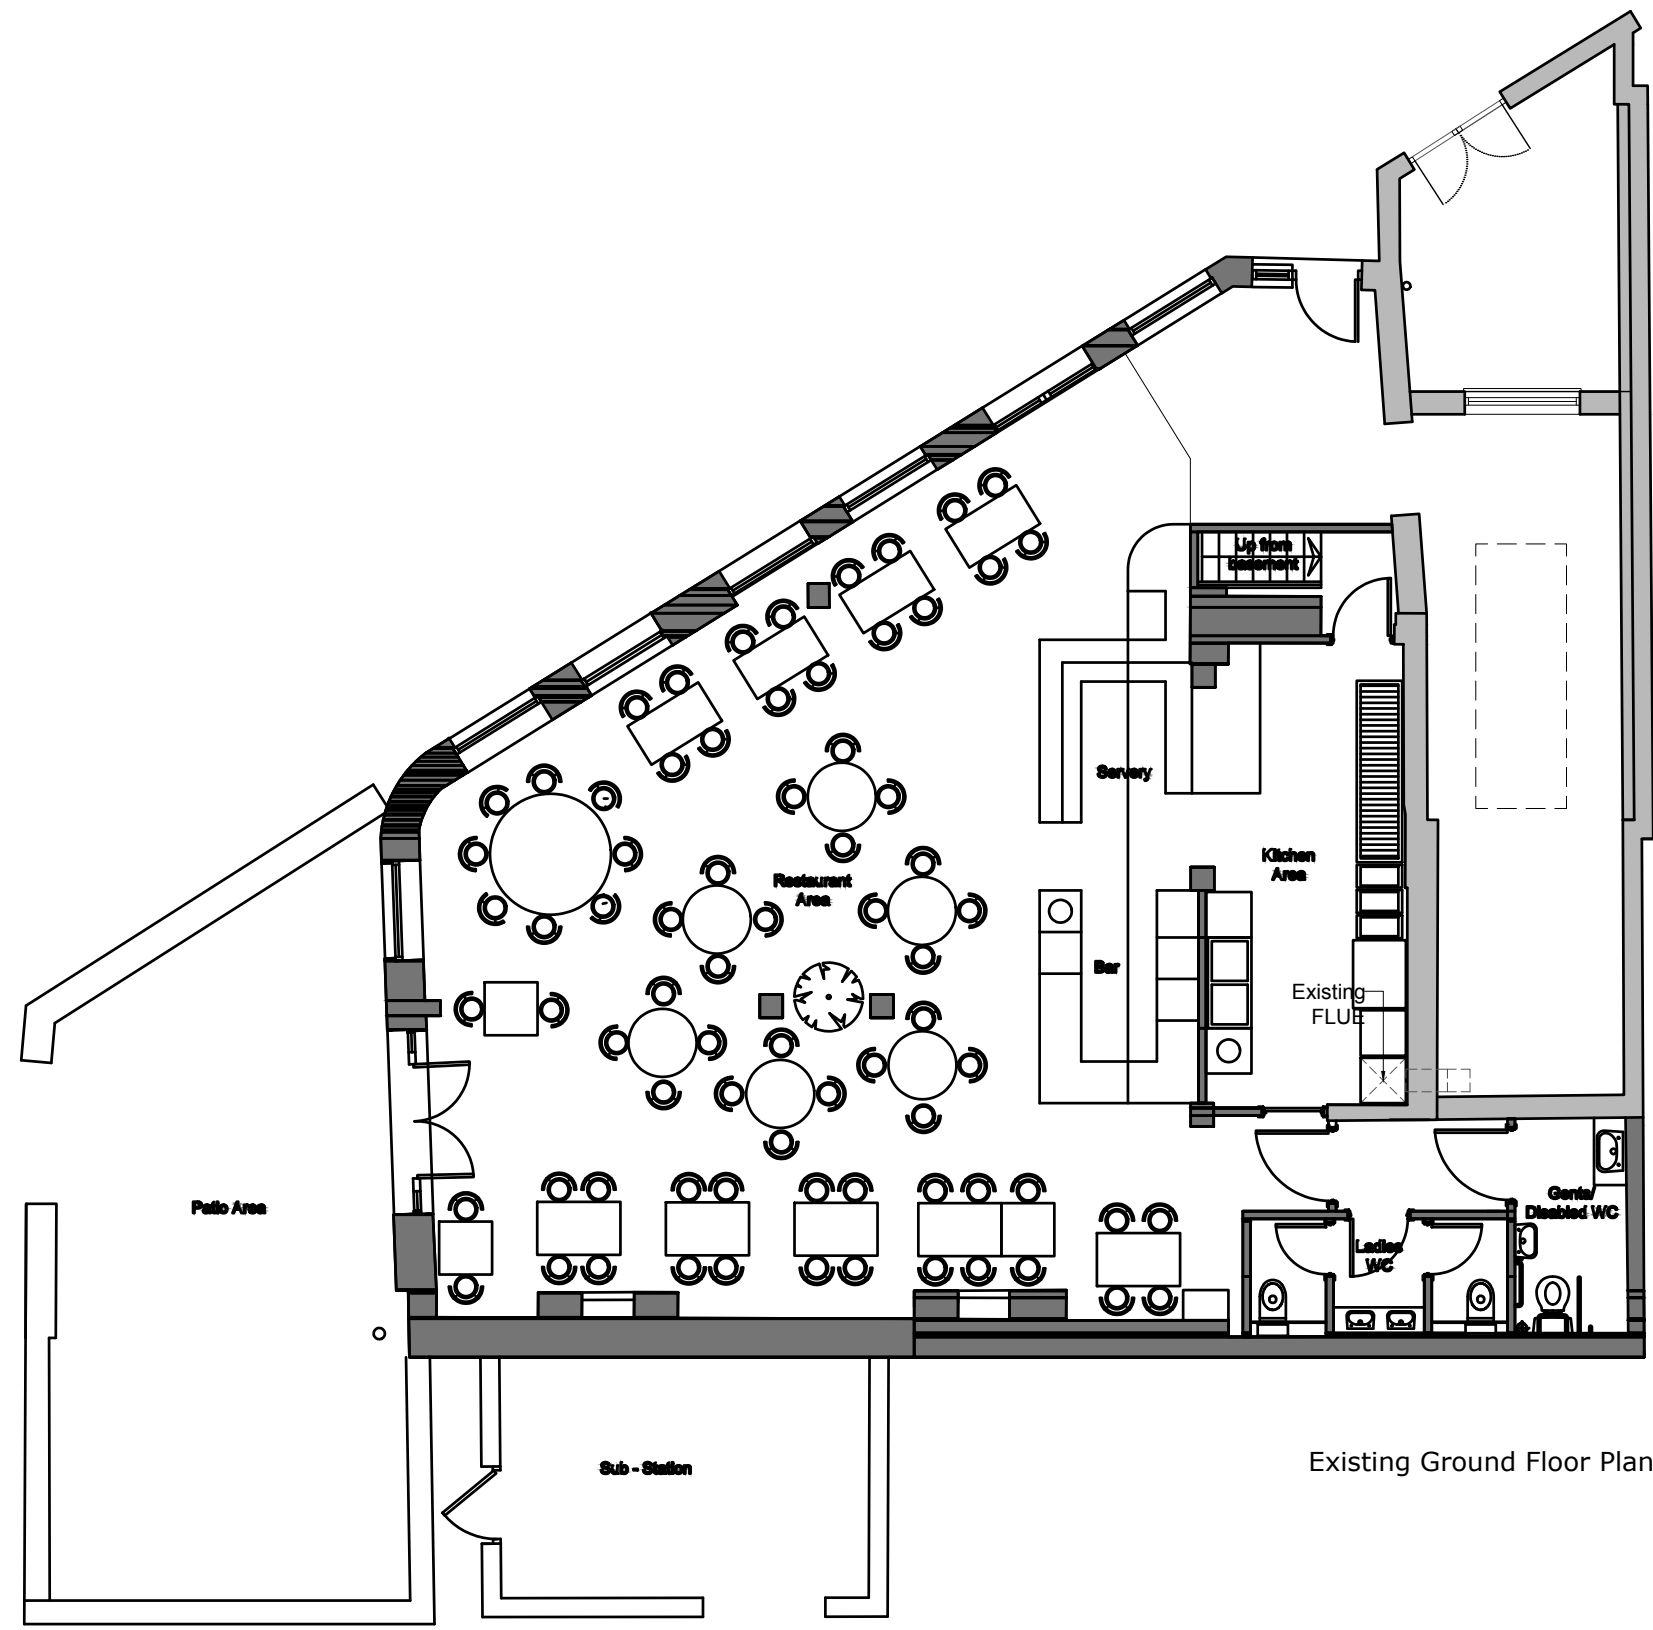


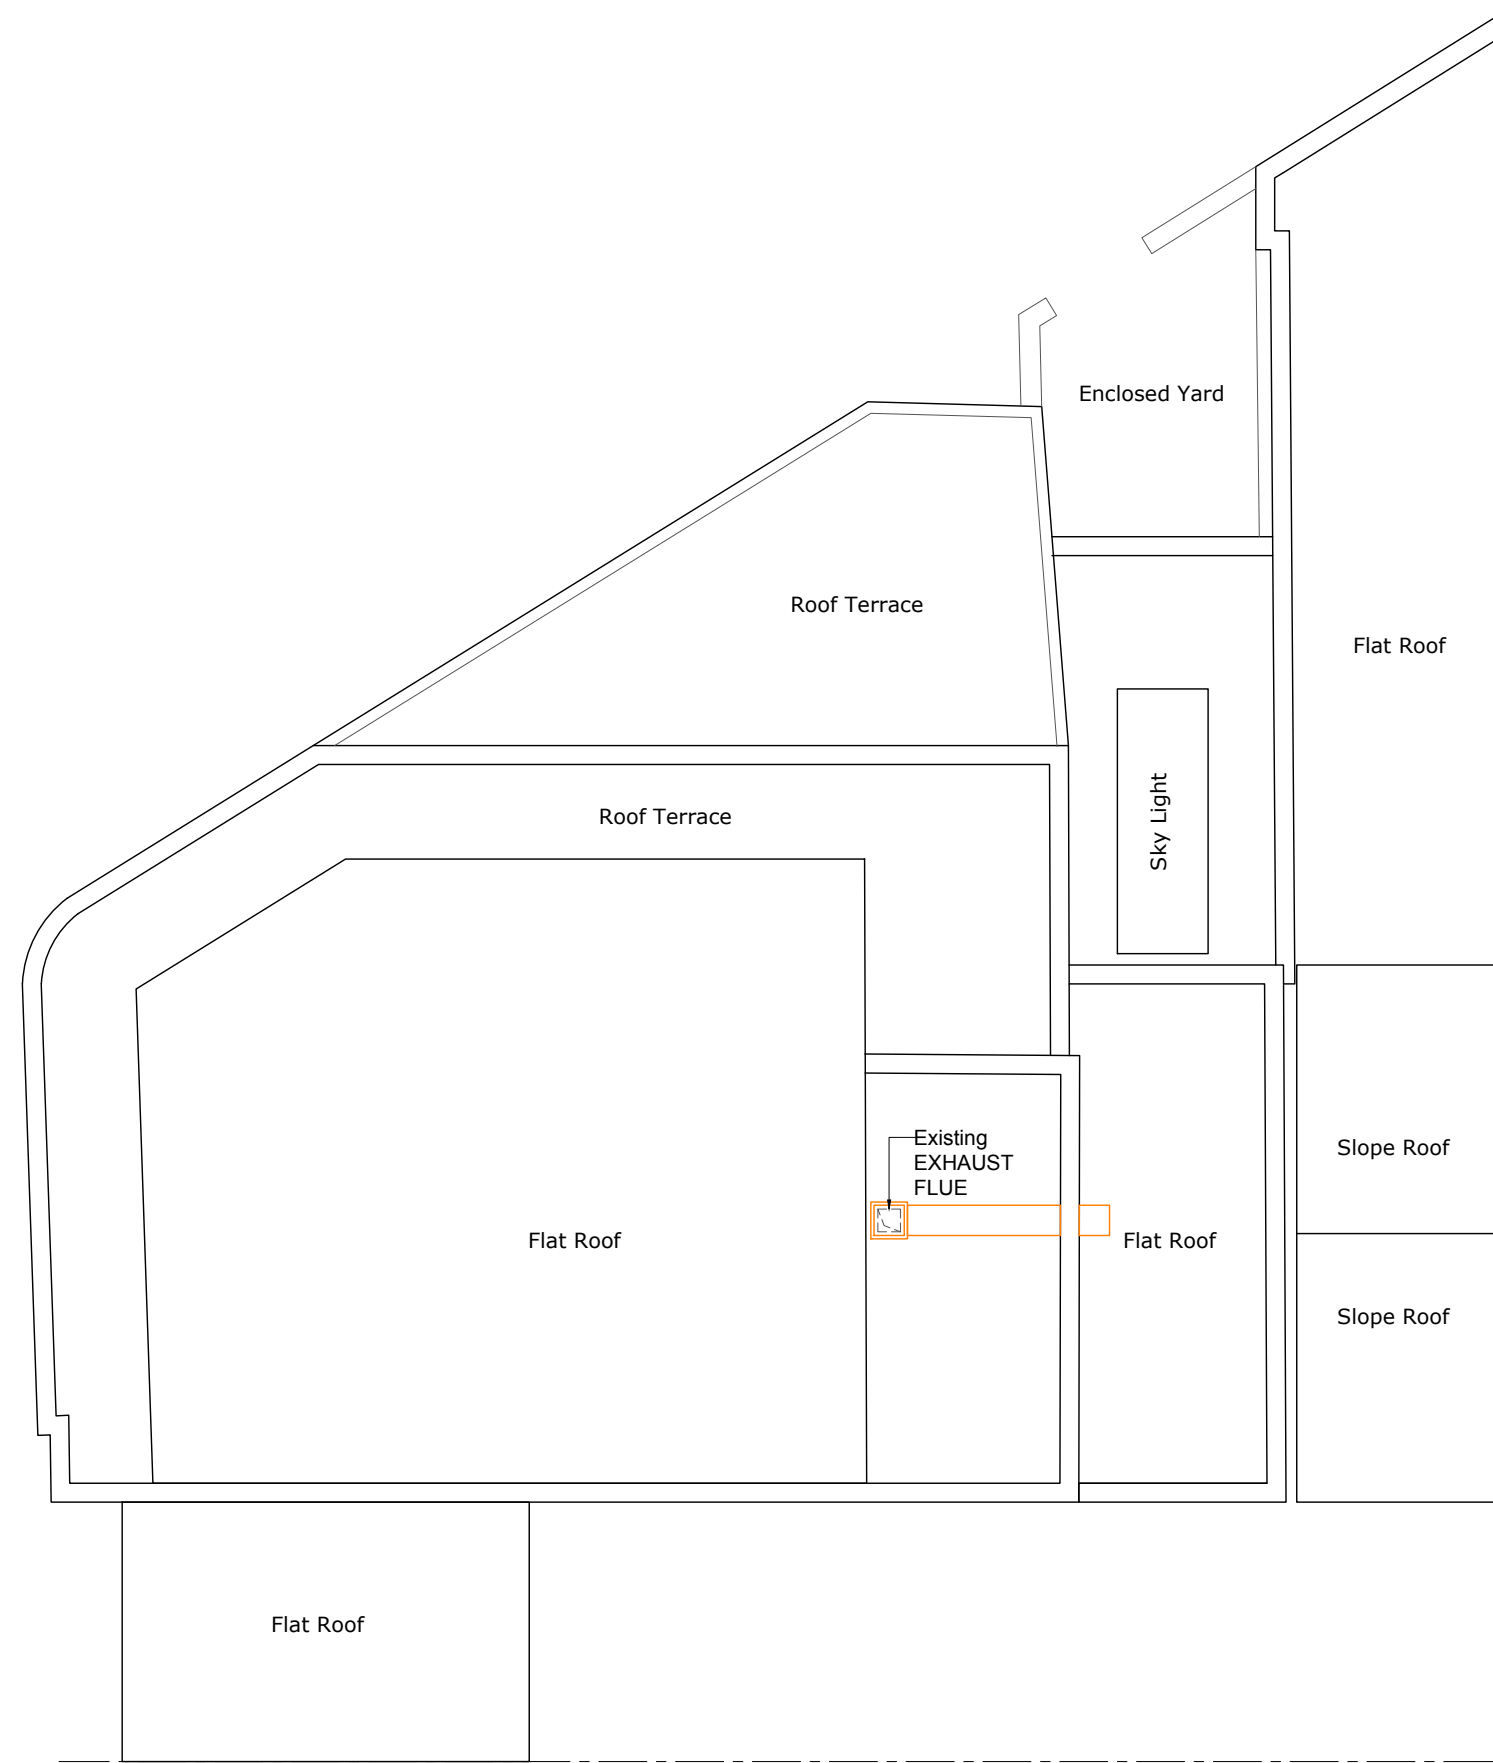
Existing Ground Floor Plan

Rev.	Date	Revisions
-	-	-
FOR PLANNING		
 ARCH ARCHITECTURAL DESIGN STUDIO 33B Grand Parade, Green Lanes, Haringey, London, N4 1LG Tel: 0208 809 2320 - 0784241 0527 Web: www.archpl.co.uk		
Client	My Aysun Uludag	
Project	15 Highgate Road, NW5 1QX	
Scale	1/100@A3	Date 11/2018
Drawn By	LLB	Checked By AEC
Project No.	18160	Drawing No. A101
		Revision -
Drawing title		
Existing Ground Floor Plan		

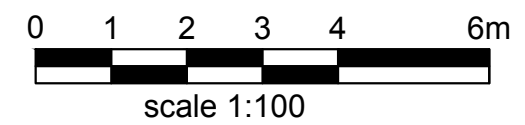- Notes
- 1- This drawing is not for construction
 - 2- All Dimension are in millimeters
 - 3- Dimensions are not to be scaled directly from drawings
 - 4- All dimensions are to be checked on site and the Architect is to be inform of any discrepancies before construction commences
 - 5- All references to drawings refer to current revision of that drawing
 - 6- The Copyright of this drawing belongs to ArchPL Ltd.




-  Existing Wall
-  Wall/partition to be removed
-  Proposed wall/partition




Rev.	Date	Revisions
-	-	-
FOR PLANNING		
 ARCH ARCHITECTURAL DESIGN STUDIO 33B Grand Parade, Green Lanes, Haringey, London, N4 1LG Tel: 0208 809 2320 - 0784241 0527 Web: www.archpl.co.uk		
Client	My Aysun Uludag	
Project	15 Highgate Road, NW5 1QX	
Scale	1/100@A3	Date 11/2018
Drawn By	LLB	Checked By AEC
Project No.	18160	Drawing No. A102
		Revision -
Drawing title		
Existing Roof Plan		

- Notes
- 1- This drawing is not for construction
 - 2- All Dimension are in millimeters
 - 3- Dimensions are not to be scaled directly from drawings
 - 4- All dimensions are to be checked on site and the Architect is to be inform of any discrepancies before construction commences
 - 5- All references to drawings refer to current revision of that drawing
 - 6- The Copyright of this drawing belongs to ArchPL Ltd.

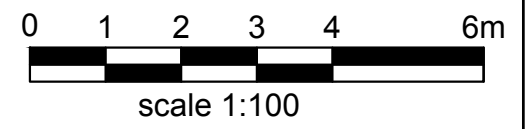

- Existing Wall
- Wall/partition to be removed
- Proposed wall/partition

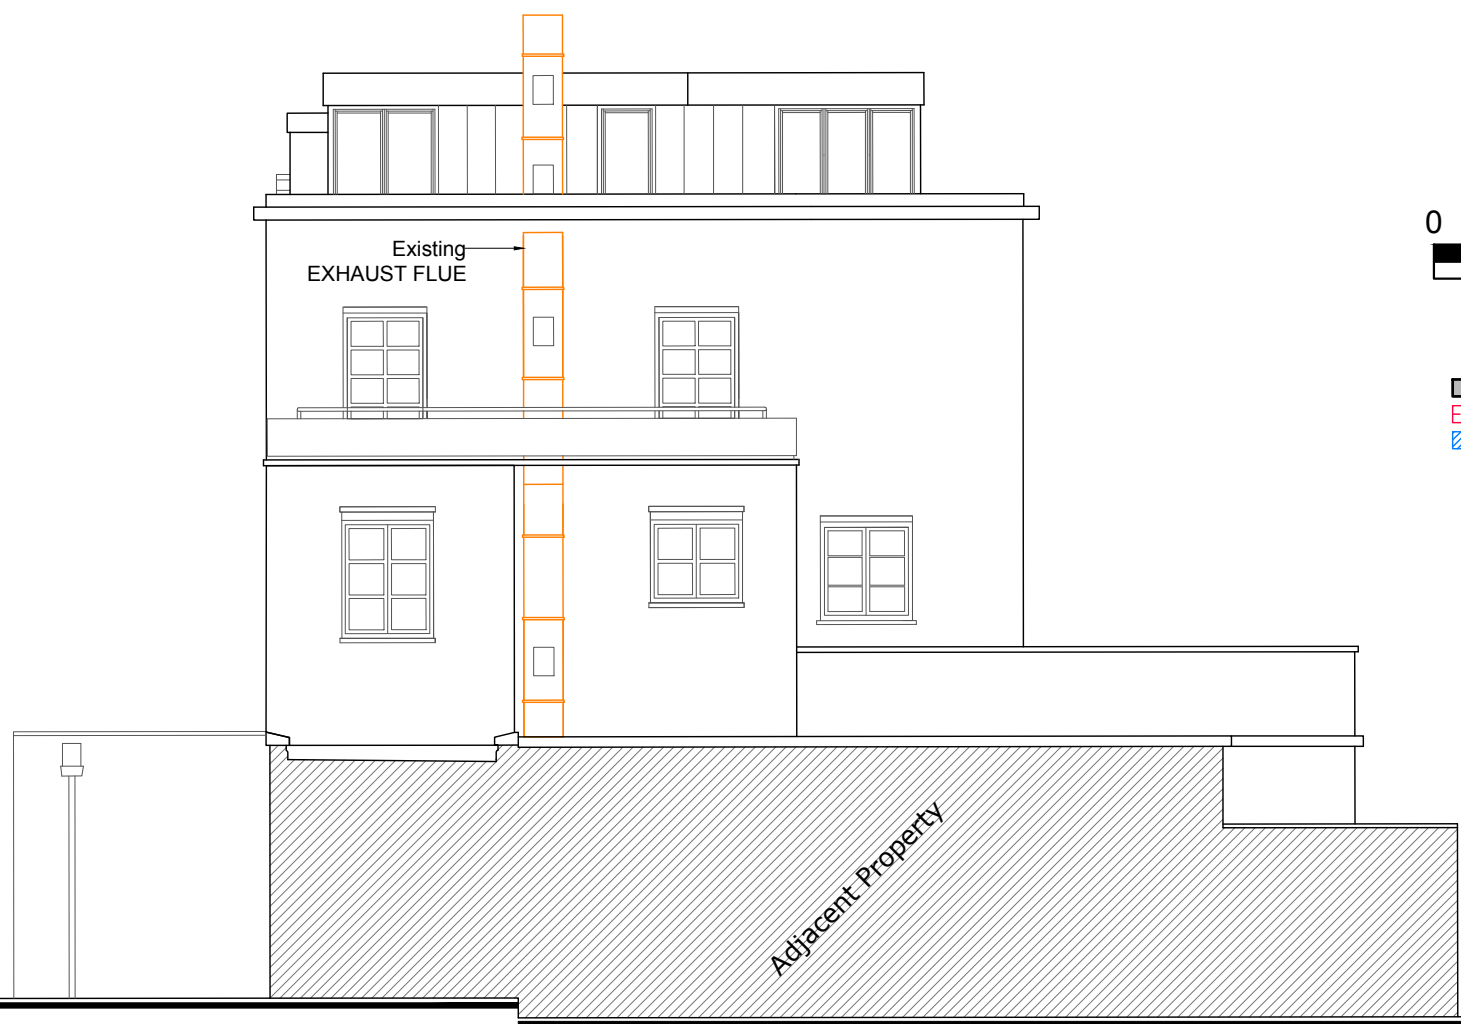

Existing Flank Elevation (East)



No.27

No.15

Existing Swains Lane Elevation (North)

Rev.	Date	Revisions
A	11/03/2019	Added further details

FOR PLANNING




ARCHITECTURAL DESIGN STUDIO
33B Grand Parade, Green Lanes,
Haringey, London, N4 1LG
Tel: 0208 809 2320 - 0784241 0527
Web: www.archpl.co.uk

Client	My Aysun Uludag		
Project	15 Highgate Road, NW5 1QX		
Scale	1/100@A3	Date	11/2018
Drawn By	LLB	Checked By	AEC
Project No.	18160	Drawing No.	A103
		Revision	A
Drawing title			
Existing Elevations (North&East)			

- Notes
- 1- This drawing is not for construction
 - 2- All Dimension are in millimeters
 - 3- Dimensions are not to be scaled directly from drawings
 - 4- All dimensions are to be checked on site and the Architect is to be inform of any discrepancies before construction commences
 - 5- All references to drawings refer to current revision of that drawing
 - 6- The Copyright of this drawing belongs to ArchPL Ltd.



- Existing Wall
- Wall/partition to be removed
- Proposed wall/partition

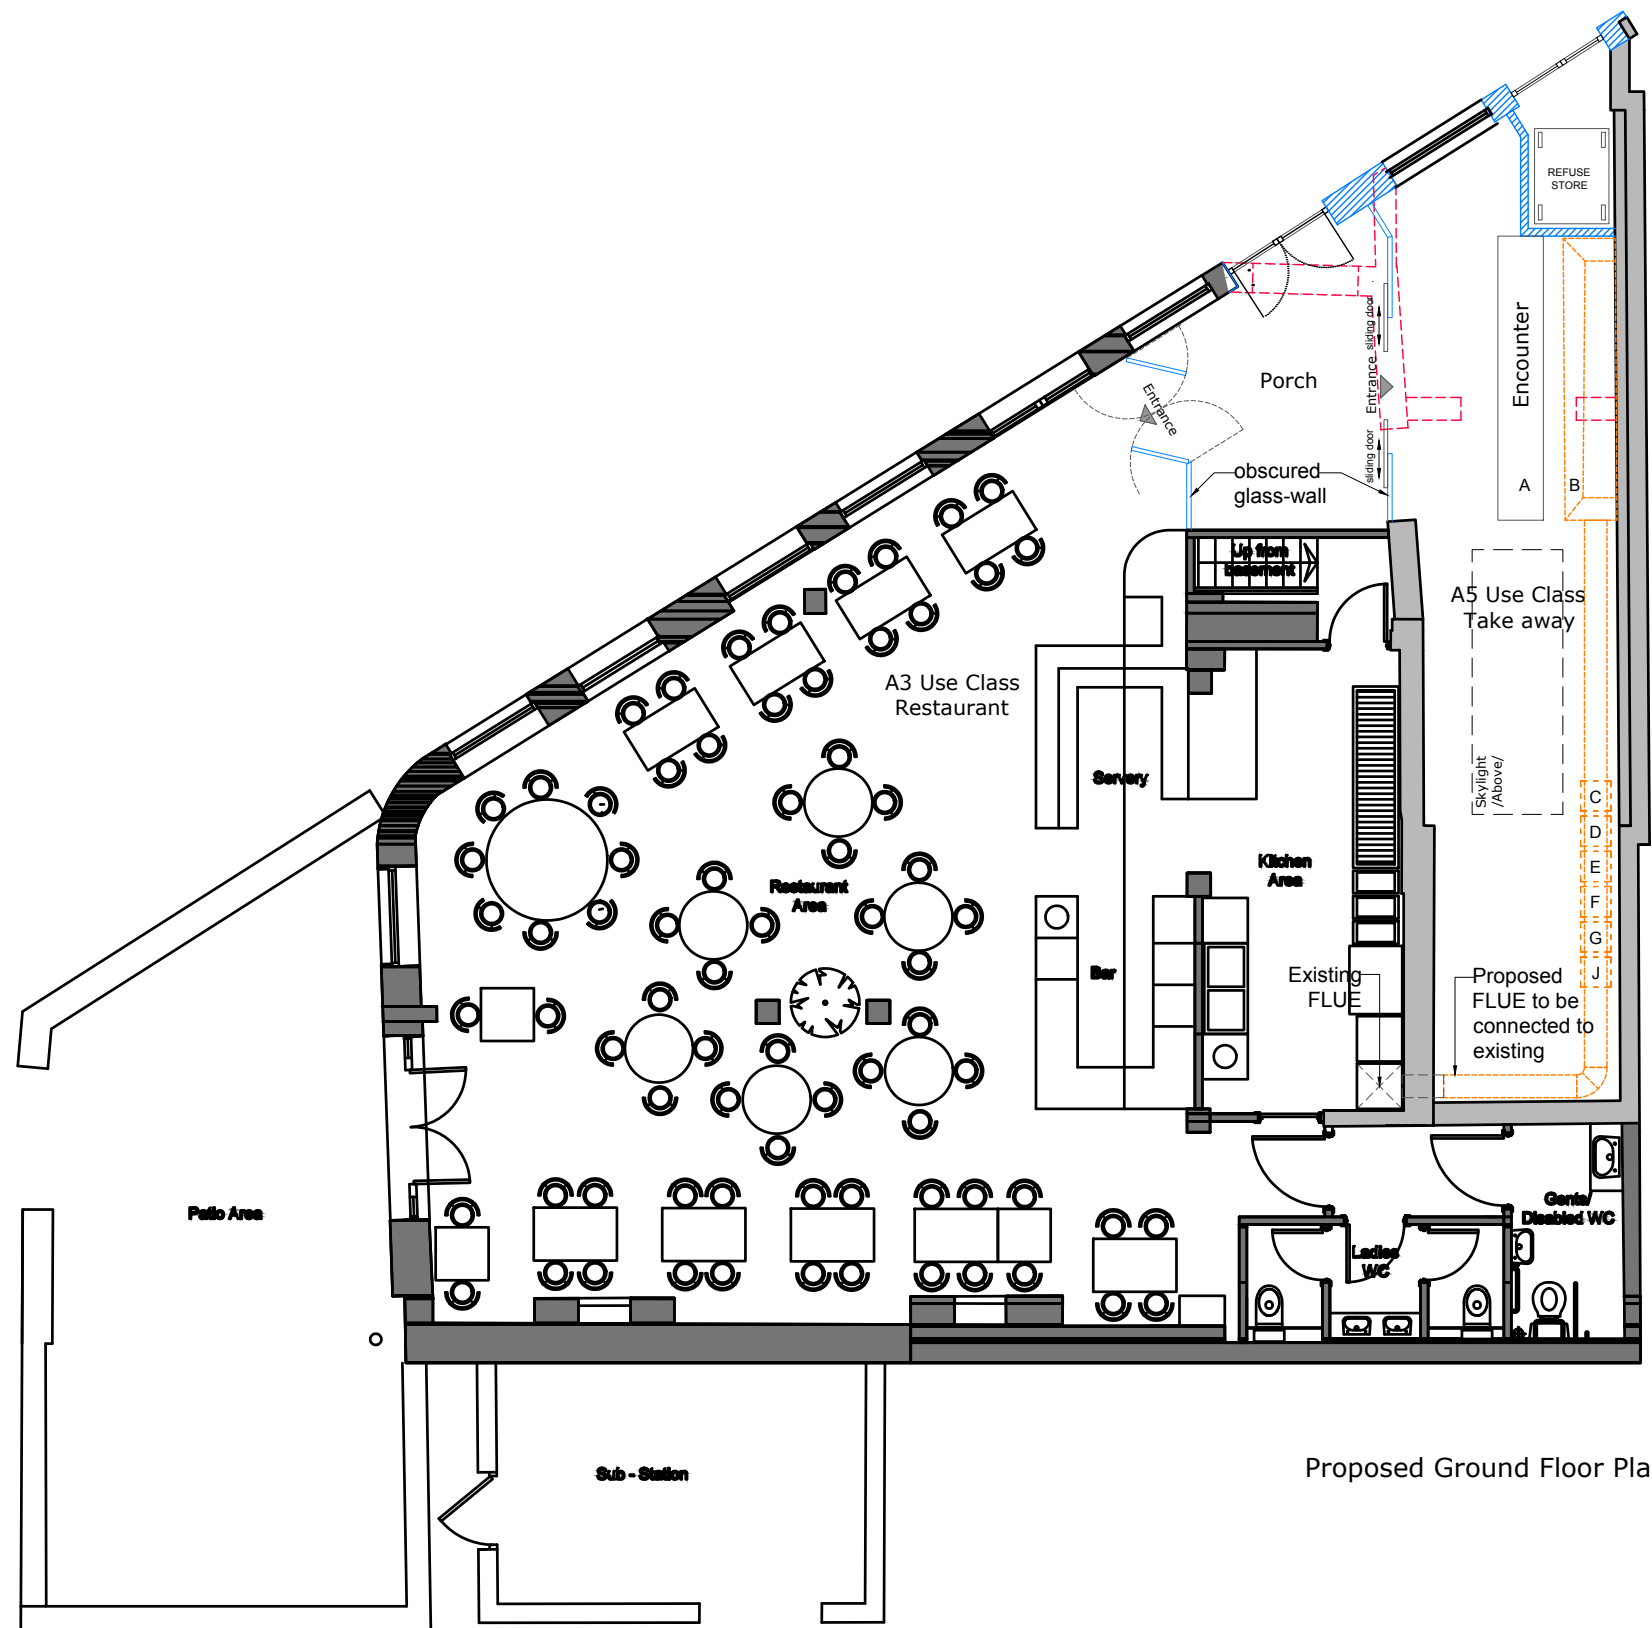


Proposed Ground Floor Plan




EXTRACTION UNIT LEGEND


- | | |
|-----------------------------|------------------------------|
| A. COOKING AREA | H. LAGGING |
| B. EXTRACTION | I. ANTI-VIBRATING MOUNTING |
| C. GREASE FILTERS | J. NOISE ATTENUATOR |
| D. COARSE PRE-FILTER | K. EXHAUST FLUE |
| E. FINE PRE-FILTER | L. RAW FOOD PREPARATION DESK |
| F. ACTIVATED CARBON FILTERS | M. HAND WASH BASIN |
| G. FAN/ MOTOR UNIT | N. FOOD WASH SINKS |

Rev.	Date	Revisions
FOR PLANNING		
 ARCH ARCHITECTURAL DESIGN STUDIO 33B Grand Parade, Green Lanes, Haringey, London, N4 1LG Tel: 0208 809 2320 - 0784241 0527 Web: www.archpl.co.uk		
Client	My Aysun Uludag	
Project	15 Highgate Road, NW5 1QX	
Scale	1/100@A3	Date 10/2018
Drawn By	LLB	Checked By AEC
Project No.	18160	Drawing No. A104
		Revision -
Drawing title		
Proposed Ground Floor Plan		

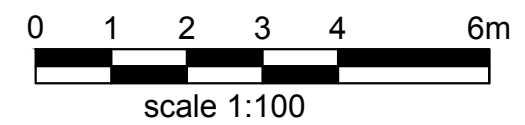- Notes
- 1- This drawing is not for construction
 - 2- All Dimension are in millimeters
 - 3- Dimensions are not to be scaled directly from drawings
 - 4- All dimensions are to be checked on site and the Architect is to be inform of any discrepancies before construction commences
 - 5- All references to drawings refer to current revision of that drawing
 - 6- The Copyright of this drawing belongs to ArchPL Ltd.




-  Existing Wall
-  Wall/partition to be removed
-  Proposed wall/partition

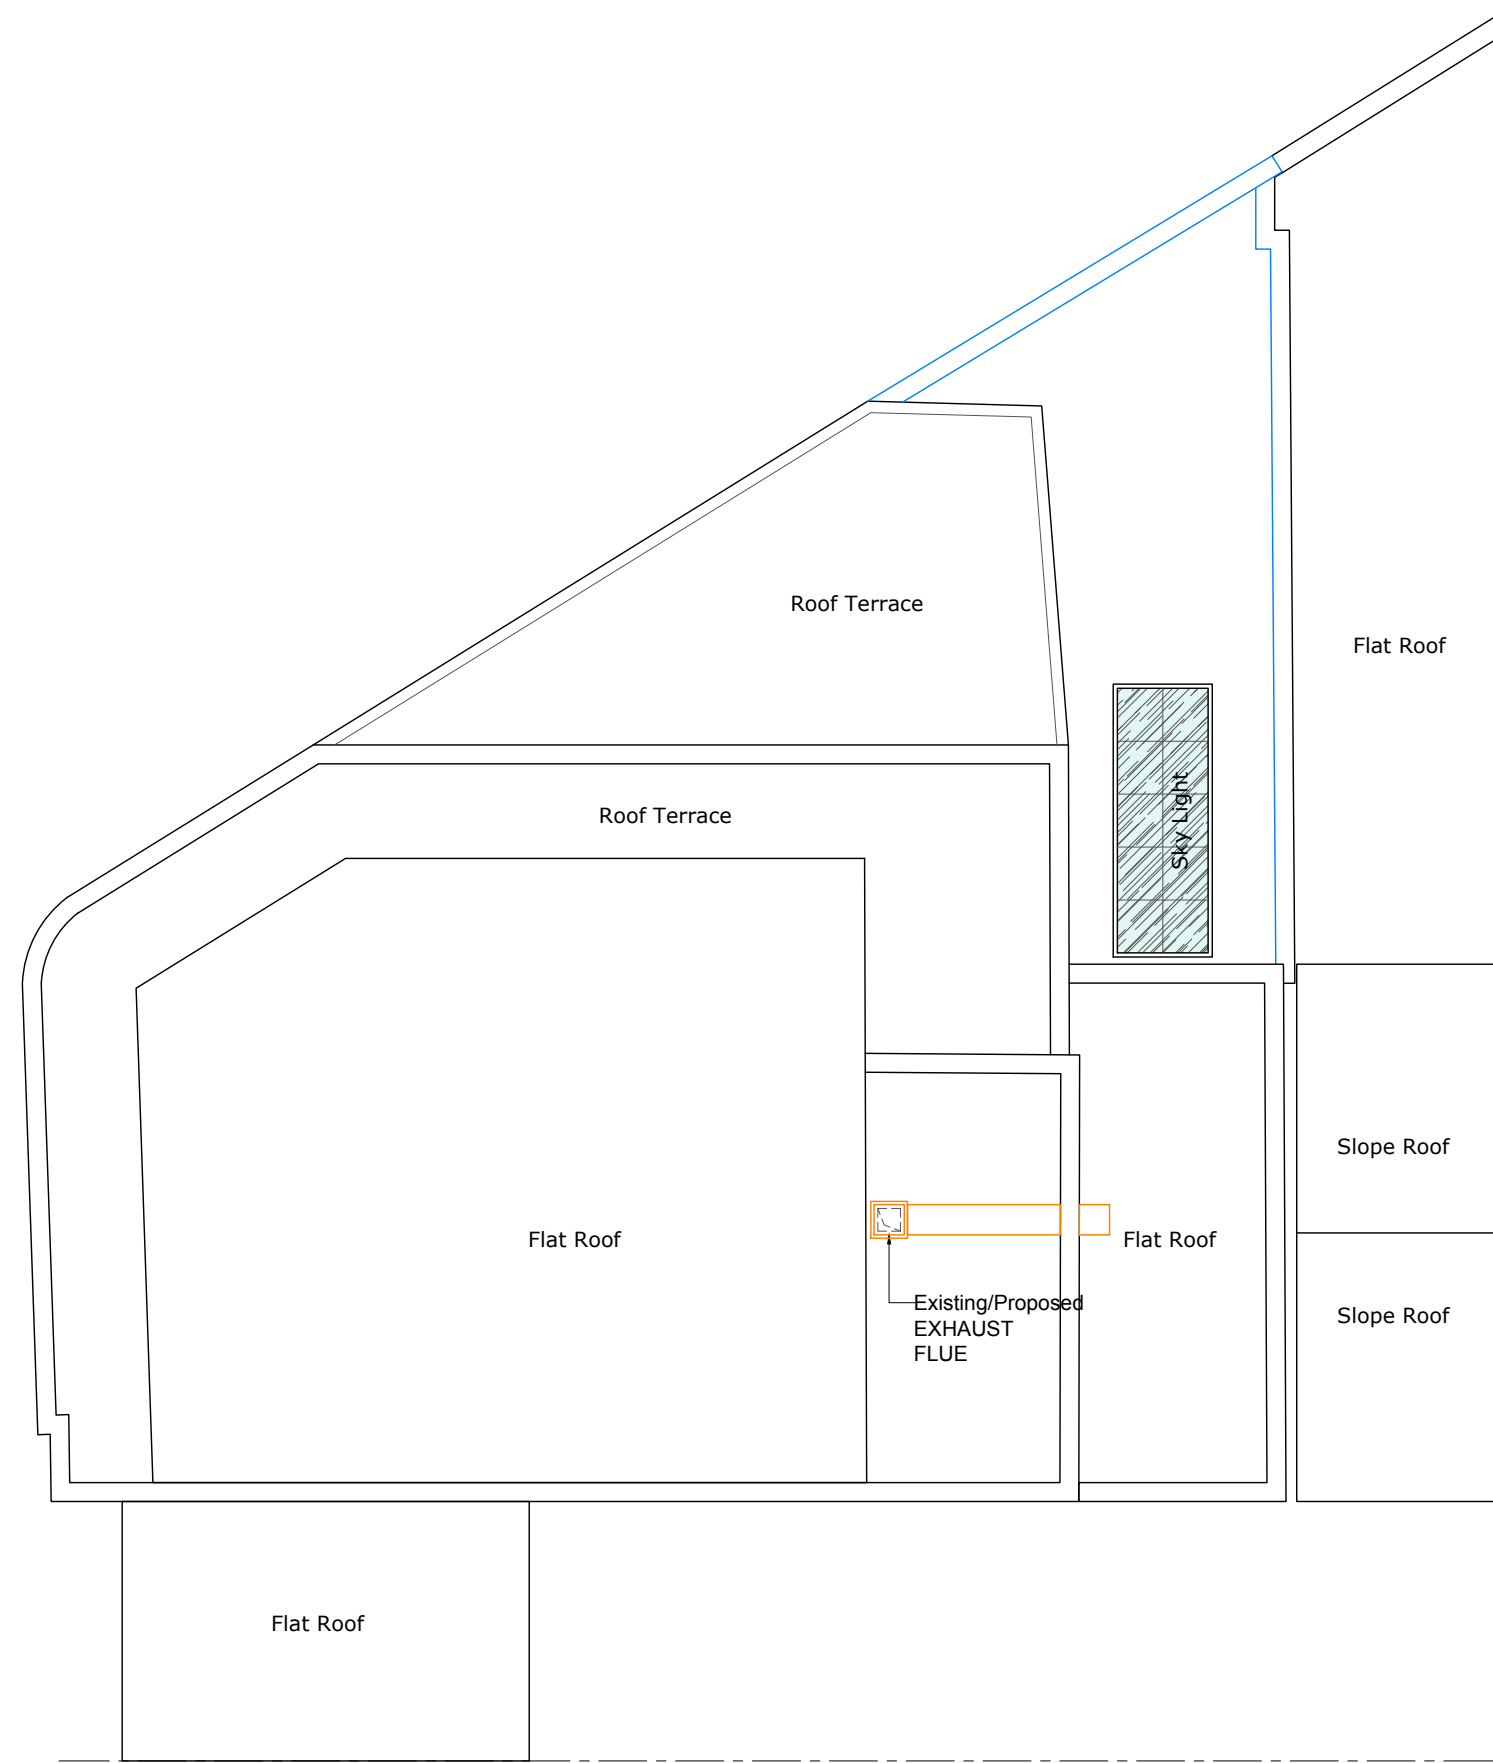

Rev.	Date	Revisions
-	-	-
FOR PLANNING		
 ARCH ARCHITECTURAL DESIGN STUDIO 33B Grand Parade, Green Lanes, Haringey, London, N4 1LG Tel: 0208 809 2320 - 0784241 0527 Web: www.archpl.co.uk		
Client	My Aysun Uludag	
Project	15 Highgate Road, NW5 1QX	
Scale	1/100@A3	Date 11/2018
Drawn By	LLB	Checked By AEC
Project No.	18160	Drawing No. A105
		Revision -
Drawing title		
Proposed Roof Plan		

- Notes
- 1- This drawing is not for construction
 - 2- All Dimension are in millimeters
 - 3- Dimensions are not to be scaled directly from drawings
 - 4- All dimensions are to be checked on site and the Architect is to be inform of any discrepancies before construction commences
 - 5- All references to drawings refer to current revision of that drawing
 - 6- The Copyright of this drawing belongs to ArchPL Ltd.

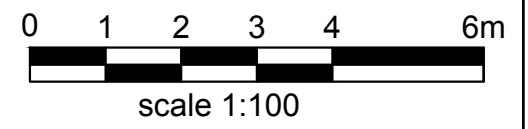

- Existing Wall
- Wall/partition to be removed
- Proposed wall/partition



Proposed Flank Elevation (East)



No.27

No.15

Proposed Swains Lane Elevation (North)


Rev.	Date	Revisions
A	11/03/2019	Added further details

FOR PLANNING




ARCHITECTURAL DESIGN STUDIO
33B Grand Parade, Green Lanes,
Haringey, London, N4 1LG
Tel: 0208 809 2320 - 0784241 0527
Web: www.archpl.co.uk

Client	My Aysun Uludag		
Project	15 Highgate Road, NW5 1QX		
Scale	1/100@A3	Date	11/2018
Drawn By	LLB	Checked By	AEC
Project No.	18160	Drawing No.	A106
		Revision	A
Drawing title			
Proposed Elevations (North&East)			

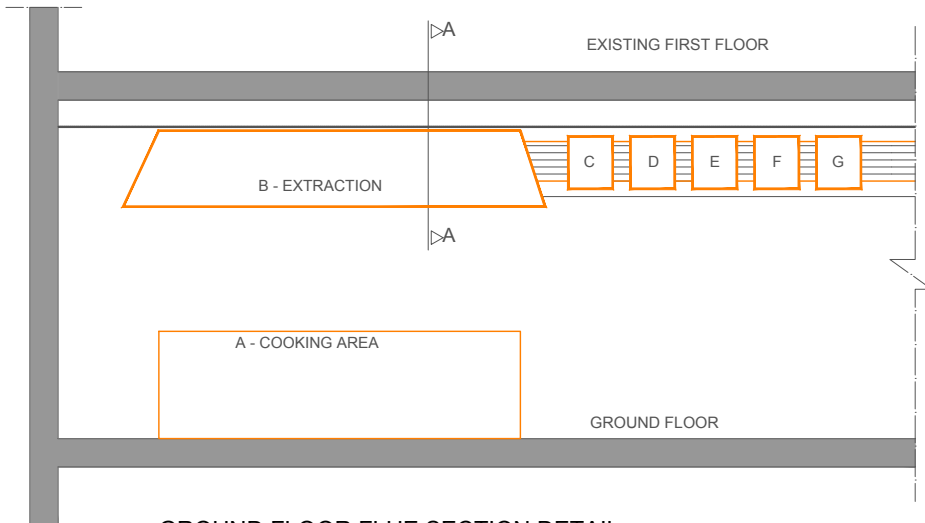

GROUND FLOOR FLUE SECTION DETAIL

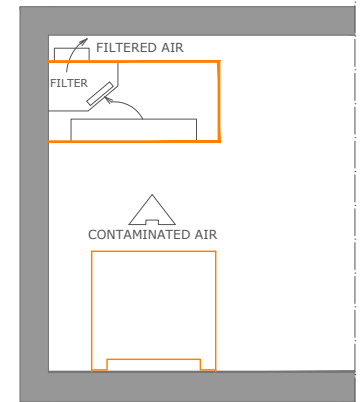

OVERHEAD WALL MOUNTED CANOPY


EXTRACTION UNIT LEGEND

- | | |
|-----------------------------|------------------------------|
| A. COOKING AREA | H. LAGGING |
| B. EXTRACTION | I. ANTI-VIBRATING MOUNTING |
| C. GREASE FILTERS | J. NOISE ATTENUATOR |
| D. COARSE PRE-FILTER | K. EXHAUST FLUE |
| E. FINE PRE-FILTER | L. RAW FOOD PREPARATION DESK |
| F. ACTIVATED CARBON FILTERS | M. HAND WASH BASIN |
| G. FAN/ MOTOR UNIT | N. FOOD WASH SINKS |

NOTES


- AN ACOUSTIC TEST CERTIFICATE WILL BE ISSUED TO ENVIRONMENTAL HEALTH DEPARTMENT & BUILDING CONTROL UPON COMPLETION OF ALL BUILDING WORKS AND BUILDING REGULATION WORKS, IF REQUIRED. ACOUSTIC MATERIAL MAY CHANGE IF REQUIRED.

- MOTOR / FAN TO BE PLANED USING ANTI-VIBRATION MOUNTING MATERIAL.

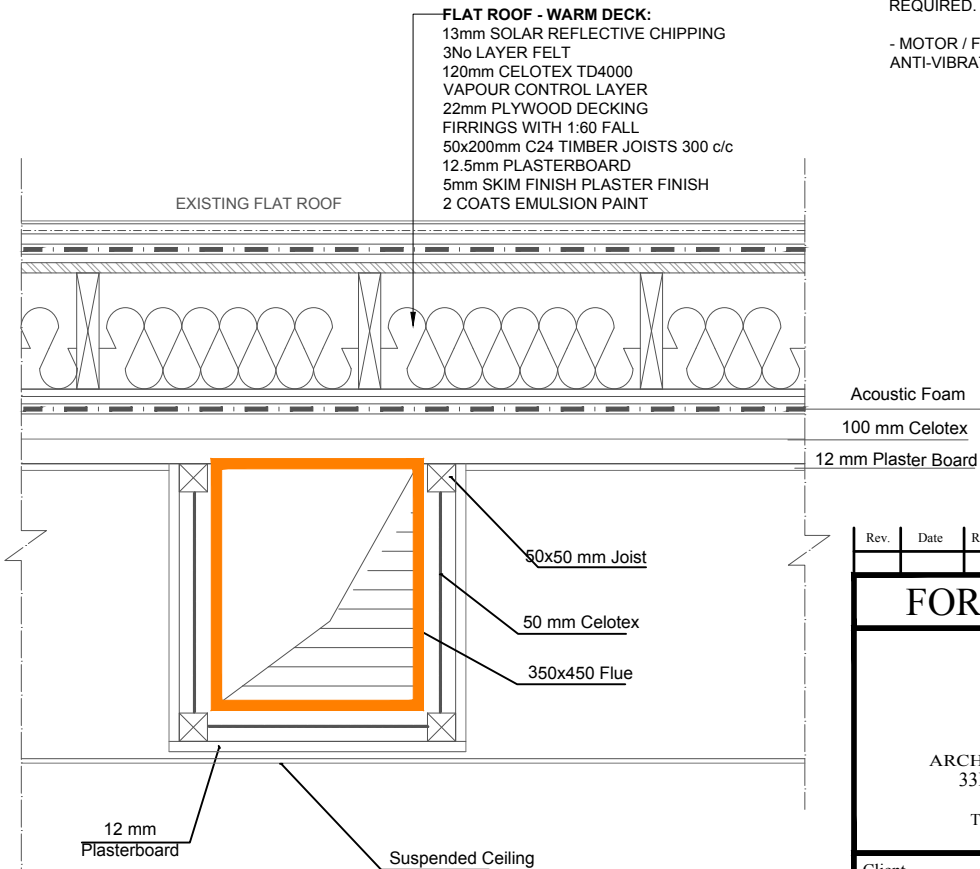

FLUE A-A SECTION DETAIL

Rev.	Date	Revisions
FOR PLANNING		
 ARCH ARCHITECTURAL DESIGN STUDIO 33B Grand Parade, Green Lanes, Haringey, London, N4 1LG Tel: 0208 809 2320 - 0784241 0527 Web: www.archpl.co.uk		
Client	My Aysun Uludag	
Project	15 Highgate Road, NW5 1QX	
Scale	1/500 @A4	Date 11/2018
Drawn By	LLB	Checked By AEC
Project No.	Drawing No.	Revision
18160	A106	-
Drawing title		
Proposed Extraction Scheme		

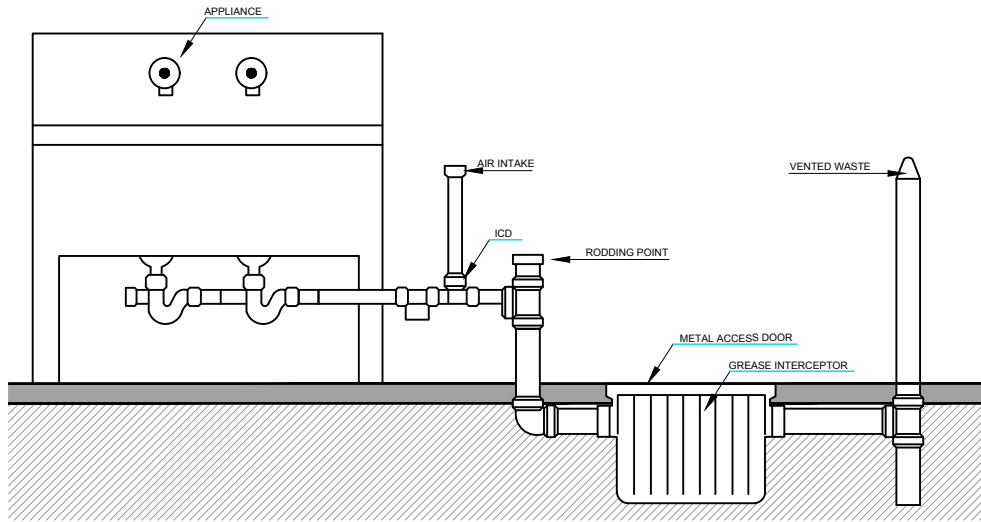


**GREASE INTERCEPTOR FOR
TYPICAL IN FLOOR INSTALLATION**

CONNECTION SIZE : 110 mm


FLOW RATE : 1.6L/Sec.

GREASE CAPACITY : 23 kg

NOTE: The grease inceptor should be installed as close as is practical to the appliances being served (max. distance 8 m.), being free standing, on or partially/fully recessed into the floor.

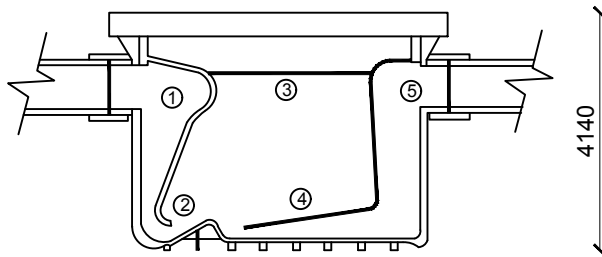

GREASE INTERCEPTOR SECTION DETAIL

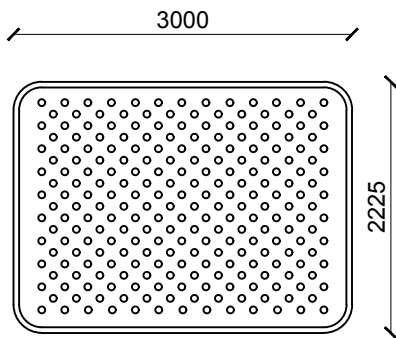

GREASE INTERCEPTOR PLAN

- ① The unit, in conjunction with the Influent Control Device (ICD) which both introduces air to the influent and protects the interceptor from influent surges, creates turbulence and slows the influent velocity.
- ② The influent is then forced upward by the integral ramp having been converted in to a laminar flow by the mouth of the inlet baffle.
- ③ The grease then floats to the top of the tank assisted by the entrained air introduced by the ICD, where it collects and is retained.
- ④ Any food particles remaining in the influent separate out of the flow under gravity and fall onto the ramp of the outlet baffle.
- ⑤ The linear design of the outlet baffle opening, creates a suction effect drawing the waste water and over 90% of the silt and particulates out of the tank, thereby reducing the required maintenance period. It is recommended however that the interceptor be fully dismantled and cleaned thoroughly on a 6 monthly basis, in addition to its regular servicing schedule.

FOR PLANNING



ARCHITECTURAL DESIGN STUDIO
33B Grand Parade, Green Lanes,
Haringey, London, N4 1LG
Tel: 0208 809 2320 - 0784241 0527
Web: www.archpl.co.uk

Client My Aysun Uludag		
Project 15 Highgate Road, NW5 1QX		
Scale 1/500 @A4	Date 11/2018	
Drawn By LLB	Checked By AEC	
Project No. 18160	Drawing No. A107	Revision -
Drawing title Proposed Details		

MINIMUM VENTILATION RATES:

- AN INTERNAL AMBIENT AIR TEMPERATURE OF 28 MAX.
- MAX. HUMIDITY LEVELS OF 70%
- DEDICATED MAKE UP AIR SYSTEM TO BE APPROXIMATELY 85% OF THE EXTRACT FLOW RATE
- MIN. AIR CHARGE RATE OF 40 PER HOUR

MINIMUM REQUIREMENTS FOR CANOPY

Velocity Requirements

- LIGHT LOADING - 0.25m/s (APPLIES TO STEAMING OVENS, BOILING PANS, BAINS MARIE AND STOCK-POT SERVERS).
- MEDIUM LOADING - 0.35 m/s (APPLIES TO DEEP FAT FRYERS, BRATT PANS SOLID AND OPEN TOP RANGES AND GRIDDLES).
- HEAVY LOADING - 0.5 m/s (APPLIES TO CHARGRILLS, MESQUITE AND SPECIALIST BROILER UNITS)

Material of Construction

- A MATERIAL THAT WOULD COMPLY WITH THE FOOD HYGIENE REQUIREMENT IS STAINLESS STEEL.

Grease Filtration

- HAVE A MIN. PERFORMANCE THE SAME AS A BAFFLE FILTER
- BE EASY TO CLEAN

MINIMUM REQUIREMENTS FOR DUCT WORK

- ALL DUCTWORK SHOULD BE LOW PRESSURE CLASS A AND CONSTRUCTED IN ACCORDANCE WITH HVCA SPECIFICATION DW/144 WITH A MIN. THICKNESS OF 0.8mm
- DUCT VELOCITIES SHOULD BE AS FOLLOWS:

SUPPLY (m/s)	EXTRACT (m/s)	
MAIN RUNS	6-8	6-9
BRANCH RUNS	4-6	5-7
SPIGOTS	3-5	5-7

- ALL INTERNAL SURFACES OF THE DUCTWORK SHOULD BE ACCESSIBLE FOR CLEANING AND INSPECTION. ACCESS PANELS SHOULD BE INSTALLED AT 3.0m CENTERS AND SHOULD BE GREASE TIGHT USING A HEAT PROOF GASKET OR SEALANT.
- DUCT WORK SHOULD NOT PASS THROUGH FIRE BARRIERS.
- WHERE IT IS NOT POSSIBLE TO IMMEDIATELY DISCHARGE THE CAPTURED AIR, FIRE RATED DUCTWORK MAY BE REQUIRED.

MINIMUM REQUIREMENTS FOR ODOUR CONTROL

OBJECTIVES

- FOR NEW PREMISES OR PREMISES COVERED BY PLANNING CONDITIONS RESTRICTING THE IMPACT OF ODOUR THE SYSTEM SHALL BE DESIGNED TO PREVENT HARM TO AMENITY.
- FOR EXISTING PREMISES NOT COVERED BY PLANNING CONDITIONS RESTRICTING THE IMPACT OF ODOUR, THE SYSTEM SHALL BE DESIGNED TO AVOID STATUTORY NUISANCE AND SHALL COMPLY WITH THE PRINCIPLES OF BEST PRACTICAL MEANS.

TO ACHIEVE THESE OBJECTIVE THE ODOUR CONTROL SYSTEM SHALL INCLUDE AN ADEQUATE LEVEL OF:

- 1.ODOUR CONTROL; AND
- 2.STACK DISPERSION.

THE OVERALL PERFORMANCE OF THE ODOUR ABATEMENT SYSTEM WILL REPRESENT A BALANCE OF 1 AND 2.

DISCHARGE STACK

THE DISCHARGE STACK SHALL:

1. DISCHARGE THE EXTRACTED AIR NOT LESS THAN 1m ABOVE THE ROOF RIDGE OF ANY BUILDING WITHIN 20m OF THE BUILDING HOUSING THE COMMERCIAL KITCHEN.
2. IF 1 CANNOT BE COMPLIED WITH FOR PLANNING REASONS, THEN THE EXTRACTED AIR SHALL BE DISCHARGE NOT LESS THAN 1m ABOVE THE ROOF EAVES OR DORMER WINDOW OF THE BUILDING HOUSING THE COMMERCIAL KITCHEN. ADDITIONAL ODOUR CONTROL MEASURES MAY BE REQUIRED.
3. IF 1 OR 2 CANNOT BE COMPLIED WITH PLANNING REASONS, THEN AN EXCEPTIONALLY HIGH LEVEL ODOUR CONTROL WILL BE REQUIRED.

Minimum requirements for canopy

Velocity requirements

- Light loading – 0.25m/s (applies to steaming ovens, boiling pans, Bains Marie and stock-pot servers)
- Medium loading – 0.35m/s (applies to deep fat fryers, bratt pans, solid and open top ranges and griddles)
- Size : 3.5mt stainless steel canopy.
- Dimensions : 3500mm x 1000mm x 600mm

Ventilation canopy constructed from 1.00mm thick satin finish stainless steel to comply with the food hygiene requirements. The canopy also constructed with 50mmX25mm perimeter condense channel completed with removable grease collection drawers. Washable baffle filters are included. All joints and seams shall be liquid tight. The canopy should be cleaned on a weekly basis.

Fan Specifications

- Mega Box centrifugal fan (Please see attached manufacturer's technical data sheets page 1,678,169)
- Acoustically insulated high performance centrifugal fan.
- Swing out ventilation unit for easy cleaning and maintenance.
- Speed controllable IEC flange mounted motor out of the air stream with thermal overload protection.
- High total efficiency, small energy consumption and low sound levels using high performance-centrifugal
- Low cost speed control.
- E Exe II ZG according to 94/9 EG
- 1 x Helios GBW500/6 1 phase, 1, 230 V, 50hz, capacitor motor, maintenance free external rotor motor in protection to IP54 (see manufacturer's brochure extracts).
- Speed : Min³ 880 r.p.m
- Sound Level : 35dB(A) at 4mt.
- Air flow rate : 5760m³/h
- Efflux velocity : 7m/s

The fan motor will be located inside of the building.

ODOUR ARRESTMENT PLANT PERFORMANCE

LOW TO MEDIUM LEVEL CONTROL MAY INCLUDE:

1. FINE FILTRATION OR ESP FOLLOWED BY CARBON FILTRATION (CARBON FILTERS RATED WITH A 0.1 SECOND RESIDENCE TIME).
2. FINE FILTRATION FOLLOWED BY COUNTERACTANT/NEUTRALIZING SYSTEM TO ACHIEVE THE SAME LEVEL OF CONTROL AS 1.

HIGH LEVEL ODOUR CONTROL MAY INCLUDE:

1. FINE FILTRATION OR ESP FOLLOWED BY CARBON FILTRATION (CARBON FILTERS RATED WITH A 0.2-0.4 SECOND RESIDENCE TIME)
2. FINE FILTRATION OR ESP FOLLOWED BY UV OZONE SYSTEM TO ACHIEVE THE SAME LEVEL OF CONTROLS AS 1.

VERY HIGH LEVEL ODOUR CONTROL MAY INCLUDE:

1. FINE FILTRATION OR ESP FOLLOWED BY CARBON FILTRATION (CARBON FILTERS RATED WITH A 0.4-0.8 SECOND RESIDENCE TIME)
2. FINE FILTRATION OR ESP FOLLOWED BY CARBON FILTRATION AND BY COUNTERACTANT/NEUTRALISING SYSTEM TO ACHIEVE THE SAME LEVEL OF CONTROL AS 1.
3. FINE FILTRATION OR ESP FOLLOWED BY UV OZONE SYSTEM TO ACHIEVE THE SAME LEVEL OF CONTROL AS 1.
4. FINE FILTRATION OR ESP FOLLOWED BY WET SCRUBBING TO ACHIEVE THE SAME LEVEL OF CONTROL AS 1.

MAINTENANCE MUST BE CARRIED OUT TO ENSURE THESE PERFORMANCE LEVELS ARE ALWAYS ACHIEVED.

MINIMUM REQUIREMENTS FOR FANS

FANS MUST BE CAPABLE OF DEALING WITH THE OPERATING STATIC PRESSURE WITHIN THE DUCT WORK SHOULD BE DESIGNED WITH A MIN. 10% PRESSURE MARGIN (NOTE OPERATING STATIC PRESSURE WILL INCREASE THROUGHOUT A MAINTENANCE CYCLE).

BACKWARD CURVED CENTRIFUGAL, MIXED FLOW OR AXIAL FLOW IMPELLERS ARE PREFERRED AS THEY ARE LESS PRONE TO IMBALANCE AND ARE MORE EASILY MAINTAINED/CLEANED DUE TO THEIR OPEN CONSTRUCTION. FIXED OR ADJUSTABLE METAL IMPELLERS WITH A ROBUST AND OPEN CONSTRUCTION SHOULD BE USED.

FAN MOTORS SHOULD BE RATED TO IP55 WITH NO NEED TO MOUNT THE MOTOR OUTSIDE OF THE AIR STREAM. FOR FANS THAT HAVE MOTORS WITHIN THE AIR STREAM AND ARE VENTILATING COOKING EQUIPMENT THAT PRODUCE HIGH LEVELS OF TEMPERATURE AND HUMIDITY THE SPECIFICATION FOR THE MOTOR SHOULD BE UPGRADE TO WITHSTAND MORE ONEROUS CONDITIONS

MINIMUM REQUIREMENTS FOR NOISE CONTROL

FOR NEW PREMISES OR PREMISES COVERED BY PLANNING CONDITIONS RESTRICTING THE IMPACT OF NOISE THE SYSTEM SHALL BE DESIGNED TO PREVENT AN ACOUSTIC IMPACT ON EXTERNAL ENVIRONMENT AND THEREFORE HARM TO THE AMENITY, AS WELL AS ENSURING THAT NOISE EXPOSURE OF KITCHEN STAFF DOES NOT CONSTITUTE A HEARING HAZARD.

FOR EXISTING PREMISES NOT COVERED BY PLANNING CONDITIONS RESTRICTING THE IMPACT OF NOISE THE SYSTEM SHALL BE DESIGNED TO AVOID STATUTORY NUISANCE AND SHALL BE COMPLY WITH THE PRINCIPLES OF "BEST PRACTICABLE MEANS".

TO ACHIEVE THESE OBJECTIVES THE NOISE CONTROL SYSTEM SHALL INCLUDE:

- CONTROL OF NOISE AT SOURCE TO THE GREATEST EXTENT POSSIBLE (WITH THE ADDED BENEFIT OF HEARING PROTECTION); AND
- CONTROL OF NOISE TO THE ENVIRONMENT BY TAKING ACOUSTIC CONSIDERATION INTO ACCOUNT WITHIN DUCT, GRILLE AND TERMINATION DESIGN.

THE CONTROL SYSTEM SHOULD MEET THE REQUIREMENTS LAID DOWN IN BS4142: 1997 "METHOD FOR RATING INDUSTRIAL NOISE AFFECTING MIXED RESIDENTIAL AND INDUSTRIAL AREAS"

Ductwork and Discharge Capture Velocity & Noise Control:

Extract air flow rate= 1.92m³/velocity 7m/s (Recommended)
(Extraction canopy 3.5x1.0x4=1.4+10 margin=1.54m³/velocity @7m/s – heavy loading under DW172)
Supply Air Flow rate=80%*1.23m³/velocity@7 m/s (Recommended)
Capture Velocity: 0.15mt/sec face velocity
The galvanised steel external approximately size 400mm x 400mm rectangle exhaust flue to go at the back of the building 2mt from the exiting point of the internal duct work and 1mt above roof eaves reducing at the discharge point to 350mm x x350mm.

The extract will be taken through the rear light well and will discharge 6 m away from any window and 1m above the level of the roof. It will not be visible from the street.

The ductwork after the canopy, the electrostatic air filter+odour neutraliser+electrostatic precipitator+centrifugal fan will be fitted the inside of the building to minimise the noise level and provide conformity to existing environment. As stated above, the Helios GBW500/6 centrifugal fan motor has technical sound level specification given 35dB(A) at 4mt. Therefore, noise level expected lower than

* The (A3) use kitchen will operate during trade hours only. Food orders to be taken until 18:30, last serving until 18:45, kitchen cleaning up until 19:00. The management will ensure no noise nuisance will be generated during the operational hours to not effect neighbouring residents.

- Ventilation equipment is to be designed and installed to avoid noise and vibration nuisance affecting neighbours. The fan and motor will be sited inside the building and fixed on anti-vibration mounts, joined to ductwork using flexible couplings preventing the transmission of vibrations either to the structure or long the ducting and minimising outdoor noise.
- The extract ducting will be rigid construction and installed with anti-vibration mountings. Bracing may be added to prevent drumming.
- Ducting size to a efflux velocity of 7 m/s to maximum 15 m/s so that he air runs slow and does not make a noise.
- Duct cleaning and anti-vibe check to be carried out every 6 months.
- The recommended cleaning period for extract ductwork is:
 - Heavy use 12-16 hours per day 3 monthly
 - Moderate use 6-12 hours per day 6 monthly
 - Light use 2-6 hours per day annually
- The duct work should receive a full deep clean every 6 months after installations and every 9 months thereafter should be cleaned by the professional and approved cleaning companies to maintain the maximum efficiency of the extraction system.

MINIMUM REQUIREMENTS FOR FIRE SUPPRESSION

PROPRIETORS OF COMMERCIAL KITCHEN ARE UNDER A DUTY TO ENSURE THAT THE FIRE PRECAUTIONS MEET THE REQUIREMENT OF THE "FIRE PRECAUTIONS (WORKPLACE) REGULATIONS 1997"

MAINTENANCE

PROPRIETORS OF COMMERCIAL KITCHENS HAVE A DUTY TO ENSURE THAT THE VENTILATION SYSTEM SERVING THE RESPECTIVE PREMISES ARE MAINTAINED AND OPERATED EFFECTIVELY. GOOD MAINTENANCE IS A PREREQUISITE FOR ENSURING THAT A SYSTEM COMPLIES WITH BEST PRACTICABLE MEANS UNDER STATUTORY NUISANCE PROVISION AND WILL FC A KEY ELEMENT OF ANY SCHEME DESIGNED TO MINIMIZE HARM THE AMENITY UNDER PLANNING REGULATION. GOOD MAINTENANCE IS REQUIRED BY THE FOOD HYGIENE REGULATIONS AND WILL ALSO MINIMIZE THE RISK OF FIRE. THE RECOMMENDED CLEANING PERIOD FOR EXTRACT DUCTWORK IS:

HEAVY USE	12-16 HOURS PER DAY	3 MONTHLY
MODERATE USE	6-12 HOURS PER DAY	6 MONTHLY
LIGHT USE	2-6 HOURS PER DAY	ANNUALLY

RECOMMENDATIONS FOR MAINTENANCE OF ODOUR CONTROL SYSTEM INCLUDE:

- SYSTEM EMPLOYING FINE FILTRATION AND CARBON FILTRATION CHANGE FINE FILTERS EVERY TWO WEEKS.
- CHANGE CARBON FILTERS EVERY 4 TO 6 MONTHS.
- USE A SYSTEM EMPLOYING ESP AND OTHER IN LINE ABATEMENT

CLEAN EVERY 2-6 MONTHS.

the types of problems encountered by council officers when dealing with odour and noise situations, a summary of this information gathering exercise is given in annex a. responses were received from metropolitan and rural authorities, authorities from england, northern ireland, scotland and wales have been consulted

Ventilation systems are used;
linear extract method: each linear meter of active filter length is assigned a vent rate depending on the vent canopy type.
Recommended canopy type:

Source of Noise	How/Why Noise Arises
Extract/supply fan	Fan motor noise, Fan impeller turning

The dimensions of a canopy are dictated by the size of the catering equipment that it is serving, the two criteria that have the most influence on the amount of air required for effective ventilation are the plan dimensions and height, unless restricted by walls etc., the plan dimensions of the canopy should always exceed the plan dimensions of the catering equipment by a minimum of 200mm on each free side and by 300mm at the front and rear, dimensions at the side may need to be increased where high output equipment is located at the end of the cooking line-up.

Where combination steamer and certain types of baking ovens are used, the overhang at the front should be 600mm to cope with steam or fumes that arise when the doors of the appliance are opened.

Canopy type	Light duty	Medium duty	Heavy duty	Extra heavy duty
Wall mounted	0.23-0.31 (m3/s)	0.31-0.46(m/s)	0.31-0.62 (m/s)	>0.54 (m/s)

The height of the canopy is governed by the height of the ceiling and the underside of the canopy should be located between 2000 and 2100 mm above the finished floor level, the efficiency of canopies less than 400mm high are less than normal because the collection volume is reduced, in these situations, the face velocity may need to be increased to 0.5m/s to compensate, where the ideal flow rate cannot be achieved the size of the canopy may be increased to aid capture, the ideal distance between the lowest edge of the grease filter and the top of the cooking surface should be between 450mm to 1350mm, this is to avoid the risk of excessive temperatures or fire in the filter that could cause the extracted grease to

vaporise and pass through to the ductwork, this dimension will vary with the type of cooking appliance and can be reduced where fire suppression equipment is installed, but should never be below 1350mm where mesh filters are installed.

types of system are available:

cassette system: is an integrated system incorporating partitioned or dedicated extract and partitioned or dedicated supply, the systems are modular and contain a number of cassettes of proprietary design, which filter and separate grease from the air prior to its exhaust, the grease is normally collected in a non-drip integral or perimeter trough for removal and cleaning.

materials of construction of canopy:

the food safety (general food hygiene) regulations[20] requires that in food preparation areas:

'ceilings and overhead fixtures must be designed, constructed and finished to prevent the accumulation of dirt and reduce condensation, the growth of undesirable moulds and the shedding of particles.' in relation to canopies, it is best practice to use stainless steel especially if the relevant surface comes directly into contact with food, typically canopies and other overhead fixtures are fabricated using ultra fine-grained stainless steel (grade 304), higher grades of stainless steel may also be specified.

Other best practice guidelines include:

where air must be equalised within a supply plenum of a canopy 0.8 mm perforated stainless steel sheet should be used, in addition, care should be taken to ensure that the face velocity is about 0.7 m/s, noise generation increases when velocities of 0.9 m/s are exceeded.

- discharge grills on make-up air system should be fabricated with 1mm perforated stainless steel sheet.
- condensation should be avoided in canopies that are provided with supply plenum, where insulation is used it should:
- be a rigid foil faced non fibrous slab, with a class 1 spread of flame; and
- not be fibre based as this could contaminate food.

Fan;

kitchen ventilation systems often have relatively high resistance against which a fan has to operate, therefore, fans need to be sized to cope with a design pressure of a minimum additional 10% pressure margin, care must be taken:

- to ensure operational changes e.g. build up of dirt on mesh filters are taken into account; and
- if changes are made to the ventilation system that may alter the operating pressure.

to overcome such changes variable speed control or balancing dampers may be used, a range of impeller designs is available as follows:

- backward curved centrifugal, mixed flow or axial flow impellers are preferred as they are less prone to imbalance and are easier to clean and maintain due to their open construction.
- fixed or adjustable metal impellers are recommended.
- lightweight multi-vane or plastic-type impellers can warp and are prone to collecting grease, although plastic bladed fans can be used in non-grease, low temperature situation.

the fan must be able to operate at between 40% and 60% at 95% relative humidity, motors should be rated to ip55, where fan motors sit within warm moist air streams, they should be upgraded to withstand more onerous conditions, to avoid excessive temperature build-up, temperature detectors should be fitted.

drain holes should be provided at the lowest point in the fan housing to remove condensation, care needs to be taken to ensure that the drain hole does not downgrade the index of protection (ip) of the motor.

dual or variable speed regulation are widely used, the fan must always operate at its design duty, especially when grease is being produced, a minimum extract level should be set within the speed regulator to ensure that, even at low speed, an adequate rate of ventilation is maintained, speed regulation should be applied to both make-up air and extraction air, speed regulation cannot be employed with water wash/cartridge systems as flow rates are fixed.

make-up and extract fan operation should be interlocked with gas supply, so that gas supply is switched off if the fans fail, fans should be isolated when fire a suppression system is activated.

the connection between ductwork and fan housing should be suitable for use in grease-laden atmospheres and at duct temperature, joints must be clamped or bonded to prevent air leakage, under fire conditions the material should have a minimum integrity of at least 15 minutes.

Fan type	Advantages	Disadvantages
Roof Extract Fans (Vertical Jet Discharge with Centrifugal Impellers)	Good temp range when motor is outside of air stream Easy removal for cleaning and maintenance No space restrictions Good external appearance No discharge ductwork required	Temperature limitations, but suitable for kitchen use. Requires good roof access for maintenance More expensive than inline/axial models

Coarse or Grease filtration

Filter type	Recommended Face Velocity (m/s)	Typical Efficiency	Advantages	Disadvantages
Cartridge	4.5-5.5 (at entry)	90-95%	Higher efficiency Non-overloading pressure drop	High pressure drop Special plenum fabrication required

series of baffles which cause air to change direction four times compared to only twice in a conventional baffle filter. The cartridge filters are installed over the full length of the extract plenum and should be sloped to allow trapped grease to fall through a drain to a grease drawer. These filters are intended for heavy grease loads. Having a higher velocity enables lower air volumes to be used. Air balancing is required to prevent carry over of grease.

Fine filtration:

A basic filtration system can be used to deal with a low intensity odour problem, but more usually will form a protective pre-treatment step before an activated carbon step.

Recommendations for maintenance of odour control system

For a system employing fine filtration and carbon filtration:

- Change fine filters every two weeks
 - Change carbon filters every 4 to 6 months
- For a system employing ESP and other in line abatement systems:
- Clean every 2-6 months

Noise reduction methods for various noise sources and transmission paths;

Reflected sound from walls, ceiling, and walk, Direct sound can be controlled only by selecting quiet equipment. Reflected sound is controlled by adding sound absorption to room and to location of equipment.

Noise reduction methods for various noise sources and transmission paths

Description	Noise reduction method
Direct sound radiated from sound source to ear. Reflected sound from walls, ceiling, and walls.	Direct sound can be controlled only by selecting quiet equipment. Reflected sound is controlled by adding sound absorption to room and to location of equipment.

Stack

Inadequate height of the discharge stack is one of the main reasons the emissions from a kitchen gives rise to odour nuisance. The stack design is paramount to achieving good dispersion. Good stack dispersion requires:

- The effective stack height (discharge height plus plume rise) must be high enough to ensure that adequate dilution takes place before the plume interacts with a receptor.
- Discharge velocity influences the plume rise and therefore the effective stack height. The effective stack height can be estimated from:

$$\Delta H = 3W \cdot d / U$$

where,

W (m/s) is the efflux speed at the chimney top

U (m/s) is the wind speed at the height of the stack

d (m) is the internal diameter of the stack

Ideally W/U should be greater than 4. If W/U is less than 1.5, then down wash will occur resulting in a reduced effective stack height.

- The discharge to be outside the wake of nearby buildings. Discharging ventilation air below a roof ridge may result in excessive entrainment within building down wash. In certain situations, the use of high velocity discharge systems can force the discharging plume out of the building wake.

• The flow to be unimpeded. Cows can increase the static pressure, noise, potential down draught and risk of re-entry of the exhaust back into the building. Alternative stack terminals are available and include:

- terminals without integral drains e.g. reducing cone, solid top cones; and
- terminals with integral drains e.g. open top cone and drain, induction types and sleeve type.

• Straight and vertical discharge.

Figure 4.5 shows examples of best stack design.

Guidance on stack requirements for commercial kitchens varies between Local Authorities. The range of guidance issued by Local Authorities is summarised below:

- Guidance on the minimum stack height ranges from:
 - 1 m above the eaves of the premises and/or above any dormer window;
 - 1 m above ridge height of any building within 15 m; and
 - low level discharge should be avoided.
 - The height of external ground level should be taken into account when setting stack height. This is particularly important on rising ground where houses may be located above the discharge.
 - A stack should be positioned to be as far as possible from the nearest residential accommodation.
 - A stack discharging into a semi-enclosed area such as a courtyard or the area between back additions should be avoided.
 - Use of Chinaman's hats or other cowls is not recommended.
 - The prevailing wind direction should also be considered in the ducting positioning.
 - The ducting should be rigid in construction and resiliently mounted.
 - Large section ducts may need bracing or stiffeners to prevent drumming.
- In certain instances restriction on stack height might arise, for example:
- Where an A3 premises is a listed building and a visible stack is prohibited;
 - Where an A3 premises is located within a conservation area and a visible stack is prohibited; and
 - Operators of the A3 premises do not have legal right to attach a stack to upper floors of building.

Standard Mesh Type Grease Filters.

- Size: 620mm X 495mm.
- Grease filters check and wash weekly.

Food processing and odour characteristics

-The operator's food processing is primarily for freshly prepared, fried and baked produce with light grilling.

-The odour and grease characteristics rising from operator's food processing would qualify as moderate concentration.

-The standard kitchen will consist of two ovens, two chip fryers and one flat grill the moisture load and grease/smoke content for these cooking types qualifies as medium.

Kitchen extraction system

It is proposed that the kitchen with extraction system will be located at the ground floor at the rear left. The proposal is to vent extract to the roof level and discharge the extracted 1 meter above roof eaves. The proposed system will meet noise criteria (35dB(A)) set in the council's guidance which indicate that levels at nearby noise sensitive receivers should be limited 47 dB(A).

Minimum ventilation rates

An internal ambient air temperature of 28° max.

Max.humidity levels of 70%

Dedicated make up air system to be approximately 85% of the extract flow rate.

Min.air charge rate of 40 per hour.

Canopy Hood Details

Minimum requirements for canopy

Velocity requirements

Light loading – 0.25m/s (applies to steaming ovens, boiling pans, Bains Marie and stock-pot servers)

Medium loading – 0.35m/s (applies to deep fat fryers, bratt pans, solid and open top ranges and griddles)

- Size : 3.5mt stainless steel canopy.

- Dimensions : 3500mm x 1000mm x 600mm