



HODKINSON



**Energy Statement
BREEAM Strategy**

Designated Contractors Ltd

**65-69 Holmes Road
Proposed Mezzanine
Level, Camden**

Final

Georgios Koronaios
Dip Arch, MSc, MCIBSE, CEng

March 2019

DOCUMENT CONTROL RECORD

REPORT STATUS: FINAL

Version	Date	Reason for issue	Author	Checked by	Approved for Issue by Project Manager
v.1	27.02.2019	Draft	G. Koronaios	N. Doshi	Z. Watkins
v.2	28.02.2019	Final	G. Koronaios	N. Doshi and K.Hodson	Z. Watkins
v.2.1	06.03.2019	Final	G. Koronaios	N. Doshi	Z. Watkins

ABOUT HODKINSON CONSULTANCY

Our team of technical specialists offer advanced levels of expertise and experience to our clients. We have a wide experience of the construction and development industry and tailor teams to suit each individual project.

We are able to advise at all stages of projects from planning applications to handover.

Our emphasis is to provide innovative and cost effective solutions that respond to increasing demands for quality and construction efficiency.

This report has been prepared by Hodkinson Consultancy using all reasonable skill, care and diligence and using evidence supplied by the design team, client and where relevant through desktop research.

Hodkinson Consultancy can accept no responsibility for misinformation or inaccurate information supplied by any third party as part of this assessment.

This report may not be copied or reproduced in whole or in part for any purpose, without the agreed permission of Hodkinson Consultancy of Harrow, London.

Executive Summary

The purpose of this Energy Statement and BREEAM Strategy is to demonstrate that the proposed addition of a mezzanine floor in the lower-basement level of the consented development at 65-69 Holmes Road by Designated Contractors Ltd, in the London Borough of Camden is considered sustainable, as measured against relevant local, regional and national planning policies. The Energy Strategy has been formulated following the London Plan Energy Hierarchy: **Be Lean, Be Clean** and **Be Green**.

The proposed addition will comprise approximately 620m² of study, social and admin areas. This Energy Statement and BREEAM strategy is to support the separate full application for the formation of a mezzanine floor, in the 65-69 Holmes Road student accommodation building.

The building has been registered under BREEAM New Construction 2014 (BREEAM-0062-3645) and achieved design stage certification on 26th September 2017. The 620m² of floor space will be included within the existing assessment and changes will be picked up during the Post Construction assessment.

The mezzanine proposal as a stand-alone application does not exceed the threshold of a 1000m² and as such it forms a minor application. Therefore, it will seek to achieve **compliance** with the **Part L 2013 baseline**. However, the mezzanine level will form part of the whole 65-69 Holmes Road student accommodation building which has been designed and constructed to achieve a 25% carbon dioxide reduction under Part L 2010. As such, the proposed mezzanine is expected to be built under Part L 2010 Building Regulations. Under these circumstances, it is reasonable for this statement to aim towards maximising the carbon reductions, in order to ensure that the 25% of the whole building under Part L 2010 will not be jeopardized.

A range of energy efficiency (**Be Lean**) measures are proposed to enable the mezzanine addition to meet Part L 2013 Target Emissions Rate (TER). This represents a good level of sustainable design and construction and indicates the Applicant's commitment to reducing energy demands of the proposed added level. The combination of energy efficiency measures will achieve compliance with the calculated Part L (2013) baseline.

In line with the London Plan, the feasibility of decentralised energy production as a **Be Clean** measure has been carefully examined. This strategy assumes that the proposed mezzanine floor will connect to the 65-69 Holmes Road wider development's energy centre.

The developer has confirmed that the gas CHP engine of the existing energy centre has been designed to provide **73%** of the heat demand of the site on an annual basis, with the remaining load being served by the communal gas boilers. The combination of energy efficiency measures and the connection of the mezzanine to the existing heat network with the CHP will enable a reduction in Regulated CO₂ emissions of **4.4%** over the Part L (2013) baseline.

The full spectrum of **Be Green** renewable energy sources has been considered. Due to the fact that the proposed mezzanine is situated within the envelope of the existing 65-69 Holmes Road building, there is no physical space for PV. It has been concluded that from the range of renewable technologies, only Air Source

Heat Pumps (ASHPs) can be utilised. The benefit of increasing the Seasonal Coefficient of Performance (SCoP) of the ASHPs for space heating, will provide further reductions and achieve a total carbon dioxide reduction of **4.8%** over Part L (2013) baseline.

The table below summarises the Regulated and Total CO₂ emissions for the development after on-site measures have been applied. A **4.8%** reduction over the Part L (2013) baseline case is predicted.

Summary Table – Site Wide Reduction in CO₂ Emissions		
	Regulated CO₂ (kg/year)	% Regulated CO₂ Saving
Part L (2013) Baseline Case	15,560	-
Emissions after <i>Be Lean</i> Measures	12,560	0.0%
Emissions after <i>Be Clean</i> Measures	14,880	4.4%
Emissions after <i>Be Green</i> Measures	14,820	0.4%
Reduction Achieved over Baseline	740	4.8%

CONTENTS

Executive Summary	2
<hr/>	
1. INTRODUCTION	5
2. DEVELOPMENT OVERVIEW	6
3. RELEVANT PLANNING POLICY	9
4. BREEAM STRATEGY	13
5. BUILDING REGULATIONS (2013) BASELINE	14
Methodology	14
<hr/>	
6. <i>BE LEAN</i> – ENERGY EFFICIENCY	15
CO ₂ Emissions after Energy Efficiency Measures	17
<hr/>	
7. <i>BE CLEAN</i> – HEATING INFRASTRUCTURE	19
Connection to existing District Heating Network	19
CO ₂ Emissions after <i>Be Clean</i> Measures	20
<hr/>	
8. <i>BE GREEN</i> – RENEWABLE ENERGY	21
CO ₂ Emissions after <i>Be Green</i> Measures	23
<hr/>	
9. SUMMARY	24
APPENDICES	26

1. INTRODUCTION

- 1.1** This Energy Statement and BREEAM Strategy has been prepared by Hodkinson Consultancy, a specialist energy and environmental consultancy for planning and development, appointed by Designated Contractors Ltd. This Statement sets out the energy strategy and BREEAM strategy for the mezzanine addition proposed at the lower-basement level of 65-69 Holmes Road in the London Borough of Camden.
- 1.2** The formulation of the energy strategy for the proposed development takes into account several important concerns and priorities. These include:
- > To address all national, regional and local planning policies and requirements applicable to this application;
 - > To achieve the maximum viable reduction in carbon dioxide (CO₂) emissions with an affordable deliverable and technically appropriate strategy;
 - > Provision of high quality, low energy buildings that are adapted to future changes in climate;
 - > To minimise, to the lowest possible extent, emissions of pollutants such as oxides of nitrogen (NO_x) and particulate matter, thereby minimising the effects on local air quality.
- 1.3** This statement first establishes a baseline assessment of the energy demands and associated CO₂ emissions for the development based on the relevant Building Regulations Part L (2013). It will then outline the energy measures that enable this.
- 1.4** The building has been registered under BREEAM New Construction 2014 (BREEAM-0062-3645) and achieved design stage certification on 26th September 2017. The BREEAM Strategy outlines why the proposed floor space will be included within the existing assessment, accounting for any changes in the Post Construction assessment.

2. DEVELOPMENT OVERVIEW

Planning History

- 2.1 In October 2013 the 65-69 Holmes Road development was granted planning permission (2013/7130/P).
- 2.2 The permission regarded the delivery of a part seven, part three-storey building (with 2 basement levels) with 273 units (341 rooms and 439 bed spaces) of student accommodation with ancillary facilities (sui generis), warehouse space and a coffee shop following demolition of the existing building.
- 2.3 After receiving consent, applications for the variation of condition 20 followed.
- 2.4 The latest application that was granted consent (2017/6786/P), regarded changes to the lower basement's, increase in area and volume of the warehouse space and the reduction of ancillary student space (including the gym facility).

Existing development

- 2.5 As per the approved scheme, the building provides 273 units (439 bed spaces) of student accommodation and incorporates a mix of B8 warehouse space and student areas on the ground floor, upper and lower basement.
- 2.6 The current approved scheme has reduced the student area in order to increase the floor space of the warehouse space.
- 2.7 The consented energy strategy for the rest of the building includes energy efficiency measures with enhanced fabric performance, low energy lighting design, low energy mechanical ventilation and the design and operation of an energy centre to cover the heat demand through communal boilers and a CHP engine.
- 2.8 The existing 65-69 Holmes Road student accommodation building has been designed and built to achieve a 25% carbon dioxide reduction over the Part L 2010 baseline.

Site Location

- 2.9 The site is an L-shaped plot of land with an area of 2470m² situated off Holmes Road to the north-west and Cathcart Street to the south-west.
- 2.10 As shown in Figure 1 overleaf, the proposed development site is located at 65-69 Holmes Road, north-west of the Kentish Town West station in the London Borough of Camden.

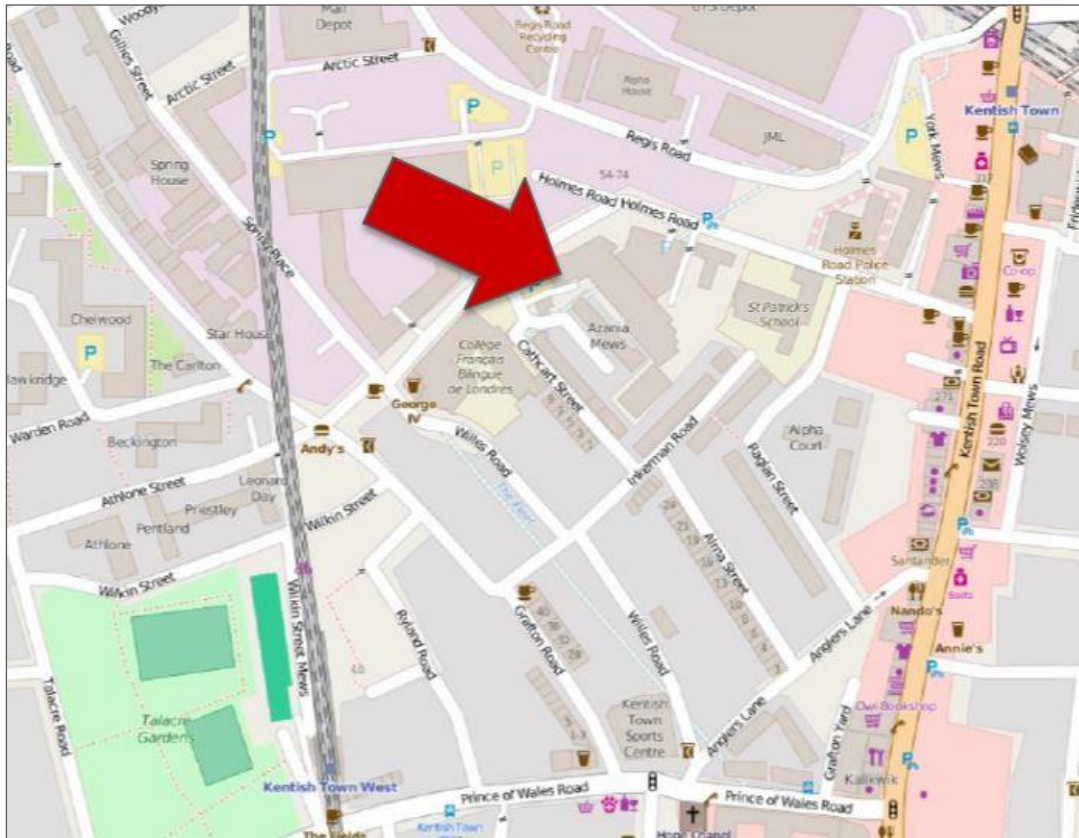


Figure 1: Site Location – © OpenStreetMap Contributors. Go to www.openstreetmap.org/copyright

Development Description

- 2.11 To compensate for the loss in student area, a mezzanine level is proposed to provide 620m² of supporting floor space for study/social and admin use.
- 2.12 The proposed development is described as follows:
“Introduction of 620sqm mezzanine level between lower and upper basement, containing a gym, kitchen, storage, student breakout area, study rooms, meeting rooms and admin offices..
- 2.13 Figure 2 overleaf shows the layout of the proposed additional mezzanine floor.

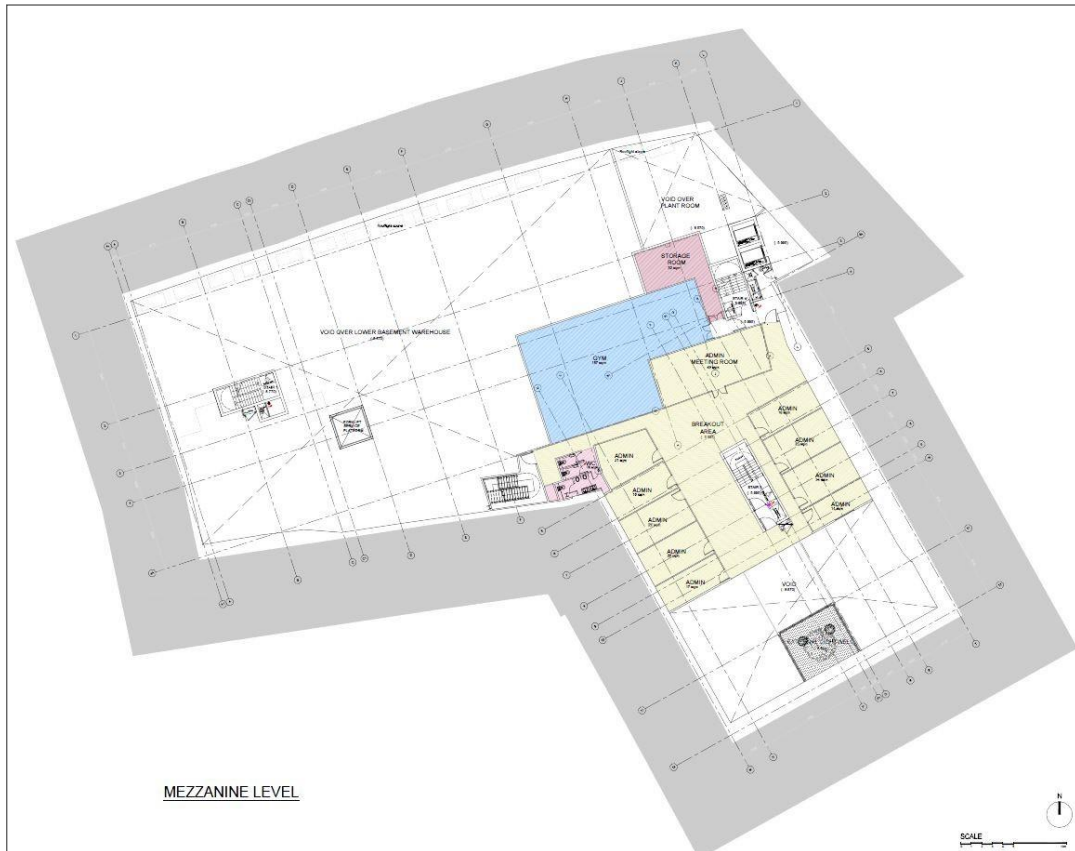


Figure 2: Proposed Mezzanine Floor Plan - Contemporary Design Solution LLP

3. RELEVANT PLANNING POLICY

3.1 The planning policies and requirements in Figure 3 below have informed the sustainable design of the proposed development.

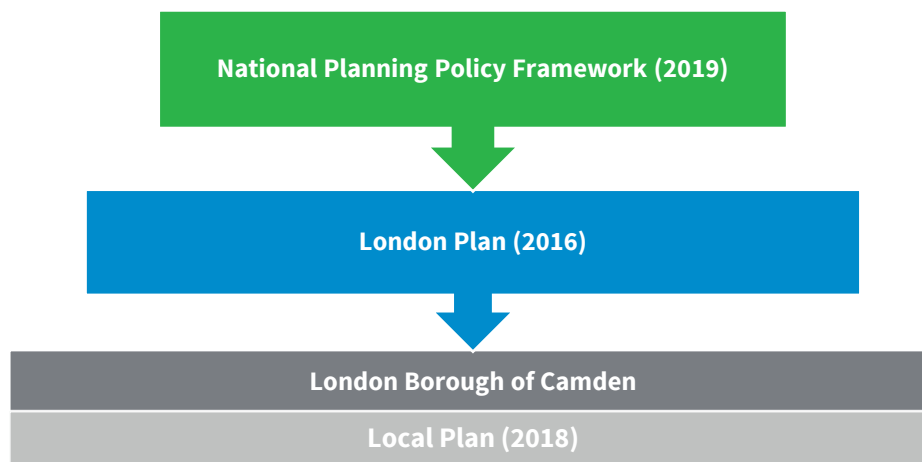


Figure 3: Relevant Planning Policy Documents

National Policy: NPPF

3.2 The revised National Planning Policy Framework (NPPF) was revised on the 19th February 2019 and sets out the Government’s planning policies for England.

3.3 The NPPF provides a framework for achieving sustainable development, which has been summarised as “*meeting the needs of the present without compromising the ability of future generations to meet their own needs*” (Resolution 42/187 of the United National General Assembly). At the heart of the framework is a **presumption in favour of sustainable development**.

3.4 The document states that the planning system has three overarching objectives which are interdependent and need to be pursued in mutually supportive ways:

- a) **An economic objective** – to help build a strong, responsive and competitive economy, by ensuring that sufficient land of the right types is available in the right places and at the right time to support growth, innovation and improved productivity; and by identifying and coordinating the provision of infrastructure;
- b) **A social objective** – to support strong, vibrant and healthy communities, by ensuring that a sufficient number and range of homes can be provided to meet the needs of present and future generations; and by fostering a well-designed and safe built environment, with accessible services and open spaces that reflect current and future needs and support communities’ health, social and cultural well-being; and

- c) **An environmental objective** – to contribute to protecting and enhancing our natural, built and historic environment; including making effective use of land, helping to improve biodiversity, using natural resources prudently, minimising waste and pollution, and mitigating and adapting to climate change, including moving to a low carbon economy.

Regional Policy: The London Plan (2016)

- 3.5 The London Plan sets out an integrated economic, environmental, transport and social framework for the development of London over the next 20 - 25 years.
- 3.6 The following outlines key policies set out in the London Plan which are relevant to the proposed development and this Sustainability Statement.
- 3.7 **Policy 5.2 – Minimising Carbon Dioxide Emissions** requires development proposals to make the fullest contribution to minimising carbon dioxide emissions in accordance with the Energy Hierarchy: *Be Lean, Be Clean and Be Green*. Major developments to achieve a 40% improvement on 2010 Building Regulations. The London Plan Sustainable Design and Construction SPG (2014) updates this target stating that the Mayor will adopt a carbon dioxide improvement target beyond Part L 2013 of 35%.
- 3.8 **Policy 5.3 – Sustainable Design and Construction** states that the highest standards of sustainable design and construction should be achieved in London to improve the environmental performance of new developments. Major development should meet the minimum standards outlined in the London Plan Supplementary Planning Guidance and this should be clearly demonstrated. The standards include sustainable design principles such as minimising CO₂ emissions and avoiding internal overheating.
- 3.9 **Policy 5.5 – Decentralised Energy Networks** states that the Mayor expects 25 per cent of the heat and power used in London to be generated through the use of localised decentralised energy systems by 2025. The Mayor will prioritise the development of decentralised heating and cooling networks at the development and area wide levels, including larger scale heat transmission networks.
- 3.10 **Policy 5.6 – Decentralised Energy** requires that all developments should evaluate the feasibility of Combined Heat and Power (CHP) systems and examine the opportunities to extend the system beyond the site boundary to adjacent sites.
- 3.11 **Policy 5.7 – Renewable Energy** states that within the framework of the energy hierarchy, major development proposals should provide a reduction in expected carbon dioxide emissions through the use of on-site renewable energy generation, where feasible.
- 3.12 **Policy 5.8 – Innovative Energy Technologies** encourages the more widespread use of innovative energy technologies to reduce use of fossil fuels and carbon dioxide emissions.

- 3.13 Policy 5.9 – Overheating and Cooling** seeks to reduce the impact of the urban heat island effect, reduce potential overheating and reduce reliance on air conditioning systems in line with the cooling hierarchy.

Sustainable Design and Construction Supplementary Planning Guidance (2014)

- 3.14** The London Plan Sustainable Design and Construction SPG was adopted in April 2014 and provides detail and best practice guidance on how to implement the sustainable design and construction and wider environmental sustainability London Plan policies.
- 3.15** The SPG provides guidance on topics such as energy efficient design; meeting carbon dioxide reduction targets; decentralised energy; how to off-set carbon dioxide where the targets set out in the London Plan are not met; retro-fitting measures; monitoring energy use during occupation; air quality; resilience to flooding; urban greening; pollution control; basements and local food growing.

Local Policy: London Borough of Camden

- 3.16** The London Borough of Camden’s Local Plan document was adopted in July 2017. The following policies are considered relevant to this Statement:
- 3.17 Policy CC1: Climate Change Mitigation** – The Council will require all development to minimise the effects of climate change and encourage all developments to meet the highest feasible environmental standards that are financially viable during construction and occupation. The Council will:
- > Require all developments to reduce carbon dioxide emissions through following the steps in the energy hierarchy;
 - > The Council will expect developments of five or more dwellings and/or more than 500 sqm of any gross internal floor space to achieve a 20% reduction in carbon dioxide emissions from on-site renewable energy generation (which can include sources of site related decentralised renewable energy), unless it can be demonstrated that such provision is not feasible. The 20% reduction should be calculated from the regulated CO₂ emissions of the development after all proposed energy efficiency measures and any CO₂ reduction from non-renewable decentralised energy (e.g. CHP) have been incorporated;
 - > Support and encourage sensitive energy efficiency improvements to existing buildings.
- 3.18 Policy CC2: Adapting to Climate Change** – All development should adopt appropriate climate change adaption measures such as:

- > Measures to reduce the impact of urban and dwelling overheating, including application of the cooling hierarchy.
 - > The Council will promote and measure sustainable design and construction by:
 - > Ensuring development schemes demonstrate how adaptation measures and sustainable development principles have been incorporated into the design and proposed implementation;
 - > Expecting non-domestic developments of 500 sqm of floorspace of above to achieve ‘Excellent’ in BREEAM assessments and encouraging zero carbon in new development from 2019.
- 3.19** As part of the built 65-69 Holmes Road student accommodation, the mezzanine floor will form part of the ongoing BREEAM assessment (registration number: BREEAM-0062-3645).
- 3.20** The existing building has targeted and achieved a BREEAM Design Stage rating of ‘Very Good’ to comply with Clause 2.35 in the S106 for the original application:
- “Building Research Establishment Environmental Assessment Method 2008 multi-residential assessment of the Student Accommodation obtaining at least a Very Good or Excellent or Outstanding rating and attaining at least 60% of the credits in each of Energy and Water and 40% of the credits in Materials categories to be carried out by a recognised independent verification body in respect of the Property”*
- 3.21** As a ‘Very Good rating’ has been achieved, in accordance with the original S106, ‘Excellent’ is not applicable.

Summary of Targets

- 3.22** The development is subject the following targets:
- > Hierarchy of **Be Lean, Be Clean, Be Green** to be followed to achieve **compliance** with the **Part L (2013) baseline**;
 - > 20% reduction in carbon dioxide emissions from on-site renewable energy generation on the **Be Green** step.
 - > **BREEAM Very Good** rating targeted with 60% of BREEAM credits in each of Energy and Water and 40% of the credits in Materials categories to be achieved.

4. BREEAM STRATEGY

- 4.1 In accordance with the original S106 (Clause 2.35) and Policy CC2 of Camden Local Plan, the building is being assessed under the BREEAM Methodology.
- 4.2 The building has been registered under BREEAM New Construction 2014 (BREEAM-0062-3645) and achieved design stage certification on 26th September 2017.
- 4.3 The 620m² of floor space that is proposed will be for study/social and admin use and as such, will be included within the existing assessment and changes will be picked up during the Post Construction assessment.
- 4.4 The BREEAM credits that would be applicable to the proposed floorspace will be:
- > **Life cycle impacts (Mat 01)** – The same materials and finishes will be used for the proposed floorspace so the same Green Guide ratings will apply.
 - > **Responsible sourcing of materials (Mat 03)** – The same manufacturers will be used for the proposed floorspace so the same responsible sourcing certification will apply.
 - > **Reduction of energy use and carbon emissions (Ene 01)** – The proposed floorspace will be included in an updated energy model, the results of which will be included in the Post Construction assessment.
 - > **Energy monitoring (Ene 02)** – The proposed floorspace will connect to the BMS that has been specified, which meets the requirements of BREEAM.
 - > **Water consumption (Wat 01)** – The flush volumes and flow rates of the sanitaryware to be installed will be the same as those already installed, as a result the Wat 01 calculator tool will not change.
- 4.5 It is therefore deemed applicable for the new proposed floor to be included as part of the ongoing BREEAM assessment (registration number: BREEAM-0062-3645).

5. BUILDING REGULATIONS (2013) BASELINE

Methodology

- 5.1 This statement first establishes a baseline assessment of the energy demands and associated CO₂ emissions for the proposed mezzanine based on the Part L (2013) Building Regulations baseline case.
- 5.2 The report will then follow the London Plan Energy Hierarchy approach of **Be Lean, Be Clean and Be Green** to enable the maximum viable reductions in Regulated and Total CO₂ emissions over the calculated baseline.
- 5.3 The estimated annual CO₂ emissions have been calculated using Simplified Building Energy Model (SBEM) methodology.
- 5.4 Table 1 shows the Regulated baseline CO₂ emissions per year. The calculations summary sheet is presented in **Appendix A** and the supporting BRUKL sheets are presented in **Appendices B-D**.

Table 1: Part L (2013) Baseline Emissions

Building Regulations Baseline Part L (2013) - Regulated and Total CO₂	
	Regulated CO₂ (kg/year)
Total CO₂ emissions	15,560

6. **BE LEAN – ENERGY EFFICIENCY**

Existing Building - Restrictions

- 6.1 The proposed mezzanine level will be situated within the existing building of the 65-69 Holmes Road development.
- 6.2 The thermal envelope is considered part of the existing consented scheme. As a result this has not been altered for this application. The envelope however is energy efficient.
- 6.3 However, the fabric and air permeability details of the existing building will affect the heating and cooling demands of the mezzanine floor.
- 6.4 As these elements are fixed to the existing building, this limits the improvement potential, and limits the energy efficiency section solely on building services.
- 6.5 The following fabric and air-tightness details apply to the existing building:

Existing Building's Insulation Standards

- 6.6 The existing building incorporates enhanced insulation in the building envelope (walls, roofs, floors and glazing) to achieve average U-values better than those required by Part L (2010) Building Regulations. There are likely to include:
 - > External wall U-value of 0.22 W/m².K;
 - > Flat roof U-value of 0.15 W/m².K;
 - > Ground floor U-value of 0.15 W/m².K;
 - > Double glazing with a U-value of 1.5 W/m².K and a g-value of <0.22;

Air Tightness

- 6.7 An air permeability of 7.0 m³/hr/m² has been targeted for the existing building, which is a good and at the same time realistic target for this type of building.

Energy Efficiency Measures

- 6.8 As mentioned above, there is very limited scope for fabric performance improvements due to the existing envelope of 65-69 Holmes Road.
- 6.9 This leaves space only for highly efficient building services, to reduce energy consumption and consequently maximise carbon dioxide reductions at the **Be Lean** step.
- 6.10 It is therefore the Applicant's intention to focus on energy efficiency measures and minimise the end-use energy consumption associated with heating, cooling, hot water, ventilation and lighting.
- 6.11 The following energy efficiency measures have been proposed for the mezzanine floor:

Ventilation

- 6.12 It is proposed that for the student and admin areas, ventilation will be provided by an Air Handling Unit (AHU) that will incorporate mechanical supply and extract ventilation with a Specific Fan Power (SFP) of <math><1.9 \text{ W/l/s}</math> and a Heat Recovery efficiency of 85%.
- 6.13 It is envisaged that the kitchen area will be served by a separate AHU with a supply SFP of <math><0.9 \text{ W/l/s}</math> and an extract SFP of <math><0.6 \text{ W/l/s}</math>.
- 6.14 Toilet and storage areas are envisaged to be served by extract fans only with an SFP of <math><0.3 \text{ W/l/s}</math>.

Lighting

- 6.15 The major energy demand within modern commercial spaces is generally lighting. Specified lighting in these areas is envisaged to be LED (likely to require >95 lumens/circuit watt and a light output ratio of 1).
- 6.16 Demand reducing lighting controls such as occupancy sensors for zones with transient occupancy (parasitic power of <math><0.1 \text{ W/m}^2</math>) would be beneficial, as they would allow light output to be automatically adjusted to suit prevailing conditions.
- 6.17 Photoelectric daylight controls would not be appropriate for this application as there are no windows to enable natural daylight to enter into the space.

Limiting the Risk of Summer Overheating

- 6.18 Due to the fact that the proposed mezzanine does not have openings that allow for solar gains, the SBEM software does not provide outputs on solar-gains exceedance risk.
- 6.19 However, due to the proposed uses of study areas, gym and admin space, that are associated with high occupancies and high internal gains, significant heat build-up is most likely to be occurring.

6.20 The absence of windows does not allow for natural ventilation, and mechanical ventilation is only limited to providing fresh air and not adequate cooling.

6.21 Therefore, it is expected that mechanical cooling will be required.

Space Heating and Cooling

6.22 As previously mentioned, it is expected that there will be a considerable cooling demand.

6.23 It is envisaged that the cooling demand will be addressed by ASHPs.

6.24 Due to the cooling provision, it is reasonable that any heating requirements of these spaces will be addressed by the ASHPs as well.

6.25 ASHPs are a renewable technology and therefore some of the benefit is to be realised in the **Be Green** section of this report.

6.26 Heat pumps which achieve the standard SBEM SCoP value of **2.5** have been used to calculate the associated emissions at the **Be Lean** stage of this assessment.

6.27 The cooling performance standard for the heat pumps require an Energy Efficiency Ratio (EER) and a Seasonal Energy Efficiency Ratio (SEER) of 6 and 7.5 respectively.

6.28 Table 2 below shows the cooling demand calculated using the SBEM software.

Table 2: Cooling Demand - Area Weighted

Cooling Demand (MJ/m ²)	
Actual	127.99
Notional	161.63

Hot Water

6.29 For the **Be Lean** case, a gas boiler covering 100% of the hot water demand has been used, targeting an efficiency of >95%.

CO₂ Emissions after Energy Efficiency Measures

6.30 Table 3 overleaf describes the energy demand for the development, based on the Building Regulations methodology.

Table 3: Energy Demand for Development after Demand Reduction Measures

Energy Demand for Site by Building Use	
Energy demand use	Site-wide
	MWh/yr
Space heating	0.32
Hot water	7.86
Lighting	8.15
Auxiliary	15.15
Cooling	3.79
Unregulated electricity	40.98
Unregulated gas	-

6.31 Table 4 outlines the CO₂ emissions following the inclusion of the above Energy Efficiency measures. It can be seen that the Building Regulations baseline has been met just by applying these measures alone.

Table 4: CO₂ Reduction after Energy Efficiency Measures

CO₂ Emissions following Be Lean Measures	Regulated CO₂ (kg/yr)
Part L2A (2013) Baseline	15,560
Be Lean Measures	15,560
Improvement %	0.0%

7. **BE CLEAN – HEATING INFRASTRUCTURE**

- 7.1 In line with Policy 5.6 of the London Plan, the feasibility of community energy networks has been evaluated. This is the next step in the Energy Hierarchy after **Be Lean**. London Plan outlines the following order of preference:
- > Connection to area wide heat networks;
 - > Communal heating system;
 - > Individual heating system.

Connection to existing District Heating Network

- 7.2 Due to the cooling demand that was explained in Section 5.20, space heating is reasonable to be provided via ASHPs.
- 7.3 However, from the **Be Lean** step of this energy statement, a gas boiler has been used to address the associated Domestic Hot Water (DHW) demand.
- 7.4 The 65-69 Holmes Road student accommodation development has a site-wide Energy Centre planned, which will utilise a CHP and back-up boilers.

Development's Energy Centre

- 7.5 The planned energy centre is designed to provide 73% of the total annual heat demand of the site through the CHP.
- 7.6 The specified CHP engine has a thermal efficiency of >41.5%, a heat to power ratio of 1.62 and a size of 81kWth.
- 7.7 The remaining 30% of the load accommodates peak demands, as this tends to fluctuate in a way the base load does not, it is more appropriately met through gas boilers.
- 7.8 These will be installed in the Energy Centre to satisfy the peak demands in heat.
- 7.9 The developer has confirmed that the installed gas boilers will have an efficiency of 95% as per the **Be Lean** case.
- 7.10 It has been confirmed by the developer that the mezzanine floor will connect to the site-wide heat network to address its hot water demand.

7.11 In line with the heat hierarchy, connection to an existing area-wide heat network will take place.

7.12 As such, further assessment is not required for this step of the energy hierarchy.

CO₂ Emissions after *Be Clean* Measures

7.13 Following the connection of the proposed mezzanine to the site-wide CHP heat network, the reductions in CO₂ emissions over the *Be Lean* measures are estimated in Table 5 below.

Table 5: CO₂ emissions following *Be Clean* measures

CO ₂ Emissions following <i>Be Clean</i> Measures	Regulated CO ₂ (kg/yr)
<i>Be Lean</i> Measures	15,560
<i>Be Clean</i> Measures	14,880
Improvement %	4.4%

8. **BE GREEN – RENEWABLE ENERGY**

- 8.1 The final part of the London Plan Energy Hierarchy is be Green which examines the feasibility of renewable energy technologies.
- 8.2 Camden council, requires a 20% reduction in CO₂ emissions to be achieved by renewable energy measures.
- 8.3 In line with the Energy Hierarchy, an assessment of the feasibility of renewable energy technologies is undertaken and presented in this section. Further information on renewable technologies can also be found in Appendix E.
- 8.4 A feasibility study table of the technologies that have been considered is provided in Appendix F.
- 8.5 The energy strategy of the consented 65-69 Holmes Road building has already considered the application of alternative technologies.

Biomass Boiler

- 8.6 Biomass boilers generate heat on a renewable basis as they are run on biomass fuel which is carbon neutral.
- 8.7 In line with the energy hierarchy, the proposed development will connect to the Energy Centre which is designed to utilise gas boilers and a CHP engine, which remains preferable.
- 8.8 As there is no control over the heat generation technology, a biomass boiler cannot be selected.

Air and Ground Source Heat Pumps

- 8.9 Whilst reducing energy significantly, heat pumps replace gas as the heating fuel with electricity, which is more carbon intensive. Electricity is also a more expensive fuel than gas, so energy bills are not necessarily reduced by heat pumps as much as by other technologies.
- 8.10 Ground Source Heat Pumps (GSHPs) are able to provide substantial reductions in energy. However, they are generally limited to sites with large amount of available ground space. The proposed development is situated within the 65-69 Holmes Road development. As such, ground space is occupied by a building that does not incorporate any GSHP technologies and has therefore been disregarded. ASHPs are more economical alternative to GSHPs as they do not require ground works.
- 8.11 Air Source Heat Pumps (ASHPs) have been specified to provide space heating and cooling.
- 8.12 To realise the benefit of the ASHPs in the **Be Green** step, the Seasonal Coefficient of Performance (SCoP) has been increased from the SBEM standard figure of **2.5** to **3.9**.

Micro Wind Turbines

- 8.13** Small rooftop wind turbines are designed to generate electricity from the wind.
- 8.14** Urban rooftop wind turbines do not generally perform sufficiently well to warrant their installation, due to the low and turbulent wind conditions present. They are therefore likely to remain technically unfeasible.
- 8.15** It has therefore been concluded that wind turbines are not a suitable technology for this site.

Solar Thermal (Hot Water) Panels

- 8.16** Solar thermal panels use the sun's radiant heat to generate hot water. Due to the seasonality of solar radiation, solar thermal panels can provide up to ~60% of a dwellings hot water demand, with the remainder being provided as top-up by the conventional heating system. They are a robust technology that provides substantial benefits to residents in terms of 'free' energy.
- 8.17** Solar thermal panels are generally installed on the roofs of developments, with panels facing as close to south as possible to maximise their efficiency.
- 8.18** As the proposed mezzanine is located within the 65-69 Holmes Road building, there is no physical roof space to accommodate Solar Thermal Panels to serve the mezzanine floor specifically. Additionally, solar thermal panels would conflict with the CHP technology.
- 8.19** Therefore, Solar Thermal Panels have not been specified.

Photovoltaic (PV) Panels

- 8.20** Unlike solar thermal panels, PV panels are not constrained by the hot water demand.
- 8.21** PV panels are good at enabling substantial reductions in CO₂ emissions as a result.
- 8.22** However, as mentioned above, there is no physical roof space available to accommodate PV panels specifically for the mezzanine floor.
- 8.23** The only available roof space is on the top floors of the part three part seven-storey building.
- 8.24** Therefore it is technically not feasible to connect the mezzanine floor to PV, as the panels would be feeding landlord areas associated with the whole building and not the mezzanine floor.
- 8.25** As such, PV panels have not been selected as they do not present a feasible option.

CO₂ Emissions after *Be Green* Measures

- 8.26 As demonstrated in this section, PV panels are not a feasible technology for this application, as there is no physical space to accommodate the technology.
- 8.27 The mezzanine floor is situated within the existing 65-69 Holmes Road student accommodation building.
- 8.28 The only feasible technology that can be utilised and has been proposed for the mezzanine floor are ASHPs.
- 8.29 The benefit that is realised by the ASHPs providing space heating is an additional **0.4%** carbon dioxide reduction over the ***Be Clean*** case and a total final reduction of **4.8%** over the **Part L 2013** baseline.
- 8.30 As such, it is demonstrated that the 20% of carbon reduction requirement through renewables is not feasible.
- 8.31 However, by following the energy hierarchy of ***Be Lean***, ***Be Clean*** and ***Be Green***, the Part L (2013) baseline has been achieved and exceeded, whereas the planning requirement is to only achieve compliance with the baseline.
- 8.32 Table 6 outlines the savings from the selected renewable energy sources for the development.

Table 6: CO₂ emissions following *Be Green* measures

CO ₂ Emissions following <i>Be Green</i> Measures	Regulated CO ₂ (kg/yr)
<i>Be Clean</i> Measures	14,880
<i>Be Green</i> Measures	14,820
Improvement %	0.4%

9. SUMMARY

- 9.1** The purpose of this Energy Statement and BREEAM Strategy is to demonstrate that the proposed addition of a mezzanine floor in the lower-basement level of the consented development at 65-69 Holmes Road by Designated Contractors Ltd, in the London Borough of Camden is considered sustainable, as measured against relevant local, regional and national planning policies. The Energy Strategy has been formulated following the London Plan Energy Hierarchy: **Be Lean, Be Clean** and **Be Green**.
- 9.2** The proposed addition will comprise approximately 620m² of study, social and admin areas. This Energy Statement and BREEAM strategy is to support the separate full application for the formation of a mezzanine floor, in the 65-69 Holmes Road student accommodation building.
- 9.3** The building has been registered under BREEAM New Construction 2014 (BREEAM-0062-3645) and achieved 'Very Good' Design Stage certification on 26th September 2017 in accordance with the original S106 (Clause 2.35). The 620m² of floor space that is proposed will be for study/social and admin use and as such, will be included within the existing assessment and will be assessed during the Post Construction assessment.
- 9.4** The mezzanine proposal as a stand-alone application does not exceed the threshold of a 1000m² and as such it forms a minor application. Therefore, it will seek to achieve **compliance** with the **Part L 2013 baseline**. However, the mezzanine level will form part of the whole 65-69 Holmes Road student accommodation building which has been designed and constructed to achieve a 25% carbon dioxide reduction under Part L 2010. As such, the proposed mezzanine is expected to be built under Part L 2010 Building Regulations. Under these circumstances, it is reasonable for this statement to aim towards maximising the carbon reductions, in order to ensure that the 25% of the whole building under Part L 2010 will not be jeopardized.
- 9.5** A range of energy efficiency (**Be Lean**) measures are proposed to enable the mezzanine addition to meet Part L 2013 Target Emissions Rate (TER). This represents a good level of sustainable design and construction and indicates the Applicant's commitment to reducing energy demands of the proposed added level. The combination of energy efficiency measures will achieve compliance with the calculated Part L (2013) baseline.
- 9.6** In line with the London Plan, the feasibility of decentralised energy production as a **Be Clean** measure has been carefully examined. This strategy assumes that the proposed mezzanine floor will connect to the 65-69 Holmes Road wider development's energy centre.
- 9.7** The developer has confirmed that the gas CHP engine of the existing energy centre has been designed to provide **73%** of the heat demand of the site on an annual basis, with the remaining load being served by the communal gas boilers. The combination of energy efficiency measures and the

connection of the mezzanine to the existing heat network with the CHP will enable a reduction in Regulated CO₂ emissions of **4.4%** over the Part L (2013) baseline.

- 9.8** The full spectrum of **Be Green** renewable energy sources has been considered. Due to the fact that the proposed mezzanine is situated within the envelope of the existing 65-69 Holmes Road building, there is no physical space for PV. It has been concluded that from the range of renewable technologies, only Air Source Heat Pumps (ASHPs) can be utilised. The benefit of increasing the Seasonal Coefficient of Performance (SCoP) of the ASHPs for space heating, will provide further reductions and achieve a total carbon dioxide reduction of **4.8%** over Part L (2013) baseline.
- 9.9** The table below summarises the Regulated and Total CO₂ emissions for the development after on-site measures have been applied. A **4.8%** reduction over the Part L (2013) baseline case is predicted.

Summary Table – Site Wide Reduction in CO₂ Emissions		
	Regulated CO₂ (kg/year)	% Regulated CO₂ Saving
Part L (2013) Baseline Case	15,560	-
Emissions after <i>Be Lean</i> Measures	12,560	0.0%
Emissions after <i>Be Clean</i> Measures	14,880	4.4%
Emissions after <i>Be Green</i> Measures	14,820	0.4%
Reduction Achieved over Baseline	740	4.8%

APPENDICES

Appendix A:

Building Regulations Be Lean, Be Clean and Be Green Calculations

Appendix B:

Be Lean SBEM BRUKL

Appendix C:

Be Clean SBEM BRUKL

Appendix D:

Be Green SBEM BRUKL

Appendix E:

Low Carbon and Renewable Energy Technologies

Appendix F:

Low Carbon and Renewable Energy Technology Feasibility Table

Appendix A

Building Regulations Be Lean, Be Clean and Be Green Calculations

Be Lean Energy Calculations

SAP / SBEM Outputs per Unit											
Unit Type	Test Unit Location	Energy (kWh/yr)					Regulated CO2 (kg/m2/yr)		Total CO2 (kg/m2/yr)		
		Space Heating	Cooling	Hot Water	Regulated Electrical	Unregulated Appliances & Cooking	TER	BER	TER	DER/BER	
Multi-residential	0	0.51	6.12	12.67	37.57	66.09	25.10	25.10	59.40	59.40	
Energy Demands & CO2 Emissions											
Unit Type	Unit Area (m2)	No. Units	Energy (kWh/yr)					Regulated CO2 (kg/yr)		Total CO2 (kg/m2/yr)	
			Space Heating	Cooling	Hot Water	Regulated Electrical	Unregulated Appliances & Cooking	TER	BER	TER	DER/BER
Multi-residential	620	1	316	3,794	7,855	23,293	40,976	15,562	15,562	36,828	36,828
TOTAL			316	3,794	7,855	23,293	40,976	15,562	15,562	36,828	36,828
Area Weighted Average								25.10	25.10	59.40	59.40
Improvement over Target (Apartments)								0.0%		0.0%	

Be Clean Energy Calculations

SAP / SBEM Outputs per Unit											
Unit Type	Test Unit Location	Energy (kWh/yr)					Regulated CO2 (kg/m2/yr)		Total CO2 (kg/m2/yr)		
		Space Heating	Cooling	Hot Water	Regulated Electrical	Unregulated Appliances & Cooking	TER	BER	TER	DER/BER	
Multi-residential	Mid Basement	0.51	6.12	19.67	32.51	66.09	25.10	24.00	59.40	58.30	
Energy Demands & CO2 Emissions											
Unit Type	Unit Area (m2)	No. Units	Energy (kWh/yr)					Regulated CO2 (kg/yr)		Total CO2 (kg/m2/yr)	
			Space Heating	Cooling	Hot Water	Regulated Electrical	Unregulated Appliances & Cooking	TER	BER	TER	DER/BER
Multi-residential	620	1	316	3,794	12,195	20,156	40,976	15,562	14,880	36,828	36,146
TOTAL			316	3,794	12,195	20,156	40,976	15,562	14,880	36,828	36,146
Area Weighted Average								25	24	59	58
Improvement over Target (Apartments)								4.4%		1.9%	

Be Green Energy Calculations

SAP / SBEM Outputs per Unit											
Unit Type	Test Unit Location	Energy (kWh/yr)					Regulated CO2 (kg/m2/yr)		Total CO2 (kg/m2/yr)		
		Space Heating	Cooling	Hot Water	Regulated Electrical	Unregulated Appliances & Cooking	TER	BER	TER	DER/BER	
Multi-residential	Mid Basement	0.33	6.12	19.67	32.51	66.09	25.10	23.90	59.40	58.20	
Energy Demands & CO2 Emissions											
Unit Type	Unit Area (m2)	No. Units	Energy (kWh/yr)					Regulated CO2 (kg/yr)		Total CO2 (kg/m2/yr)	
			Space Heating	Cooling	Hot Water	Regulated Electrical	Unregulated Appliances & Cooking	TER	BER	TER	DER/BER
Multi-residential	620	1	205	3,794	12,195	20,156	40,976	15,562	14,818	36,828	36,084
TOTAL			205	3,794	12,195	20,156	40,976	15,562	14,818	36,828	36,084
Area Weighted Average								25	24	59	58
Improvement over Target (Apartments)								4.8%		2.0%	

Appendix B

Be Lean SBEM BRUKL

Project name

Holmes Road Student hall

As designed

Date: Thu Feb 21 11:20:37 2019

Administrative information

Building Details

Address: 65-69 Holmes Road, London, NW5 3AU

Certification tool

Calculation engine: SBEM

Calculation engine version: v5.4.b.0

Interface to calculation engine: DesignBuilder SBEM

Interface to calculation engine version: v5.4.0

BRUKL compliance check version: v5.4.b.0

Owner Details

Name:

Telephone number:

Address: , ,

Certifier details

Name: Donald Sinclair

Telephone number:

Address: The Heights 59-65 Lowlands Road Harrow,
London, HA1 3AWCriterion 1: The calculated CO₂ emission rate for the building must not exceed the target

CO ₂ emission rate from the notional building, kgCO ₂ /m ² .annum	25.1
Target CO ₂ emission rate (TER), kgCO ₂ /m ² .annum	25.1
Building CO ₂ emission rate (BER), kgCO ₂ /m ² .annum	25.1
Are emissions from the building less than or equal to the target?	BER =< TER
Are as built details the same as used in the BER calculations?	Separate submission

Criterion 2: The performance of the building fabric and fixed building services should achieve reasonable overall standards of energy efficiency

Values which do not achieve the standards in the Non-Domestic Building Services Compliance Guide and Part L are displayed in red.

Building fabric

Element	U _a -Limit	U _a -Calc	U _i -Calc	Surface where the maximum value occurs*
Wall**	0.35	0.22	0.22	Mezzanine - Stairs 1_W_10
Floor	0.25	-	-	"No heat loss floors"
Roof	0.25	-	-	"No heat loss roofs"
Windows***, roof windows, and rooflights	2.2	-	-	"No external windows/rooflights"
Personnel doors	2.2	-	-	"No external personnel doors"
Vehicle access & similar large doors	1.5	-	-	"No external vehicle access doors"
High usage entrance doors	3.5	-	-	"No external high usage entrance doors"
U _a -Limit = Limiting area-weighted average U-values [W/(m ² K)] U _a -Calc = Calculated area-weighted average U-values [W/(m ² K)] U _i -Calc = Calculated maximum individual element U-values [W/(m ² K)]				
* There might be more than one surface where the maximum U-value occurs.				
** Automatic U-value check by the tool does not apply to curtain walls whose limiting standard is similar to that for windows.				
*** Display windows and similar glazing are excluded from the U-value check.				
N.B.: Neither roof ventilators (inc. smoke vents) nor swimming pool basins are modelled or checked against the limiting standards by the tool.				

Air Permeability	Worst acceptable standard	This building
m ³ /(h.m ²) at 50 Pa	10	0

Building services

The standard values listed below are minimum values for efficiencies and maximum values for SFPs. Refer to the Non-Domestic Building Services Compliance Guide for details.

Whole building lighting automatic monitoring & targeting with alarms for out-of-range values	NO
Whole building electric power factor achieved by power factor correction	>0.95

1- VRF with Ventilation

	Heating efficiency	Cooling efficiency	Radiant efficiency	SFP [W/(l/s)]	HR efficiency
This system	2.5	6	-	-	-
Standard value	2.5*	N/A	N/A	N/A	N/A
Automatic monitoring & targeting with alarms for out-of-range values for this HVAC system					YES

* Standard shown is for all types >12 kW output, except absorption and gas engine heat pumps. For types <=12 kW output, refer to EN 14825 for limiting standards.

1- Project DHW

	Water heating efficiency	Storage loss factor [kWh/litre per day]
This building	Hot water provided by HVAC system	0
Standard value	N/A	N/A

1- CHP 1

	CHPQA quality index	CHP electrical efficiency
This building	110	0.31
Standard value	Not provided	N/A

Local mechanical ventilation, exhaust, and terminal units

ID	System type in Non-domestic Building Services Compliance Guide
A	Local supply or extract ventilation units serving a single area
B	Zonal supply system where the fan is remote from the zone
C	Zonal extract system where the fan is remote from the zone
D	Zonal supply and extract ventilation units serving a single room or zone with heating and heat recovery
E	Local supply and extract ventilation system serving a single area with heating and heat recovery
F	Other local ventilation units
G	Fan-assisted terminal VAV unit
H	Fan coil units
I	Zonal extract system where the fan is remote from the zone with grease filter

Zone name	SFP [W/(l/s)]										HR efficiency	
	ID of system type	A	B	C	D	E	F	G	H	I	Zone	Standard
	Standard value	0.3	1.1	0.5	1.9	1.6	0.5	1.1	0.5	1		
Mezzanine - Stairs 1		-	-	-	-	-	-	-	-	-	-	N/A
Mezzanine - WC		-	-	0.3	-	-	-	-	-	-	-	N/A
Mezzanine - Study rooms		-	-	-	1.9	-	-	-	-	-	0.85	0.5
Mezzanine - Stairs 2		-	-	-	-	-	-	-	-	-	-	N/A
Mezzanine - Breakout area		-	-	-	1.9	-	-	-	-	-	0.85	0.5
Mezzanine - Admin		-	-	-	1.9	-	-	-	-	-	0.85	0.5
Mezzanine - Gym		-	-	-	1.9	-	-	-	-	-	0.85	0.5
Mezzanine - Kitchen		-	0.9	-	-	-	-	-	-	0.6	-	N/A
Mezzanine - Circulation		-	-	-	-	-	-	-	-	-	-	N/A
Mezzanine - Storage room		-	-	-	-	-	-	-	-	-	-	N/A

Zone name	SFP [W/(l/s)]									HR efficiency		
	A	B	C	D	E	F	G	H	I	Zone	Standard	
Mezzanine - Stairs	-	-	-	-	-	-	-	-	-	-	-	N/A

General lighting and display lighting		Luminous efficacy [lm/W]			General lighting [W]
Zone name	ID of system type	Luminaire	Lamp	Display lamp	
	Standard value	60	60	22	
Mezzanine - Stairs 1		-	95	-	33
Mezzanine - WC		-	95	-	63
Mezzanine - Study rooms		95	-	-	671
Mezzanine - Stairs 2		-	95	-	41
Mezzanine - Breakout area		-	95	-	1544
Mezzanine - Admin		95	-	-	665
Mezzanine - Gym		-	95	-	378
Mezzanine - Kitchen		-	95	-	104
Mezzanine - Circulation		-	95	-	71
Mezzanine - Storage room		95	-	-	29
Mezzanine - Stairs		-	95	-	50

Criterion 3: The spaces in the building should have appropriate passive control measures to limit solar gains

Zone	Solar gain limit exceeded? (%)	Internal blinds used?
Mezzanine - Stairs 1	N/A	N/A
Mezzanine - WC	N/A	N/A
Mezzanine - Study rooms	N/A	N/A
Mezzanine - Stairs 2	N/A	N/A
Mezzanine - Breakout area	N/A	N/A
Mezzanine - Admin	N/A	N/A
Mezzanine - Gym	N/A	N/A
Mezzanine - Kitchen	N/A	N/A
Mezzanine - Circulation	N/A	N/A
Mezzanine - Storage room	N/A	N/A
Mezzanine - Stairs	N/A	N/A

Criterion 4: The performance of the building, as built, should be consistent with the calculated BER

Separate submission

Criterion 5: The necessary provisions for enabling energy-efficient operation of the building should be in place

Separate submission

EPBD (Recast): Consideration of alternative energy systems

Were alternative energy systems considered and analysed as part of the design process?	NO
Is evidence of such assessment available as a separate submission?	NO
Are any such measures included in the proposed design?	NO

Technical Data Sheet (Actual vs. Notional Building)

Building Global Parameters

	Actual	Notional
Area [m ²]	759.2	759.2
External area [m ²]	140.9	140.9
Weather	LON	LON
Infiltration [m ³ /hm ² @ 50Pa]	0	0
Average conductance [W/K]	31	36.63
Average U-value [W/m ² K]	0.22	0.26
Alpha value* [%]	24.86	13.49

* Percentage of the building's average heat transfer coefficient which is due to thermal bridging

Building Use

% Area Building Type

	A1/A2 Retail/Financial and Professional services
	A3/A4/A5 Restaurants and Cafes/Drinking Est./Takeaways
	B1 Offices and Workshop businesses
	B2 to B7 General Industrial and Special Industrial Groups
	B8 Storage or Distribution
	C1 Hotels
	C2 Residential Institutions: Hospitals and Care Homes
79	C2 Residential Institutions: Residential schools
	C2 Residential Institutions: Universities and colleges
	C2A Secure Residential Institutions
	Residential spaces
	D1 Non-residential Institutions: Community/Day Centre
	D1 Non-residential Institutions: Libraries, Museums, and Galleries
	D1 Non-residential Institutions: Education
	D1 Non-residential Institutions: Primary Health Care Building
	D1 Non-residential Institutions: Crown and County Courts
21	D2 General Assembly and Leisure, Night Clubs, and Theatres
	Others: Passenger terminals
	Others: Emergency services
	Others: Miscellaneous 24hr activities
	Others: Car Parks 24 hrs
	Others: Stand alone utility block

Energy Consumption by End Use [kWh/m²]

	Actual	Notional
Heating	0.51	0.37
Cooling	6.12	12.22
Auxiliary	24.43	12.9
Lighting	13.14	18.61
Hot water	12.67	13
Equipment*	66.09	66.09
TOTAL**	56.88	57.1

* Energy used by equipment does not count towards the total for consumption or calculating emissions.

** Total is net of any electrical energy displaced by CHP generators, if applicable.

Energy Production by Technology [kWh/m²]

	Actual	Notional
Photovoltaic systems	0	0
Wind turbines	0	0
CHP generators	0	0
Solar thermal systems	0	0

Energy & CO₂ Emissions Summary

	Actual	Notional
Heating + cooling demand [MJ/m ²]	127.99	161.63
Primary energy* [kWh/m ²]	147.79	147.85
Total emissions [kg/m ²]	25.1	25.1

* Primary energy is net of any electrical energy displaced by CHP generators, if applicable.

HVAC Systems Performance

System Type	Heat dem MJ/m ²	Cool dem MJ/m ²	Heat con kWh/m ²	Cool con kWh/m ²	Aux con kWh/m ²	Heat SSEFF	Cool SSEER	Heat gen SEFF	Cool gen SEER
[ST] Split or multi-split system, [HS] Heat pump (electric): air source, [HFT] Electricity, [CFT] Electricity									
Actual	4.5	123.4	0.5	6.1	24.4	2.45	5.61	2.5	7.5
Notional	3.3	158.4	0.4	12.2	12.9	2.43	3.6	----	----

Key to terms

Heat dem [MJ/m ²]	= Heating energy demand
Cool dem [MJ/m ²]	= Cooling energy demand
Heat con [kWh/m ²]	= Heating energy consumption
Cool con [kWh/m ²]	= Cooling energy consumption
Aux con [kWh/m ²]	= Auxiliary energy consumption
Heat SSEFF	= Heating system seasonal efficiency (for notional building, value depends on activity glazing class)
Cool SSEER	= Cooling system seasonal energy efficiency ratio
Heat gen SSEFF	= Heating generator seasonal efficiency
Cool gen SSEER	= Cooling generator seasonal energy efficiency ratio
ST	= System type
HS	= Heat source
HFT	= Heating fuel type
CFT	= Cooling fuel type

Key Features

The Building Control Body is advised to give particular attention to items whose specifications are better than typically expected.

Building fabric

Element	U _{i-Typ}	U _{i-Min}	Surface where the minimum value occurs*
Wall	0.23	0.22	Mezzanine - Stairs 1_W_10
Floor	0.2	-	"No heat loss floors"
Roof	0.15	-	"No heat loss roofs"
Windows, roof windows, and rooflights	1.5	-	"No external windows/rooflights"
Personnel doors	1.5	-	"No external personnel doors"
Vehicle access & similar large doors	1.5	-	"No external vehicle access doors"
High usage entrance doors	1.5	-	"No external high usage entrance doors"
U _{i-Typ} = Typical individual element U-values [W/(m ² K)]		U _{i-Min} = Minimum individual element U-values [W/(m ² K)]	
* There might be more than one surface where the minimum U-value occurs.			

Air Permeability	Typical value	This building
m ³ /(h.m ²) at 50 Pa	5	0

Appendix C

Be Clean SBEM BRUKL

Project name

Holmes Road Student hall

As designed

Date: Thu Feb 21 11:23:49 2019

Administrative information

Building Details

Address: 65-69 Holmes Road, London, NW5 3AU

Certification tool

Calculation engine: SBEM

Calculation engine version: v5.4.b.0

Interface to calculation engine: DesignBuilder SBEM

Interface to calculation engine version: v5.4.0

BRUKL compliance check version: v5.4.b.0

Owner Details

Name:

Telephone number:

Address: , ,

Certifier details

Name: Donald Sinclair

Telephone number:

Address: The Heights 59-65 Lowlands Road Harrow,
London, HA1 3AWCriterion 1: The calculated CO₂ emission rate for the building must not exceed the target

CO ₂ emission rate from the notional building, kgCO ₂ /m ² .annum	25.1
Target CO ₂ emission rate (TER), kgCO ₂ /m ² .annum	25.1
Building CO ₂ emission rate (BER), kgCO ₂ /m ² .annum	24
Are emissions from the building less than or equal to the target?	BER =< TER
Are as built details the same as used in the BER calculations?	Separate submission

Criterion 2: The performance of the building fabric and fixed building services should achieve reasonable overall standards of energy efficiency

Values which do not achieve the standards in the Non-Domestic Building Services Compliance Guide and Part L are displayed in red.

Building fabric

Element	U _a -Limit	U _a -Calc	U _i -Calc	Surface where the maximum value occurs*
Wall**	0.35	0.22	0.22	Mezzanine - Stairs 1_W_10
Floor	0.25	-	-	"No heat loss floors"
Roof	0.25	-	-	"No heat loss roofs"
Windows***, roof windows, and rooflights	2.2	-	-	"No external windows/rooflights"
Personnel doors	2.2	-	-	"No external personnel doors"
Vehicle access & similar large doors	1.5	-	-	"No external vehicle access doors"
High usage entrance doors	3.5	-	-	"No external high usage entrance doors"
U _a -Limit = Limiting area-weighted average U-values [W/(m ² K)] U _a -Calc = Calculated area-weighted average U-values [W/(m ² K)] U _i -Calc = Calculated maximum individual element U-values [W/(m ² K)]				
* There might be more than one surface where the maximum U-value occurs.				
** Automatic U-value check by the tool does not apply to curtain walls whose limiting standard is similar to that for windows.				
*** Display windows and similar glazing are excluded from the U-value check.				
N.B.: Neither roof ventilators (inc. smoke vents) nor swimming pool basins are modelled or checked against the limiting standards by the tool.				

Air Permeability	Worst acceptable standard	This building
m ³ /(h.m ²) at 50 Pa	10	0

Building services

The standard values listed below are minimum values for efficiencies and maximum values for SFPs. Refer to the Non-Domestic Building Services Compliance Guide for details.

Whole building lighting automatic monitoring & targeting with alarms for out-of-range values	NO
Whole building electric power factor achieved by power factor correction	>0.95

1- VRF with Ventilation

	Heating efficiency	Cooling efficiency	Radiant efficiency	SFP [W/(l/s)]	HR efficiency
This system	2.5	6	-	-	-
Standard value	2.5*	N/A	N/A	N/A	N/A
Automatic monitoring & targeting with alarms for out-of-range values for this HVAC system					YES
* Standard shown is for all types >12 kW output, except absorption and gas engine heat pumps. For types <=12 kW output, refer to EN 14825 for limiting standards.					

1- Project DHW

	Water heating efficiency	Storage loss factor [kWh/litre per day]
This building	Hot water provided by HVAC system	0
Standard value	N/A	N/A

1- CHP 1

	CHPQA quality index	CHP electrical efficiency
This building	110	0.31
Standard value	105	0.2

Local mechanical ventilation, exhaust, and terminal units

ID	System type in Non-domestic Building Services Compliance Guide
A	Local supply or extract ventilation units serving a single area
B	Zonal supply system where the fan is remote from the zone
C	Zonal extract system where the fan is remote from the zone
D	Zonal supply and extract ventilation units serving a single room or zone with heating and heat recovery
E	Local supply and extract ventilation system serving a single area with heating and heat recovery
F	Other local ventilation units
G	Fan-assisted terminal VAV unit
H	Fan coil units
I	Zonal extract system where the fan is remote from the zone with grease filter

Zone name	SFP [W/(l/s)]										HR efficiency	
	ID of system type	A	B	C	D	E	F	G	H	I	Zone	Standard
	Standard value	0.3	1.1	0.5	1.9	1.6	0.5	1.1	0.5	1		
Mezzanine - Stairs 1		-	-	-	-	-	-	-	-	-	-	N/A
Mezzanine - WC		-	-	0.3	-	-	-	-	-	-	-	N/A
Mezzanine - Study rooms		-	-	-	1.9	-	-	-	-	-	0.85	0.5
Mezzanine - Stairs 2		-	-	-	-	-	-	-	-	-	-	N/A
Mezzanine - Breakout area		-	-	-	1.9	-	-	-	-	-	0.85	0.5
Mezzanine - Admin		-	-	-	1.9	-	-	-	-	-	0.85	0.5
Mezzanine - Gym		-	-	-	1.9	-	-	-	-	-	0.85	0.5
Mezzanine - Kitchen		-	0.9	-	-	-	-	-	-	0.6	-	N/A
Mezzanine - Circulation		-	-	-	-	-	-	-	-	-	-	N/A
Mezzanine - Storage room		-	-	-	-	-	-	-	-	-	-	N/A

Zone name	SFP [W/(l/s)]									HR efficiency		
	A	B	C	D	E	F	G	H	I	Zone	Standard	
Mezzanine - Stairs	-	-	-	-	-	-	-	-	-	-	-	N/A

General lighting and display lighting		Luminous efficacy [lm/W]			General lighting [W]
Zone name	ID of system type	Luminaire	Lamp	Display lamp	
	Standard value	60	60	22	
Mezzanine - Stairs 1		-	95	-	33
Mezzanine - WC		-	95	-	63
Mezzanine - Study rooms		95	-	-	671
Mezzanine - Stairs 2		-	95	-	41
Mezzanine - Breakout area		-	95	-	1544
Mezzanine - Admin		95	-	-	665
Mezzanine - Gym		-	95	-	378
Mezzanine - Kitchen		-	95	-	104
Mezzanine - Circulation		-	95	-	71
Mezzanine - Storage room		95	-	-	29
Mezzanine - Stairs		-	95	-	50

Criterion 3: The spaces in the building should have appropriate passive control measures to limit solar gains

Zone	Solar gain limit exceeded? (%)	Internal blinds used?
Mezzanine - Stairs 1	N/A	N/A
Mezzanine - WC	N/A	N/A
Mezzanine - Study rooms	N/A	N/A
Mezzanine - Stairs 2	N/A	N/A
Mezzanine - Breakout area	N/A	N/A
Mezzanine - Admin	N/A	N/A
Mezzanine - Gym	N/A	N/A
Mezzanine - Kitchen	N/A	N/A
Mezzanine - Circulation	N/A	N/A
Mezzanine - Storage room	N/A	N/A
Mezzanine - Stairs	N/A	N/A

Criterion 4: The performance of the building, as built, should be consistent with the calculated BER

Separate submission

Criterion 5: The necessary provisions for enabling energy-efficient operation of the building should be in place

Separate submission

EPBD (Recast): Consideration of alternative energy systems

Were alternative energy systems considered and analysed as part of the design process?	NO
Is evidence of such assessment available as a separate submission?	NO
Are any such measures included in the proposed design?	NO

Technical Data Sheet (Actual vs. Notional Building)

Building Global Parameters

	Actual	Notional
Area [m ²]	759.2	759.2
External area [m ²]	140.9	140.9
Weather	LON	LON
Infiltration [m ³ /hm ² @ 50Pa]	0	0
Average conductance [W/K]	31	36.63
Average U-value [W/m ² K]	0.22	0.26
Alpha value* [%]	24.86	13.49

* Percentage of the building's average heat transfer coefficient which is due to thermal bridging

Building Use

% Area Building Type

	A1/A2 Retail/Financial and Professional services
	A3/A4/A5 Restaurants and Cafes/Drinking Est./Takeaways
	B1 Offices and Workshop businesses
	B2 to B7 General Industrial and Special Industrial Groups
	B8 Storage or Distribution
	C1 Hotels
	C2 Residential Institutions: Hospitals and Care Homes
79	C2 Residential Institutions: Residential schools
	C2 Residential Institutions: Universities and colleges
	C2A Secure Residential Institutions
	Residential spaces
	D1 Non-residential Institutions: Community/Day Centre
	D1 Non-residential Institutions: Libraries, Museums, and Galleries
	D1 Non-residential Institutions: Education
	D1 Non-residential Institutions: Primary Health Care Building
	D1 Non-residential Institutions: Crown and County Courts
21	D2 General Assembly and Leisure, Night Clubs, and Theatres
	Others: Passenger terminals
	Others: Emergency services
	Others: Miscellaneous 24hr activities
	Others: Car Parks 24 hrs
	Others: Stand alone utility block

Energy Consumption by End Use [kWh/m²]

	Actual	Notional
Heating	0.51	0.37
Cooling	6.12	12.22
Auxiliary	24.43	12.9
Lighting	13.14	18.61
Hot water	19.67	13
Equipment*	66.09	66.09
TOTAL**	58.81	57.1

* Energy used by equipment does not count towards the total for consumption or calculating emissions.

** Total is net of any electrical energy displaced by CHP generators, if applicable.

Energy Production by Technology [kWh/m²]

	Actual	Notional
Photovoltaic systems	0	0
Wind turbines	0	0
CHP generators	5.06	0
Solar thermal systems	0	0

Energy & CO₂ Emissions Summary

	Actual	Notional
Heating + cooling demand [MJ/m ²]	127.99	161.63
Primary energy* [kWh/m ²]	140.78	147.85
Total emissions [kg/m ²]	24	25.1

* Primary energy is net of any electrical energy displaced by CHP generators, if applicable.

HVAC Systems Performance

System Type	Heat dem MJ/m2	Cool dem MJ/m2	Heat con kWh/m2	Cool con kWh/m2	Aux con kWh/m2	Heat SSEFF	Cool SSEER	Heat gen SEFF	Cool gen SEER
[ST] Split or multi-split system, [HS] Heat pump (electric): air source, [HFT] Electricity, [CFT] Electricity									
Actual	4.5	123.4	0.5	6.1	24.4	2.45	5.61	2.5	7.5
Notional	3.3	158.4	0.4	12.2	12.9	2.43	3.6	----	----

Key to terms

Heat dem [MJ/m2]	= Heating energy demand
Cool dem [MJ/m2]	= Cooling energy demand
Heat con [kWh/m2]	= Heating energy consumption
Cool con [kWh/m2]	= Cooling energy consumption
Aux con [kWh/m2]	= Auxiliary energy consumption
Heat SSEFF	= Heating system seasonal efficiency (for notional building, value depends on activity glazing class)
Cool SSEER	= Cooling system seasonal energy efficiency ratio
Heat gen SSEFF	= Heating generator seasonal efficiency
Cool gen SSEER	= Cooling generator seasonal energy efficiency ratio
ST	= System type
HS	= Heat source
HFT	= Heating fuel type
CFT	= Cooling fuel type

Key Features

The Building Control Body is advised to give particular attention to items whose specifications are better than typically expected.

Building fabric

Element	U _{i-Typ}	U _{i-Min}	Surface where the minimum value occurs*
Wall	0.23	0.22	Mezzanine - Stairs 1_W_10
Floor	0.2	-	"No heat loss floors"
Roof	0.15	-	"No heat loss roofs"
Windows, roof windows, and rooflights	1.5	-	"No external windows/rooflights"
Personnel doors	1.5	-	"No external personnel doors"
Vehicle access & similar large doors	1.5	-	"No external vehicle access doors"
High usage entrance doors	1.5	-	"No external high usage entrance doors"
U _{i-Typ} = Typical individual element U-values [W/(m ² K)]		U _{i-Min} = Minimum individual element U-values [W/(m ² K)]	
* There might be more than one surface where the minimum U-value occurs.			

Air Permeability	Typical value	This building
m ³ /(h.m ²) at 50 Pa	5	0

Appendix D

Be Green SBEM BRUKL

Project name

Holmes Road Student hall

As designed

Date: Thu Feb 21 11:25:52 2019

Administrative information

Building Details

Address: 65-69 Holmes Road, London, NW5 3AU

Certification tool

Calculation engine: SBEM

Calculation engine version: v5.4.b.0

Interface to calculation engine: DesignBuilder SBEM

Interface to calculation engine version: v5.4.0

BRUKL compliance check version: v5.4.b.0

Owner Details

Name:

Telephone number:

Address: , ,

Certifier details

Name: Donald Sinclair

Telephone number:

Address: The Heights 59-65 Lowlands Road Harrow,
London, HA1 3AWCriterion 1: The calculated CO₂ emission rate for the building must not exceed the target

CO ₂ emission rate from the notional building, kgCO ₂ /m ² .annum	25.1
Target CO ₂ emission rate (TER), kgCO ₂ /m ² .annum	25.1
Building CO ₂ emission rate (BER), kgCO ₂ /m ² .annum	23.9
Are emissions from the building less than or equal to the target?	BER =< TER
Are as built details the same as used in the BER calculations?	Separate submission

Criterion 2: The performance of the building fabric and fixed building services should achieve reasonable overall standards of energy efficiency

Values which do not achieve the standards in the Non-Domestic Building Services Compliance Guide and Part L are displayed in red.

Building fabric

Element	U _a -Limit	U _a -Calc	U _i -Calc	Surface where the maximum value occurs*
Wall**	0.35	0.22	0.22	Mezzanine - Stairs 1_W_10
Floor	0.25	-	-	"No heat loss floors"
Roof	0.25	-	-	"No heat loss roofs"
Windows***, roof windows, and rooflights	2.2	-	-	"No external windows/rooflights"
Personnel doors	2.2	-	-	"No external personnel doors"
Vehicle access & similar large doors	1.5	-	-	"No external vehicle access doors"
High usage entrance doors	3.5	-	-	"No external high usage entrance doors"
U _a -Limit = Limiting area-weighted average U-values [W/(m ² K)] U _a -Calc = Calculated area-weighted average U-values [W/(m ² K)] U _i -Calc = Calculated maximum individual element U-values [W/(m ² K)]				
* There might be more than one surface where the maximum U-value occurs.				
** Automatic U-value check by the tool does not apply to curtain walls whose limiting standard is similar to that for windows.				
*** Display windows and similar glazing are excluded from the U-value check.				
N.B.: Neither roof ventilators (inc. smoke vents) nor swimming pool basins are modelled or checked against the limiting standards by the tool.				

Air Permeability	Worst acceptable standard	This building
m ³ /(h.m ²) at 50 Pa	10	0

Building services

The standard values listed below are minimum values for efficiencies and maximum values for SFPs. Refer to the [Non-Domestic Building Services Compliance Guide](#) for details.

Whole building lighting automatic monitoring & targeting with alarms for out-of-range values	NO
Whole building electric power factor achieved by power factor correction	>0.95

1- VRF with Ventilation

	Heating efficiency	Cooling efficiency	Radiant efficiency	SFP [W/(l/s)]	HR efficiency
This system	3.9	6	-	-	-
Standard value	2.5*	N/A	N/A	N/A	N/A
Automatic monitoring & targeting with alarms for out-of-range values for this HVAC system					YES
* Standard shown is for all types >12 kW output, except absorption and gas engine heat pumps. For types <=12 kW output, refer to EN 14825 for limiting standards.					

1- Project DHW

	Water heating efficiency	Storage loss factor [kWh/litre per day]
This building	Hot water provided by HVAC system	0
Standard value	N/A	N/A

1- CHP 1

	CHPQA quality index	CHP electrical efficiency
This building	110	0.31
Standard value	105	0.2

Local mechanical ventilation, exhaust, and terminal units

ID	System type in Non-domestic Building Services Compliance Guide
A	Local supply or extract ventilation units serving a single area
B	Zonal supply system where the fan is remote from the zone
C	Zonal extract system where the fan is remote from the zone
D	Zonal supply and extract ventilation units serving a single room or zone with heating and heat recovery
E	Local supply and extract ventilation system serving a single area with heating and heat recovery
F	Other local ventilation units
G	Fan-assisted terminal VAV unit
H	Fan coil units
I	Zonal extract system where the fan is remote from the zone with grease filter

Zone name	SFP [W/(l/s)]										HR efficiency	
	ID of system type	A	B	C	D	E	F	G	H	I	Zone	Standard
	Standard value	0.3	1.1	0.5	1.9	1.6	0.5	1.1	0.5	1		
Mezzanine - Stairs 1		-	-	-	-	-	-	-	-	-	-	N/A
Mezzanine - WC		-	-	0.3	-	-	-	-	-	-	-	N/A
Mezzanine - Study rooms		-	-	-	1.9	-	-	-	-	-	0.85	0.5
Mezzanine - Stairs 2		-	-	-	-	-	-	-	-	-	-	N/A
Mezzanine - Breakout area		-	-	-	1.9	-	-	-	-	-	0.85	0.5
Mezzanine - Admin		-	-	-	1.9	-	-	-	-	-	0.85	0.5
Mezzanine - Gym		-	-	-	1.9	-	-	-	-	-	0.85	0.5
Mezzanine - Kitchen		-	0.9	-	-	-	-	-	-	0.6	-	N/A
Mezzanine - Circulation		-	-	-	-	-	-	-	-	-	-	N/A
Mezzanine - Storage room		-	-	-	-	-	-	-	-	-	-	N/A

Zone name	SFP [W/(l/s)]									HR efficiency	
	A	B	C	D	E	F	G	H	I	Zone	Standard
Mezzanine - Stairs	-	-	-	-	-	-	-	-	-	-	N/A

General lighting and display lighting		Luminous efficacy [lm/W]			General lighting [W]
Zone name	ID of system type	Luminaire	Lamp	Display lamp	
	Standard value	60	60	22	
Mezzanine - Stairs 1		-	95	-	33
Mezzanine - WC		-	95	-	63
Mezzanine - Study rooms		95	-	-	671
Mezzanine - Stairs 2		-	95	-	41
Mezzanine - Breakout area		-	95	-	1544
Mezzanine - Admin		95	-	-	665
Mezzanine - Gym		-	95	-	378
Mezzanine - Kitchen		-	95	-	104
Mezzanine - Circulation		-	95	-	71
Mezzanine - Storage room		95	-	-	29
Mezzanine - Stairs		-	95	-	50

Criterion 3: The spaces in the building should have appropriate passive control measures to limit solar gains

Zone	Solar gain limit exceeded? (%)	Internal blinds used?
Mezzanine - Stairs 1	N/A	N/A
Mezzanine - WC	N/A	N/A
Mezzanine - Study rooms	N/A	N/A
Mezzanine - Stairs 2	N/A	N/A
Mezzanine - Breakout area	N/A	N/A
Mezzanine - Admin	N/A	N/A
Mezzanine - Gym	N/A	N/A
Mezzanine - Kitchen	N/A	N/A
Mezzanine - Circulation	N/A	N/A
Mezzanine - Storage room	N/A	N/A
Mezzanine - Stairs	N/A	N/A

Criterion 4: The performance of the building, as built, should be consistent with the calculated BER

Separate submission

Criterion 5: The necessary provisions for enabling energy-efficient operation of the building should be in place

Separate submission

EPBD (Recast): Consideration of alternative energy systems

Were alternative energy systems considered and analysed as part of the design process?	NO
Is evidence of such assessment available as a separate submission?	NO
Are any such measures included in the proposed design?	NO

Technical Data Sheet (Actual vs. Notional Building)

Building Global Parameters

	Actual	Notional
Area [m ²]	759.2	759.2
External area [m ²]	140.9	140.9
Weather	LON	LON
Infiltration [m ³ /hm ² @ 50Pa]	0	0
Average conductance [W/K]	31	36.63
Average U-value [W/m ² K]	0.22	0.26
Alpha value* [%]	24.86	13.49

* Percentage of the building's average heat transfer coefficient which is due to thermal bridging

Building Use

% Area Building Type

	A1/A2 Retail/Financial and Professional services
	A3/A4/A5 Restaurants and Cafes/Drinking Est./Takeaways
	B1 Offices and Workshop businesses
	B2 to B7 General Industrial and Special Industrial Groups
	B8 Storage or Distribution
	C1 Hotels
	C2 Residential Institutions: Hospitals and Care Homes
79	C2 Residential Institutions: Residential schools
	C2 Residential Institutions: Universities and colleges
	C2A Secure Residential Institutions
	Residential spaces
	D1 Non-residential Institutions: Community/Day Centre
	D1 Non-residential Institutions: Libraries, Museums, and Galleries
	D1 Non-residential Institutions: Education
	D1 Non-residential Institutions: Primary Health Care Building
	D1 Non-residential Institutions: Crown and County Courts
21	D2 General Assembly and Leisure, Night Clubs, and Theatres
	Others: Passenger terminals
	Others: Emergency services
	Others: Miscellaneous 24hr activities
	Others: Car Parks 24 hrs
	Others: Stand alone utility block

Energy Consumption by End Use [kWh/m²]

	Actual	Notional
Heating	0.33	0.37
Cooling	6.12	12.22
Auxiliary	24.43	12.9
Lighting	13.14	18.61
Hot water	19.67	13
Equipment*	66.09	66.09
TOTAL**	58.63	57.1

* Energy used by equipment does not count towards the total for consumption or calculating emissions.

** Total is net of any electrical energy displaced by CHP generators, if applicable.

Energy Production by Technology [kWh/m²]

	Actual	Notional
Photovoltaic systems	0	0
Wind turbines	0	0
CHP generators	5.06	0
Solar thermal systems	0	0

Energy & CO₂ Emissions Summary

	Actual	Notional
Heating + cooling demand [MJ/m ²]	127.99	161.63
Primary energy* [kWh/m ²]	140.23	147.85
Total emissions [kg/m ²]	23.9	25.1

* Primary energy is net of any electrical energy displaced by CHP generators, if applicable.

HVAC Systems Performance

System Type	Heat dem MJ/m ²	Cool dem MJ/m ²	Heat con kWh/m ²	Cool con kWh/m ²	Aux con kWh/m ²	Heat SSEFF	Cool SSEER	Heat gen SEFF	Cool gen SEER
[ST] Split or multi-split system, [HS] Heat pump (electric): air source, [HFT] Electricity, [CFT] Electricity									
Actual	4.5	123.4	0.3	6.1	24.4	3.83	5.61	3.9	7.5
Notional	3.3	158.4	0.4	12.2	12.9	2.43	3.6	----	----

Key to terms

Heat dem [MJ/m ²]	= Heating energy demand
Cool dem [MJ/m ²]	= Cooling energy demand
Heat con [kWh/m ²]	= Heating energy consumption
Cool con [kWh/m ²]	= Cooling energy consumption
Aux con [kWh/m ²]	= Auxiliary energy consumption
Heat SSEFF	= Heating system seasonal efficiency (for notional building, value depends on activity glazing class)
Cool SSEER	= Cooling system seasonal energy efficiency ratio
Heat gen SSEFF	= Heating generator seasonal efficiency
Cool gen SSEER	= Cooling generator seasonal energy efficiency ratio
ST	= System type
HS	= Heat source
HFT	= Heating fuel type
CFT	= Cooling fuel type

Key Features

The Building Control Body is advised to give particular attention to items whose specifications are better than typically expected.

Building fabric

Element	U _{i-Typ}	U _{i-Min}	Surface where the minimum value occurs*
Wall	0.23	0.22	Mezzanine - Stairs 1_W_10
Floor	0.2	-	"No heat loss floors"
Roof	0.15	-	"No heat loss roofs"
Windows, roof windows, and rooflights	1.5	-	"No external windows/rooflights"
Personnel doors	1.5	-	"No external personnel doors"
Vehicle access & similar large doors	1.5	-	"No external vehicle access doors"
High usage entrance doors	1.5	-	"No external high usage entrance doors"
U _{i-Typ} = Typical individual element U-values [W/(m ² K)]		U _{i-Min} = Minimum individual element U-values [W/(m ² K)]	
* There might be more than one surface where the minimum U-value occurs.			

Air Permeability	Typical value	This building
m ³ /(h.m ²) at 50 Pa	5	0

Appendix E

Low Carbon and Renewable Energy Technologies

1. INTRODUCTION

- > This Appendix is intended to provide the background information for the low carbon and renewable energy technologies that have been considered in the formulation of this Energy Statement.
- > The information provided here forms the basis for the project specific technical selection of low carbon/renewable energy technologies contained in the main section of this Energy Statement.

2. COMBINED HEAT AND POWER (CHP)

> CHP is a form of decentralised energy generation that generally uses gas to generate electricity for local consumption, reducing the need for grid electricity and its associated high CO₂ emissions. As the CHP system is close to the point of energy demand, it is possible to use the heat that is generated during the electricity generation process. As both the electricity and heat from the generator is used, the efficiency of the system is increased above that of a conventional power plant where the heat is not utilised.

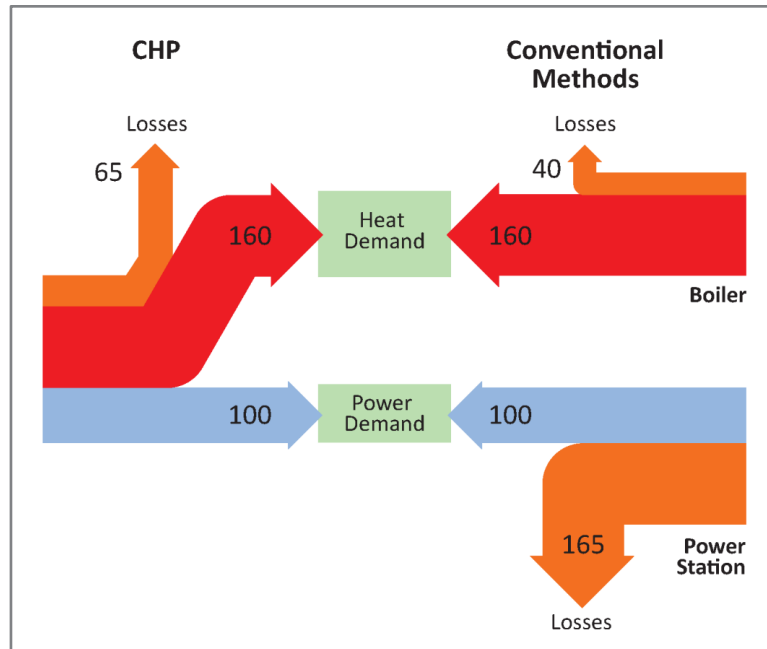


Diagram 1 – CHP Diagram

- > However, the overall efficiency of ~80% is still lower than the ~90% efficiency of a heat only gas boiler.
- > Where there are high thermal loads, CHP can be used within district heating networks to supply the required heat.
- > **Performance and Calculation Methodology: -**
 - > Most commonly sized on the heat load of a development, not the electrical load. This prevents an over-generation of heat.
 - > Require a high and relatively constant heat demand to be viable.
 - > CHP engines are best suited to providing the base heating load of a development (~year round hot water demand) with conventional gas boilers responding to the peak heating demand (~winter space heating). CHP engines are not able to effectively respond to peaks in demand.
 - > In general, CHP engines have an electrical efficiency of ~30% and a thermal efficiency of ~45%. Larger engines have a better heat to power ratio and are therefore able to reduce CO₂ emissions by greater amount.
 - > Electricity produced by the CHP engine displaces grid electricity which is given a carbon intensity of 0.519 kg per kWh.

> **Capital Cost: -**

- > Around £1,000 per kW of electrical output.
- > Relative cost reduces as the size of engine increases.
- > Generally best suited to larger sites, where there is a suitable economy of scale.

> **Running Costs/Savings: -**

- > CHP engines often struggle to provide cost-effective energy to dwellings on smaller residential schemes compared to conventional individual gas boilers.
- > Onsite use of CHP generated electricity; power Purchase Agreement with electricity Supply Company or Private Wire arrangement to local large non-domestic demand enhances economic case.

> **Land Use Issues and Space Required: -**

- > CHP engines require a plant room, and possibly an energy centre for large residential developments.
- > CHP engines require a flue to effectively disperse pollutants. This is best to rise to a minimum of 2m above the roofline of the tallest building.
- > Route for district heating pipe around the site must be safeguarded.

> **Operational Impacts/Issues: -**

- > Often run by Energy Services Company (ESCo) who maybe unenthusiastic about getting involved in small – medium scale schemes.
- > Can also be run in-house with specialist maintenance and customer services activities contracted out.
- > Issues with rights to dig up roads for district heating networks.
- > Emissions of oxides of nitrogen – ~500mg/kWh – 10 times higher than for a gas boiler. Specialist technologies exist (e.g. selective catalytic reduction) to reduce this to ~20mg/kWh if air quality issues require.

> **Embodied Energy: -** Comparable to that of a conventional gas boiler.

> **Funding Opportunities: -**

- > Tax relief for businesses under the Enhanced Capital Allowances scheme..

> **Reductions in Energy Achievable: -** Can provide some reductions in effective primary energy, but when distribution losses and other local losses are included more fuel is required.

> **Reductions in CO₂ Achievable: -** Can provide greater reductions in CO₂ than energy, aided by the emissions factor of grid displaced electricity of 0.519 kg CO₂/kWh. CO₂ reduction increase as size of engine increases.

> **Advantages: -**

- > Good reductions in overall primary energy and CO₂ emissions.
- > Most cost effective and appropriate strategy to achieve substantial CO₂ reductions on large schemes.

> **Disadvantages: -**

- > On smaller schemes often do not supply energy cost-effectively in comparison to conventional individual gas boilers.
- > Requires sale of generated electricity to maximise cost effectiveness.

Application: - Best suited to larger developments.

3. COMBINED COOLING HEAT AND POWER (CCHP)

- > CCHP is a CHP system which additionally has the facility to transform heat into energy for cooling. This is done with an absorption chiller which utilises a heat source to provide the energy needed to drive a cooling system. As absorption chillers are far less efficient than conventional coolers (CoP of 0.7 compared to >4) they are generally only used where there is a current excess generation of heat. New CHP systems are generally sized to provide the year round base heating load only.
- > For this reason it is generally not suitable for new CHP systems to include cooling.
- > Where there are high thermal loads, CCHP can be used within district heating and cooling networks to supply the required heat and coolth.
- > **Performance and Calculation Methodology: -**
 - > Most commonly sized on the heat load of a development, not the electrical load. This prevents an over-generation of heat.
 - > Require a high and relatively constant heat and cooling demand to be viable.
 - > CCHP systems are best suited to providing the base loads of a development with conventional gas boilers and chillers responding to the peak demands. CCHP systems are not able to effectively respond to peaks in demand.
 - > In general, CHP engines have an electrical efficiency of ~30% and a thermal efficiency of ~45%.
 - > Absorption chillers have a CoP of ~0.7.
 - > Electricity produced by the CHP engine displaces grid electricity which is given a carbon intensity of 0.519 kg per kWh.
- > **Capital Cost: -**

- > High in comparison to biomass boilers and increased further by inclusion of absorption chiller.
- > **Running Costs/Savings: -**
 - > Coolth from absorption chillers is more expensive than from conventional systems unless heat used is genuine waste heat.
- > **Land Use Issues and Space Required: -**
 - > CCHP systems require a plant room, and possibly an energy centre for large residential developments.
 - > CHP engines require a flue to effectively disperse pollutants. This is best to rise to a minimum of 2m above the roofline of the tallest building. Additionally the absorption chiller requires either a cooling tower or dry cooler bed for heat rejection purposes.
 - > Heating and cooling distribution pipework required around the site.
- > **Operational Impacts/Issues: -**
 - > Often run by an ESCo who are unenthusiastic about getting involved in small – medium scale schemes.
 - > Can also be run in-house with specialist maintenance and customer services activities contracted out.
 - > Issues with rights to dig up roads for heat networks.
 - > Emissions of oxides of nitrogen– ~500mg/kWh – 10 times higher than for gas boilers. Specialist technologies exist (e.g. selective catalytic reduction) to reduce this ~20mg/kWh if air quality issues require.
 - > Rejection of heat is higher than for conventional cooling, thus enforcing the urban heat island effect.
 - > Embodied Energy: - Comparable to conventional gas boilers.
- > **Funding Opportunities: -**
 - > Tax relief for businesses under Enhanced Capital Allowance scheme.
 - > Reductions in Energy Achievable: - Absorption cooling generally requires more energy than conventional chillers.
 - > Reductions in CO₂ Achievable: - Can provide greater reductions in CO₂ than energy, aided by the emissions factor of grid displaced electricity of 0.519 kg CO₂/kWh.
- > **Advantages: -**
 - > Reasonable reductions in overall primary energy and CO₂ emissions.

- > Disadvantages: - More expensive to install than conventional chillers.
 - > Operational costs higher than for conventional chillers.
 - > **Application:** - Best suited where there is genuine waste heat available.
-

4. BIOMASS BOILERS

- > Biomass boilers generate heat on a renewable basis as they are run on biomass fuel which is almost carbon neutral. Fuel is generally wood chip or wood pellets. Wood pellets are slightly more expensive than wood chips but have a significantly higher calorific value and enable greater automation of the system.
- > Various other suitable fuels are available including organic materials including straw, dedicated energy crops, sewage sludge and animal litter. Each fuel tends to have its own advantages dependant on site requirements.
- > Can be used with district heating networks or as individual boilers on a house-by-house basis.
- > **Performance and Calculation Methodology:** -
 - > Biomass boilers are best suited to providing the base heating load of a development (~year round hot water demand) with conventional gas boilers responding to the peak heating demand (~winter space heating).
 - > Operate with an efficiency of around 90%.
 - > Small models available.
 - > Conflicts with CHP they are both best suited to providing the base heating load of a development. As such they should not be installed in tandem unless surplus hot water capacity is available. Special control measures would be required in this case.
- > **Capital Cost:** -
 - > Low in comparison to CHP.
 - > More suitable to smaller developments than CHP as installed cost is lower.
- > **Running Costs/Savings:** -
 - > Biomass fuel is more expensive than gas and as such heat being provided to dwellings is generally more expensive than alternatives.
- > **Land Use Issues and Space Required:** -
 - > Biomass boilers require a plant room and possibly separate energy centre for large residential developments.
 - > Require a flue to effectively disperse pollutants. This is best to rise to a minimum of 2m above the roofline of the tallest building. Additionally the

absorption chiller requires either a cooling tower or dry cooler bed for heat rejection purposes.

- > Fuel store will be required. This should be maximised to reduce fuel delivery frequency.
- > Space must be available for delivery vehicle to park close to plant room.
- > Route for district heating pipe around the site must be safeguarded.

> **Operational Impacts/Issues: -**

- > Normally run on biomass, but can also work with biogas.
- > Require some operational support and maintenance.
- > Fuel deliveries required.
- > Boiler and fuel store must be sited in proximity to space for delivery vehicle to park.
- > Issues with rights to dig up roads, etc (for heat networks).
- > Emissions of oxides of nitrogen – ~80-100mg/kWh.
- > Emissions of particulate matter. To minimise this ceramic filter systems are required.
- > Embodied Energy: - Comparable to conventional gas boiler.

> **Funding Opportunities: -**

- > Renewable Heat Incentive (RHI) provides incentive funds to developers of small or medium installations with a reasonable heat load that meet a minimum energy efficiency standard & meet the RHI eligibility criteria.
- > Reductions in Energy Achievable: - No reduction in energy demand, but energy generated from a renewable fuel. Significant long term running costs (fuel).
- > Reductions in CO₂ Achievable: - Can provide significant reductions in CO₂, but generally limited by the hot water load (base heating load).
- > Advantages: - Reductions in CO₂ at low installed cost.

> **Disadvantages: -**

- > High long-term running costs, unless receiving RHI.
- > Often do not supply energy cost-effectively in comparison to gas boilers.

5. SOLAR THERMAL PANELS

- > Solar Thermal Heating Systems contribute to the hot water demand of a dwelling or building. Water or glycol (heat transfer fluid) is circulated to roof level where it is heated using solar energy before being returned to a thermal store in the plant room where heat is exchanged with water from the conventional system. Due to the seasonal availability of heat, solar thermal panels should be scaled to provide no more than 1/2 of the hot water load.

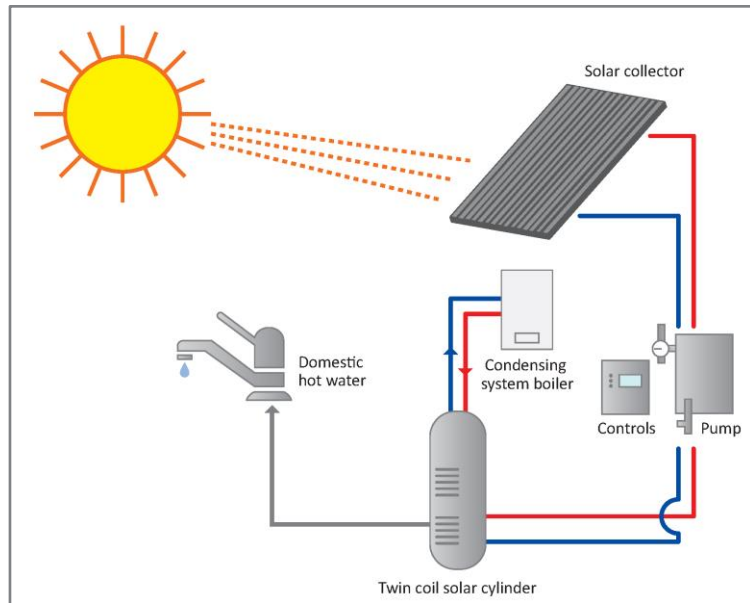


Diagram 2 – Solar Thermal System

- > Can also be used to provide energy for space heating in highly insulated dwellings.
- > There are two types of solar thermal panel: evacuated tube collectors and flat plate collectors.
- > **Performance and Calculation Methodology:** -
 - > Evacuated Tube Collectors: ~60% efficiency.
 - > Flat Plate Collectors: ~50% efficiency.
 - > SAP Table H2 used for solar irradiation at different angles.
 - > Operate best on south facing roofs angled at 30-45° and free of shading, or on flat roofs on frames. East/West facing panels suffer a loss in performance of 15-20% depending on the angle of installation.
 - > Flat plate collectors cannot be installed horizontally as this would prevent operation of the water pump. Must therefore be angled and separated to avoid overshadowing each other.
- > **Capital Cost:** - Typically £2,500 per 4m² plus installation. Costs higher for evacuated tubes than flat plate collectors.
- > **Running Costs/Savings:** -
 - > Reduce reliance on gas and therefore reduce costs.

- > Payback period of ~20 years per dwelling.
- > **Land Use Issues and Space Required:** -
 - > Installed on roof so no impact on land use.
 - > Requires hot water cylinders in dwellings.
 - > Due to amount of roof space required and distance from tank to panels, less suitable for dense developments of relatively high rise flats.
 - > Within permitted development rights unless in a conservation area where they must not be visible from the public highways.
 - > Dormer and Velux windows may conflict if energy/CO₂ reduction required is large.
- > **Operational Impacts/Issues:** - Biggest reductions achieved by people who operate their hot water system with consideration of the panels.
 - > Embodied Energy: - Carbon payback is ~2 years.
 - > Funding Opportunities: - none
- > **Reductions in Energy Achievable:** - Reduce primary energy demand by more per standard panel area than solar PV panels.
 - > Reductions in CO₂ Achievable: - Comparable to solar PV per m².
- > **Advantages:** - Virtually free fuel, low maintenance and reductions in energy/CO₂.
- > **Disadvantages:** - Benefits limited to maximum ~50% of hot water load.
 - > Higher Costs in comparison to PV
- > **Application:** - Best suited for small to medium housing developments ~1-100

6. SOLAR PHOTOVOLTAIC (PV) PANELS

- > Solar PV panels generate electricity by harnessing the power of the sun. They convert solar radiation into electricity which can be used on site or exported to the grid in times of excess generation.
- > **Performance and Calculation Methodology:** -
 - > The best PV panels operate with an efficiency approaching 20%. ~7m² of these high performance panels will produce 1kWp of electricity.

- > Operate best on south facing roofs angled at 30-45° or on flat roofs on frames. Panels orientated east/west suffer from a loss in performance of 15-20% depending on the angle of installation.
- > Must be free of any potential shading.
- > Cannot be installed horizontally as would prevent self-cleaning. Must therefore be angled and separated to avoid overshadowing each other.
- > Electricity produced displaces grid electricity which has a carbon intensity of 0.519 kg CO₂ per kWh.
- > **Capital Cost:** - ~£2,000 per kWp.
- > **Running Costs/Savings:** -
 - > Reduce reliance on grid electricity and therefore reduce running costs.
 - > At current electricity prices, payback period of ~60-70 years per dwelling.
 - > Feed-in tariff and Renewables Obligation Certificates (ROCs) payments required for maximum financial benefit.
- > **Land Use Issues and Space Required:** -
 - > Installed on roof so no impact on land use.
 - > Due to amount of roof space required are less suitable for dense developments of relatively high rise flats.
 - > Within permitted development rights unless in a conservation area where they must not be visible from the public highways.
 - > Dormer and Velux windows may conflict if energy/CO₂ reduction required is large.
- > **Operational Impacts/Issues:** -
 - > Proportionately large arrays may need electrical infrastructure upgrade.
 - > Virtually maintenance free and panels are self-cleaning at angles in excess of 10 degrees.
 - > Provision for access to solar panels installed on flat roofs needs to be incorporated into the design of PV arrays layout as well as inclusion of spaces for inverters within the development.
 - > Quality of PV panels varies dramatically.
- > **Embodied Energy:** - Carbon payback of 2-5 years.
- > **Funding Opportunities:** - Financier utilising Feed-in-Tariffs.
- > **Reductions in Energy Achievable:** - Reduce energy demand by less per m² than solar thermal panels.
- > **Reductions in CO₂ Achievable:** - Provide greater percentage reductions in CO₂ than energy. Comparable to solar thermal per square metre.

- > **Advantages:** - Virtually free fuel, very low maintenance and good reductions in CO₂.
 - > Cheaper in comparison to solar thermal panels.
- > **Disadvantages:** -
 - > Slightly greater loss in performance than solar thermal panels when orientated away from south.
- > **Application:** Best suited for a variety of developments from single houses to multi apartment blocks and even whole estates.

7. GROUND SOURCE HEAT PUMPS (GSHPS)

- > Ground Source Heat Pumps work in much the same way as a refrigerator, converting low grade heat from a large 'reservoir' into higher temperature heat for input in a smaller space. Electricity drives the pump which circulates a fluid (water/antifreeze mix or refrigerant) through a closed loop of underground pipe. This fluid absorbs the solar energy that is stored in the earth (which in the UK remains at a near constant temperature of 12°C throughout the year) and carries it to a pump. A compressor in the heat pump upgrades the temperature of the fluid which can then be used for space heating and hot water.

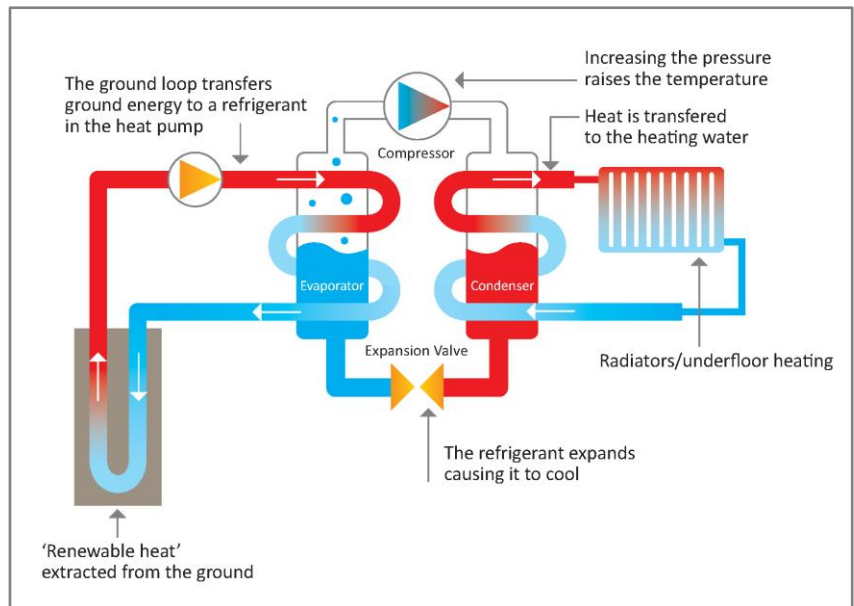


Diagram 3 – Ground Source Heat Pump

- > **Performance and Calculation Methodology:** -

- > System requires electricity to drive the pump. Therefore displaces gas heating with electric, which has higher carbon intensity (gas: 0.216; electricity: 0.519).
- > As they are upgrading heat energy from the earth, GSHPs operate at 'efficiencies' in excess of 350%. This is limited in SAP unless Appendix Q rated model used.
- > Due to the lower temperature of the output of GSHPs compared to traditional gas boilers, GSHPs work best in well insulated buildings and with underfloor heating. They can, however, also be installed with oversized radiators, albeit with a consequent reduction in performance.
- > **Capital Cost:** - ~£7,500 per house. Additional costs if underfloor heating is to be installed.
- > **Running Costs/Savings:** -
 - > Electricity more expensive than gas, thus fuel costs not reduced as much as energy is reduced.
 - > Payback period of ~20 years per dwelling.
- > **Land Use Issues and Space Required:** -
 - > Require extensive ground works to bury the coils that extract the low grade heat from the earth. They therefore require a large area for horizontal burial (40-100m long trench) or a vertical bore (50-100m) which is considerably more expensive but can be used where space is limited.
 - > Best suited to new developments that have provision for large ground works already in place, to minimise ground work costs.
 - > Must be sized correctly to prevent freezing of the ground during winter and consequent shutdown of the system.
 - > May require planning permission for engineering works. Once buried, there is no external evidence of the GSHPs.
- > **Operational Impacts/Issues:** -
 - > Work best in well insulated houses.
 - > Need immersion backup for hot water.
 - > Highly reliable and require virtually no maintenance.
 - > Problems if ground bore fails.
- > **Embodied Energy:** - Low, but as gas is being replaced with the more carbon intensive electricity, carbon payback is slowed. Carbon payback depends on CoP.
- > **Funding Opportunities:** - Renewable Heat Incentive (RHI) provides incentive funds to developers of small or medium installations with a reasonable heat load that meet a minimum energy efficiency standard & meet the RHI eligibility criteria.

- > **Reductions in Energy Achievable:** - Reduce energy demand by less per m² than solar thermal panels.
- > **Reductions in CO₂ Achievable:** - Provide greater %age reductions in CO₂ than energy. Comparable to solar thermal (esp. in SAP).
- > **Advantages:** - Large reductions in Energy. Currently receives benefit from SAP of an electrical baseline rather than gas.
- > **Disadvantages:** -
 - > Small reduction in CO₂. CoP limited in SAP. Only small cost savings.
 - > GSHPs are not entirely a 'renewable' technology as they require electricity to drive their pumps or compressors.
- > **Application:** - Best suited for small to medium developments ~1-100

8. AIR SOURCE HEAT PUMPS (ASHPS)

- > Air Source Heat Pumps work in much the same way as a refrigerator, converting low grade heat from a large 'reservoir' into higher temperature heat for input into a smaller space. Electricity drives the pump which extracts heat from the air as it flows over the coils in the heat pump unit. A compressor in the heat pump upgrades the temperature of the extracted energy which can then be used for space heating and hot water.

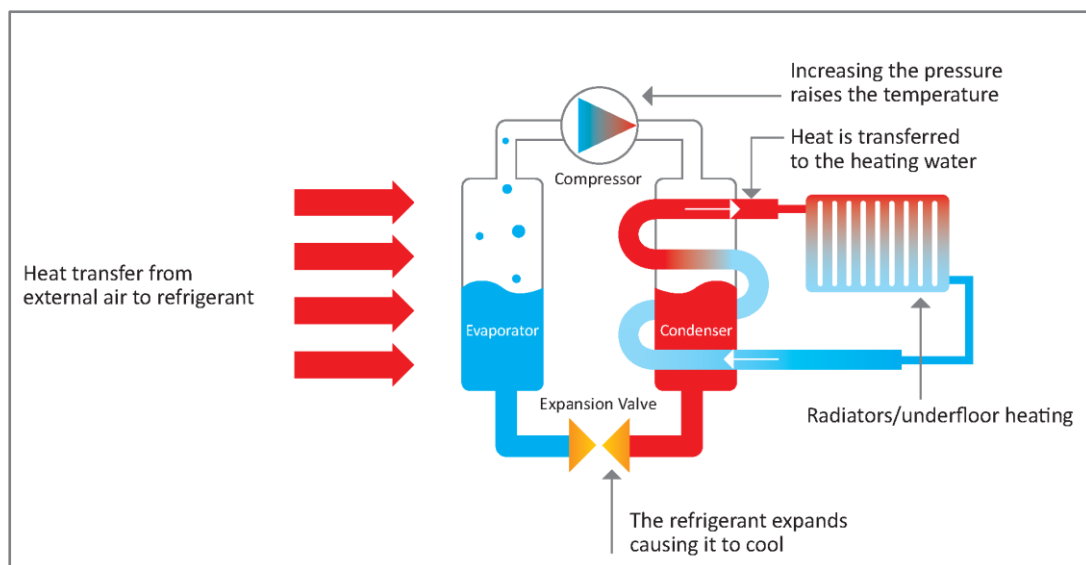


Diagram 4 – Air Source Heat Pump

- > Generally ASHPs are air-to-water devices but can also be air-to-air.
- > **Performance and Calculation Methodology: -**
 - > System requires electricity to drive the pump. Therefore displaces gas heating with electric, which has higher carbon intensity (gas: 0.216; electricity: 0.519).
 - > Performance defined by the Coefficient of Performance (CoP) which is a measure of electricity input to heat output. However, the concept of a CoP must be treated with caution as it is an instantaneous measurement and does not take account of varying external conditions throughout the year.
 - > As they are upgrading heat energy from the air, ASHPs operate at 'efficiencies' in excess of 250%. This is limited in SAP unless an Appendix Q rated model is used.
 - > British winter conditions (low temperatures and high humidity) lead to freezing of external unit. Reverse cycling defrosts the ASHP, but can substantially reduce performance when it is most needed. Performance under these conditions varies considerably between models. Vital that ASHP that has been proven in British winter conditions is installed.
 - > Due to the lower temperature of the output of ASHPs compared to traditional gas boilers, ASHPs work best in well insulated buildings and with underfloor heating. They can, however, also be installed with oversized radiators, albeit with a consequent reduction in performance.
- > **Capital Cost: -** ~£2,000 per house.
- > **Running Costs/Savings: -**
 - > Electricity more expensive than gas, thus fuel costs not reduced as much as energy is reduced.
 - > Payback period of ~10 years per dwelling.
- > **Land Use Issues and Space Required: -**
 - > No need for external ground works, only a heat pump unit for the air to pass through.
 - > Minimal external visual evidence.
- > **Operational Impacts/Issues: -**
 - > Work best in well insulated houses.
 - > Unit must be sized correctly for each dwelling.
 - > Vital that ASHP model selected has been proven to maintain performance at the low temperature and high humidity conditions of the British winter.
 - > May need immersion backup for hot water.
 - > Highly reliable and require virtually no maintenance.

- > Noise from ASHPs must be below 42 dB at a position one metre external to the centre point of any door or window in a habitable room. According to planning standards MCS020.
 - > **Embodied Energy:** - Low. Carbon payback longer than for GSHPs as the CoP is lower.
 - > **Funding Opportunities:** - Renewable Heat Incentive (RHI) provides incentive funds to developers of small or medium installations with a reasonable heat load that meet a minimum energy efficiency standard & meet the RHI eligibility criteria.
 - > **Reductions in Energy Achievable:** - Large reductions in energy demand. Less so than GSHPs.
 - > **Reductions in CO₂ Achievable:** - Provide smaller percentage reductions in CO₂ than energy. Less than GSHPs.
 - > **Advantages:** - Large reductions in Energy. Currently receives benefit from SAP of an electrical fuel factor rather than a gas baseline.
 - > **Disadvantages:** -
 - > Small reduction in CO₂ CoP limited in SAP. Only small cost savings.
 - > ASHPs are not entirely a 'renewable' technology as they require electricity to drive their pumps or compressors.
 - > **Application:** - Best suited for small to medium developments ~1-100
-

9. WIND POWER

- > Wind energy installations can range from small domestic turbines (1kW) to large commercial turbines (140m tall, 2MW). There are also different designs and styles (horizontal or vertical axis; 1 blade to multiple blades) to suit the location. They generate clean electricity that can be provided for use on-site, or sold directly to the local electricity network
- > **Performance and Calculation Methodology:** -
 - > Power generated is proportional to the cube of the wind speed. Therefore, wind speed is critical.
 - > Horizontal axis turbines require >~6m/s to operate effectively and vertical axis turbines require >~4.5m/s. The rated power of a turbine is often for wind speeds double these figures.
 - > Wind speeds for area from BERR's Wind Speed Database.

- > Electricity produced displaces grid electricity which has a carbon intensity of 0.568 kg/kWh.
- > **Capital Cost: -**
 - > ~£1,000 per kW. Smaller models are more expensive per kW.
 - > Vertical axis turbines more expensive than horizontal.
- > **Running Costs/Savings: -**
 - > Reduce reliance on grid electricity and therefore reduce costs.
 - > Payback period of ~15-20 years per dwelling.
 - > Feed-in tariff and ROC payments required for maximum financial benefit.
- > **Land Use Issues and Space Required: -**
 - > Smaller models (<6kW) can be roof mounted.
 - > Must be higher than surrounding structures/trees.
 - > Planning permission required.
- > **Operational Impacts/Issues: -**
 - > Urban environments generally have low wind speeds and high turbulence which reduce the effectiveness of turbines.
 - > Vertical axis turbines have a lower performance than horizontal axis turbines but work better in urban environments.
 - > Annual services required.
 - > Turbines rated in excess of 5kW may require the network to be strengthened and arrangements to be made with the local Distribution Network Operator and electricity supplier.
 - > Noise.
- > **Embodied Energy: -** Carbon payback is ~1 year for most turbines.
- > **Funding Opportunities: -** Financier utilising Feed-in-Tariffs.
- > **Reductions in Energy Achievable: -** Significant reduction in reliance on grid electricity.
- > **Reductions in CO₂ Achievable: -** Good. Greater reduction in CO₂ than PV for same investment.
- > **Advantages: -** Virtually free fuel; reductions in CO₂.
- > **Disadvantages: -**
 - > Expensive, although cheaper than PV for same return.
 - > Lack of suitable sites.
 - > Maintenance costs.

- > Often not building integrated.
 - > **Application:** Best suited for small to large developments in rural open areas
-

10. HYDRO POWER

- > Hydro power harnesses the energy of falling water, converting the potential or kinetic energy of water into electricity through use of a hydro turbine. Micro hydro schemes (<100kW) tend to be 'run-of-river' developments, taking the flow of the river that is available at any given time and not relying on a reservoir of stored water. They generate clean electricity that can be provided for use on-site, or sold directly to the local electricity network.
- > **Performance and Calculation Methodology: -**
 - > Flow rates at particular sites from National River Flow Archive held by Centre for Ecology and Hydrology.
 - > Electricity produced displaces grid electricity which has a carbon intensity of 0.568 kg/kWh.
- > **Capital Cost: -**
 - > £3,000 - £5,000 per kW.
 - > Particularly cost effective on sites of old water mills where much of the infrastructure is in place.
- > **Running Costs/Savings: -**
 - > Reduce reliance on grid electricity and therefore reduce costs.
 - > Payback period of ~10-15 years per dwelling
 - > Feed-in tariff and ROC payments required for maximum financial benefit.
- > **Land Use Issues and Space Required: -**
 - > Require suitable water resource.
 - > Visual intrusion of scheme.
 - > Special requirements where river populated by migrating species of fish.
 - > Planning permission will require various consents and licences including an Environmental Statement and Abstraction Licence.
- > **Operational Impacts/Issues: -**
 - > Routine inspections and annual service required.

- > Automatic cleaners should be installed to prevent intake of rubbish.
- > **Embodied Energy:** - Carbon payback for small schemes of ~1 year.
- > **Funding Opportunities:** - Financier utilising Feed-in-Tariffs.
- > **Reductions in Energy Achievable:** - significant reduction in reliance on grid electricity.
- > **Reductions in CO₂ Achievable:** - High.
- > **Advantages:** - Virtually free fuel, reductions in CO₂.
- > **Disadvantages:** -
 - > Expensive, but good payback period.
 - > Lack of suitable sites.
 - > Planning obstructions.
- > **Application:** - Best suited to medium to larger developments in rural places ~ 100+ units

Appendix F

Low Carbon and Renewable Energy Technologies Feasibility Table

Appendix F - Feasibility Table of Low Carbon Renewable Energy Technologies

Feasibility Study Table									
Technology	Sufficient Energy Generated?	Payback	Land Use Issues	Local Planning Requirements	Noise	Carbon Payback	Available Grants	Feasible?	Reason not Feasible or Selected
Combined Heat & Power (CHP)	Yes	Medium	Air quality in residential area	Emphasis on district heating	In Plant Room	Yes	Tax Relief - ECA, RHI	Yes	Existing heat network on site, connection proposed and confirmed
Biomass	Yes	None	Air quality in residential area	Encouraged for large scale developments	In Plant Room	Yes	RHI; Bio-energy Capital Grants Scheme	No	Existing heat network on site, no control over equipment
Solar Thermal	Yes	High	Sufficient roof space required	Encouraged	None	~2 years	RHI	No	Conflicts with CHP, not available roof space
Solar Photovoltaic (PV)	Yes	Very High	Sufficient roof space required	Encouraged	None	2-5 years	FiT	No	Not available roof space associated with the development
Ground Source Heat Pumps (GSHPs)	Yes	High	Requires large area for coils or borehole	Encouraged	None	Low	RHI	No	Site occupied by existing building, no ground floor available
Air Source Heat Pumps (ASHPs)	Yes	Very High	Visual intrusion of external units	None	Low	Low	RHI	Yes	High efficiency, ASHPs to cover both heating and cooling demand
Wind Power	No	Low	Urban Area - low and turbulent wind; Visual impact	Encouraged for large scale developments	Yes	~1 year	FiT	No	Wind speeds in area insufficient
Hydro Power	No	Medium	Requires suitable water resource; Visual impact	None	Low	~1 year	FiT	No	No water source in the vicinity