










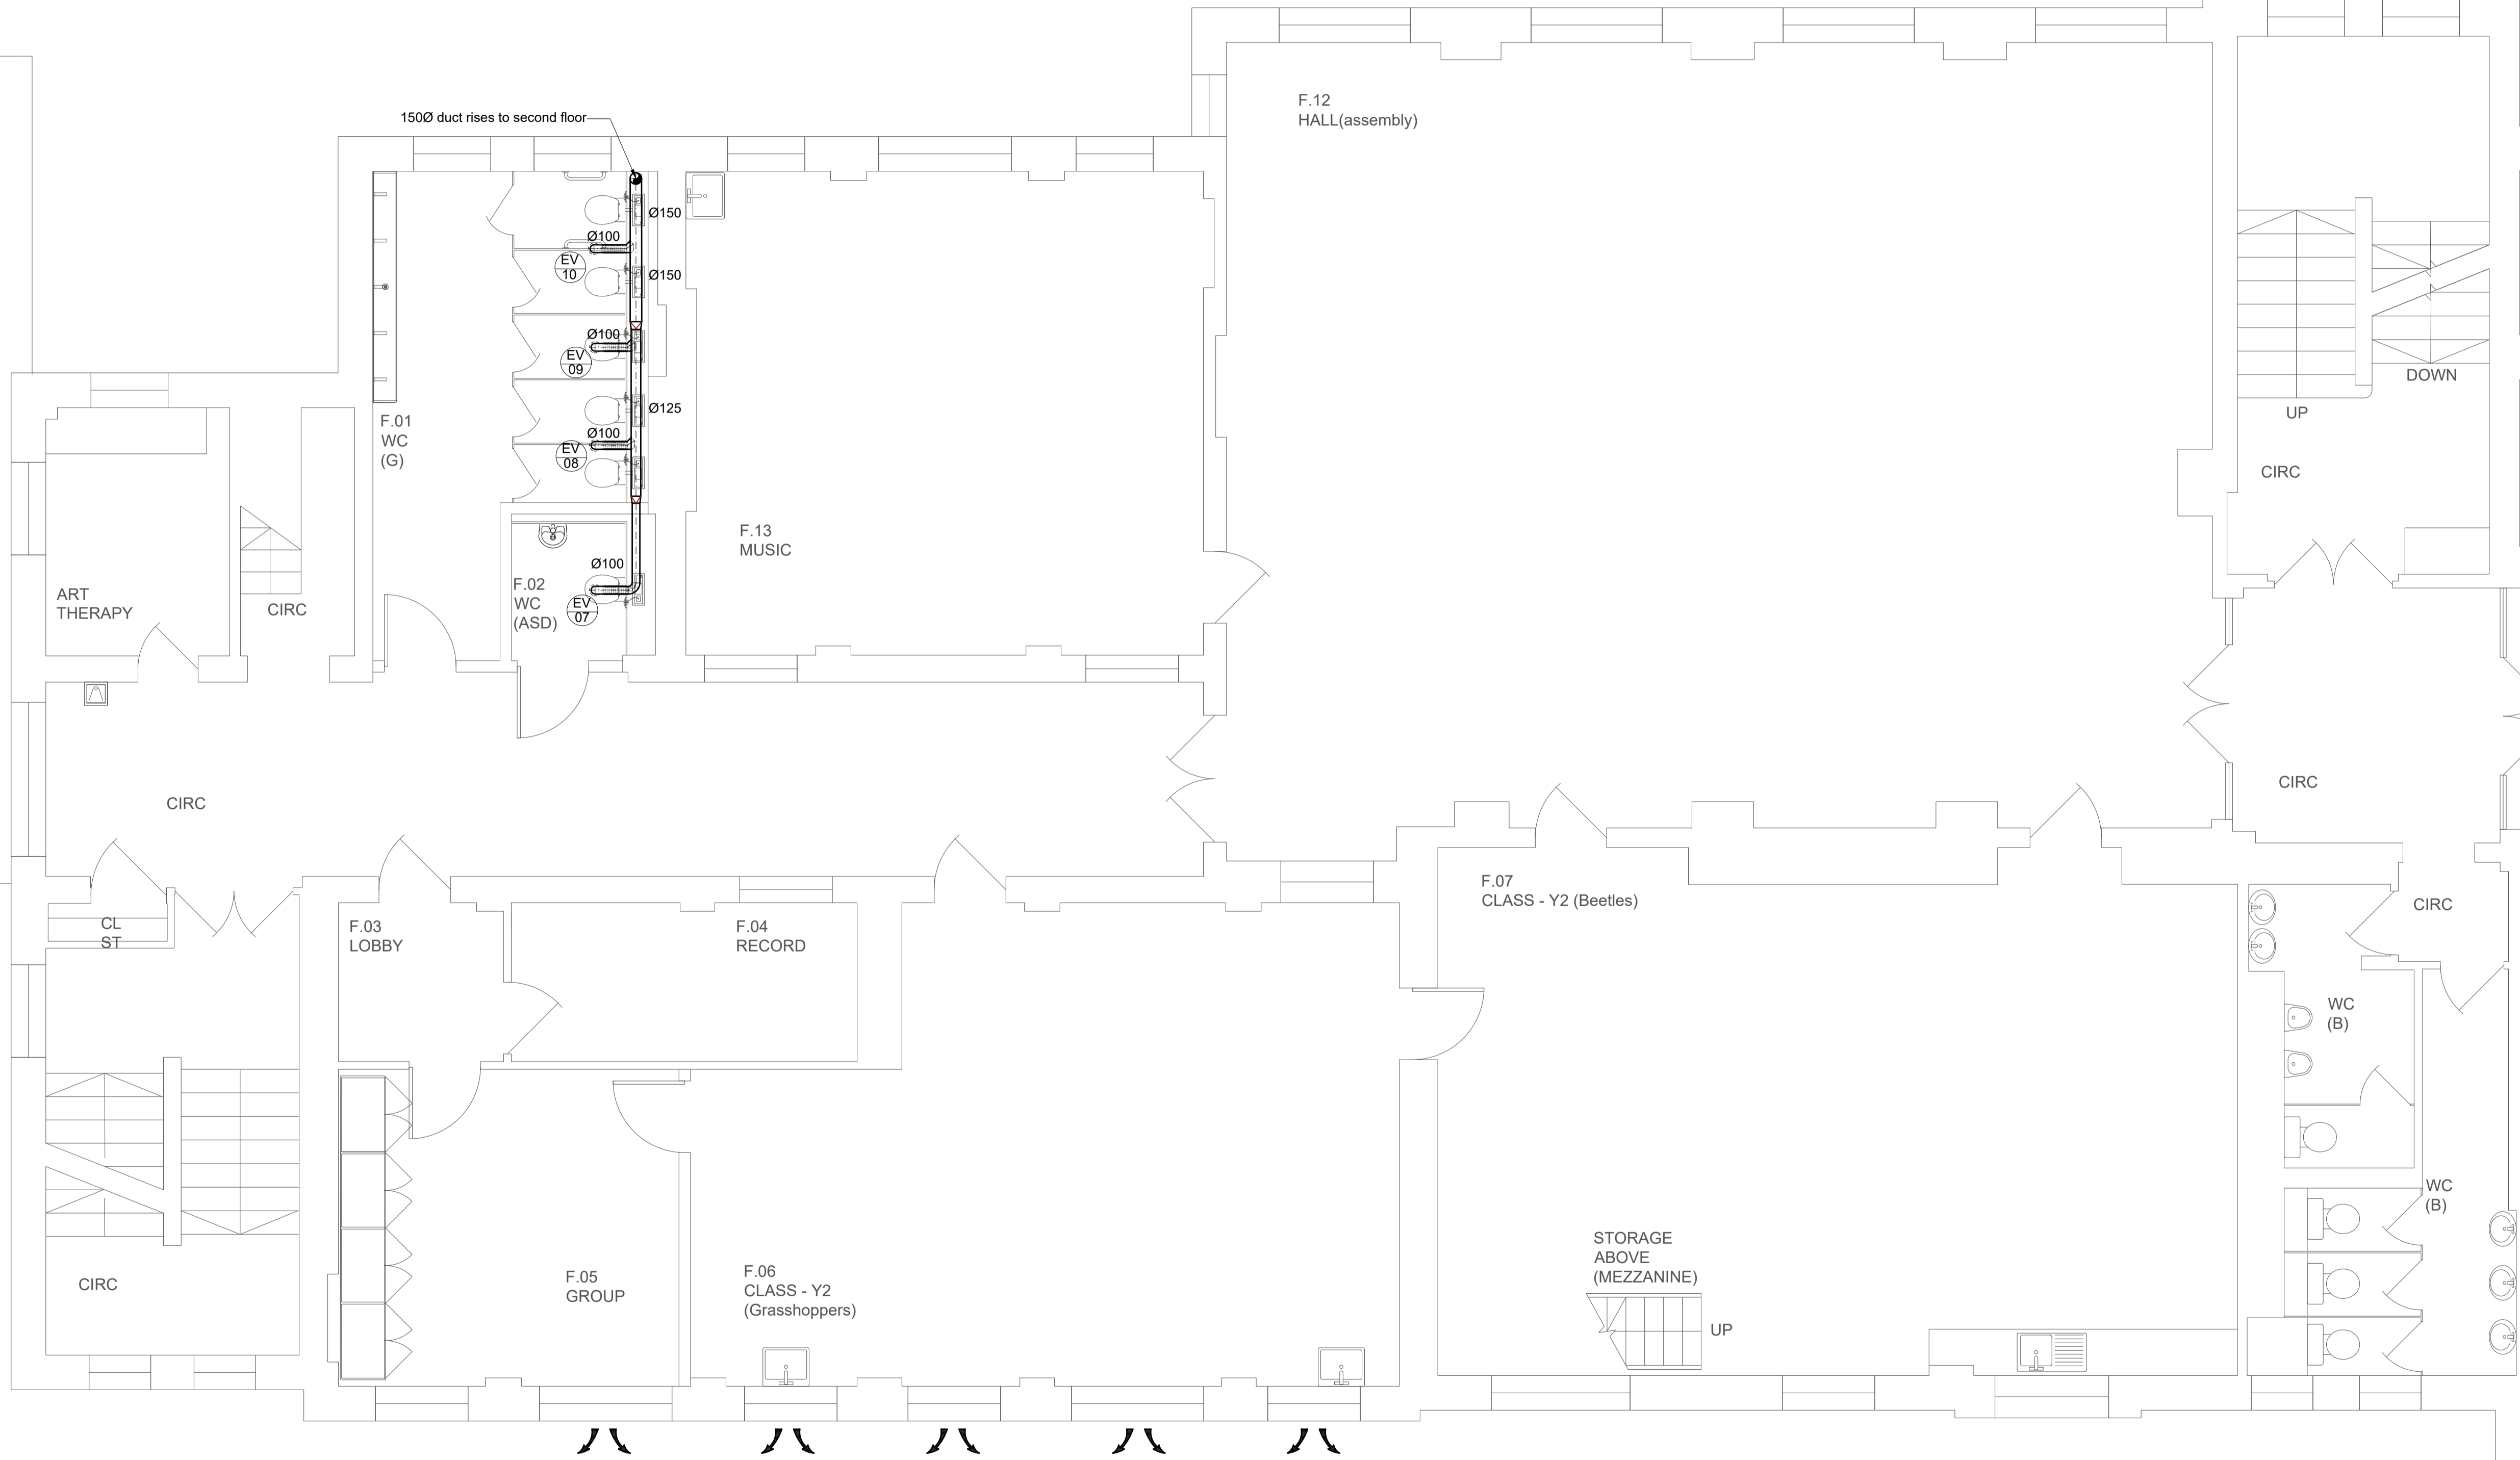
**COPYRIGHT**  
 This drawing is copyright and may not be altered, reproduced or used other than for the Contract Works for which it is issued without written permission.  
 © : Johns Slater and Haward Ltd.

**Notes:**

1. This drawing should be read in conjunction with JSH mechanical services specification ref: EB/CR/5557/M.
2. The School has advised that there is asbestos products in the working areas. The Contractor shall communicate with the Main Contractor and the School prior to any works being undertaken.
3. All terminations and penetrations through external fabric to be undertaken in accordance with the conservation architect's details.

**Legend:**

-  Circular ductwork
-  In-line extract fan
-  Extract valve (EV)
-  External louvre
-  Ceiling void heat recovery unit (HRV)
-  Circular attenuator
-  Supply diffuser (SD)
-  Extract grille (EG)
-  Natural ventilation through the windows




EXTRACT VALVES SCHEDULE		
REF	LOCATION	FLOW RATE (l/s)
EV 07	WC (ASD)	15
EV 08	WC (G)	15
EV 09	WC (G)	15
EV 10	WC (G)	15

P02	Tender Issue	CR	EB	05/19
P01	Tender Issue - WIP	CR	EB	04/19
REV	DESCRIPTION	DR'WN	CHK'D	DATE

**Johns Slater and Haward**  
 Chartered Building Services Consultants  
 Ardennais House, 6 Sorrel Horse Mews, Grimwade St, Ipswich IP4 1LN  
 01473 255965, engineers@jshipswich.co.uk, www.jshipswich.co.uk



CLIENT:  


PROJECT:  
 Primrose Hill School

DRG TITLE:  
 First Floor  
 Proposed Ventilation Layout

SCALE: 1:50 @ A1	STATUS: D2 - Tender	PROJECT: 5557.00	ORIGINATOR: JSH
ZONE: XX	LEVEL: 01	TYPE: DR	DRG No. REV M-0403 P02