


8-11 Montague Street - To be read in conjunction with BDP drawings (20)AP007 Rev B, (20)AP009 Rev A & (20)AE001



Front elevation 8-11 MS - all external lights confirmed removed

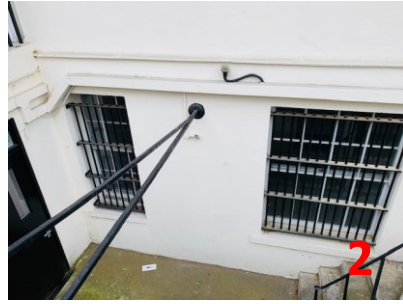

Front lightwell 8 MS - previously installed service light removed



Front lightwell 9 MS - previously installed service light removed



Front lightwell 10 MS - previously installed service light removed




Front lightwell 11 MS - previously installed service light removed



Rear of 11 Montague St - external light fitting installed to provide illumination to the ground floor terrace area, where safe access for maintenance is required to mechanical services and existing rooflights.



Rear lightwell 8 MS - service light installed at 2500mm h

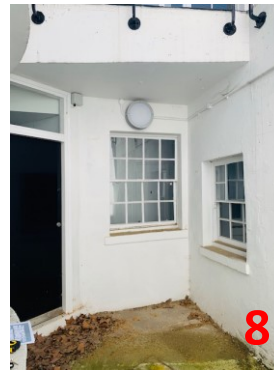

Rear lightwell 9 MS - service light installed at 2500mm h



Rear lightwell 10 MS - service light installed at 2500mm h

\*Note: No lightwell to rear of 11 MS

**8-11 Montague Street** - To be read in conjunction with BDP drawings (20)AP007, (20)AP009 & (20)AE001



**Railings** to rear of 8 MS – 1850mm high



**Railings** to rear of 9 MS – 1850mm high



**Railings** to rear of 10 MS – 1850mm high



**Railings** to rear of 11 MS – 1850mm high



**News sash window B.01.W03**  
Basement level of 8 MS – new sliding timber sash window to match existing rotten and damaged window



**News sash window B.01.W09**  
Basement level of 9 MS – new sliding timber sash window to match existing rotten and damaged window




**News sash window B.01.W13**  
Basement level of 10 MS – new sliding timber sash window to match existing rotten and damaged window

**8-11 Montague Street** - To be read in conjunction with BDP drawings (20)AP007, (20)AP009 & (20)AE001



**Lightwell** to rear of 10 MS reinstated

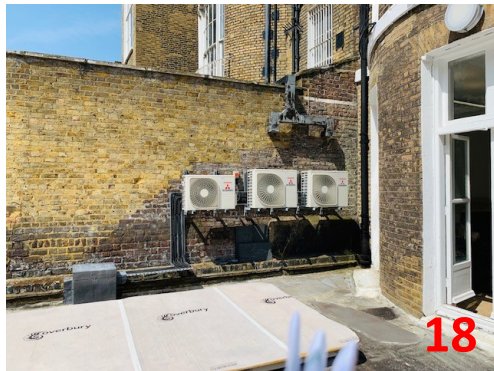

**External mechanical plant** to garden of 11 MS – units are 800w x 620h x 300d installed 1220mm from ground level