

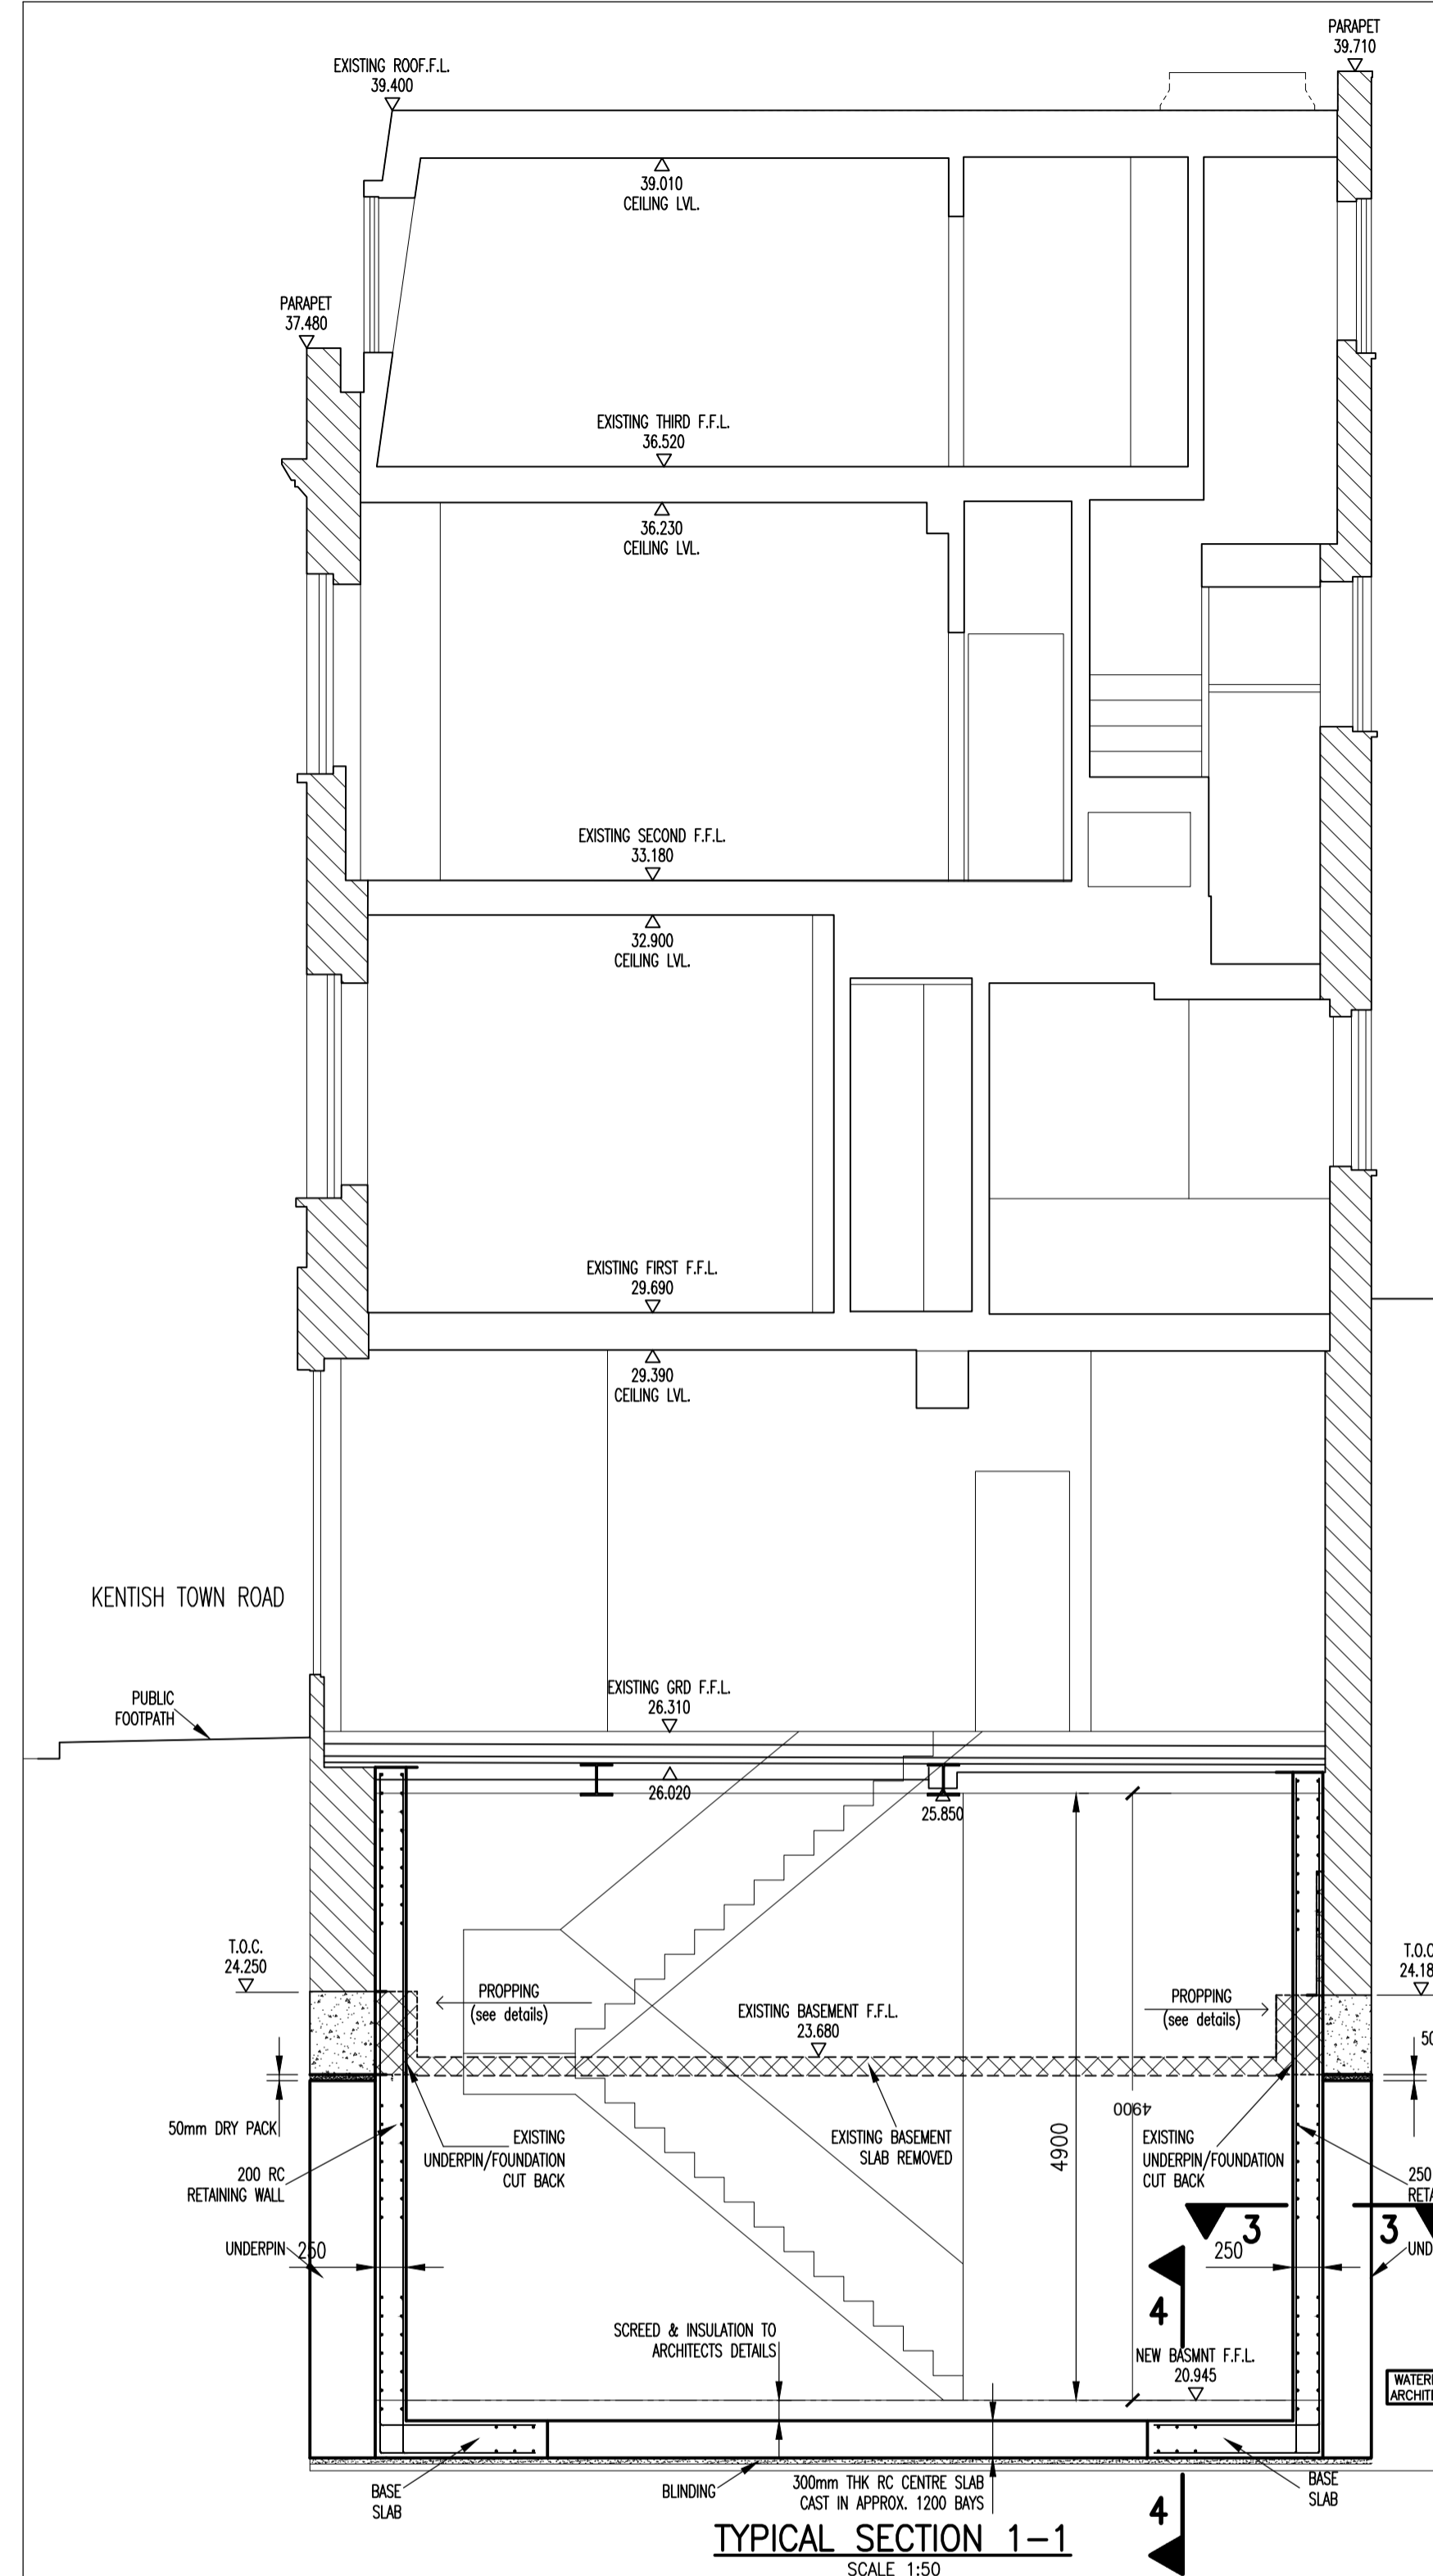


NOTES


1. THE ORIGINAL SIZE OF THIS DRAWING IS A1.
2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS, ENGINEERS, SERVICES ENGINEERS AND ANY OTHER SPECIALISTS DETAILS/DRAWINGS AND THE SPECIFICATION.
3. ALL DIMENSIONS ARE IN MILLIMETRES.
4. ALL LEVELS ARE IN METRES.
5. ALL DIMENSIONS ARE TO BE CONFIRMED AND CHECKED ON SITE PRIOR TO COMMENCEMENT OF FABRICATION DRAWINGS AND/OR SITE WORKS.
6. REACTIONS AND MOMENTS FOR THE DESIGN OF CONNECTIONS FOR STEEL BEAMS/STANCHIONS AND BRACING etc. WILL BE GIVEN BY THE ENGINEER TO ENABLE THE STEELWORK CONTRACTOR TO DESIGN THE CONNECTIONS. IF NOT GIVEN PLEASE ASK. DO NOT MAKE ASSUMPTIONS.
7. ALL WORKS ARE TO BE CARRIED OUT IN ACCORDANCE WITH ALL RELEVANT BRITISH STANDARDS, CODES OF PRACTICE, BUILDING REGULATIONS, HEALTH AND SAFETY REQUIREMENTS AND MANUFACTURERS RECOMMENDATIONS.
8. DO NOT SCALE FROM THIS DRAWING.




TYPICAL SECTION 1-1
SCALE 1:50

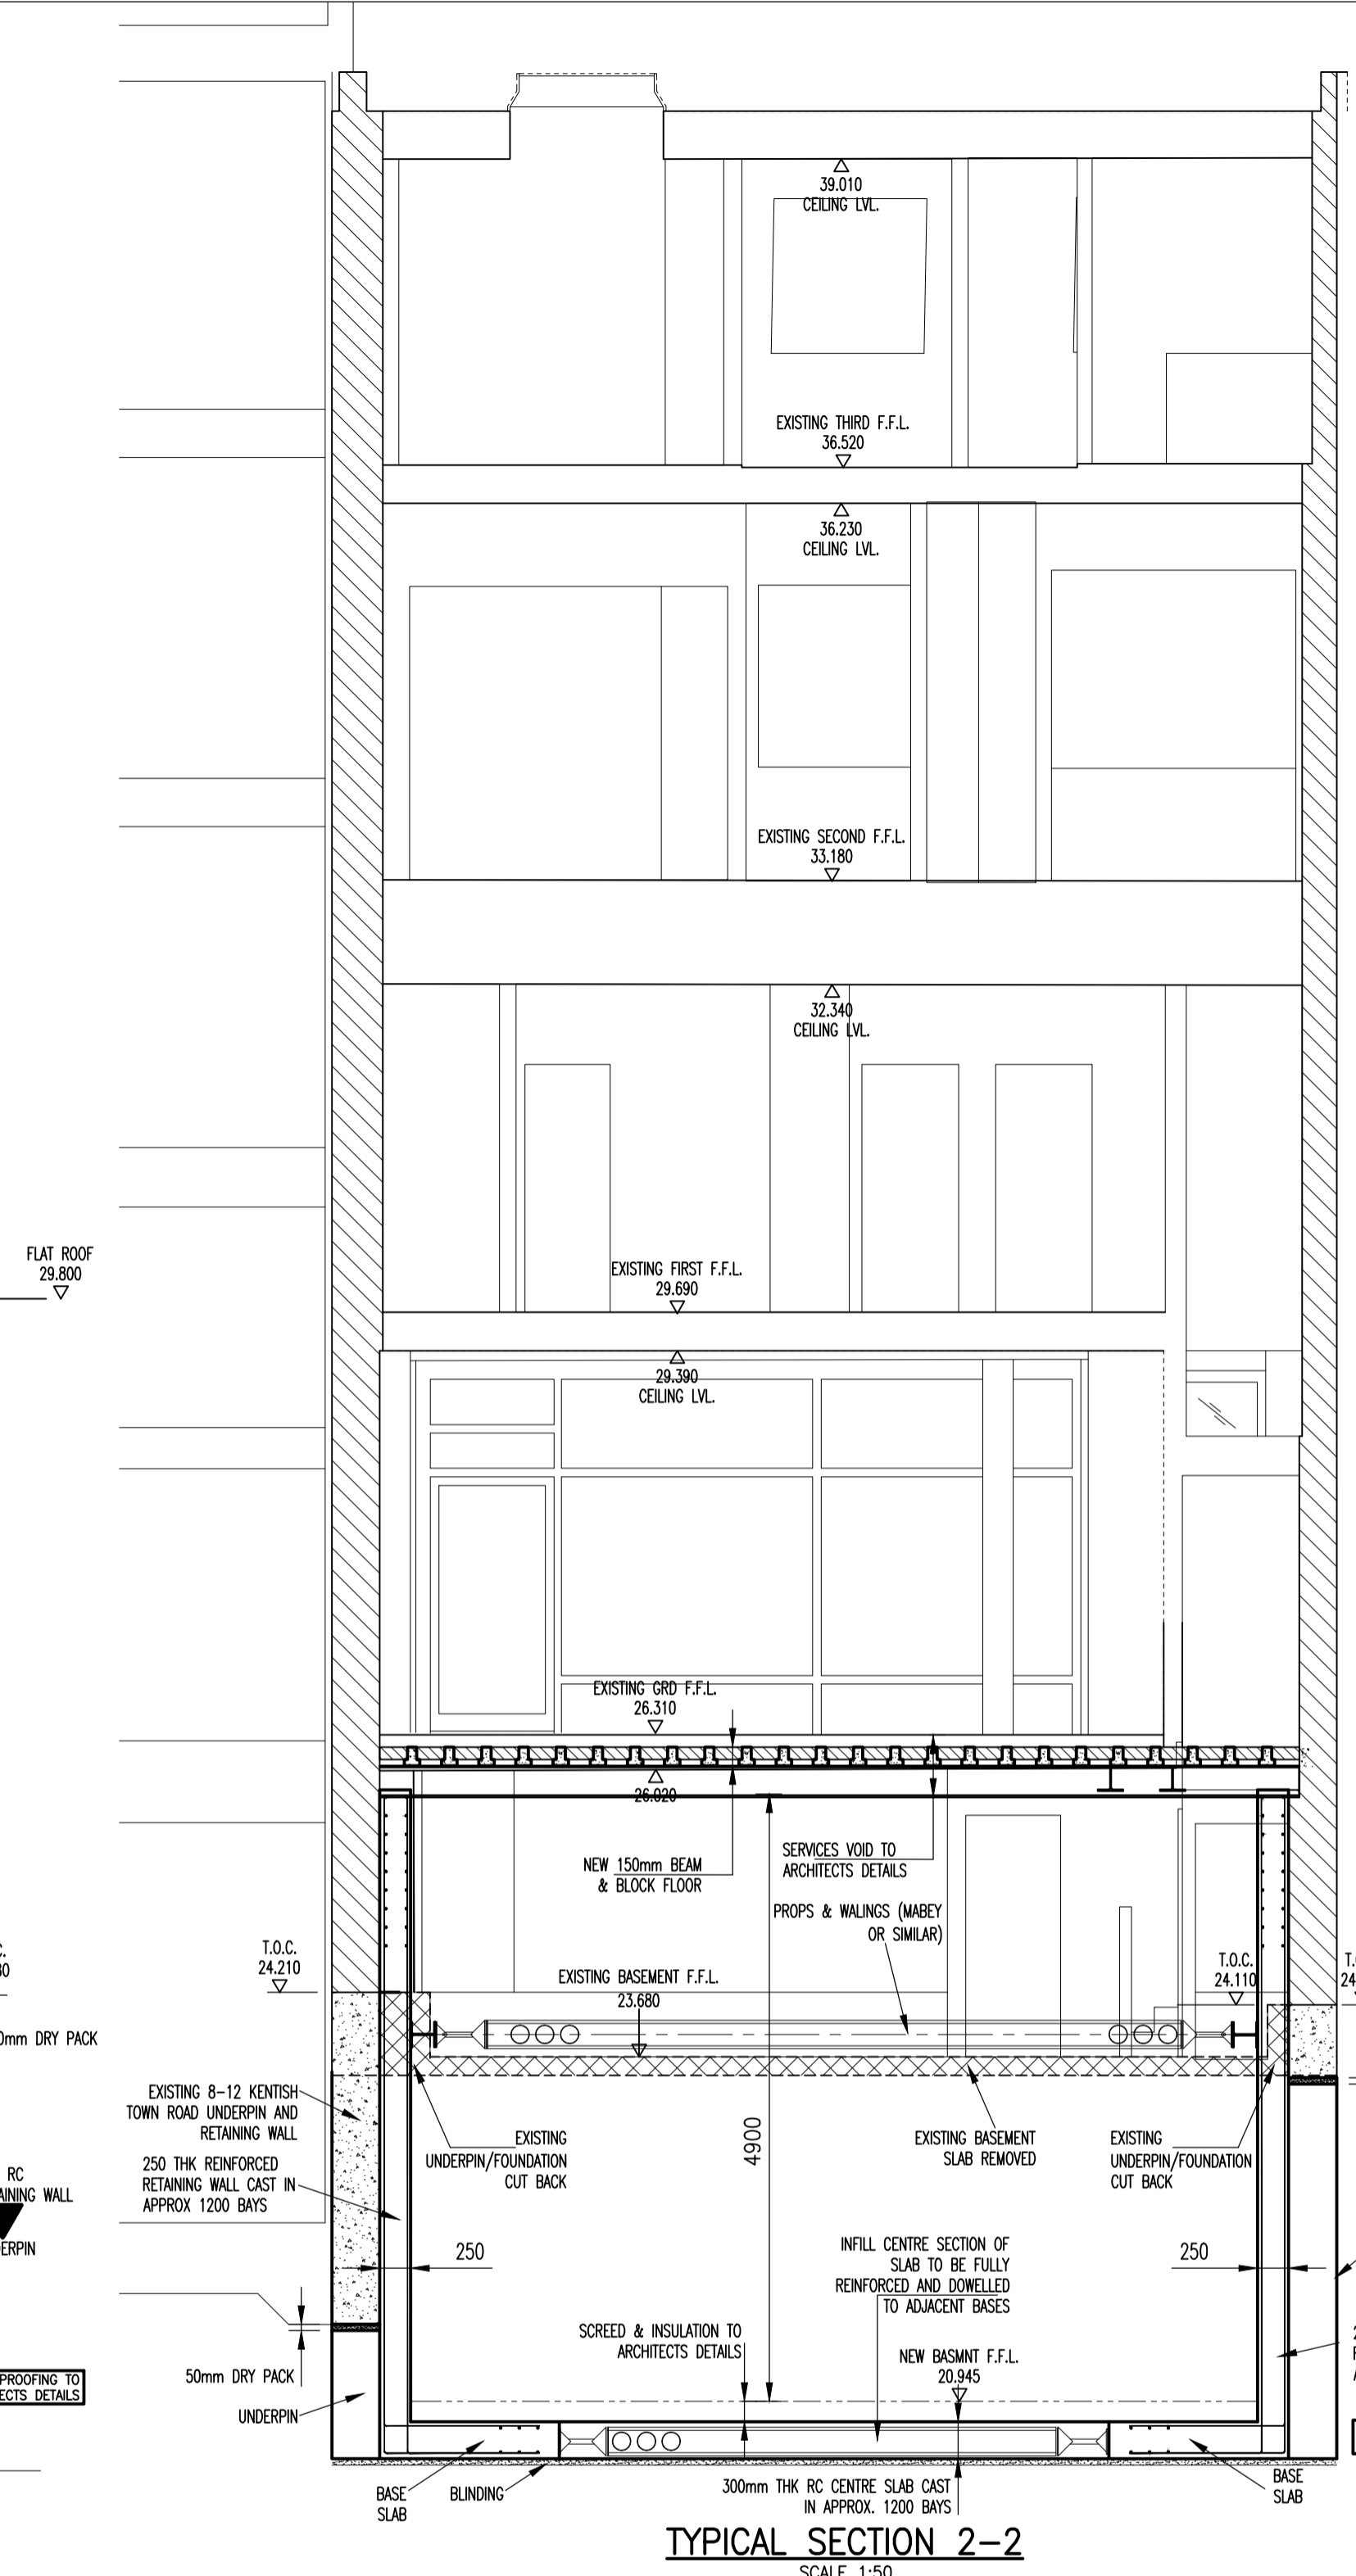


TYPICAL SECTION 2-2
SCALE 1:50

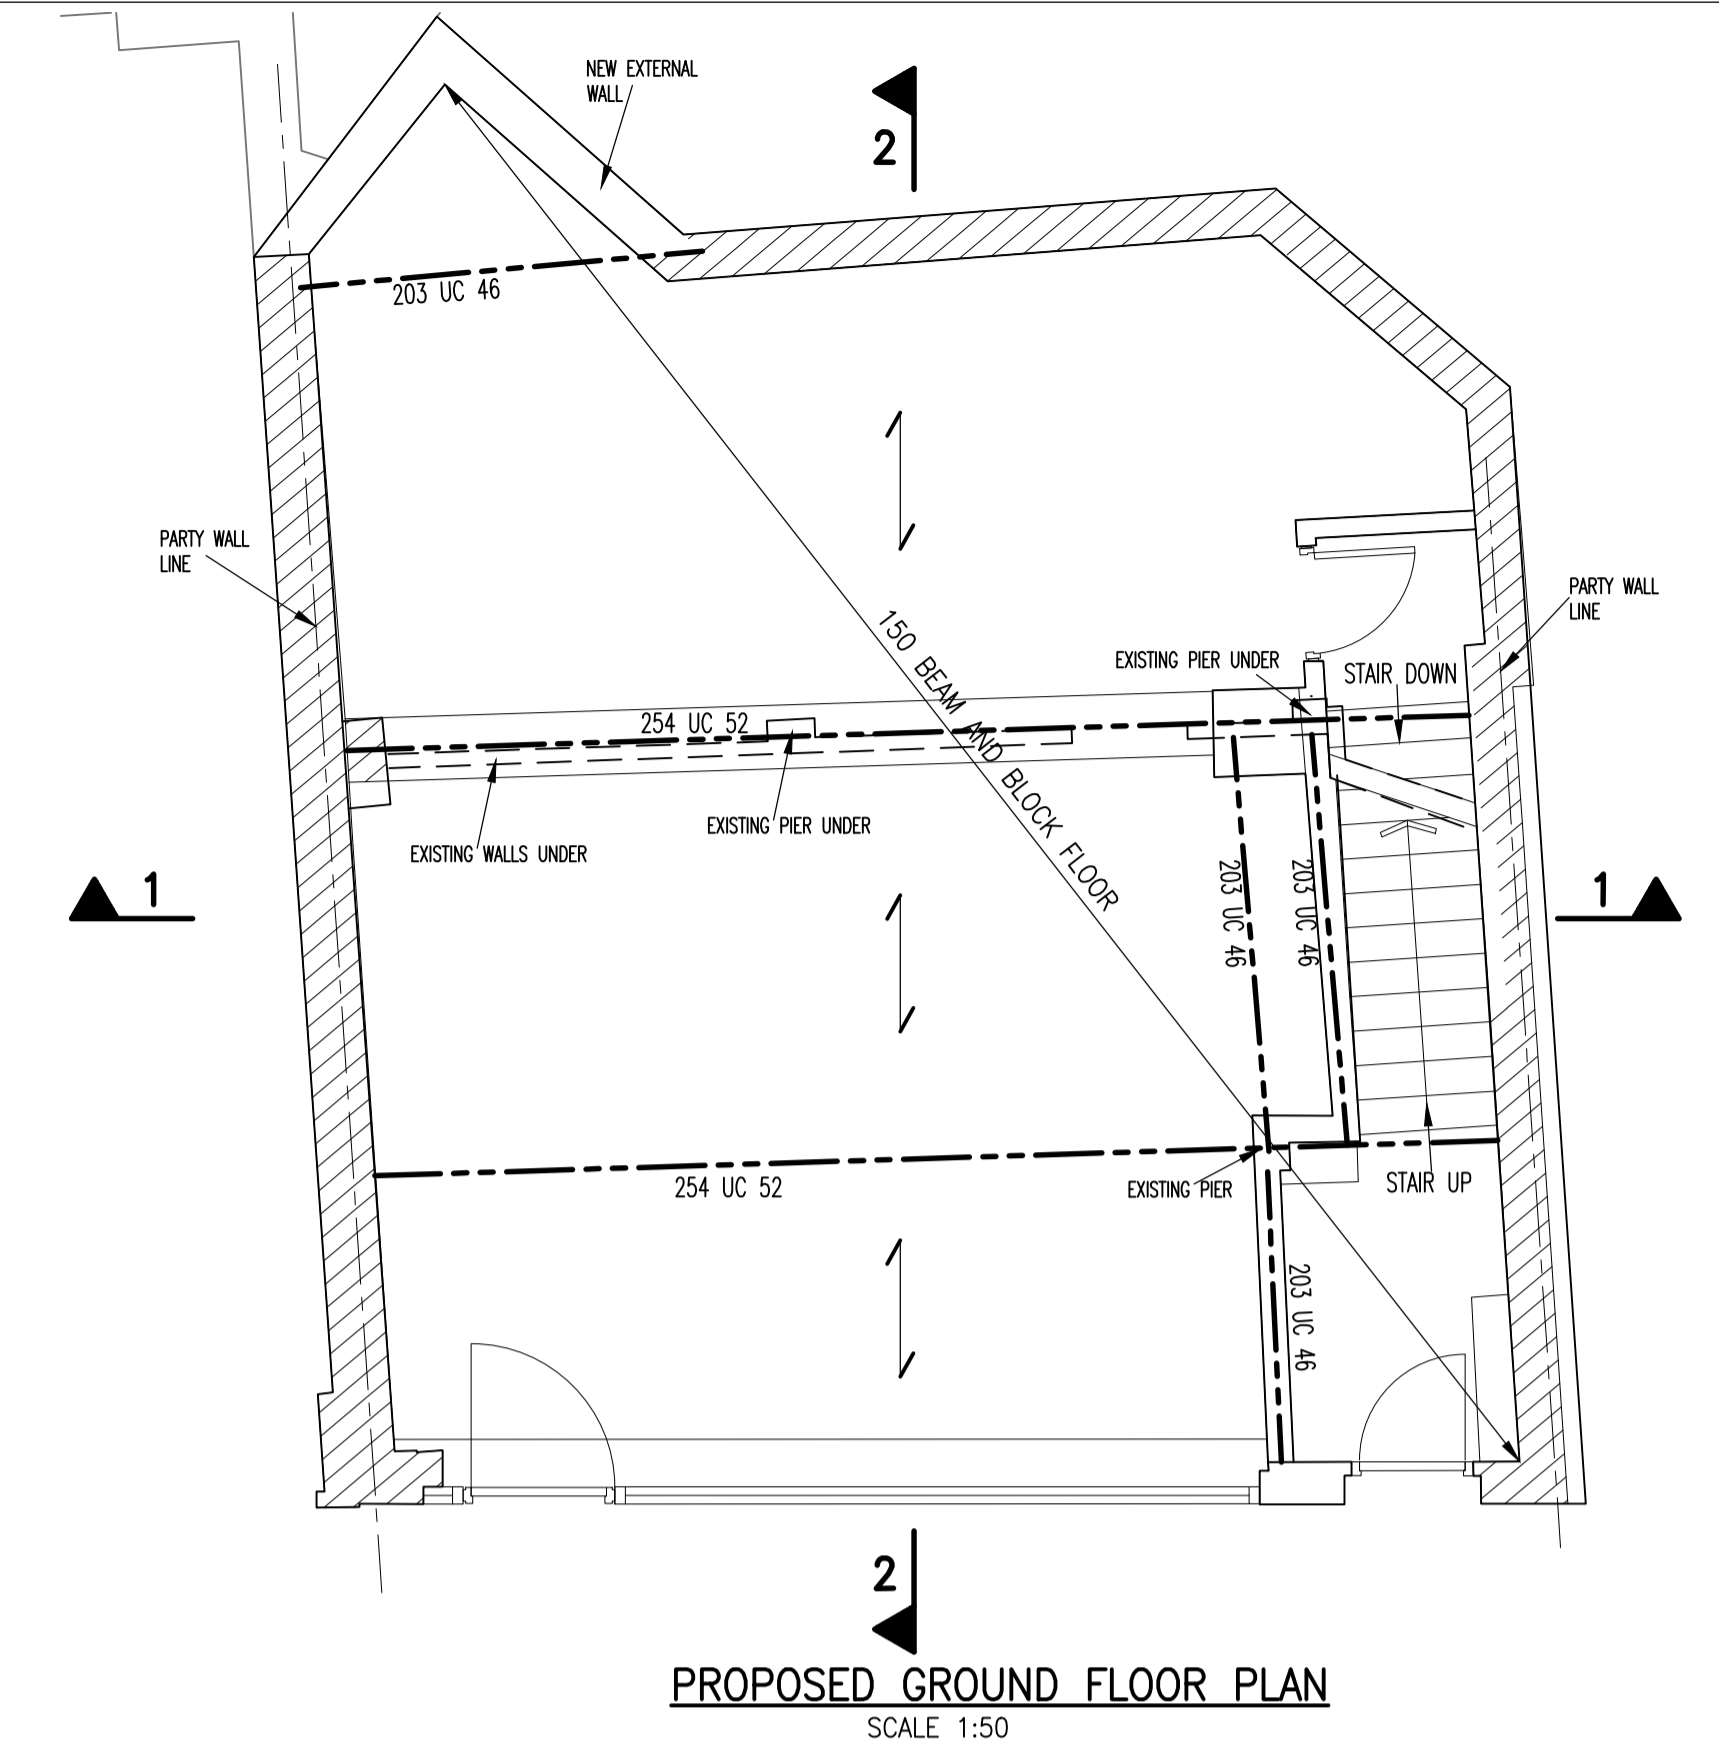

PROPOSED GROUND FLOOR PLAN
SCALE 1:50

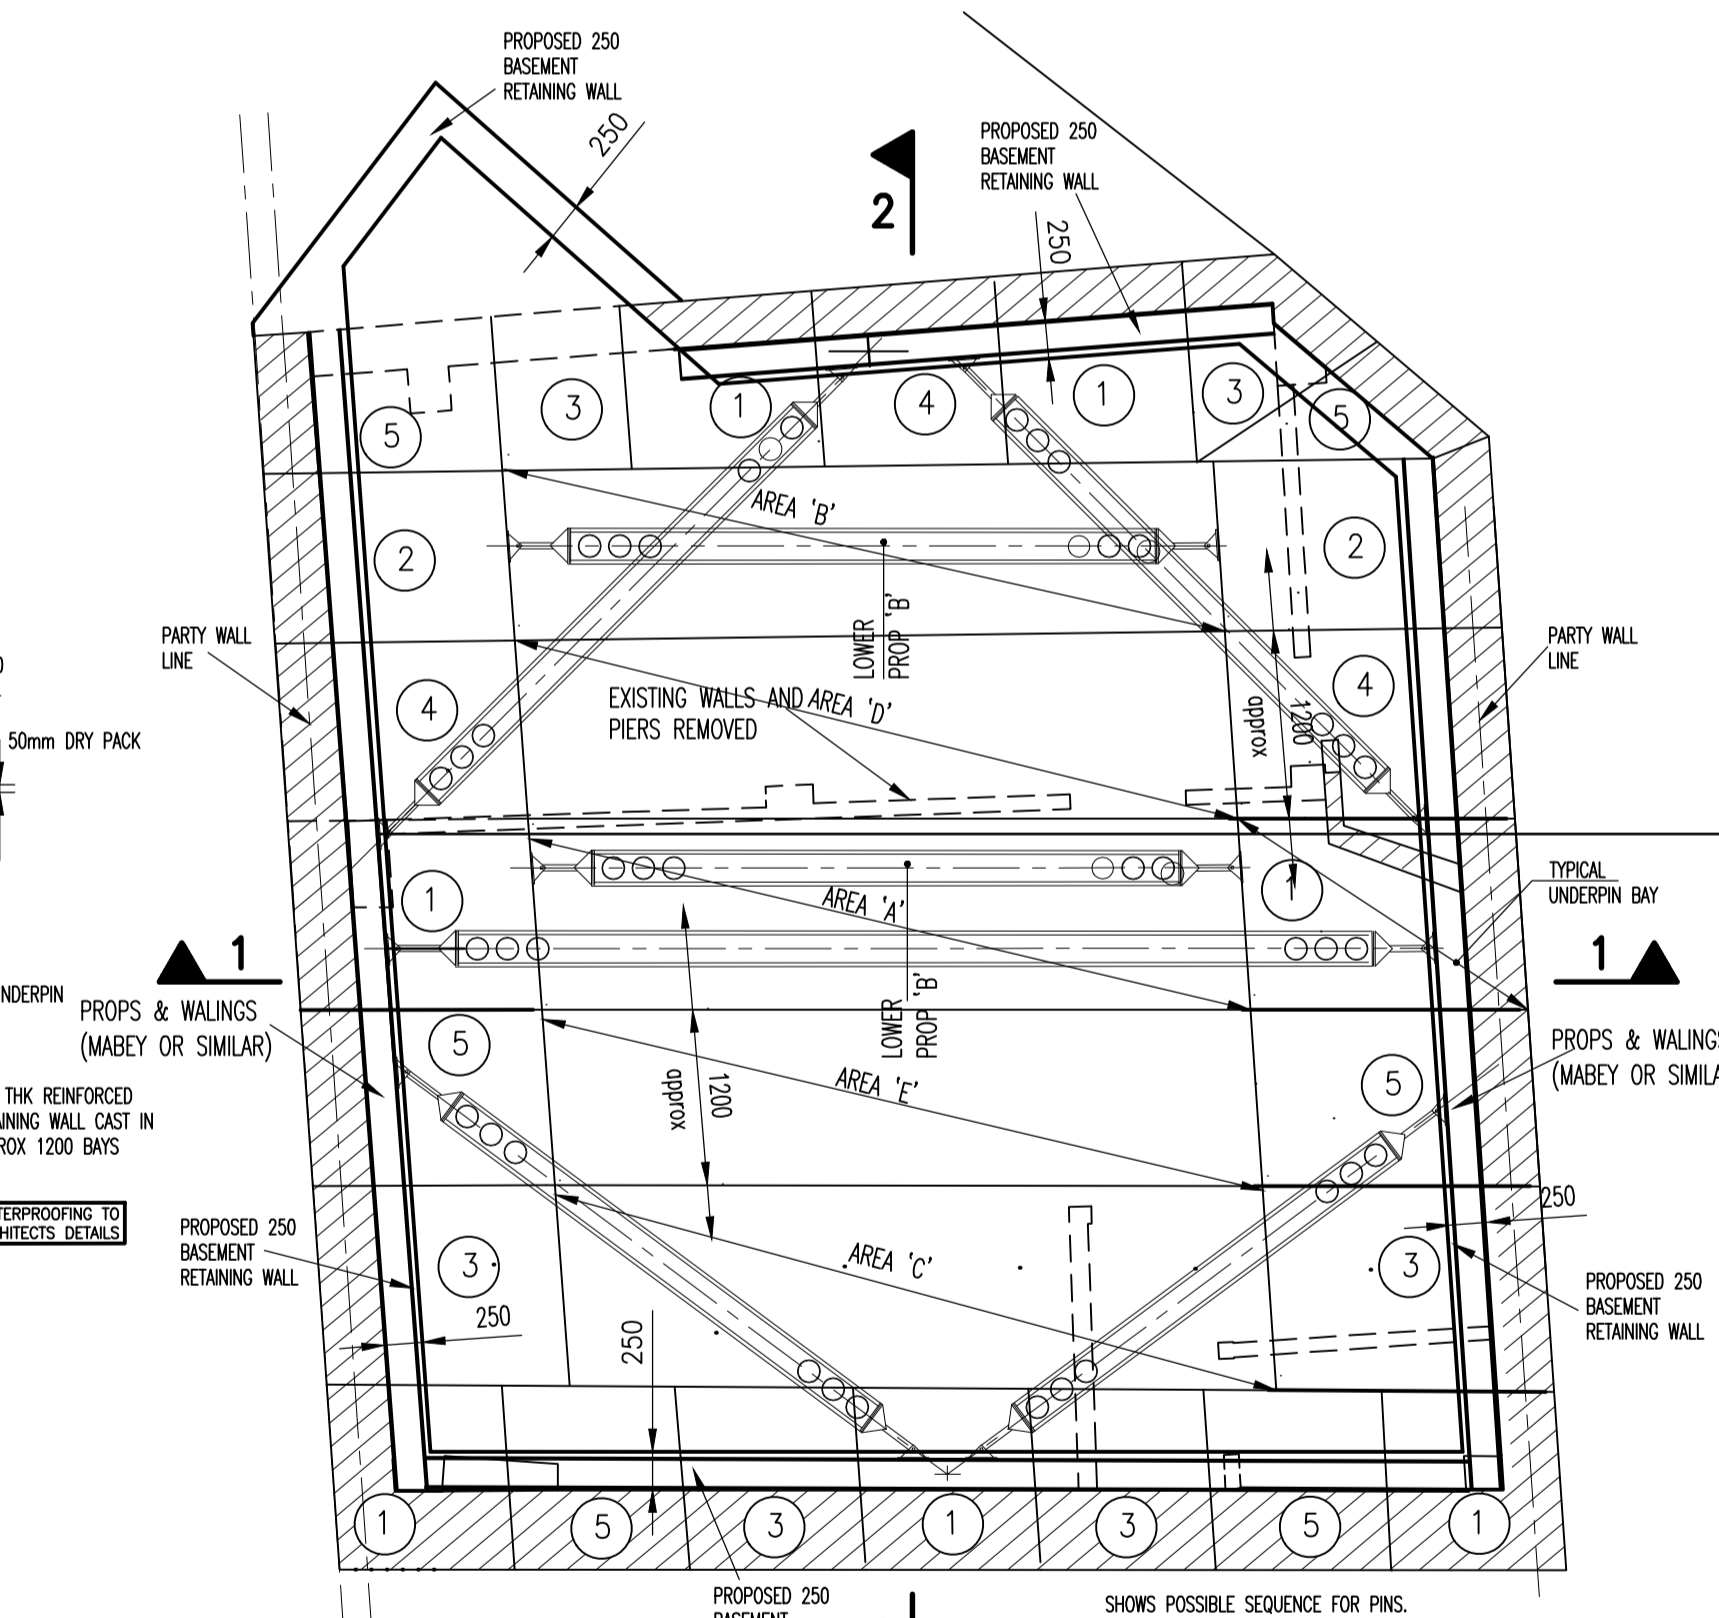


PROPOSED BASEMENT PLAN
SCALE 1:50

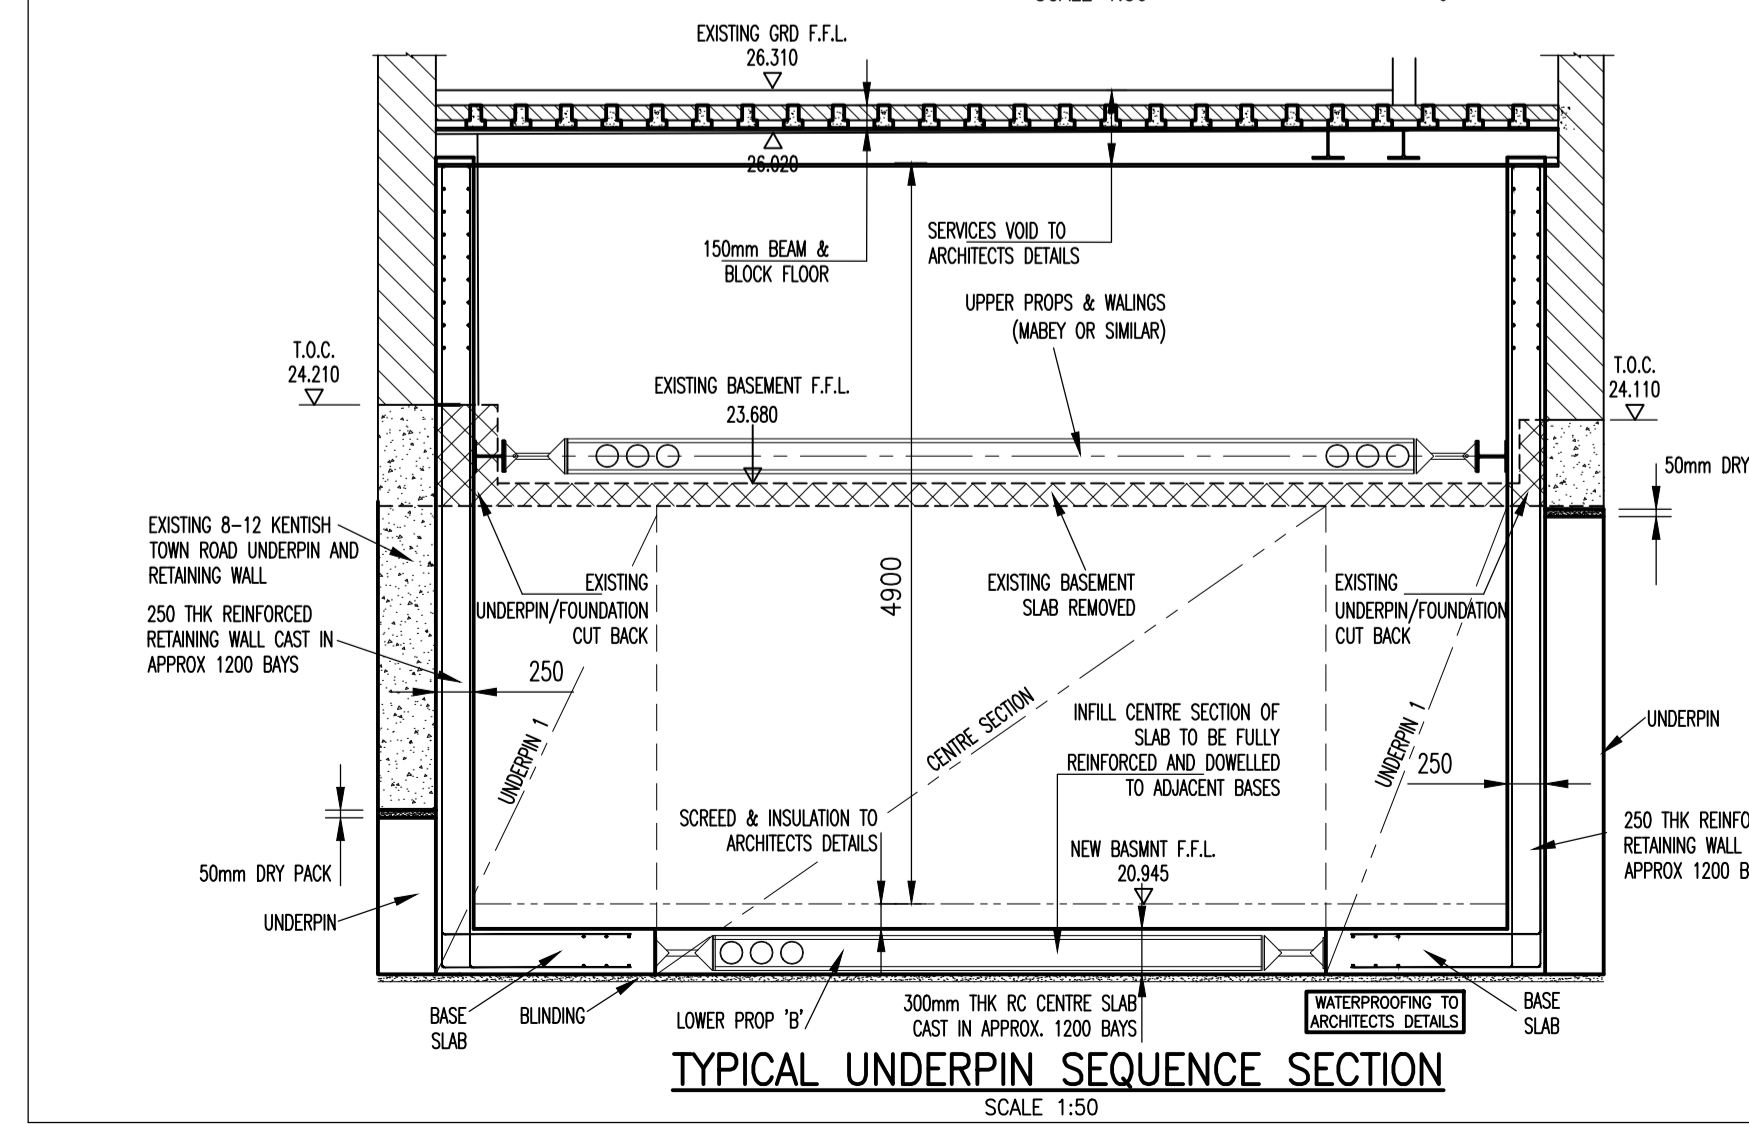


TYPICAL UNDERPIN SEQUENCE SECTION
SCALE 1:50

- TYPICAL SEQUENCE NOTES**
- 1) ALL WORKS TO COMPLY WITH THE LATEST HEALTH & SAFETY REGULATIONS
 - 2) EXCAVATE TO UNDERSIDE OF EXISTING FOUNDATIONS
 - 3) CONSTRUCTION SEQUENCE FOR UNDERPIN 1 AS FOLLOWS:
 - a) EXCAVATE TO LOWEST LEVEL ENSURING SIDES ARE ADEQUATELY SUPPORTED
 - b) REMOVE ALL SOIL AND LOOSE MATERIAL FROM UNDERSIDE OF EXISTING FOUNDATION
 - c) FIX REINFORCEMENT
 - d) CAST BASE SLAB
 - e) CAST 50mm DRY PACK
 - f) DRY PACK WITH 1:3 DRY MIX RANDED IN
 - 4) EXCAVATE CENTRAL AREA BETWEEN UNDERPINNINGS 1 TO UNDERSIDE OF PROPPING
 - 5) INSTALL UPPER PROPPING A SYSTEM
 - 6) EXCAVATE AREA 'A' TO UNDERSIDE SLAB & INSTALL LOWER PROP B
 - 7) REPEAT (3-7) FOR AREAS 'B' & 'C'
 - 8) FIX SLAB REINFORCEMENT AREAS C, D AND E
 - 9) CAST CENTRAL SLAB C, D AND E
 - 10) REMOVE LOWER PROPS AREAS A AND B FIX REINFORCEMENT AND CAST SLAB A AND B
 - 11) INSTALL NEW GROUND BEAM AND BLOCK FLOOR
 - 12) REMOVE UPPER PROPS

NOTE: REINFORCEMENT TO HAVE MINIMUM 50 MM COVER AT VERTICAL JOINTS BETWEEN SECTIONS. ANY HORIZONTAL JOINTS REQUIRED IN CONCRETE CONSTRUCTION TO HAVE WATERSTOP ON OUTSIDE FACE.

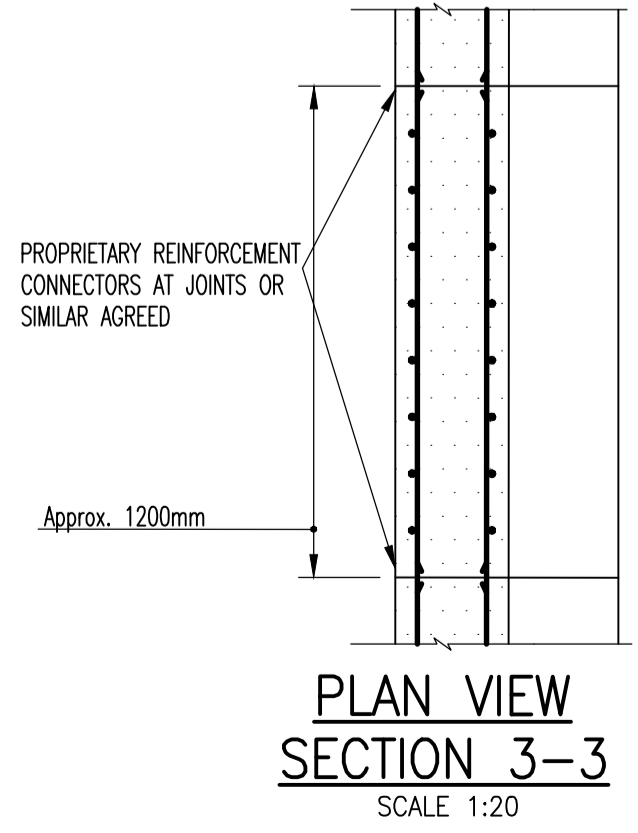

PLAN VIEW SECTION 3-3
SCALE 1:20

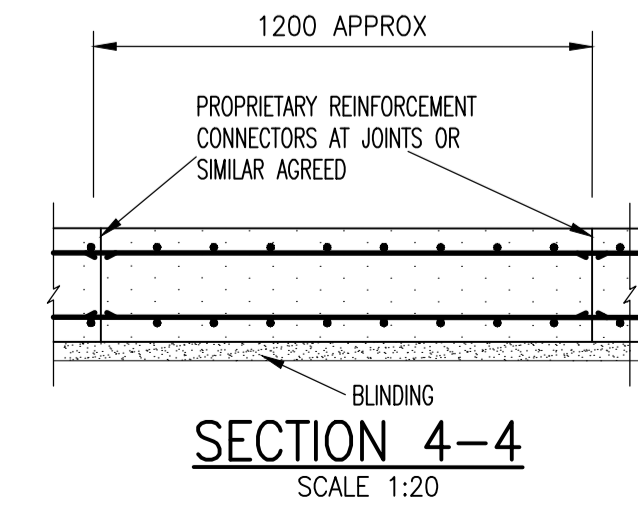

SECTION 4-4
SCALE 1:20

REV	DESCRIPTION	DATE	CHKD
P2	UPDATED TO ARCHITECTS COMMENTS	22/08/19	
P1	ISSUED FOR COMMENT & APPROVAL	05/08/19	

Gledsdale Associates
Consulting Structural Engineers

40A Dartford Road
Sevenoaks, Kent TN13 3TQ.
Email: <name>@gledsdale.co.uk

Tel: 01732 456531

PROJECT TITLE:
6 KENTISH TOWN ROAD

DRAWING TITLE:
PARTY WALL DETAILS BETWEEN 6 AND Nos 4 & 8 KENTISH TOWN RD

CLIENT:

ARCHITECT:

DATE: **05/08/19** DRAWN: **K.G.A.**

SCALE (© A1): **1:20 1:50** DRAWING No: **3640/660** REV: **P2**