Supply Specification Notes:

FILTER SECTION

GRADE & TYPE	:G4 PANEL		
QUANTITY & SIZE	:3@610X610X50	QUANTITY & SIZE	:3@610X305X50
PART NO.	:PP52424ZNOM	PART NO.	:PP24122NOM
CLEAN CONDITION	:50Pa		
DIRTY CONDITION	:100Pa	SPARE MEDIA SET	:0

FAN SECTION – 50/50 – data per fan

TYPE	:SUPPLY		EXT. STATIC PRESS.	:300	Pa
AIR VOLUME	:2.9	m³/s	TOT. STATIC PRESS.	:504	Pa
FAN SIZE	:NPA500				
BLADE TYPE	:BACKWARD		MOTOR POWER	:3.0	kW
FAN SPEED	:1263	R.P.M.	MOTOR SPEED	:940	R.P.M.
ABSORBED POWER	:1.11	kW	FRAME SIZE	:132S	
EFFICIENCY	:75.0	%	FULL LOAD CURRENT	:6.26	Amps
			STARTING CURRENT	:-	
			METHOD OF START	:INVERTER	
			ELECTRICAL SUPPLY	:400V 3Ph 50Hz	

SOUND SPECTRUM	63	125	250	500	1K	2K	4K	8K	(Hz)
FAN INLET	73	80	78	73	71	69	67	63	(dB)
FAN OUTLET	74	77	80	80	78	75	72	62	(dB)

INVERTER TO OPERATE @ : 67.18Hz

* NOTE: THE FAN MANUFACTURERS NOISE DATA WE HAVE DECLARED IS TESTED IN ACCORDANCE WITH DIN 45 3 PART 3A & 3B, BS848 PART 2 & ISO 5136. IN ORDER TO ALLOW FOR THE EFFECTS IF INSTALLING A FAN IN AN AHU SECTION, APPLY A CORRECTION OF +6dB ACROSS THE SPECTRUM FROM 63Hz TO 8KHz

COIL SECTION

MODEL & PART No.	:4C-0840-0910				
MEDIUM	:CHILLED WATER				
AIR ON	:24.0	°C	FLOW RATE	:1.56	l/s
RELATIVE HUMIDITY	:-	%	WATER IN	:6.0	°C
AIR OFF	:10.06	°C	WATER OUT	:16.5	°C
RELATIVE HUMIDITY	:-	%	WATER PRESS. DROP	:24.61	kPa
SENS. HEAT RATIO	:-		AIR PRESS. DROP	:75.0	Pa
FACE VELOCITY	:1.89	m/s	FLUID CONTENT	:46.01	Litres
DUTY	:68.9	kW			
TUBE MATERIAL	:COPPER		INLET CONNECTION	:1x1 1/2"B.S.P.	
FIN MATERIAL	:ALUVER		OUTLET CONNECTION	:1x1 1/2"B.S.P.	

SFP int - 111.17 **W/(m³/s)**

SFP_V - 0.95 **W/l/s**

SFP_E - – **W/l/s**

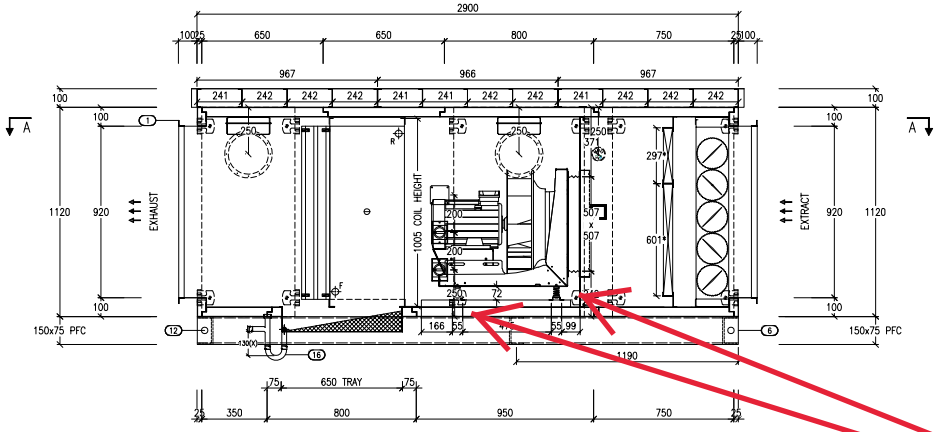

SECTION ON B–B

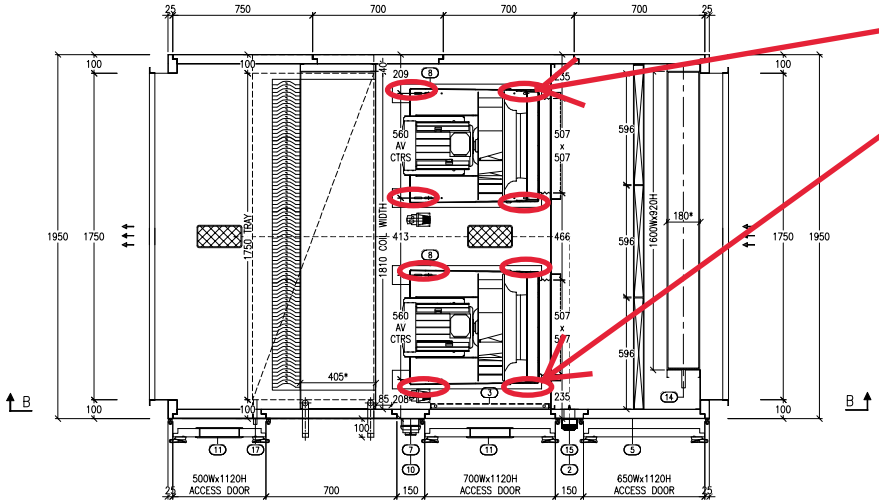

SECTION ON A–A

Anti Vibration Mounts

CONSTRUCTION & FINISH

- MODEL TYPE : FRAMELESS CONTSTRUCTION
- OUTER PANEL : HDX GRANITE ANTHRACITE
- INNER PANEL : WHITE ENAMEL
- PANEL INFILL TYPE : FOAM (45Kg/m3)
- DOOR HINGE TYPE : UNIVERSAL COMPRESSION HINGE (SC = SAFETY CATCH FITTED)
- PAINT CODE : NCP/S2 – BASE/LEG COLOUR : MATT BLACK
- HDX GRANITE ANTHRACITE STEEL ROOF FITTED (TWIN PITCHED TYPE)

UNIT WEIGHT & DIMENSIONS

- AHU SUPPLIED TO SITE IN : ONE SECTION — AHU LOCATION : EXTERNAL UNIT

SECTIONS	SIZE (WxHxL – mm)	WEIGHT (Kgs)
1	1950x1370x3100	1321

- SIZES EXCLUDE COIL CONNECTIONS AND ELECTRICAL COMPONENTS
- FACTORY ASSEMBLED SECTIONS TO BE FIXED TOGETHER AND BASE STEELS FIXED TO UNIT FRAME
- PLEASE REFER TO OFFICE FOR FURTHER DETAILS

- UNIT APPROX. TOTAL WEIGHT : 1321Kgs (+/– 10%)

1	AHU CONNECTION MANUFACTURED FROM 30mm GALVANISED STEEL MEZ FLANGE
2	FLUSH MOUNTED 0–250 Pa PRESSURE GAUGE & FIXING – PART No : PC–DPG2–5000–250
3	SUPPLY FAN WIREMESH DOOR GUARD : 650mm X 1015mm (WxH)
5	FILTER WITHDRAWAL TYPE : SIDE WITHDRAWAL
6	BASE MATERIAL : 150x75 R.S.C (SHOT BLASTED & PRIMED) – FULL PERIMETER
7	FOR MOTOR WIRED TO ISOLATOR ONLY – AHU MOTOR PREWIRED TO AN IP66 EXTERNAL ISOLATOR, INSTALLATION TO COMPLY WITH BS7671 IET REGULATIONS – CABLE TYPE: SY (STANDARD)
8	FAN TOPHATS REQUIRED (SUPPLY) – 100mm Wide x 38mm High 14 Gauge
10	MOTOR THERMISTOR WIRED : TO EXTERNAL JUNCTION BOX – KIT PART : EC–GW44205
11	ø215mm POLYCARBONATE VIEWPORT : KIT PART – PCOBP035
12	LIFTING METHOD : ø35mm SHACKLE LIFTING POINT
14	LOW LOSS GALVANISED STEEL OPPOSED BLADE DAMPER CONTROL: MOTORISED BY OTHERS
15	BULKHEAD LIGHTS PREWIRED TO A COMMON EXTERNAL IP66 SWITCH PER UNIT, INSTALLATION TO COMPLY WITH BS7671 IET REGULATIONS. LIGHT : GLS (LED TYPE) PART No : EC–LED5.5W CABLE : SY (STANDARD)
16	DRAIN TRAP : POSITIVE TRAP REQUIRED – SUPPLIED BY OTHERS DRAIN TRAP SEAL (X) = 130mm DRAIN TRAP DOES EXCEED BASE DIMENSIONS – SITE MODIFICATION MAY BE REQUIRED
17	FIXED TRAY MATERIAL : 20 SWG 316L 2B STAINLESS STEEL DRAIN CONNECTION TYPE : 3/4" BSP STAINLESS STEEL (AHS) TRAY TYPE : HTM 1 (DP2) – STAINLESS TRAY & GALVANISED COVER

MANUFACTURING NOTES

ALL FIXED PANELS SECURED WITH DRILL SCREWS EXTERNAL TO AHU UNLESS SPECIFIED.

AHU MANUFACTURED IN ACCORDANCE WITH HEVAC DW143 CLASS C & BS EN 1886 L1.

E : steven.yale@ahs.uk.com | W : ahs.uk.com | T : +44 (0)1388 776287

ahs™ *innovation through heritage*

CLIENT: INTEGRAL UK LTD.

PROJECT: GOSH ITALIAN HOSPITAL

UNIT REF: AHU 2 SOUTH EXTRACT

DRAWN BY: GM | **ENG:** STEVEN YALE | **CHK BY:**

DRAWING NUMBER: 4010-17875-4 | **REV:** -

SCALE: 1:15 @ A1 | **DATE:** 09/05/19

This document is the sole property of Air Handling Systems Limited (AHS) and is loaned only upon condition that it is not to be copied or reproduced nor to be used for furnishing information to others or any other purpose detrimental to the interest of AHS.

FIRST ANGLE PROJECTION

SITE INSTALLATION NOTES

- FOR REMOVAL OF SINGLE PIECE COILS CLEARANCE REQUIRED SHOULD EQUAL OR BE GREATER THAN THE WIDTH OF THE AHU. SPLIT COILS REQUIRE HALF AHU WIDTH.
- FOR REMOVAL OF ANY FILTER MEDIA CLEARANCE REQUIRED WILL BE 650mm MINIMUM.
- ALL DUCTWORK MUST BE SELF SUPPORTED TO ENSURE NO LOADS ARE IMPOSED ON THE AHU CONNECTIONS.
- ANY CABLE/ PIPE PANEL PENETRATIONS MUST BE SEALED APPROPRIATELY AFTER CORRECTLY SIZED GLAND PLATES HAVE BEEN FITTED.
- TO AVOID DAMAGE TO PIPE CONNECTIONS PLEASE ENSURE NO WEIGHT IS APPLIED WHEN CONNECTING TO SERVICES.
- HIGH LEVEL ACCESS EQUIPMENT TO BE SUPPLIED BY OTHERS.
- IT IS THE RESPONSIBILITY OF OTHERS TO ENSURE THAT ANY EXTERNALLY MOUNTED FIELD DEVICES EITHER SUPPLIED BY AHS OR OTHERS ARE FULLY WEATHER PROTECTED.
- ELECTRICAL CABLE ENTRY TO ELECTRIC HEATER TO BE BY OTHERS AND SHOULD UTILISE A WEATHERPROOF GLANDED ADAPTABLE BOX.
- WHERE ISOLATORS, JUNCTION BOXES OR LIGHT SWITCHES ARE INSTALLED ON THE SIDE OF AN AIR HANDLING UNIT CASING AND FAN REMOVAL IS REQUIRED, IT IS ESSENTIAL THAT ALL POWER SUPPLIES INSTALLED BY OTHERS ARE PROVIDED IN FLEXIBLE CONDUIT TO ALLOW FOR THE CASING & PANEL REMOVAL.
- UNIT MUST BE INSTALLED ON A FLAT LEVEL SURFACE OR PLATFORM, FAILURE TO DO SO MAY INVALIDATE WARRANTY.

BASE STEELS

CHANNEL TO SIT 20mm INBOARD FROM OUTSIDE EDGE OF PANEL

SPARES OR LOOSE ITEMS FOR THIS AHU:

SPARES SUPPLIED WITH AHU	COMPONENTS SUPPLIED LOOSE WITH AHU
- –	- INVERTER – 3KW

REVISION	DATE	AMENDMENT	CAD INTIALS