

LABTECH

client

Buck Street Market

project


Licensing Plan - Unit 2.16 / 2.17

content

SDJ	1/50 @ A3	JR.656	3	LIC 2.16 / 2.17
drawn	1/100 @ A4			
Sept 19				
date	scale	job no.	stage	drawing no.

unit 6 pool bank business park high street tarvin chester ch3 8jh  
t 01829 749010 f 01829 740388 enquires@johnsonrobson.co.uk

date:	revision:
18/09/19	0 First Issue

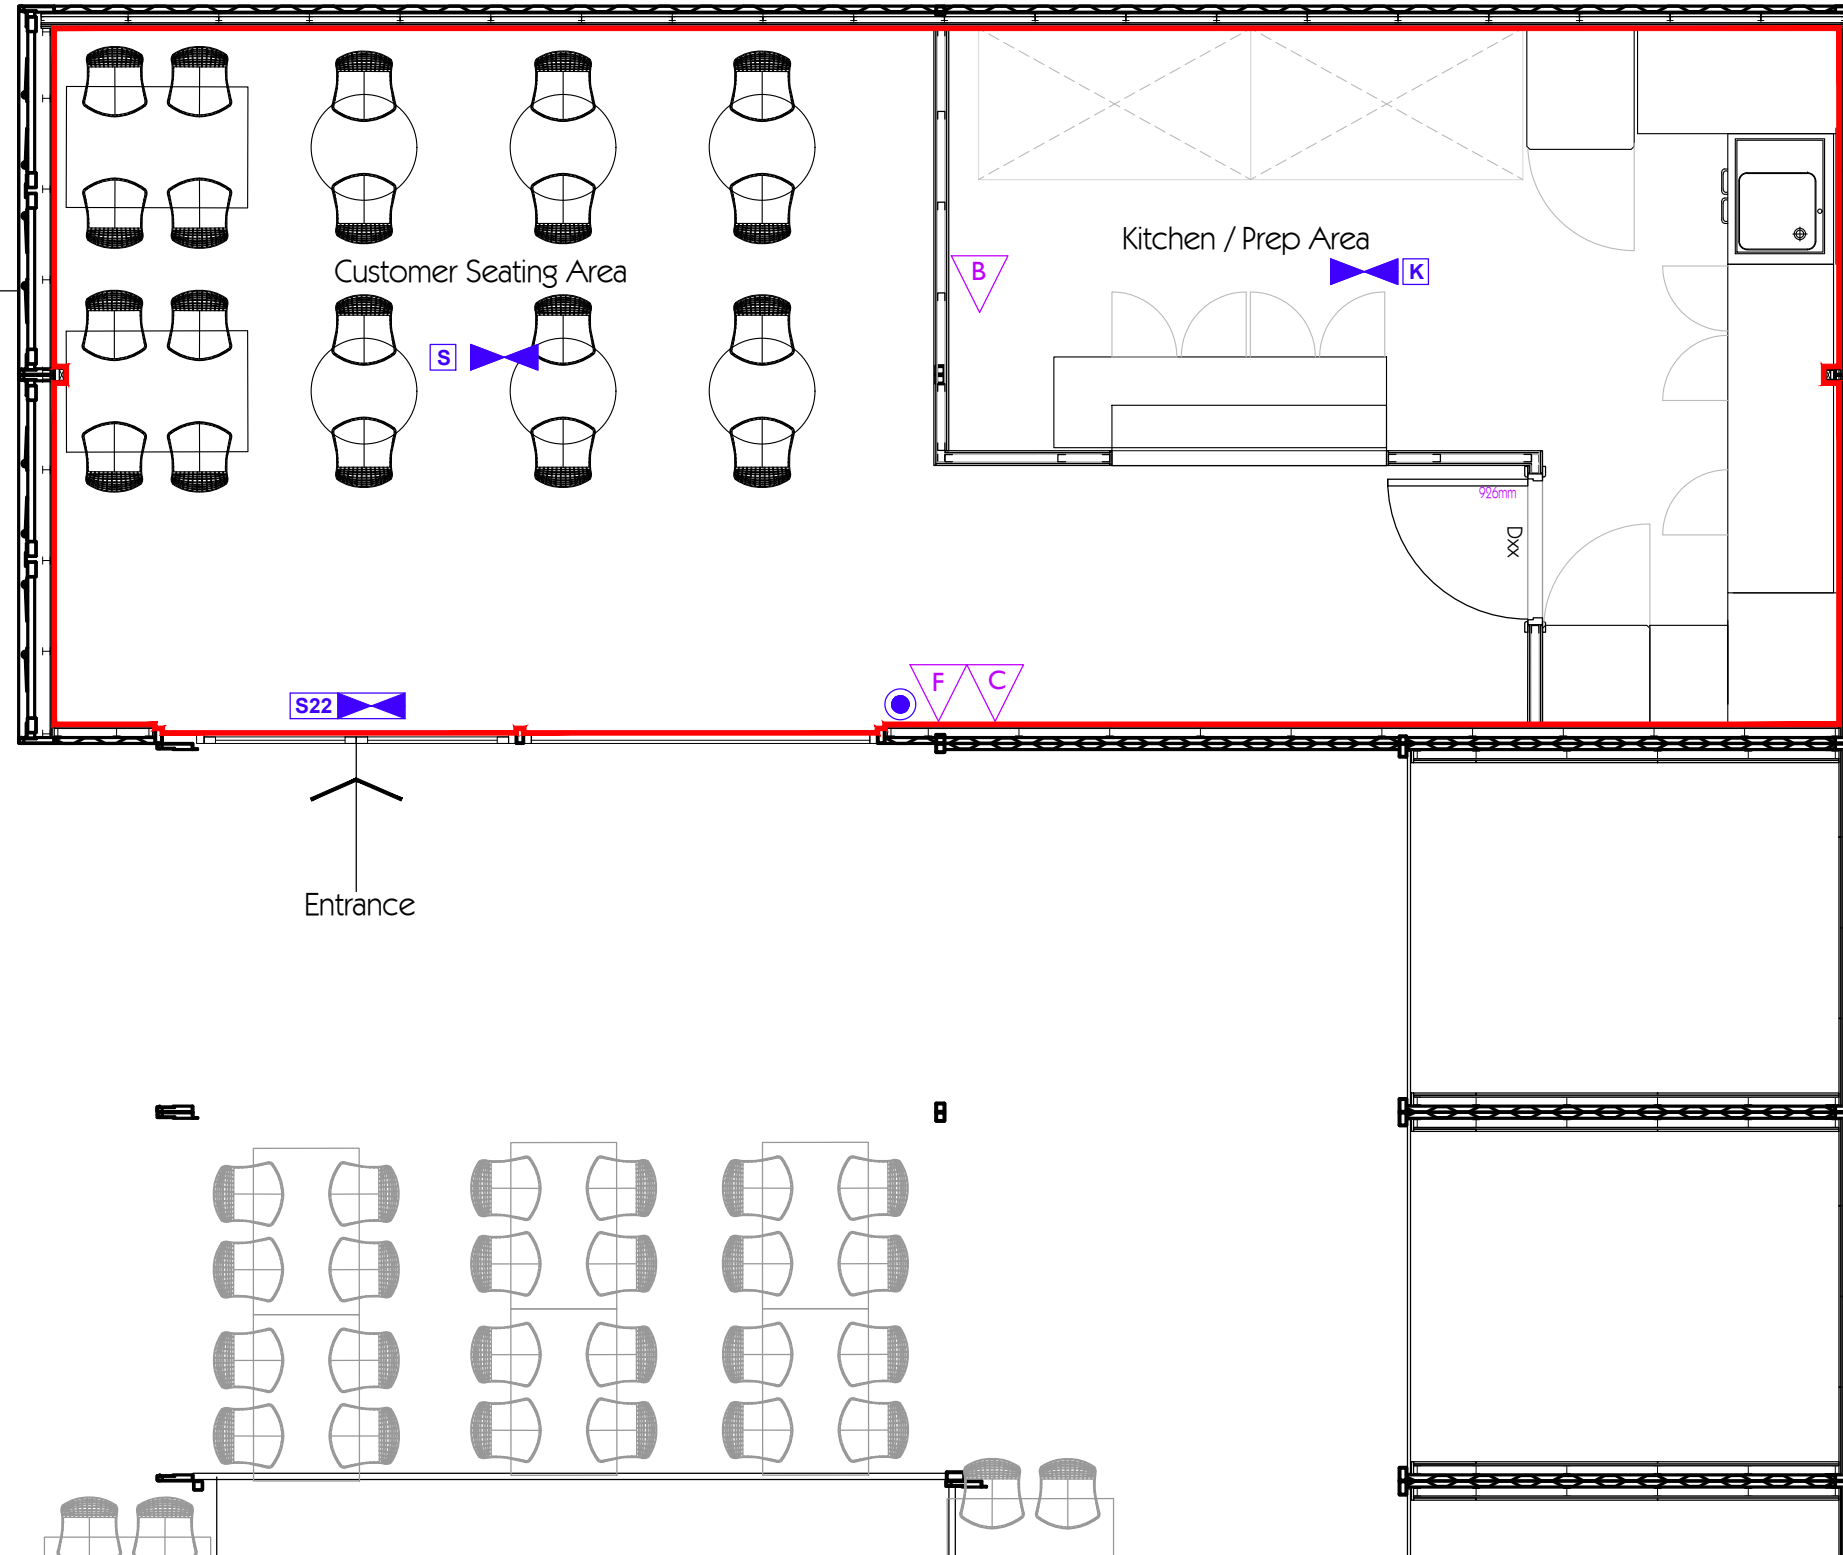

LICENSING KEY

— All licensable activities

FIRE ALARM SYSTEM

A Fire Alarm system will be installed to BS 5839 : Part 6, 2019 Code of Practice for system design, installation, commissioning and maintenance, comprising of devices as indicated.

The system shall be designed, installed and certified by the electrical contractor with equipment located in the approximate positions indicated on this drawing.

- FAP Fire Alarm Panel
- Manual Call Point
- K Heat Detector
- S Smoke Detector

EMERGENCY LIGHTING SYSTEM

An independent self-contained non-maintained system installed in accordance with BS 5266-1:2016, Emergency Lighting - Part 1 : Code of Practice for Emergency Lighting of premises other than cinemas and certain other specified premises for entertainment, and BS EN 50172 : 2004, BS 5266-8 : 2004 Lighting Applications - Emergency Lighting. The system shall be designed, installed and certified by the electrical contractor with equipment located in the approximate positions indicated on this drawing. All signs and notices will comply with BS 5499 : Part 1 - Fire Safety Notices and Graphic

- S22 3 hr maintained exit legend
- ▶▶ 3 hr non-maintained emergency light

FIRE FIGHTING EQUIPMENT

Portable fire appliances to be sited and installed in accordance with BS 5306-8 : 2012 by specialist supplier.

FIRE FIGHTING EQUIPMENT TO COMPLY WITH BS EN3, BS 7863 : 2009, BS 5306 - 3 : 2017 and BS 5306-8 : 2012

- F FOAM SPRAY  
WALL MOUNTED @ 1m
- C CARBON DIOXIDE  
WALL MOUNTED @ 1m
- B FIRE BLANKET  
WALL MOUNTED @ 1.5m

UPHOLSTRY

ALL UPHOLSTRY TO SATISFY CIGARETTE AND MATCH IGNITABILITY TEST AND IGNITION SOURCE 5 TESTS AS SPECIFIED IN B.S 5852 : 1990 (1998)

NB. Furniture and fire safety layout indicative only and subject to change