


ISO A1 84mm x 118mm
Approved: RP
Checked: BP
Designer: BL
Project Management Initials:
Last saved by: BACONG/0181-2(03)
Last Printed: 2019-12-03
Filename: K:\INFRASTRUCTURE\LONDON\6516144 - MIDDLESEX ANNEXE HOSPITAL 06_CAD_DATA\01-WP\DISCIPLINE\01-DRAWINGS\SS\STAGE 4_191104\HMA\ACM-XX-00-DR-C-0001.DWG
Project: 6516144 - MIDDLESEX ANNEXE HOSPITAL 06

NOTES

- THIS DRAWING IS TO BE USED FOR THE PURPOSE OF ISSUE THAT IT WAS ISSUED FOR ONLY AND IS SUBJECT TO AMENDMENT DURING DESIGN DEVELOPMENT.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DOCUMENTATION. ANY DISCREPANCIES IN DIMENSIONS OR DETAILS ON OR BETWEEN THESE DRAWINGS SHOULD BE DRAWN TO THE ATTENTION OF THE ARCHITECT AND/OR THE ENGINEER FOR CLARIFICATION.
- DO NOT SCALE FROM DRAWING FOR CONSTRUCTION PURPOSES. USE ONLY PRINTED DIMENSIONS. ANY DISCREPANCIES IN DIMENSIONS OR DETAILS ON OR BETWEEN THESE DRAWINGS SHOULD BE DRAWN TO THE ATTENTION OF THE ARCHITECT AND/OR THE ENGINEER FOR CLARIFICATION.
- ALL DIMENSIONS, CHAINAGES, LEVELS AND COORDINATES ARE IN METRES UNLESS NOTED OTHERWISE.
- ALL DRAWINGS ARE TO BE READ IN CONJUNCTION WITH THE PROJECT HEALTH AND SAFETY INFORMATION, INCLUDING THE PROJECT HAZARD LOG FOR ANY IDENTIFIED POTENTIAL RISKS.
- DRAWING USES BACKGROUND INFORMATION RECEIVED FROM:
 - STRUCTURES (EXISTING BUILDING RECEIVED ON 12.08.2019 AND NEW BUILD ON 25.10.2018)
 - MEP (DRAIN POINTS RECEIVED ON 14.08.2019 AND PUMP RATES RECEIVED ON 13.08.2019)
 - ARCHITECT (RECEIVED ON 11.10.2019)
 - LANDSCAPE ARCHITECT (RECEIVED ON 10.10.2019)
 - TOPOGRAPHICAL SURVEY (RECEIVED ON 26.09.2016)
 - NORTH HOUSE BASEMENT TRIAL PIT RESULTS (RECEIVED ON 17.12.2018)
 - CCTV DRAINAGE SURVEY (RECEIVED ON 19.12.2017, 11.06.2018 AND 10.09.2018)
- TOTAL SURFACE WATER DISCHARGE FROM THE SITE TO EXISTING THAMES WATER SEWER IS RESTRICTED TO A RATE OF 10% + PROPOSED FOUW FLOW RATE AND UNRESTRICTED SURFACE WATER DISCHARGE OF 0.67%. THIS CAN ONLY BE INCREASED BY WRITTEN ACCEPTANCE FROM TWUL AND LOCAL PLANNING AUTHORITY.
- PROPOSED SURFACE WATER ATTENUATION REQUIREMENTS:
 - SW TANK 1 = 39m³
 - SW TANK 2 = 29m³
 - SW TANK 3 = 37.9m³
 - SHALLOW GEOSHELLULAR MODULAR UNIT = 47m³
- ALL BUILDING DRAINAGE TO BE INSTALLED AND TESTED IN COMPLIANCE WITH THE BUILDING REGULATIONS 2010 PART H (2015 EDITION) AND BS EN 752: 2008. PRE AND POST CONSTRUCTION CCTV DRAINAGE SURVEY TO BE UNDERTAKEN TO DEMONSTRATE THE DRAINAGE IS FULLY OPERATIONAL AND IN COMPLIANCE OF PART H.
- ANY PART OF THE EXISTING DRAINAGE SYSTEM TO BE RETAINED AS PART OF THE NEW SCHEME SHALL BE FULLY CLEANED AND FULLY INSPECTED. ANY STRUCTURAL DEFECTS SHALL BE REPAIRED USING APPROVED AND APPROVED MEANS.
- DRAINAGE SYSTEM WITHIN BUILDING FOOTPRINT TO ENSURE TIMESAVER (CAST IRON) SPECIFICATION OR EQUIVALENT APPROVED. DRAIN PIPES TO BE CASTED INTO THE FOUNDATIONS WHERE SHOWN BELOW GROUND DRAINAGE OUTSIDE THE BUILDING FOOTPRINT TO BE PLASTIC OR OTHERWISE SPECIFIED (REFER TO DRAINAGE SPECIFICATION).
- FOR INTERNAL BUILDING DRAIN POINT SETTING OUT, REFER TO ARCHITECT AND MEP DRAWINGS.
- CAVITY DRAINAGE DESIGN TO BE CARRIED OUT BY THE ARCHITECT/WATERPROOFING SPECIALIST.
- ALL FOUL WATER DRAINAGE PIPEWORK UNDER BUILDING FLOOR SLAB TO BE MINIMUM 100mm DIAMETER PIPEWORK UNLESS OTHERWISE SHOWN.
- ALL SURFACE WATER PIPEWORK UNDER BUILDING FLOOR SLAB TO BE MINIMUM 100mm DIAMETER PIPEWORK UNLESS OTHERWISE SHOWN.
- ALL BRANCH DISCHARGE PIPE SHOULD NOT DISCHARGE INTO A STACK LOWER THAN 750mm ABOVE THE INVERT OF THE TAIL OF THE BEND AT THE FOOT OF THE STACK. THE BEND AT THE FOOT OF THE STACK TO HAVE A MINIMUM RADIUS OF 200mm (BUILDING REGULATIONS PART H).
- ALL ABOVE GROUND DRAINAGE TO INCORPORATE RIDDING ACCESS FACILITIES. REFER TO MEP DRAWINGS.
- MECHANICAL ELECTRICAL SUPPLY, VENTING, RISING MAINS, PUMPS, DRAIN POINTS, GULLY, PUDDLE FLANGE AND BUILDING MANAGEMENT SYSTEM COMMUNICATION BY MEP ENGINEER.
- POSITION OF PROPOSED TREES, ETC. TO ACCOMMODATE ALL UNDERGROUND STRUCTURES, SERVICES AND DRAINAGE.
- ROOT BARRIERS TO BE PROVIDED WITHIN TREE ZONE. REFER TO LANDSCAPE ARCHITECTS DRAWINGS AND SPECIFICATION.
- ALL PRECAST CONCRETE UNITS USED IN THE DRAINAGE WORKS SHALL BE MANUFACTURED USING SULPHATE RESISTING CEMENT TO BE SPECIAL DIGEST 1 FOR ACEC CLASSIFICATION OF AC-2 AND A DESIGN SULPHATE CLASS OF DS-2.
- COVER LEVELS SHOWN ARE APPROXIMATE ONLY AND ARE TO BE ADJUSTED TO SUIT AS CONSTRUCTED GROUND AND FLOOR LEVELS.
- ALL DRAINAGE RUNS TO BE LAID SOFFIT TO SOFFIT UNLESS SPECIFIED OTHERWISE.
- THE CONTRACTOR SHALL, BEFORE COMMENCING THE WORKS, VERIFY ALL SITE AND SETTING OUT DIMENSIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE TRUE AND PROPER SETTING OUT OF THE WORKS AND FOR THE CORRECTNESS OF THE POSITION, LEVELS, DIMENSIONS, AND ALIGNMENT OF ALL PARTS OF THE WORKS.
- THE CONTRACTOR IS TO FULLY VERIFY THE LOCATION AND LEVELS OF ALL EXISTING SERVICES AND DRAINAGE INCLUDING EXISTING THAMES WATER SEWER AND INVESTIGATIONS IS INDICATIVE BASED ON THAMES WATER SEWER RECORDS. THEREFORE, CONTRACTOR IS TO UNDERTAKE SURVEYS AS NECESSARY.
- THE CONTRACTOR IS RESPONSIBLE FOR CONSTRUCTION OF NEW UTILITIES CONNECTIONS, DIVERSIONS, REINFORCEMENT AND ADJUSTMENT OF EXISTING CHAMBERS/COVERS AND OTHER WORKS ETC.
- ALL MANHOLES TO BE CONSTRUCTED TO FACILITATE THE POSITIONING OF COVER AND FRAME TO COINCIDE WITH PAVEMENT PATTERN. ORIENTATION OF PAVEMENT PATTERN TO BE SUPPLIED FROM LANDSCAPE ARCHITECTS.

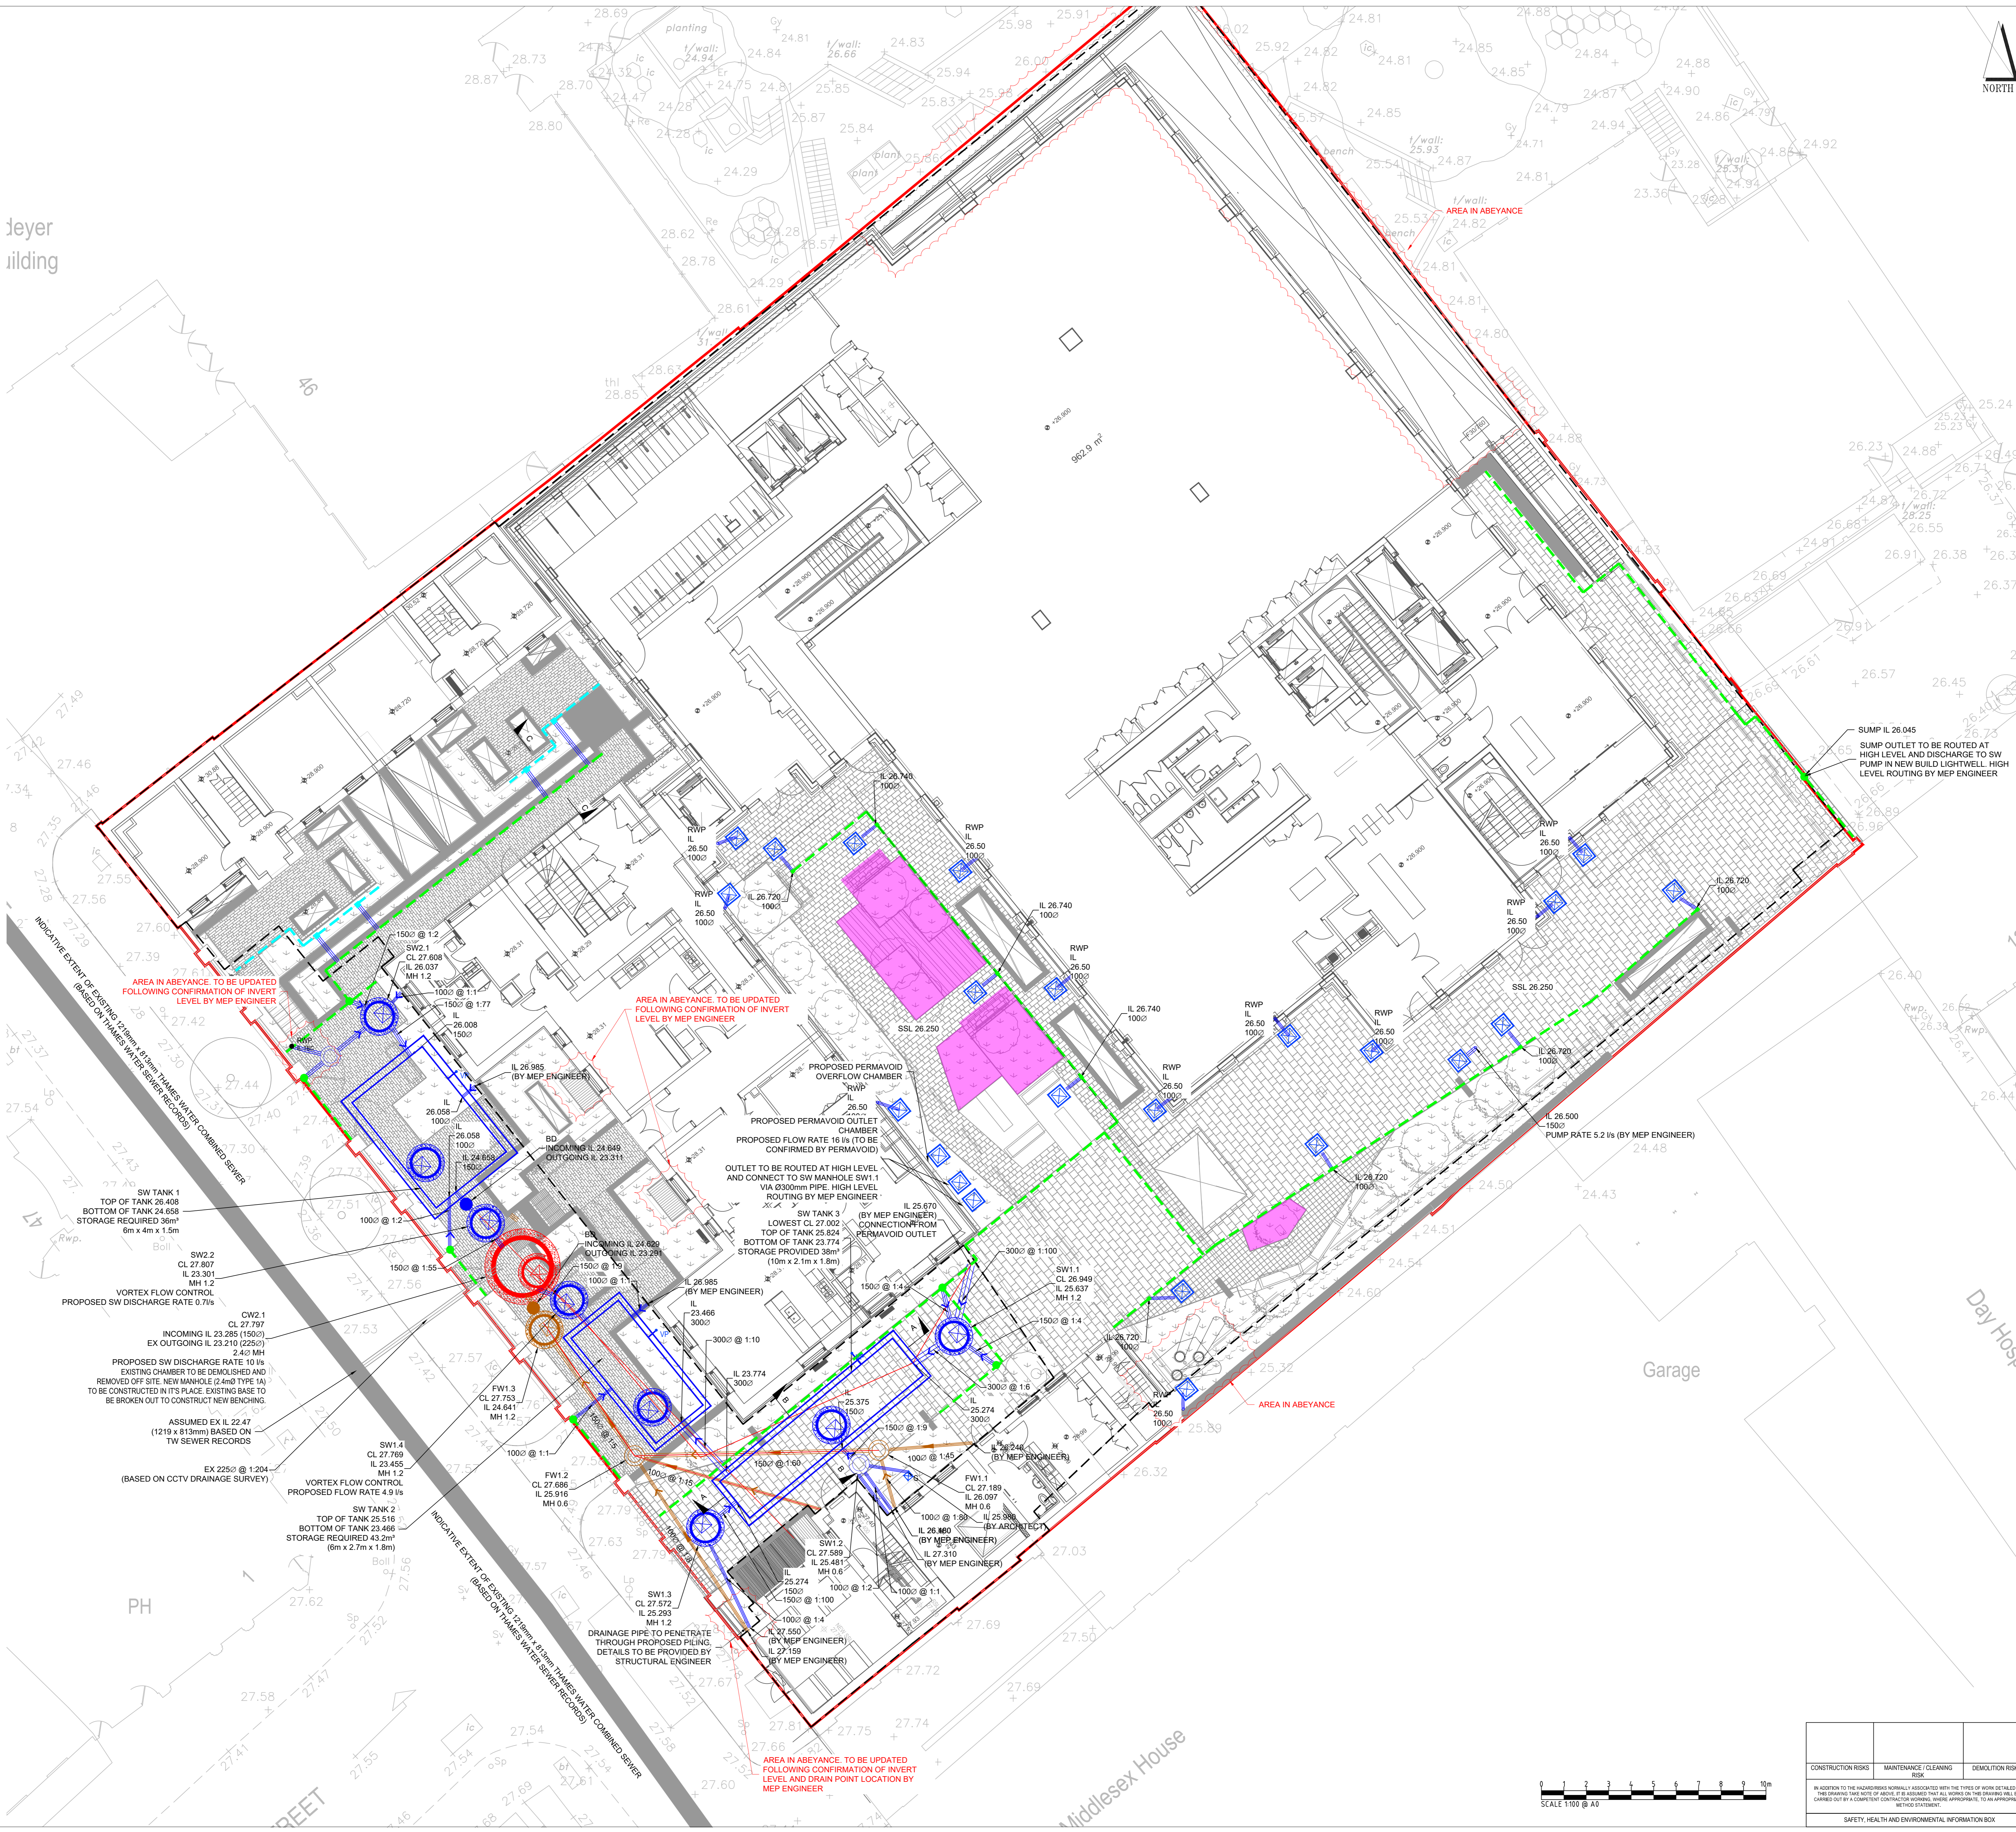

PROJECT

BEDFORD PASSAGE DEVELOPMENT

CLIENT
MIDDLESEX ANNEXE LLP

CONSULTANT
AECOM
Aldgate Tower
2 Leman Street
London E1 6FA
www.aecom.com

GENERAL NOTES

- #### LEGEND
- PROPOSED COMBINED MANHOLE
 - PROPOSED SURFACE WATER MANHOLE
 - PROPOSED SURFACE WATER INSPECTION CHAMBER
 - PROPOSED SURFACE WATER PIPE
 - PROPOSED FOUL WATER MANHOLE
 - PROPOSED FOUL WATER INSPECTION CHAMBER
 - PROPOSED FOUL WATER PIPE
 - PROPOSED PERMAVOID 150mm
 - PROPOSED ROOT CELL EXTENT BY LANDSCAPE ARCHITECT
 - PROPOSED PERMAVOID DIFFUSER CHAMBER
 - PROPOSED PRECAST CONCRETE ATTENUATION CULVERT TANK
 - PROPOSED SURFACE AND FOUL WATER BACKDROP
 - PROPOSED RAINWATER PIPE
 - PROPOSED VENT PIPE
 - PROPOSED DRAINAGE CHANNEL (MD100 WITH SLOT GRATING)
 - PROPOSED DRAINAGE CHANNEL (MD100 WITH STEEL GRATING)
 - PROPOSED BASEMENT BOUNDARY
 - SITE BOUNDARY


ISSUE/REVISION

NO	DATE	DESCRIPTION
P01	04.11.2019	REVISED STAGE 4
P02	21.08.2019	STAGE 4 REDESIGN
P03	23.01.2019	ENABLING WORKS TENDER
P04	04.01.2019	ENABLING WORKS TENDER
P05	30.04.2018	FOR INFORMATION
P02	29.03.2018	STAGE 4 DRAFT ISSUE
P01	22.12.2018	PRELIMINARY ISSUE
WR		DESCRIPTION

KEY PLAN

PROJECT NUMBER	60516144
SHEET TITLE	PROPOSED DRAINAGE LAYOUT GROUND LEVEL
SHEET NUMBER	MHA-ACM-XX-00-DR-C-00001

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as required by law. AECOM accepts no responsibility, and denies any liability, whatsoever, for any party that uses or relies on this document. All measurements must be obtained from the stated dimensions.

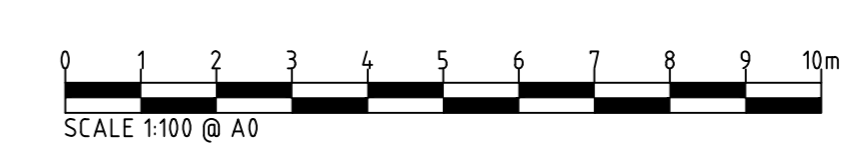

CONSTRUCTION RISKS	MAINTENANCE / CLEANING RISKS	DEMOLITION RISKS

IN ACCORDANCE WITH THE HAZARD RISK MANUAL ASSOCIATED WITH THE TYPE OF WORK DETAIL ON THIS DRAWING THE RISK OF ADULT IF IT IS ASSUMED THAT ALL WORK ON THE DRAWING WILL BE COMPLETED BY A COMPETENT CONTRACTOR HAVING THEIR APPROPRIATE TRAINING AND EXPERIENCE IS NOTED.

SAFETY, HEALTH AND ENVIRONMENTAL INFORMATION BOX