



Daylight, Sunlight & Overshadowing Report



28

Redington
Road,
Hampstead,
London,
NW3 7RB

August 2019

Ref: 15-1601

1	EXECUTIVE SUMMARY	5
2	INTRODUCTION	6
3	PLANNING POLICY	7
4	ASSESSMENT METHODOLOGY.....	8
4.1	General	8
4.2	BRE 209: "Site layout planning for daylight and sunlight"	9
5	ASSESSMENT	12
5.1	Daylight.....	12
5.2	Sunlight.....	14
5.3	Overshadowing	16
6	CONCLUSION	17
6.1	Daylight.....	17
6.2	Sunlight.....	17
6.3	Overshadowing	17
7	APPENDIX.....	18
7.1	Suntrace	18
7.2	Site plan and location	19
7.3	Model images.....	22
7.4	Daylight results.....	24
7.5	Sunlight results	35
7.6	Overshadowing results (21 st March)	49
7.7	SunCast Images.....	51

Quality Standards Control

The signatories below verify that this document has been prepared in accordance with our quality control requirements. These procedures do not affect the content and views expressed by the originator.

This document must only be treated as a draft unless it has been signed by the originators and approved by a director.

<i>Revision</i>	<i>Initial</i>	<i>Rev A</i>	<i>Rev B</i>	<i>Rev C</i>
Date	17/07/2019	06/08/2019		
Prepared by	S. Lee	S. Lee		
Checked by	V. Mwenze	V. Mwenze		
Authorised by	Y. Choi	Y. Choi		

Limitations

Syntegra Consulting Ltd ("SC") has prepared this report for the sole use of client in accordance with the agreement under which our services were performed. No other warranty, expressed or implied, is made as to the professional advice included in this report or any other services provided by SC.

The conclusions and recommendations contained in this report are based upon information provided by others and upon the assumption that all relevant information has been provided by those parties from whom it has been requested and that such information is accurate. Information obtained by SC has not been independently verified by SC, unless otherwise stated in the report.

The methodology adopted and the sources of information used by SC in providing its services are outlined in this report. The work described in this report was undertaken in **August 2019** and is based on the conditions encountered and the information available during the said period of time. The scope of this report and the services are accordingly factually limited by these circumstances.

Where assessments of works or costs identified in this report are made, such assessments are based upon the information available at the time and where appropriate are subject to further investigations or information which may become available.

SC disclaim any undertaking or obligation to advise any person of any change in any matter affecting the report, which may come or be brought to SC's attention after the date of the report.

Certain statements made in the report that are not historical facts may constitute estimates, projections or other forward-looking statements and even though they are based on reasonable assumptions as of the date of the report, such forward-looking statements by their nature involve risks and uncertainties that could cause actual results to differ materially from the results predicted. SC specifically does not guarantee or warrant any estimate or projections contained in this report.

Costs may vary outside the ranges quoted. Whilst cost estimates are provided for individual issues in this report these are based upon information at the time which can be incomplete. Cost estimates for such issues may therefore vary from those provided. Where costs are supplied, these estimates should be considered in aggregate only. No reliance should be made in relation to any division of aggregate costs, including in relation to any issue, site or other subdivision.

No allowance has been made for changes in prices or exchange rates or changes in any other conditions which may result in price fluctuations in the future. Where assessments of works or costs necessary to achieve compliance have been made, these are based upon measures which, in SC's experience, could normally be negotiated with the relevant authorities under present legislation and enforcement practice, assuming a proactive and reasonable approach by site management.

Forecast cost estimates do not include such costs associated with any negotiations, appeals or other non-technical actions associated with the agreement on measures to meet the requirements of the authorities, nor are potential business loss and interruption costs considered that may be incurred as part of any technical measures.

Copyright

© This report is the copyright of SC. Any unauthorised reproduction or usage by any person other than the addressee is strictly prohibited.

1 EXECUTIVE SUMMARY

This report demonstrates the impact of the proposed development on the surrounding buildings and amenity areas/gardens/open spaces.

The results of the assessment show that in terms of:

- ✓ Daylight, this report demonstrates that the levels of daylight for the surrounding buildings located at 26 and 30 Redington Road will not be adversely affected by the proposed development. Details can be found in section 5.1 of this report.

BRE criteria are met: ☒

- ✓ Sunlight, this report demonstrates that the levels of sunlight for the surrounding buildings located at 26 and 30 Redington Road will not be adversely affected by the proposed development. Details can be found in section 5.2 of this report.

BRE criteria are met: ☒

- ✓ Overshadowing, the existing amenity area/garden located at 30 Redington Road will not be adversely affected by the proposed development. Details can be found in section 5.3 of this report.

BRE criteria are met: ☒

On balance, the surrounding buildings located at 26 and 30 Redington Road will not be adversely affected by the proposed development, as all assessed windows and gardens meet the BRE criteria. Hence, the proposed scheme is acceptable in terms of daylight, sunlight and overshadowing impacts.

2 INTRODUCTION

This report has been prepared to support the planning application for the proposed development at **28 Redington Road, Hampstead, London, NW3 7RB**.

The report assesses the daylight, sunlight and overshadowing effect of the proposed development on the surrounding buildings. The assessment is undertaken in accordance with **"BRE 209 Digest: Site Layout Planning for Daylight and Sunlight – A Guide to Good Practice"**.

The existing & proposed drawings (in AutoCAD format) of the project were provided by **Thomas Croft Architects** and have been used in preparing this report. Please note that the surrounding buildings elevations have not been provided to carry out this assessment. Hence the size and location of the assessed windows have been assumed based on the on-site pictures and Google maps.

No.	Document Name	Format	Received Date
1	1384-28 Redington Road London, NW3 7RB (Issue Drawing 2015.10.02)	dwg	02-07-2019
2	28RR-100-BasementPlan	dwg	05-07-2019
3	28RR-101-GroundFloorPlan	dwg	05-07-2019
4	28RR-102-1stFloorPlan	dwg	05-07-2019
5	28RR-103-2ndFloorPlan	dwg	05-07-2019
6	28RR-104-RoofFloorPlan	dwg	05-07-2019
7	28RR-120-FrontElevation	dwg	05-07-2019
8	28RR-121-RearElevation	dwg	05-07-2019
9	28RR-122-NorthWestElevation	dwg	05-07-2019
10	28RR-123-SouthEastElevation	dwg	05-07-2019
11	28RR-140-SectionA	dwg	05-07-2019
12	28RR-141-SectionB	dwg	05-07-2019
13	28RR-142-SectionC	dwg	05-07-2019
14	28RR-143-SectionD	dwg	05-07-2019
15	28RR-144-SectionE	dwg	05-07-2019
16	OI1332760	dwg	05-07-2019

Table 1 Document list used for assessment

The study has been undertaken by constructing a 3D IES model of the existing site, the proposed site and the surrounding buildings. This model analyses the daylight, sunlight and overshadowing impact of the new development on the affected buildings. All images used in this report are technical 3D models created using 2D AutoCAD Drawings (floor plans, sections and elevations) and is not 3D visualisation images.

3 PLANNING POLICY

Where the proposed development has the potential to negatively impact the existing levels of daylight or sunlight on neighbouring properties, a daylight and sunlight assessment must accompany the planning application.

The daylight and sunlight assessment includes the necessary information to meet the criteria outlined in Building Research Establishment report **BRE 209: Site layout planning for daylight and sunlight (Second Edition 2011)**

It is important to note that the BRE report stresses that the document is provided for guidance purposes only and it is not intended to be interpreted as a strict and rigid set of rules. It also recommends that it may be appropriate to adopt a flexible approach and alternative target values in dealing with “special circumstances” for example “in a historic city centre, or in an area with modern high-rise buildings, a higher degree of obstruction may be unavoidable if new developments are to match the height and proportions of existing buildings”. This is amplified by the following extracts from the introduction (p1, para. 6) and Section 2.2:

“The advice given here is not mandatory and this document should not be seen as an instrument of planning policy; its aim is to help rather than constrain the designer. Although it gives numerical guidelines, these should be interpreted flexibly because natural lighting is only one of many factors in site layout design”. (p1, para. 1.6)

“In special circumstances the Developer or Planning Authority may wish to use different target values”. (p1, para. 1.6)

“Note that numerical values given here are purely advisory. Different criteria may be used, based upon the requirements for daylight in an area viewed against other site layout constraints. Another important issue is whether the existing building is itself a good neighbour, standing a reasonable distance from the boundary and taking no more than its fair share of light”. (p7 para. 2.2.3)

The examples given in the report can be applied to any part of the country: suburban, urban and rural areas. The inflexible application of the target values given in the report may make reaching the BRE criteria difficult in a tight, urban environment where there is unlikely to be the same expectation of daylight and sunlight amenity as in a suburban or rural environment.

4 ASSESSMENT METHODOLOGY

4.1 General

When assessing any potential effects on the surrounding properties, the BRE guidelines suggest that only those windows that have a reasonable expectation of daylight or sunlight need be assessed. In particular the BRE guidelines at paragraph 2.2.2 state:

"The guidelines given here are intended for use for rooms in adjoining dwellings where daylight is required, including living rooms, kitchens and bedrooms. Windows to bathrooms, toilets, storerooms, circulation areas and garages need not be analysed. The guidelines may also be applied to any existing non-domestic buildings where the occupants have a reasonable expectation of daylight; this would normally include schools, hospitals, hotels and hostels, small workshops and some offices."

Further to the above statement, it is considered that the vast majority of commercial properties do not have a reasonable expectation of daylight or sunlight. This is because they are generally designed to rely on electric lighting rather than natural daylight or sunlight.

This report assesses the potential impact of the proposed development in relation to daylight, sunlight and overshadowing on the surrounding building at **26 and 30 Redington Road**. Specifically, it takes into consideration the possible effect and influence that the new development would have on the property and on the amenity area.

Twenty-four windows (S1-S20, RL1-RL4) have been assessed for external levels of daylight VSCs (Vertical Sky Components) and sunlight APSHs (Annual Probable Sunlight Hours). And, **one existing amenity area/garden (A1)** has been assessed for overshadowing impacts. The location of the assessed windows and gardens can be found in section 7.2 of this report.

The IES Virtual Environment modelling software utilised for the compilation of this report has been accredited by CIBSE and acknowledged by the BRE as a suitable software tool for undertaking daylight, sunlight and overshadowing assessments in accordance with the BRE Good Practice guidelines. The specific IES software modules utilised for this assessment are the following:

- **ModelIT:** enables you to create a 3D "Virtual Environment" model without CAD data, or alternatively allows you to create a 3D model from 2D CAD data. Interfaces with AutoCAD and Google Sketchup.
- **Radiance:** is a detailed 3D simulation tool designed to predict daylight and electric light levels, and the appearance of a space prior to construction. Vertical Sky Components (VSC) and Average Daylight Factors (ADF) can be simulated using Radiance.
- **SunCast:** produces visual, graphical and numerical information that can be used to explain to colleagues, clients and planning authorities how the sun impacts on and inside the building, and on the site.

If a property is considered to have a reasonable expectation of daylight or sunlight the following methodology to assess the impacts has been used.

4.2 BRE 209: "Site layout planning for daylight and sunlight"

This section provides a brief description of the calculating methods for the daylight, sunlight and overshadowing to gardens and open spaces criteria presented in BRE Digest 209.

4.2.1 Daylight

The BRE guidelines *"Site layout planning for daylight and sunlight"* set out methods for assessing the daylight within section 2.

Vertical Sky Component (VSC)

The VSC method measures the amount of light available on the outside plane at the centre of a window, as a ratio (expressed as a percentage) of the amount of total unobstructed sky visible following the introduction of visible barriers such as buildings. The BRE guidelines at paragraph 2.2.6 and 2.2.7 state:

"Any reduction in the total amount of skylight can be calculated by finding the VSC at the centre of each main window." and "If the VSC, with the new development in place, is both less than 27% and less than 0.8 times its former value, occupants of the existing building will notice the reduction in the amount of skylight."

In the assessment, the reduction between existing and proposed situations is expressed as a percentage, where a change in daylight levels above 20% equates to a figure of less than 0.8 times its former value. Assessment points that do not meet the above criteria require further considerations to show the level of impact likely to be incurred.

No Sky Line (NSL)

The No Sky Line method of assessment is a test to indicate how good the distribution of daylight is in a room, taking into account external obstructions and divide those areas of the working plane that can receive direct skylight and those that cannot.

The BRE guidelines suggest that the daylight distribution test is carried out to existing surrounding properties when the internal room arrangements are known. To assess the impact of any reduction the BRE guidelines at paragraph 2.2.9 state:

"If, following construction of a new development, the no sky line moves so that the area of the existing room, which does receive direct skylight, is reduced to less than 0.8 times its former value this will be noticeable to the occupants, and more of the room will appear poorly lit."

4.2.2 Sunlight

The BRE guidelines *"Site layout planning for daylight and sunlight"* recommend that access to sunlight is assessed with a development proposal. Potential impacts on available sunlight were assessed using the BRE's Annual Probable Sunlight Hours (APSH) method. This method involves the forecasting of sunlight availability throughout the year and in the winter months, for the main window of each habitable room that faces within 90° of due south. The buildings surrounding the site that do not contain windows that face within 90° of due south has been excluded from the sunlight assessment.

The sunlight criteria given within the BRE guidelines have been used as a basis to assess the potential impacts of the development:

"A window may be adversely affected if a point at the centre of the window receives in the year less than 25% of the Annual Probable Sunlight Hours (APSH) including at least 5% of the APSH during the winter months (21st October to 21st March)".

Assessment points that do not meet the above criteria require further considerations to show the level of impact likely to be incurred. To provide a concise and comprehensive indicative analysis, the closest surfaces within the surrounding properties were analysed for both daylight and sunlight.

4.2.3 Overshadowing to gardens and open spaces

The BRE guidelines *"Site layout planning for daylight and sunlight"* provide sunlight availability criteria for open spaces. In particular it gives guidance for calculating any areas of open space that may be in permanent shadow on 21st March.

In summary the BRE document states:

"It is suggested that, for it to appear adequately sunlit throughout the year, at least half of a garden or amenity area should receive at least two hours of sunlight on 21st March. If as a result of new development, an existing garden or amenity area does not meet these guidelines, and the area which can receive two hours of sun on 21st March is less than 0.8 times its former value, then the loss of sunlight is likely to be noticeable".

For this assessment the IES "Virtual Environment" SunCast software package has been used. A 3D model of the proposed and surrounding buildings was first modelled and the sunlight-tracking feature within the software used to view the shadow results. The study illustrated the extent of the shadow on one key date:

- March 21 (Spring Equinox)

4.2.4 Criteria for assessing daylight, sunlight and overshadowing effects

The table 2 is a summary of the criteria to assess daylight, sunlight and overshadowing impacts as per the BRE 209 guidance. Based on that, Syntegra classifies the magnitude of effect according to the ratio.

Magnitude of effect	Criteria		
Beneficial	An improvement ratio > 1.3 of the baseline value		
Negligible	Daylight A VSC of 27% or above in the proposed scenario with adequate daylight distribution Or A reduction ratio <1.0 and ≥ 0.8 of the baseline value	Sunlight An APSH of 25%, of which 5% are in the winter months Or A reduction ratio <1.0 and ≥ 0.8 of the baseline value	Overshadowing 50% of any amenity areas receiving at least 2 hours of direct sunlight on 21 st March Or A reduction ratio <1.0 and ≥ 0.8 of the baseline value
Minor adverse	A reduction ratio <0.8 and ≥ 0.7 of the baseline value		
Moderate adverse	A reduction ratio <0.7 and ≥ 0.6 of the baseline value		
Major adverse	A reduction ratio <0.6 of the baseline value		

Table 2 Criteria for assessing daylight, sunlight and overshadowing effects

5 ASSESSMENT

5.1 Daylight

The daylight results and Waldram Diagrams are presented in section 7.4 in Appendix. The images and results show and compare the external levels of daylight (VSC – Vertical Sky Components) on the windows at **26 and 30 Redington Road** with the existing and the proposed development.

A summary of results is displayed in the table below. Location of the assessed windows can be found in section 7.2 of this report.

Daylight assessment (Surrounding buildings)				
Assessed Window	Existing VSC >27%	Proposed VSC >27%	Ratio	Result
S1 – 30 Redington Rd – SE Elevation – GF	7.59	8.10	1.07	Negligible
S2 – 30 Redington Rd – SE Elevation – GF	8.86	10.18	1.15	Negligible
S3 – 30 Redington Rd – SE Elevation – GF	11.45	13.11	1.15	Negligible
S4 – 30 Redington Rd – SE Elevation – GF	11.62	15.11	1.30	Negligible
S5 – 30 Redington Rd – SE Elevation – GF	10.48	12.48	1.19	Negligible
S6 – 30 Redington Rd – SE Elevation – GF	24.92	24.99	1.00	Negligible
S7 – 30 Redington Rd – SE Elevation – 1F	26.86	28.09	1.05	Negligible
S8 – 30 Redington Rd – SE Elevation – 1F	14.73	16.15	1.10	Negligible
S9 – 30 Redington Rd – SE Elevation – 1F	18.44	21.59	1.17	Negligible
S10 – 30 Redington Rd – SE Elevation – 1F	17.53	19.21	1.10	Negligible
S11 – 30 Redington Rd – SE Elevation – 2F	30.10	31.09	1.03	Negligible
S12 – 26 Redington Rd – NW Elevation – B	16.08	16.46	1.02	Negligible
S13 – 26 Redington Rd – NW Elevation – GF	32.00	31.93	1.00	Negligible
S14 – 26 Redington Rd – NW Elevation – 1F	34.89	34.82	1.00	Negligible
S15 – 26 Redington Rd – NW Elevation – 1F	32.71	30.92	0.95	Negligible
S16 – 26 Redington Rd – NW Elevation – 1F	32.88	30.33	0.92	Negligible
S17 – 26 Redington Rd – NW Elevation – 1F	31.39	29.09	0.93	Negligible
S18 – 26 Redington Rd – NW Elevation – 1F	30.81	28.95	0.94	Negligible

S19 – 26 Redington Rd – NW Elevation – 2F	37.71	36.68	0.97	Negligible
S20 – 26 Redington Rd – NW Elevation – 2F	37.36	36.63	0.98	Negligible
RL1 – 26 Redington Rd - GF	40.55	59.30	1.46	Beneficial
RL2 – 26 Redington Rd - GF	58.15	42.70	0.73	Negligible
RL3 – 26 Redington Rd - GF	50.05	48.40	0.97	Negligible
RL4 – 26 Redington Rd - GF	58.05	50.45	0.87	Negligible

Table 3 Daylight results

As shown in the above table, **none of assessed windows at 26/30 Redington Road will be adversely impacted by the proposed development. Hence, in terms of daylight the proposed scheme is considered acceptable.**

The slight loss in daylight for the surfaces is not considered to be a concern as the proposed VSC levels are either above 27% or more than 0.8 times their former values and will provide adequate levels of daylight. It should be noted that the values provided in the BRE 209 are for guidance purposes only.

5.2 Sunlight

Where necessary (as defined in the Assessment Methodology section of this report) the Annual Probable Sunlight Hours (APSH) tests have been undertaken with the results and Waldram diagrams presented in section 7.5 in the appendix.

The table below indicates the likely levels of sunlight on the windows at **26 and 30 Redington Road** with the existing and the proposed development.

A summary of results is displayed in the table below. Location of the assessed windows can be found in section 7.2 of this report.

Assessed Window	Sunlight assessment (Surrounding buildings)				Ratio Annual	Result
	Total APSH >25%		Winter APSH >5%			
	Existing	Proposed	Existing	Proposed		
S1 – 30 Redington Rd – SE Elevation – GF	11	11	0	0	1.00	Negligible
S2 – 30 Redington Rd – SE Elevation – GF	12	13	2	3	1.08	Negligible
S3 – 30 Redington Rd – SE Elevation – GF	18	19	6	7	1.06	Negligible
S4 – 30 Redington Rd – SE Elevation – GF	21	27	5	8	1.29	Negligible
S5 – 30 Redington Rd – SE Elevation – GF	18	23	1	5	1.28	Negligible
S6 – 30 Redington Rd – SE Elevation – GF	27	28	0	0	1.04	Negligible
S7 – 30 Redington Rd – SE Elevation – 1F	56	59	22	23	1.05	Negligible
S8 – 30 Redington Rd – SE Elevation – 1F	23	25	7	8	1.09	Negligible
S9 – 30 Redington Rd – SE Elevation – 1F	39	46	7	10	1.18	Negligible
S10 – 30 Redington Rd – SE Elevation – 1F	33	39	2	6	1.18	Negligible
S11 – 30 Redington Rd – SE Elevation – 2F	62	67	23	23	1.08	Negligible
S12 – 26 Redington Rd – NW Elevation – B	N/A	N/A	N/A	N/A	N/A	N/A
S13 – 26 Redington Rd – NW Elevation – GF	N/A	N/A	N/A	N/A	N/A	N/A
S14 – 26 Redington Rd – NW Elevation – 1F	N/A	N/A	N/A	N/A	N/A	N/A
S15 – 26 Redington Rd – NW Elevation – 1F	N/A	N/A	N/A	N/A	N/A	N/A
S16 – 26 Redington Rd – NW Elevation – 1F	N/A	N/A	N/A	N/A	N/A	N/A
S17 – 26 Redington Rd – NW Elevation – 1F	N/A	N/A	N/A	N/A	N/A	N/A
S18 – 26 Redington Rd – NW Elevation – 1F	N/A	N/A	N/A	N/A	N/A	N/A

S19 – 26 Redington Rd – NW Elevation – 2F	N/A	N/A	N/A	N/A	N/A	N/A
S20 – 26 Redington Rd – NW Elevation – 2F	N/A	N/A	N/A	N/A	N/A	N/A
RL1 – 26 Redington Rd - GF	13	15	3	2	1.19	Negligible
RL2 – 26 Redington Rd - GF	13	13	2	2	0.97	Negligible
RL3 – 26 Redington Rd - GF	16	15	2	2	0.98	Negligible
RL4 – 26 Redington Rd - GF	17	18	3	3	1.03	Negligible

Table 4 Sunlight results

NOTE: N/A - Not applicable. The buildings surrounding or adjacent to the site that do not contain windows within 90° of due South have been excluded from the sunlight assessments. This is because the sunlight is directional and the North-facing windows in this location will only receive sunlight at the height of summer at occasional times. As such, pursuant to the BRE guide, North-facing windows are not considered to have a reasonable expectation of sunlight and do not require assessment.

The table above demonstrates that **none of assessed windows facing south, east, and west will be adversely impacted by the proposed development. Hence, in terms of sunlight the proposed scheme is considered acceptable.**

The slight loss in sunlight for the other surfaces is not considered to be a concern as the proposed total APSH is above >25% of which more than 5% is in winter months or more than 0.8 times their former values and will provide adequate levels of sunlight. It should be noted that the values provided in the BRE 209 are for guidance purposes only.

5.3 Overshadowing

The following results represent the cumulative overshadowing impacts of the proposed development. As identified from the AutoCAD drawings and/or site plan, **one existing amenity area is located at 30 Redington Road**. In accordance with the BRE guidelines, overshadowing has been assessed during times of the day where the sun's altitude is above 10° (from 7:30am to 5:00pm).

"It is suggested that, for it to appear adequately sunlit throughout the year, at least half of a garden or amenity area should receive at least two hours of sunlight on 21st March. If as a result of new development, an existing garden or amenity area does not meet these guidelines, and the area which can receive two hours of sun on 21st March is less than 0.8 times its former value, then the loss of sunlight is likely to be noticeable".

The detailed results are presented in section 7.6 in the appendix, and the pictures showing the overshadowing impact are indicated in section 7.7 of the Appendix.

A summary of results is displayed in the table below. Location of the assessed amenity areas can be found in section 7.2 of this report.

Overshadowing assessment from 7.30am to 5.00pm % of area receiving sunlight on 21 st March				
Amenity area	Existing (%)	Proposed (%)	Ratio	Result
A1 – 30 Redington Rd – Amenity/Garden	71.69	51.10	0.71	Negligible (6 hours sunlight)

Table 5 Overshadowing results

As shown in the table above, **the existing amenity at 30 Redington Road will not be adversely impacted by the proposed development as half of the area will receive at least 6 hours of sunlight on 21st March with the proposed scheme (shown in the table below). Hence in terms of overshadowing, the proposed scheme is acceptable.**

Time	07:00	08:00	09:00	10:00	11:00	12:00	13:00	14:00	15:00	16:00	17:00	18:00
Existing (%)	32.60	80.70	81.10	82.20	76.50	69.80	65.90	71.20	85.60	74.80	67.30	72.60
Proposed (%)	29.70	4.40	24.00	37.40	43.40	47.00	54.70	70.70	87.20	74.80	67.30	72.60

A percentage of area receiving direct sunlight on the 21st March

6 CONCLUSION

6.1 Daylight

This report demonstrates that the levels of daylight at the surrounding buildings at 26 and 30 Redington Road will not be adversely affected by the proposed development. Twenty-four windows/rooflights have been assessed and all meet the BRE criteria for daylight.

6.2 Sunlight

This report demonstrates that the levels of sunlight at the surrounding buildings at 26 and 30 Redington Road will not be adversely affected by the proposed development. Twenty-four windows/rooflights have been assessed and all meet the BRE criteria for sunlight.


6.3 Overshadowing

This report demonstrates that the existing amenity area/garden located at 30 Redington Road will not be adversely affected by the proposed development, as it meets the BRE criteria for overshadowing.

7 APPENDIX

7.1 Suntrace


- ❖ The red line represents the sun's path during June.
- ❖ The yellow line represents the sun's path during March/September.
- ❖ The blue line represents the sun's path during December.

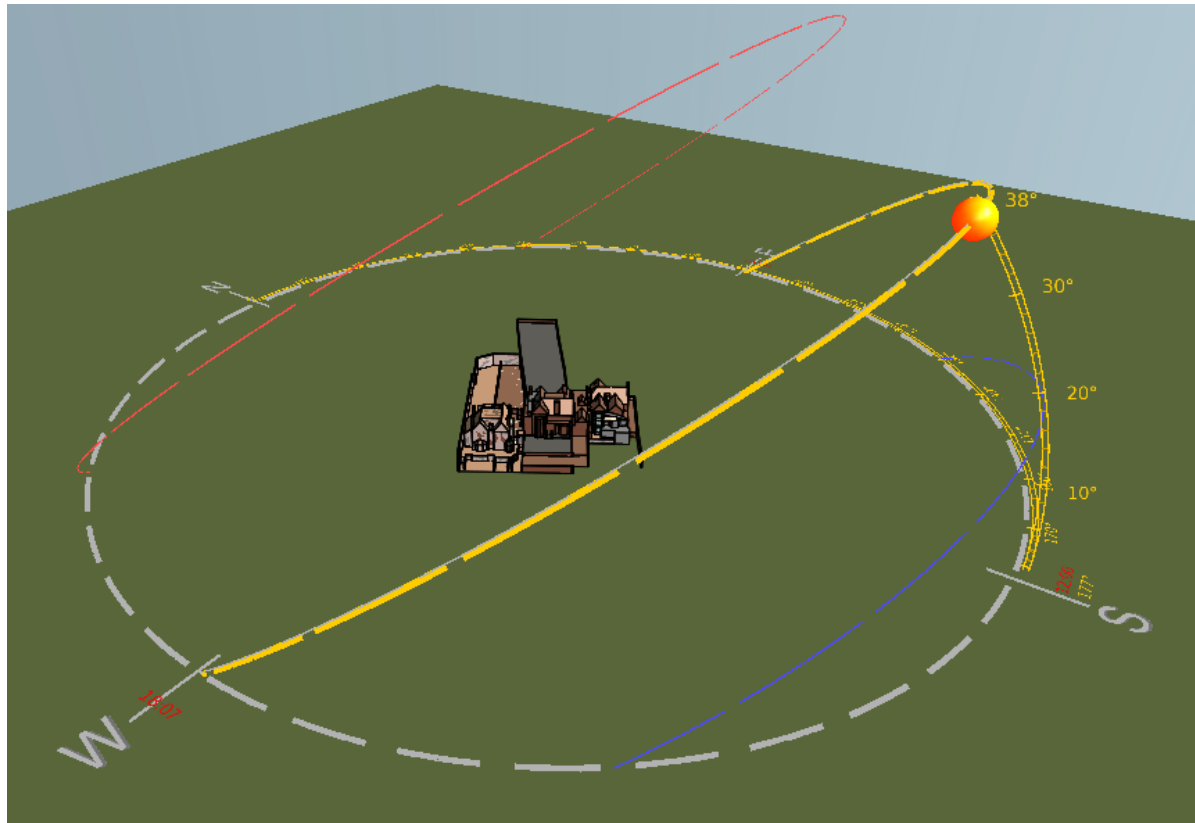


7.2 Site plan and location

Location	28 Redington Road, Hampstead, London, NW3 7RB
Latitude (°)	51.56 N
Longitude (°)	0.19 W

7.2.1 Site Plans

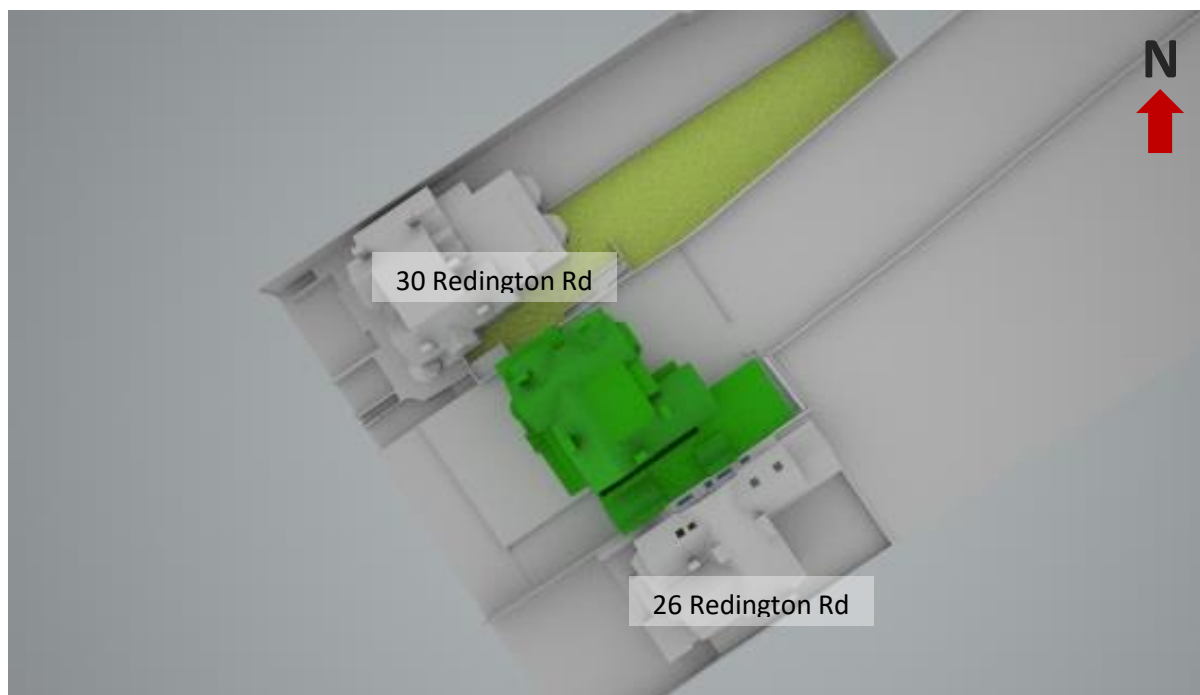


Existing site layout

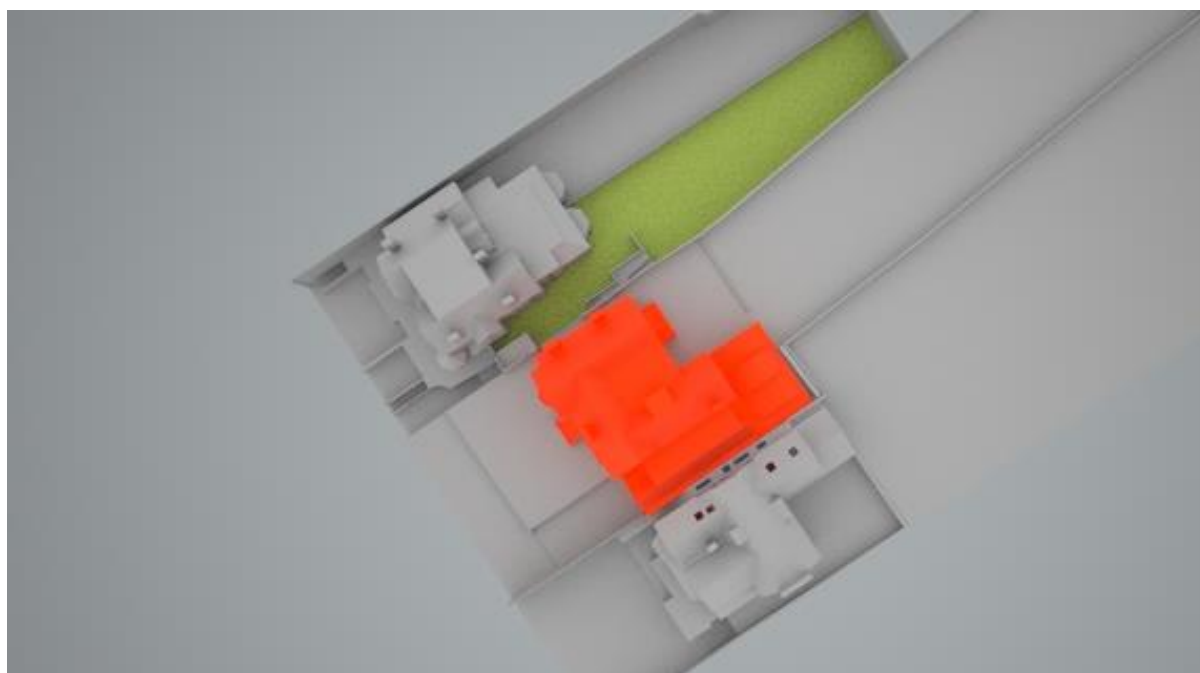


Proposed site layout


7.2.1 Location of Assessed Windows and Amenities

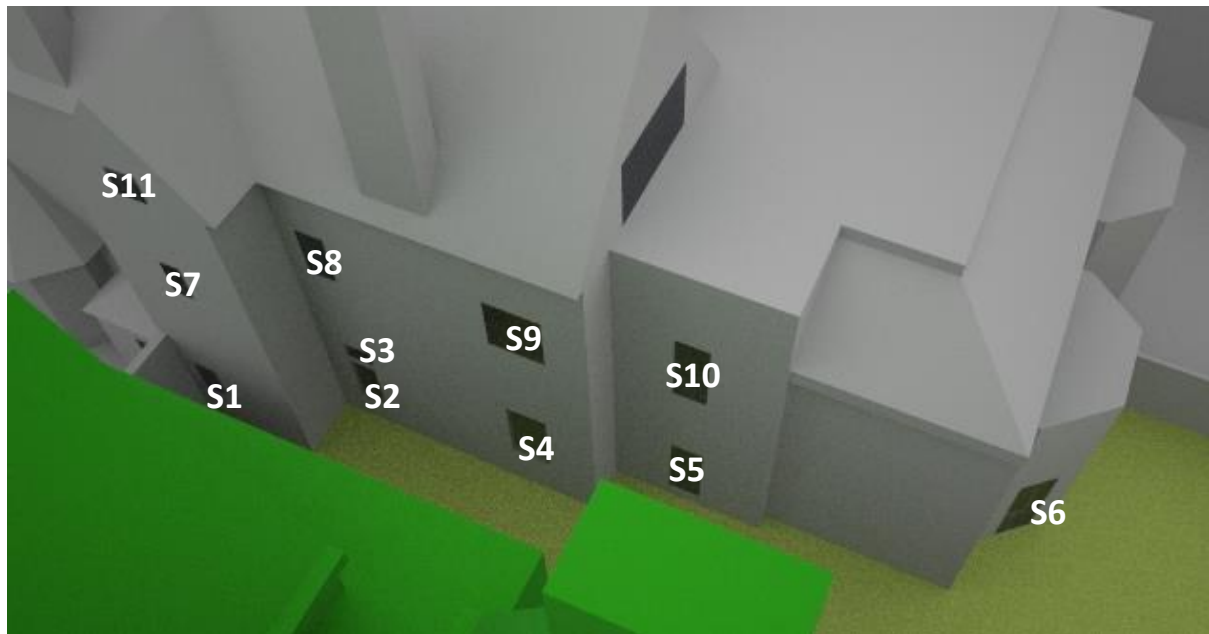

30 Redington Road

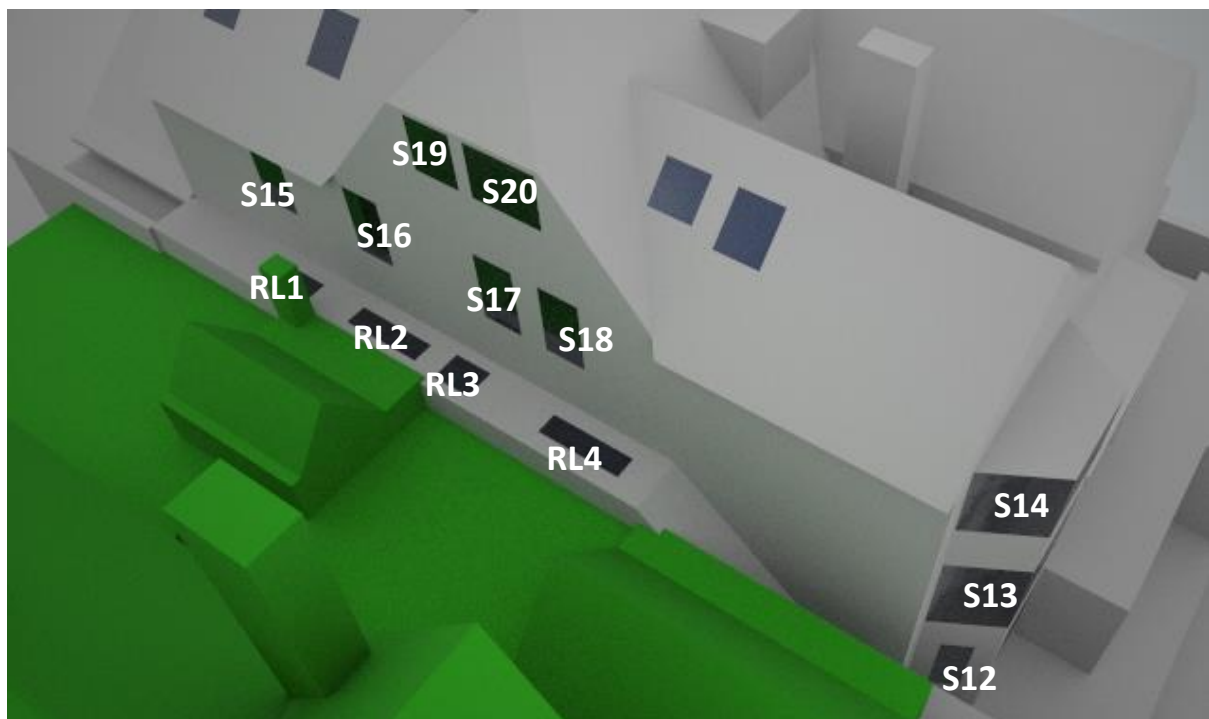


26 Redington Road

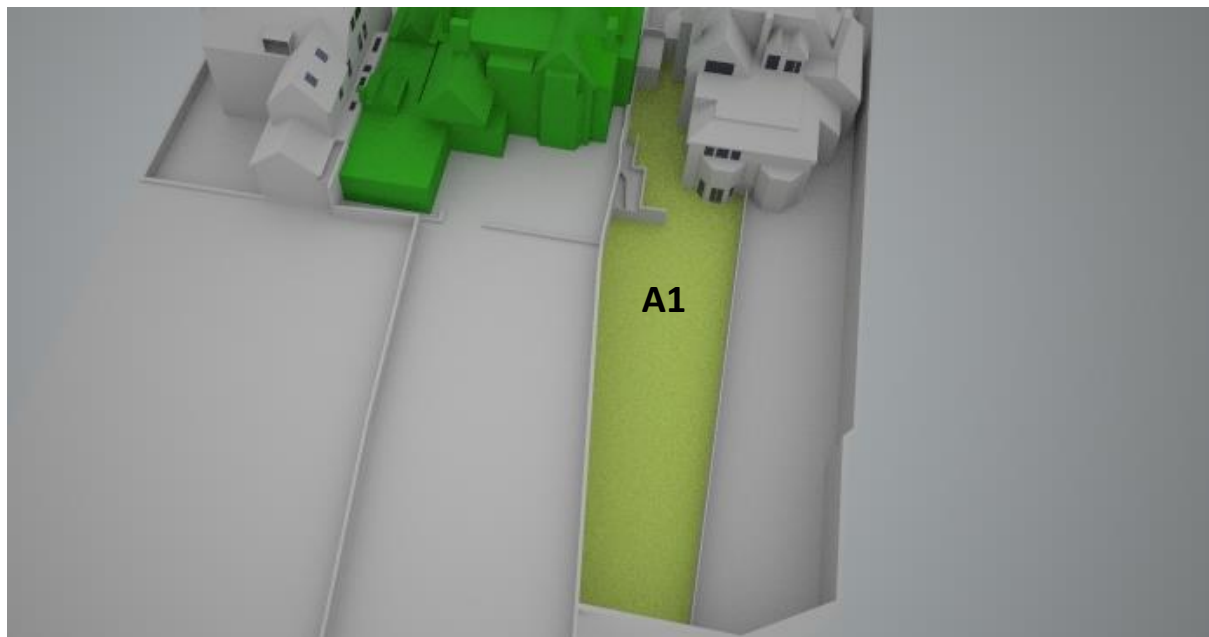


Assessed Amenity


7.3 Model images

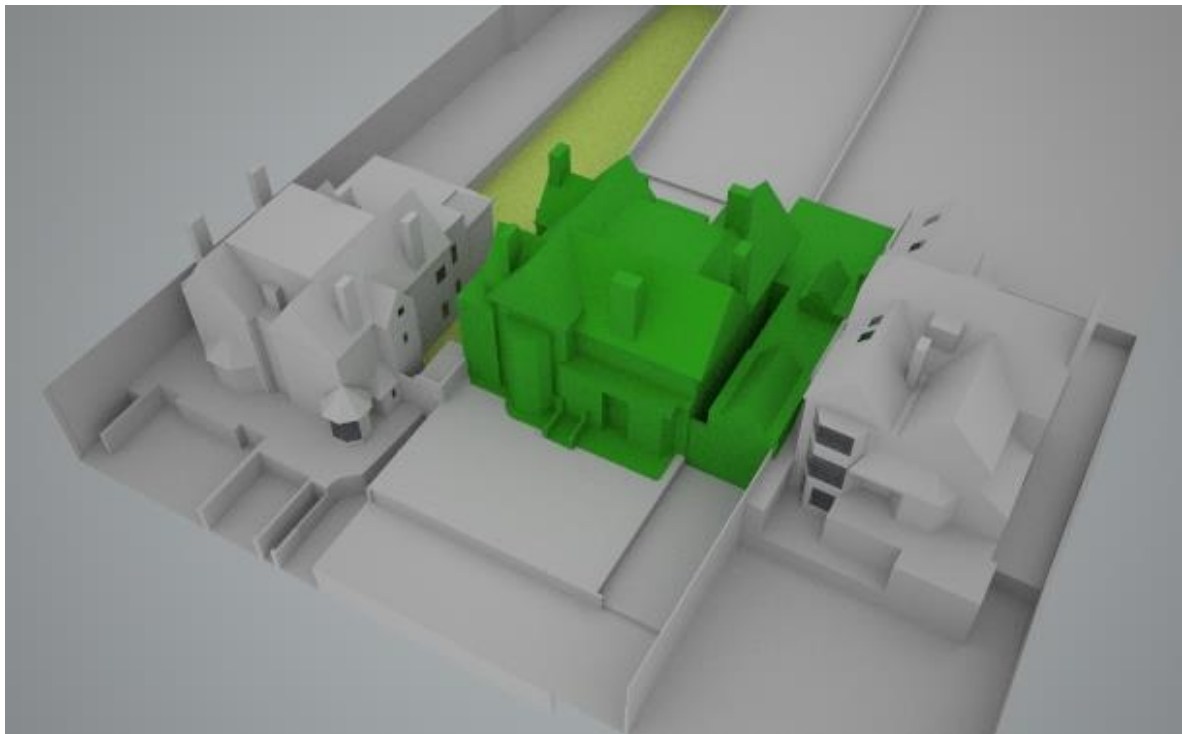


Existing image 1

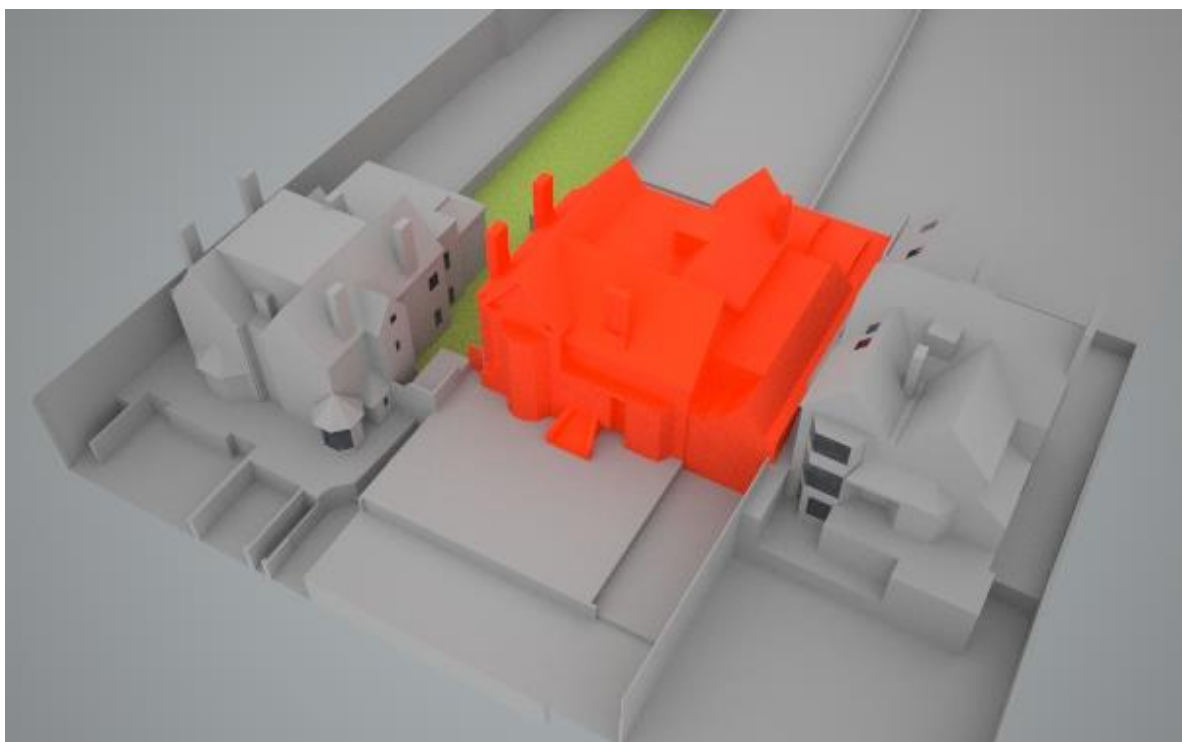

Proposed image 1

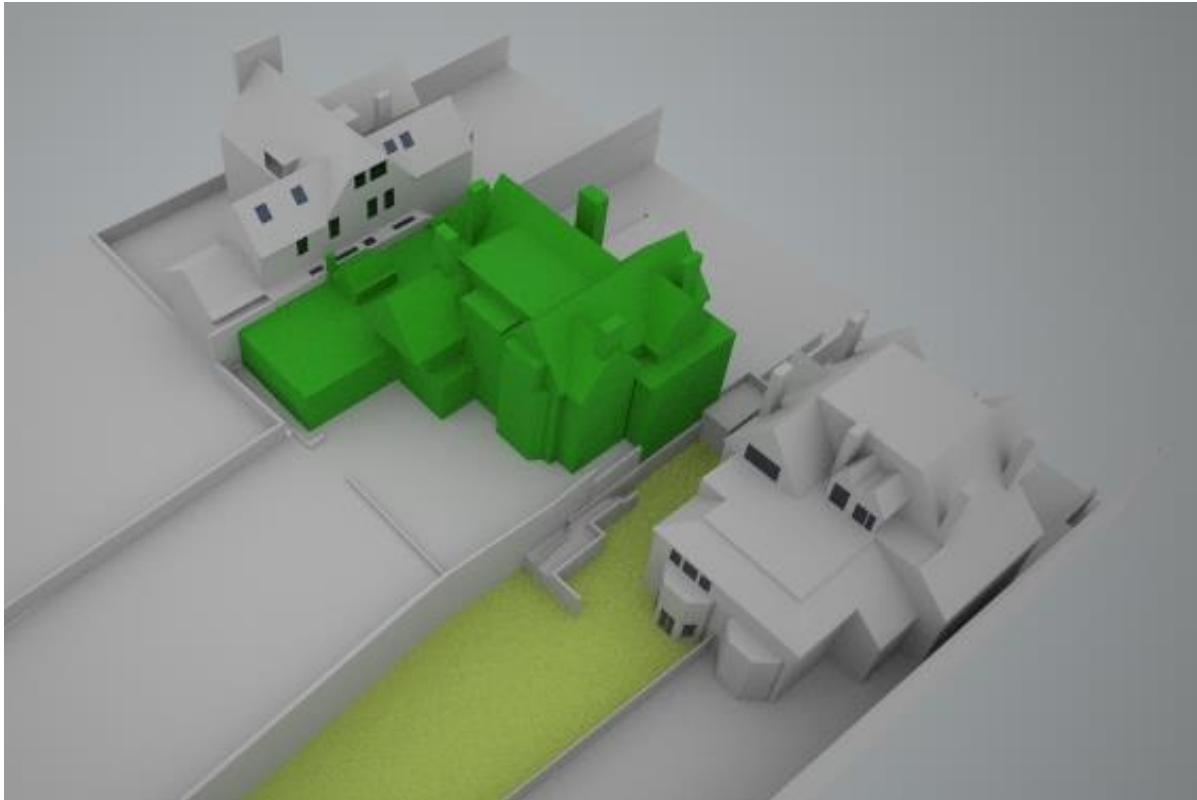

Existing image 2

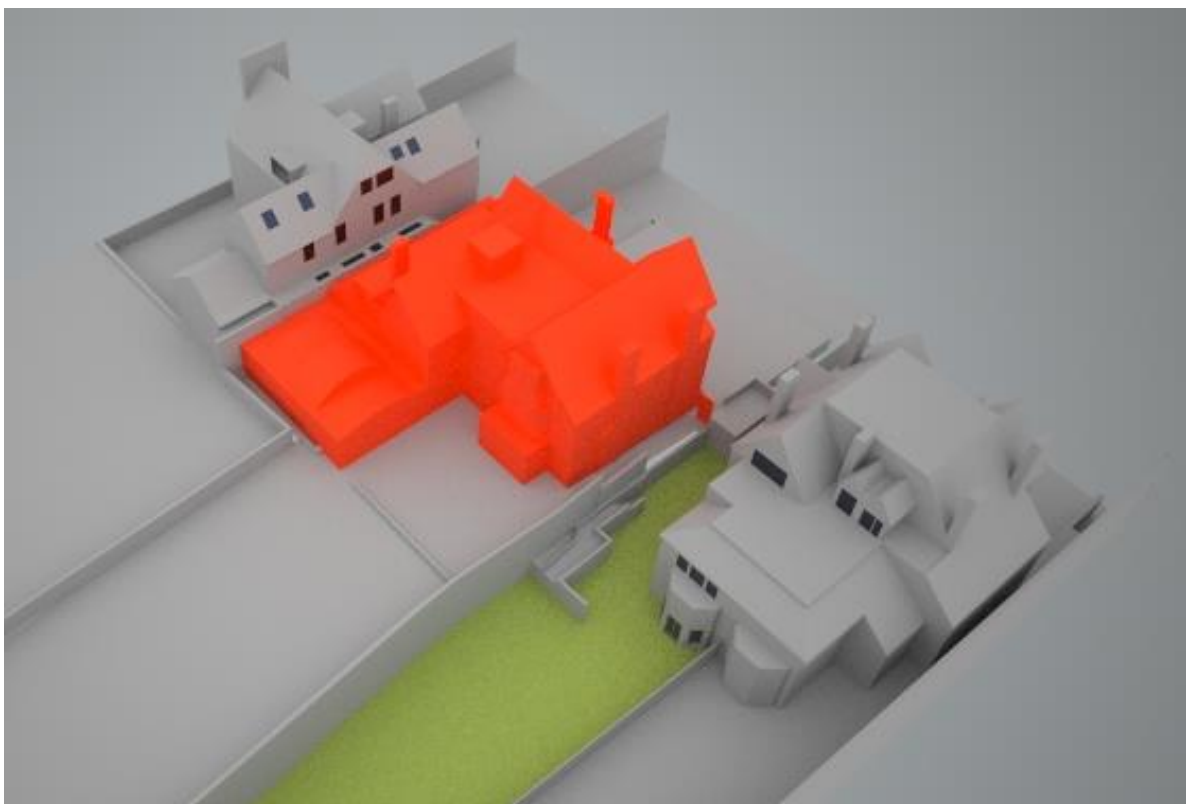


Proposed image 2


7.4 Daylight results

7.4.1 External daylight results

S1 – 30 Redington Rd – SE Elevation – GF

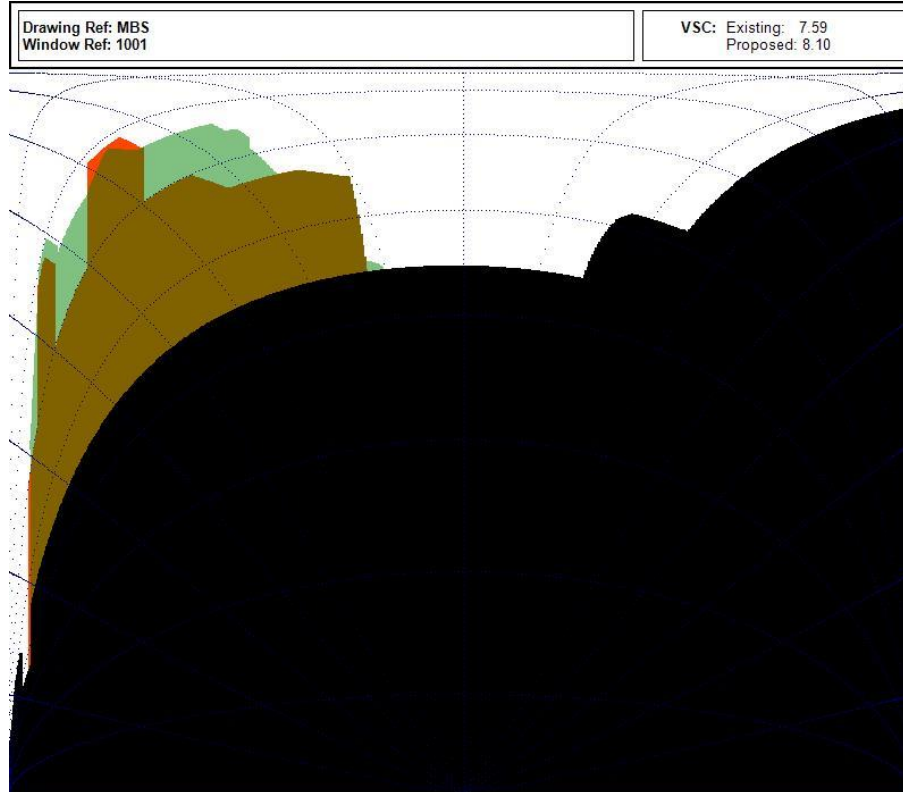


S2 – 30 Redington Rd – SE Elevation – GF

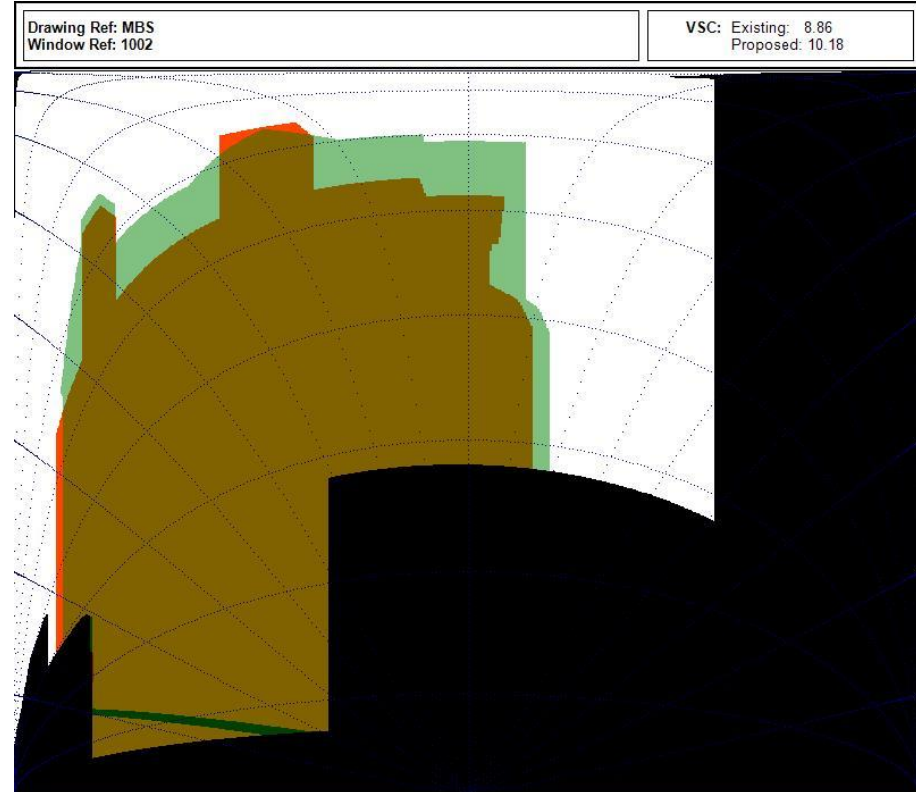


- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.

S3 – 30 Redington Rd – SE Elevation – GF

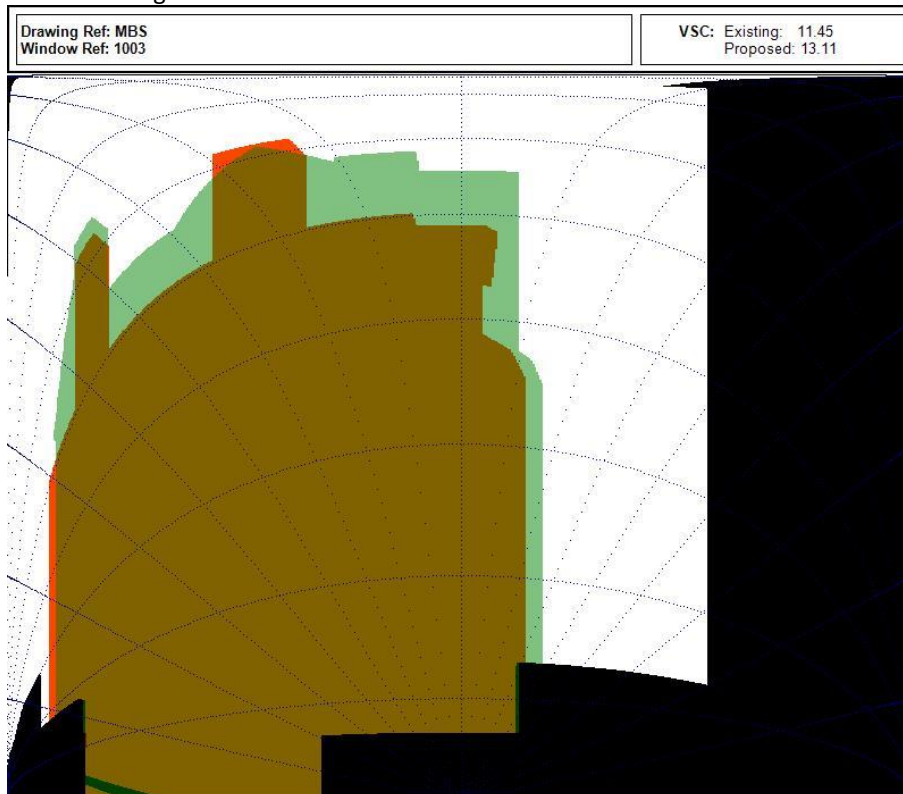


S4 – 30 Redington Rd – SE Elevation – GF

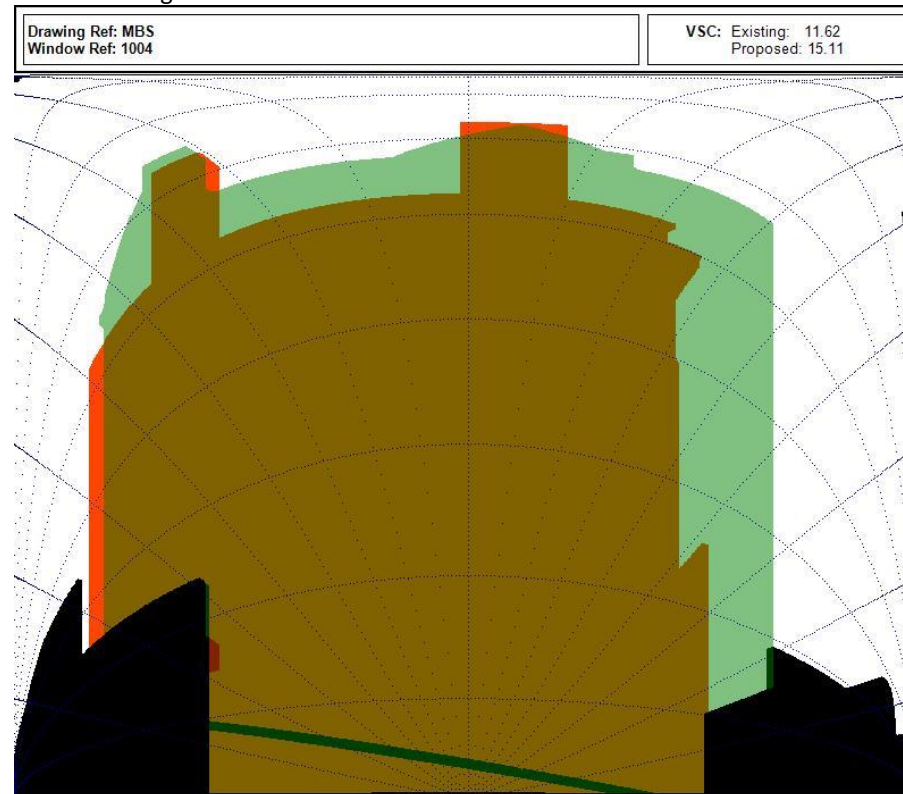


- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.

S5 – 30 Redington Rd – SE Elevation – GF

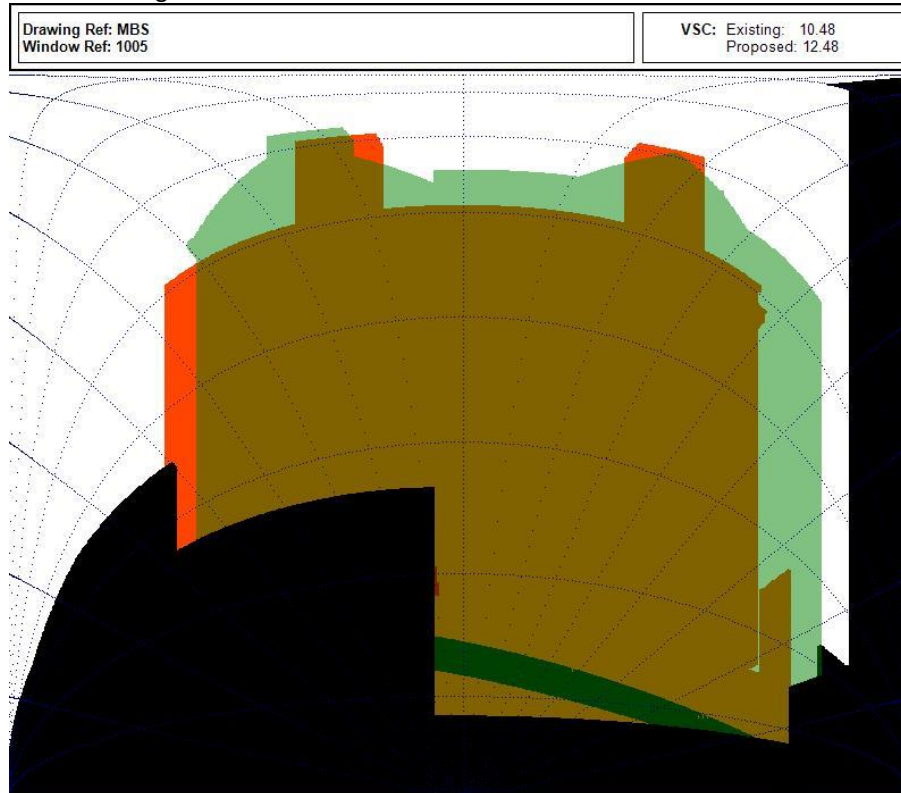


S6 – 30 Redington Rd – SE Elevation – GF

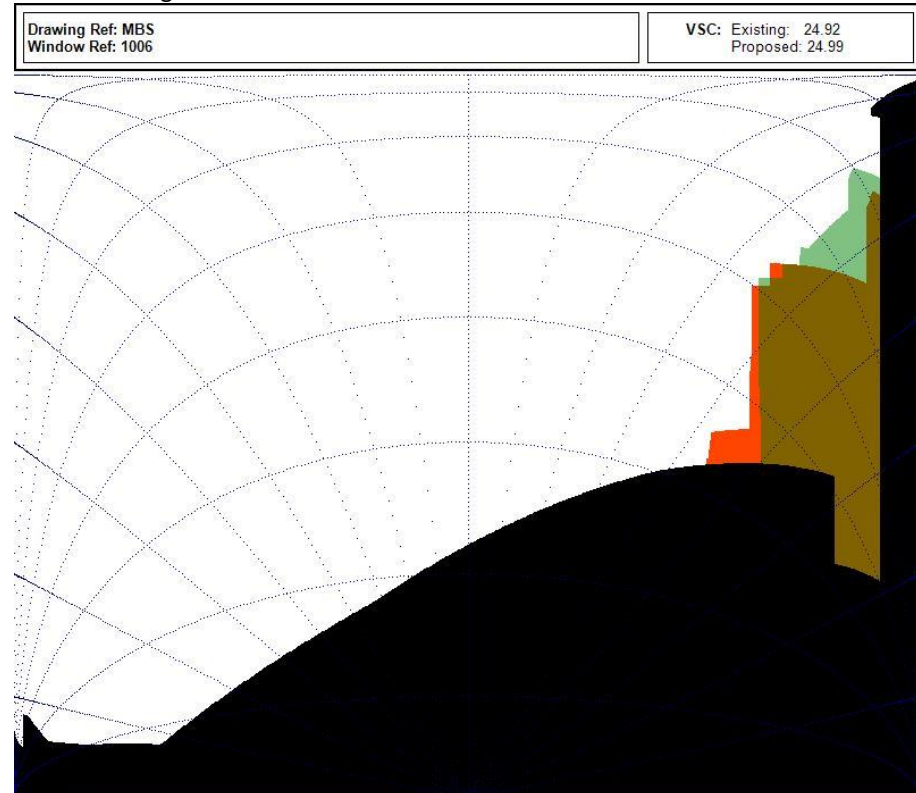


- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.

S7 – 30 Redington Rd – SE Elevation – 1F

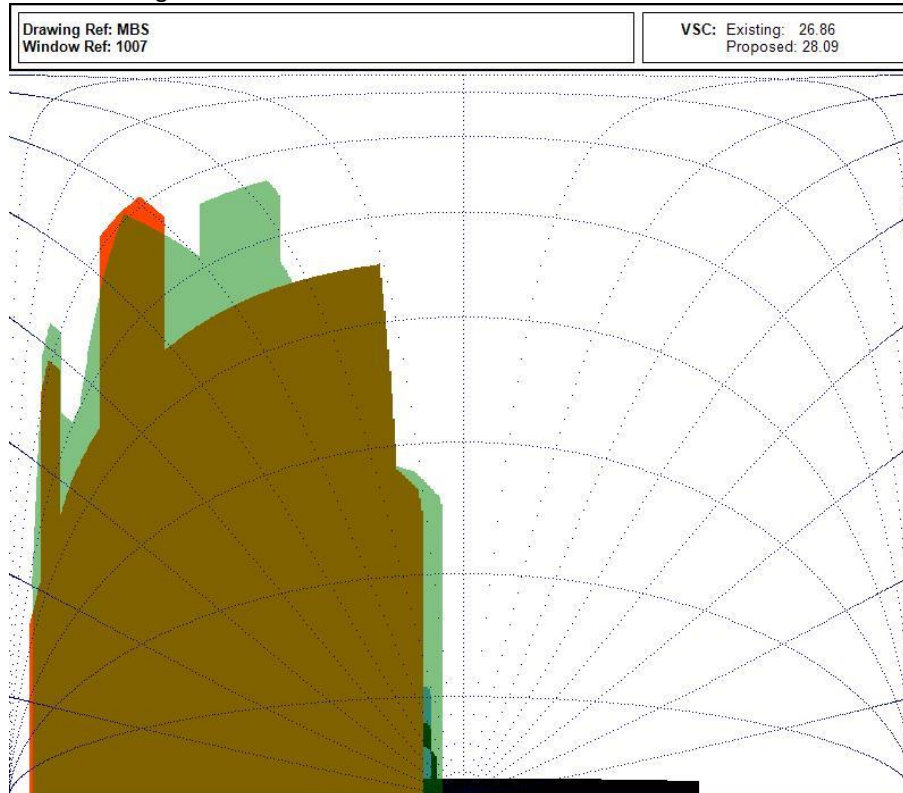


S8 – 30 Redington Rd – SE Elevation – 1F

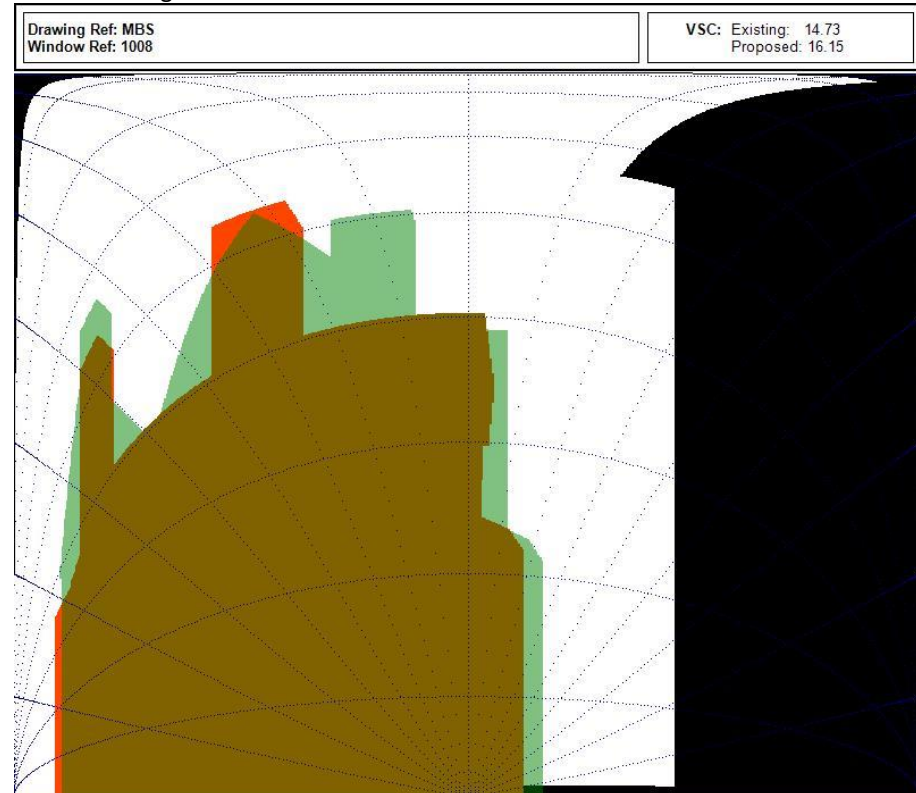


- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.

S9 – 30 Redington Rd – SE Elevation – 1F

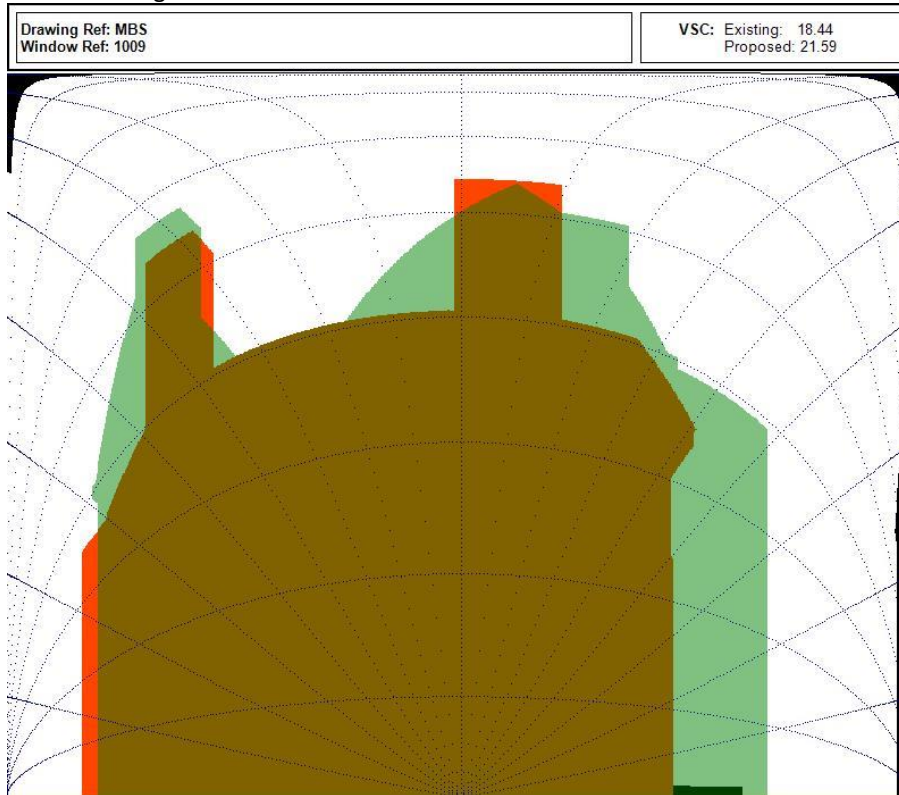


S10 – 30 Redington Rd – SE Elevation – 1F

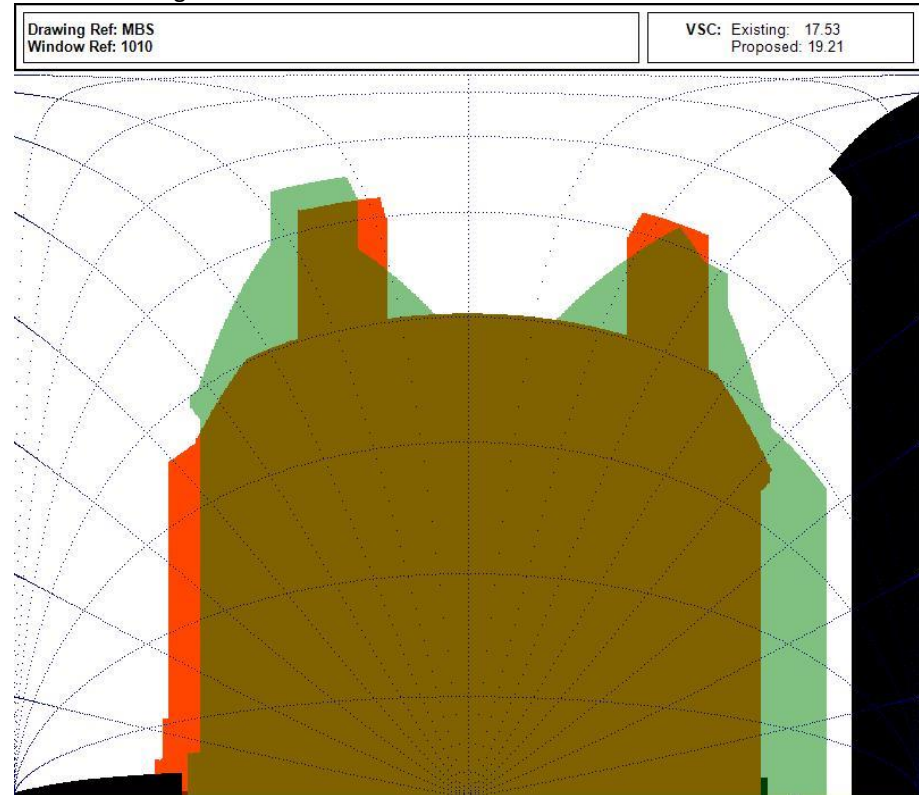


- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.

S11 – 30 Redington Rd – SE Elevation – 2F

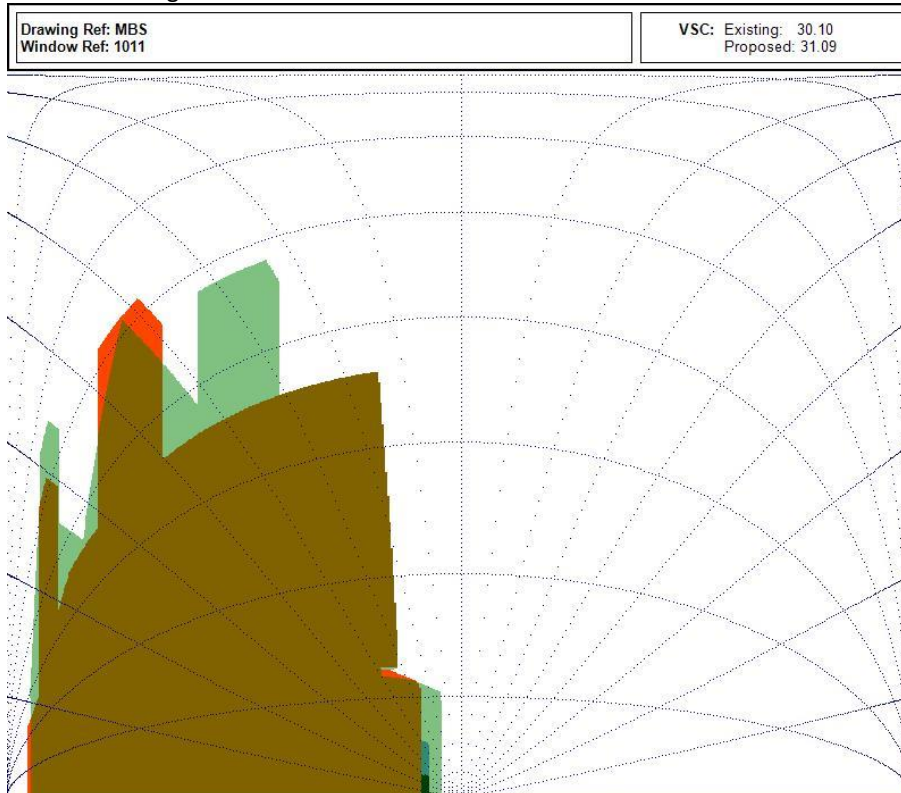


S12 – 26 Redington Rd – NW Elevation – B

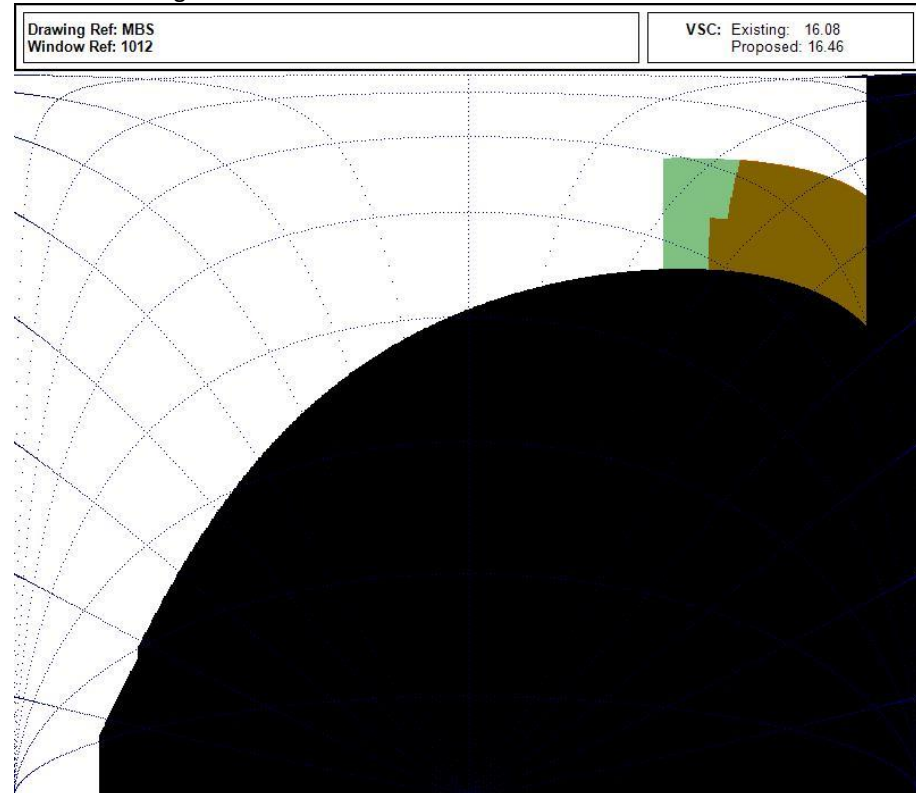


- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.

S13 – 26 Redington Rd – NW Elevation – GF

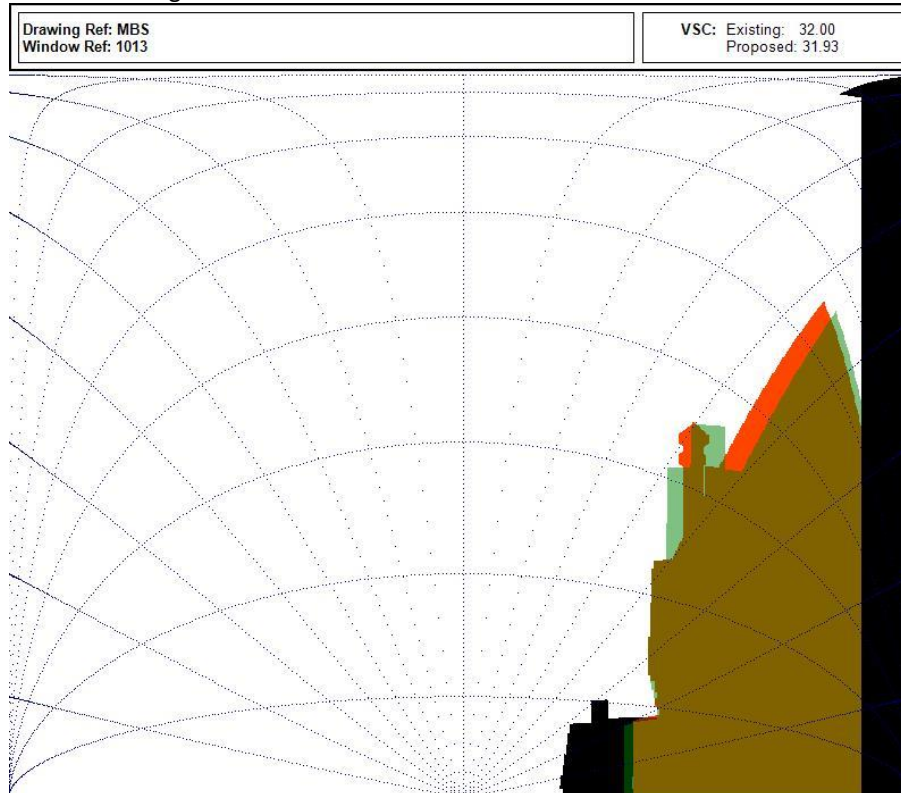


S14 – 26 Redington Rd – NW Elevation – 1F

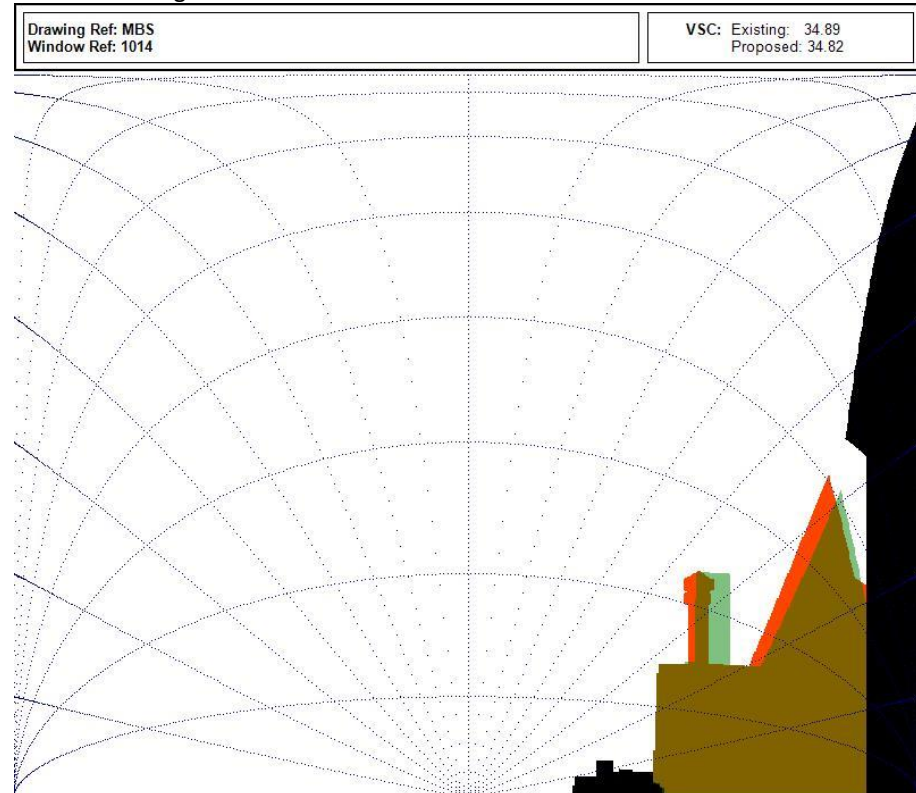


- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.

S15 – 26 Redington Rd – NW Elevation – 1F

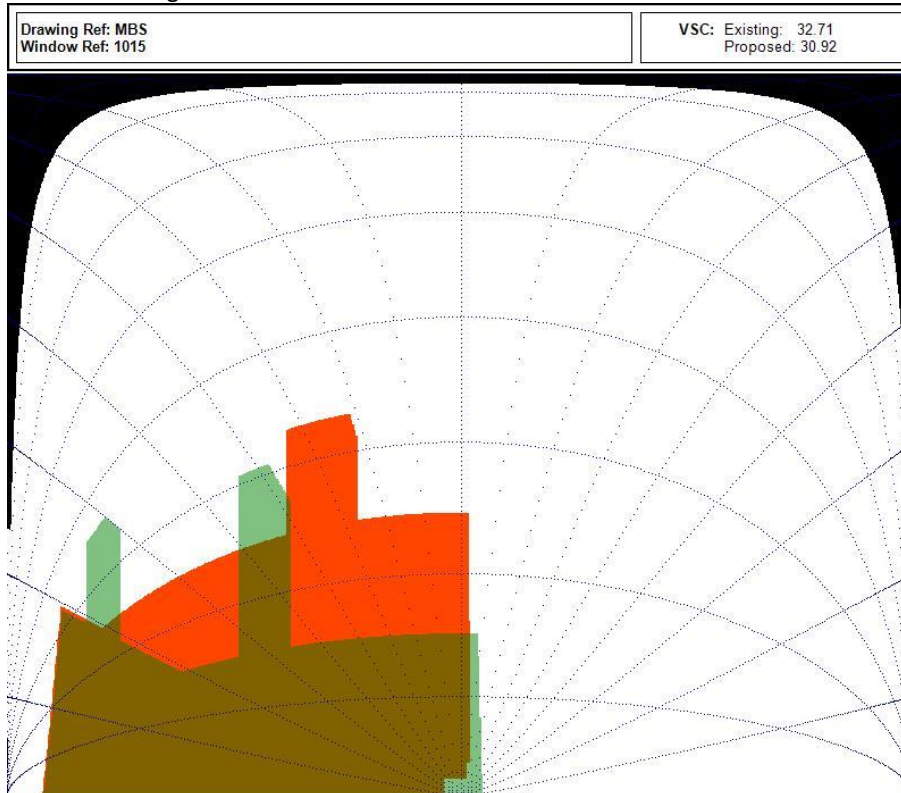


- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.


S16 – 26 Redington Rd – NW Elevation – 1F

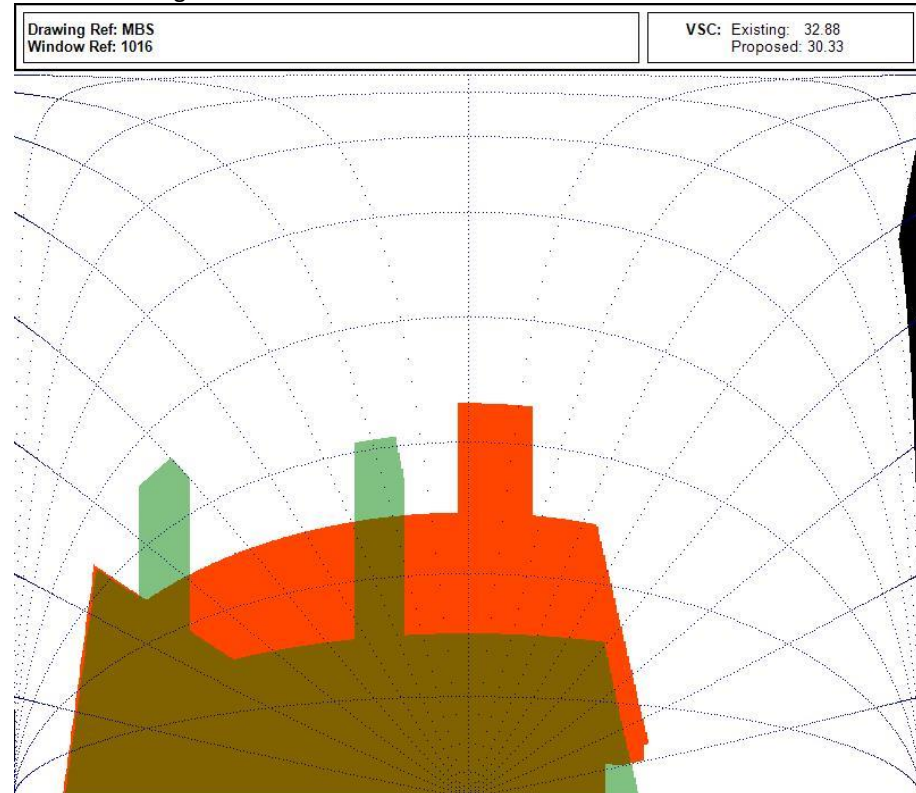

S17 – 26 Redington Rd – NW Elevation – 1F

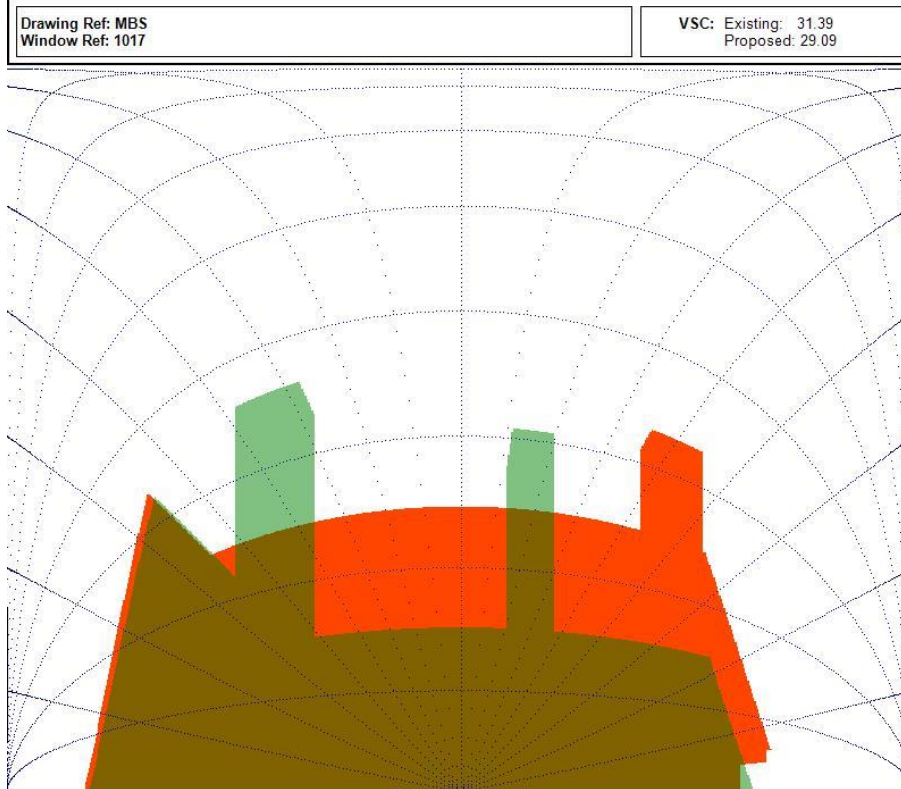


S18 – 26 Redington Rd – NW Elevation – 1F

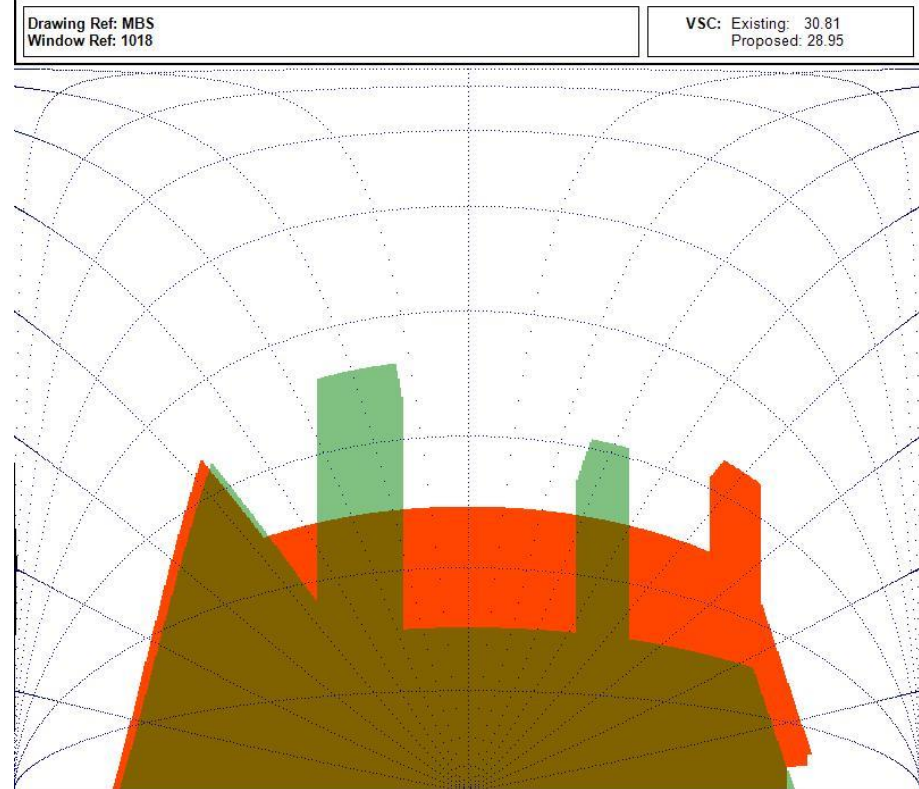

- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.

S19 – 26 Redington Rd – NW Elevation – 2F


Drawing Ref: MBS Window Ref: 1019	VSC: Existing: 37.71 Proposed: 36.68
--------------------------------------	---

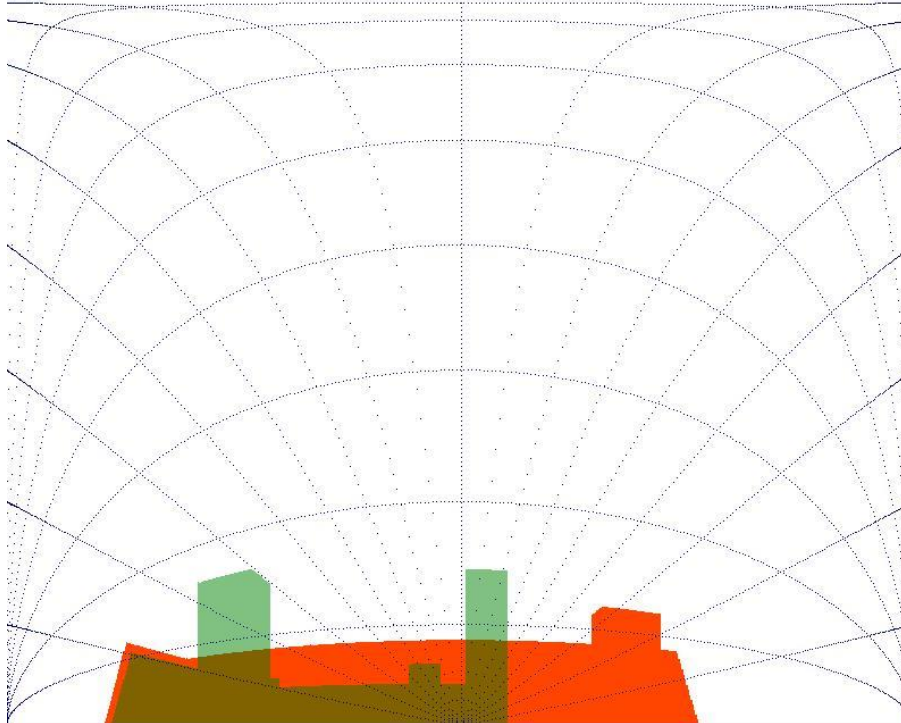



- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.

S20 – 26 Redington Rd – NW Elevation – 2F

Drawing Ref: MBS Window Ref: 1020	VSC: Existing: 37.36 Proposed: 36.63
--------------------------------------	---

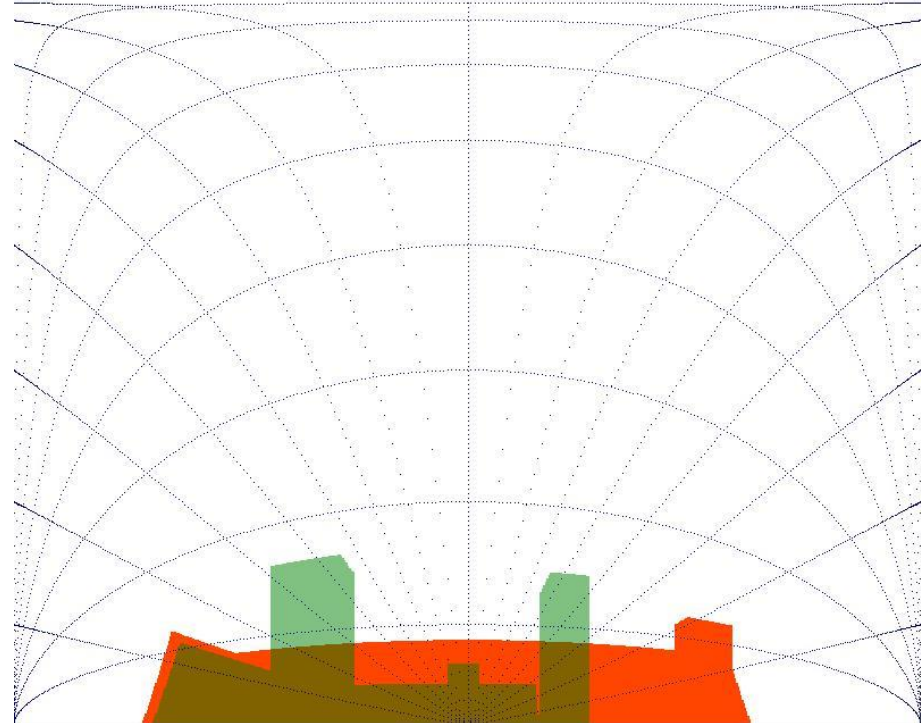


RL1 – 26 Redington Rd - GF & RL2 – 26 Redington Rd - GF & RL3 – 26 Redington Rd - GF & RL4 – 26 Redington Rd - GF

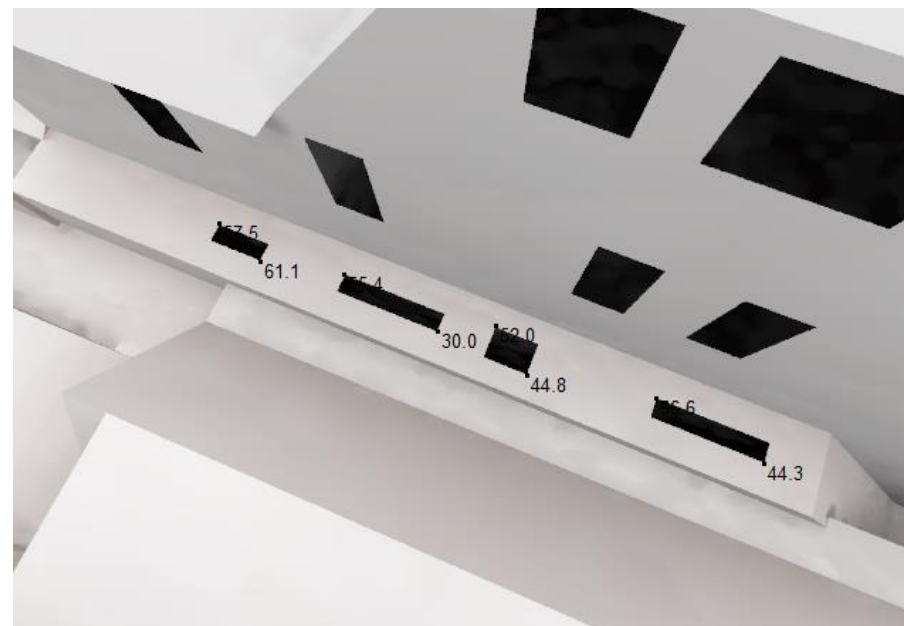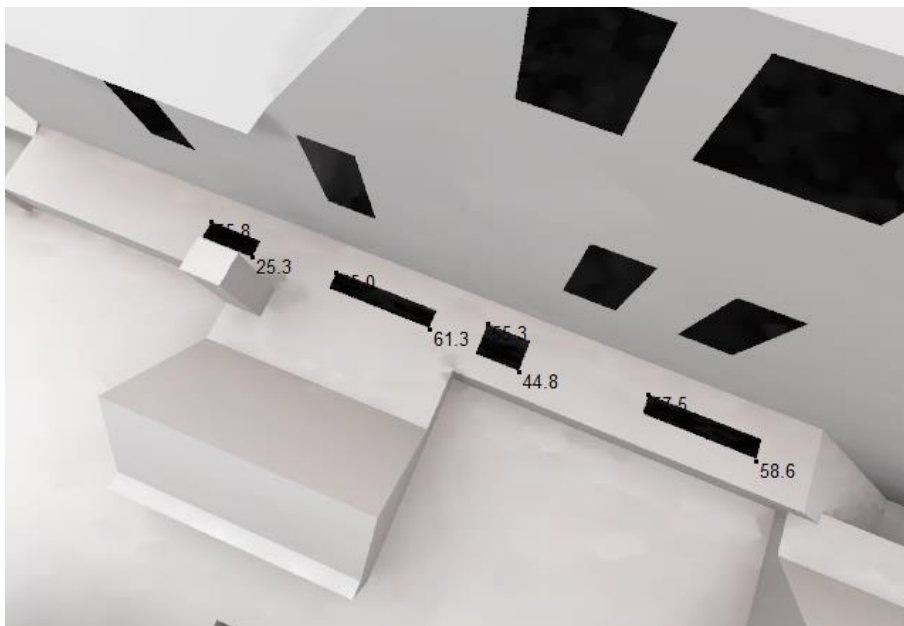


Existing				Proposed			
	Sample of VSC		Average		Sample of VSC		Average
RL1	55.8	25.3	40.55	RL1	57.5	61.1	59.30
RL2	55.0	61.3	58.15	RL2	55.4	30.0	42.70
RL3	55.3	44.8	50.05	RL3	52.0	44.8	48.40
RL4	57.5	58.6	58.05	RL4	56.6	44.3	50.45

7.5 Sunlight results

S1 – 30 Redington Rd – SE Elevation – GF

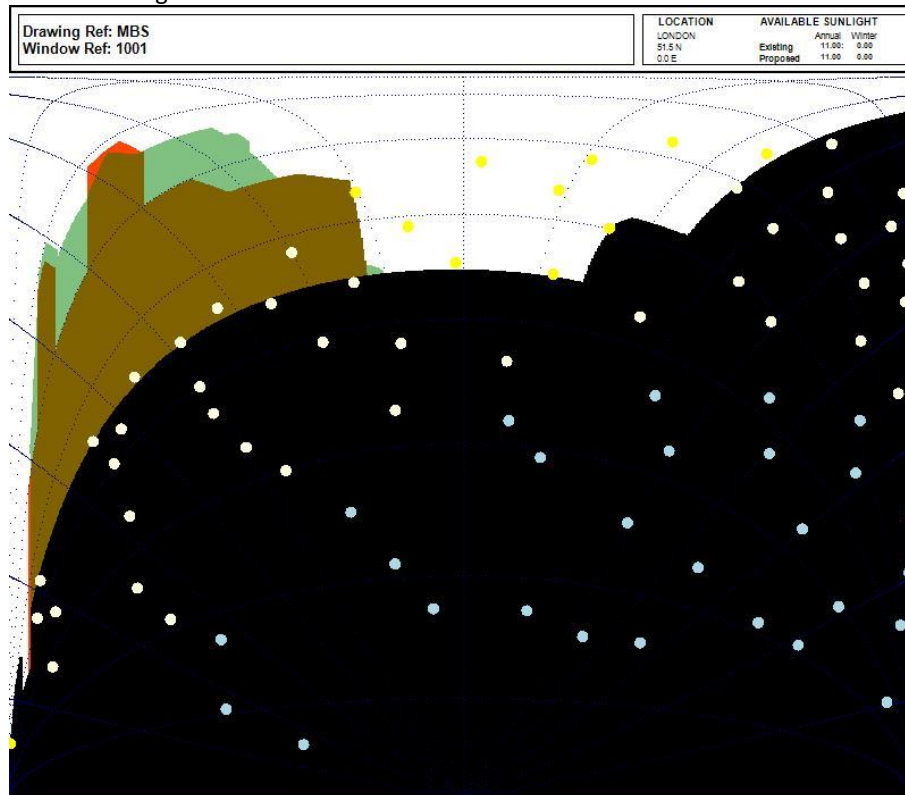


S2 – 30 Redington Rd – SE Elevation – GF

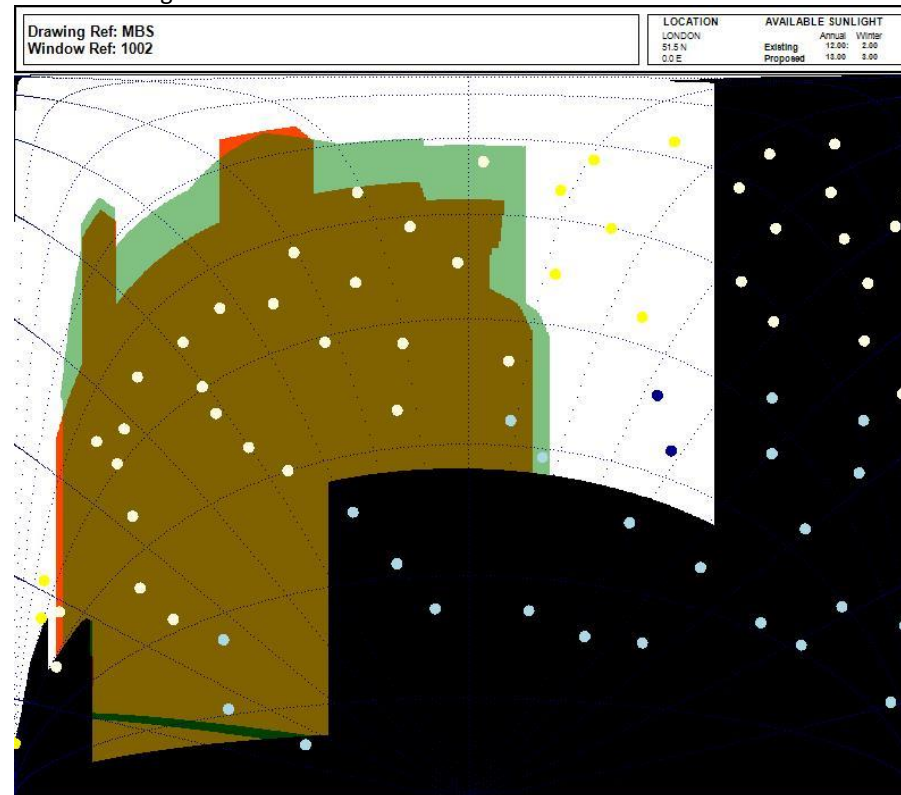


- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.
- The yellow dot represents the available sunlight during the summer months (Summer).
- The blue dot represents the available sunlight during the winter months (Winter).
- The sum of the yellow and blue dots gives the available sunlight for the whole year (Annual).
- The white dot represents the sunlight blocked by buildings.

S3 – 30 Redington Rd – SE Elevation – GF

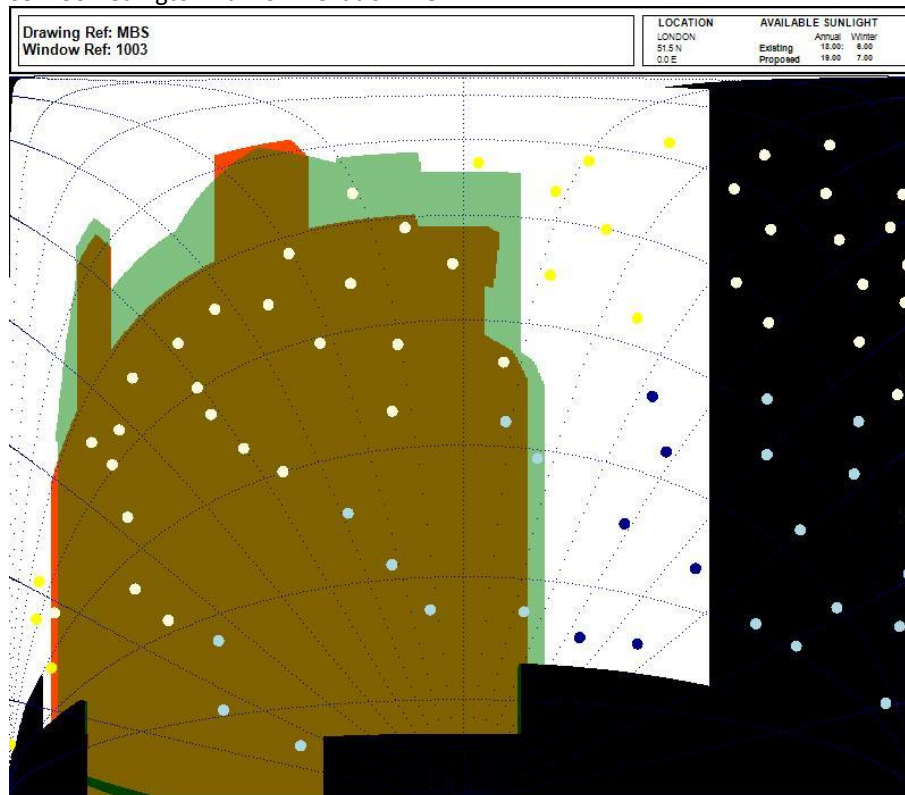


S4 – 30 Redington Rd – SE Elevation – GF

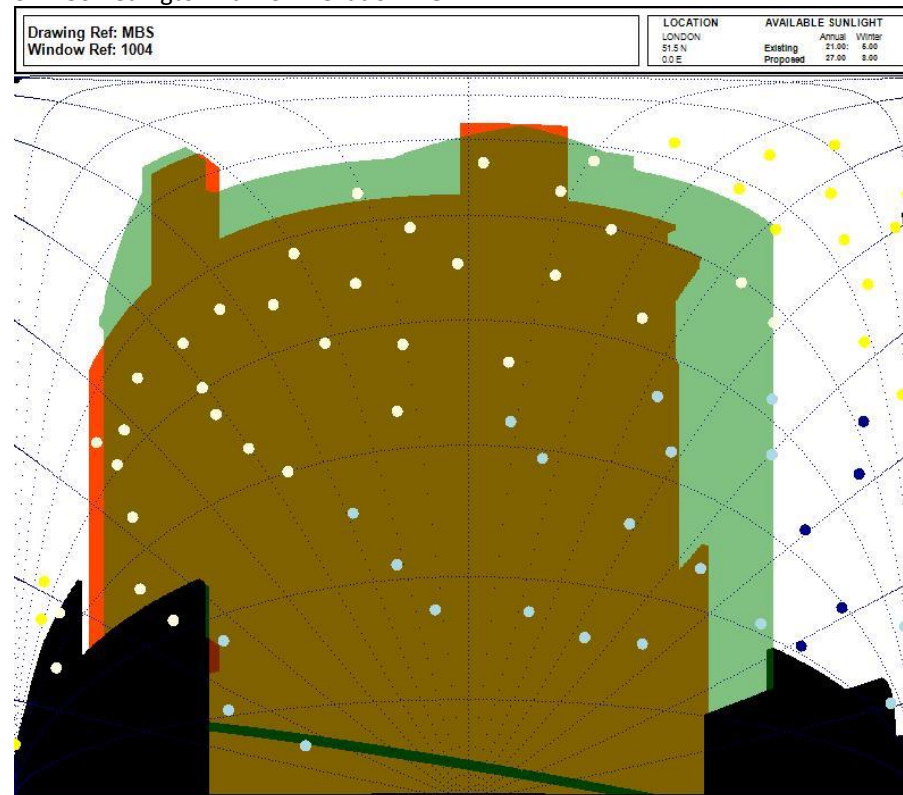


- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.
- The yellow dot represents the available sunlight during the summer months (Summer).
- The blue dot represents the available sunlight during the winter months (Winter).
- The sum of the yellow and blue dots gives the available sunlight for the whole year (Annual).
- The white dot represents the sunlight blocked by buildings.

S5 – 30 Redington Rd – SE Elevation – GF

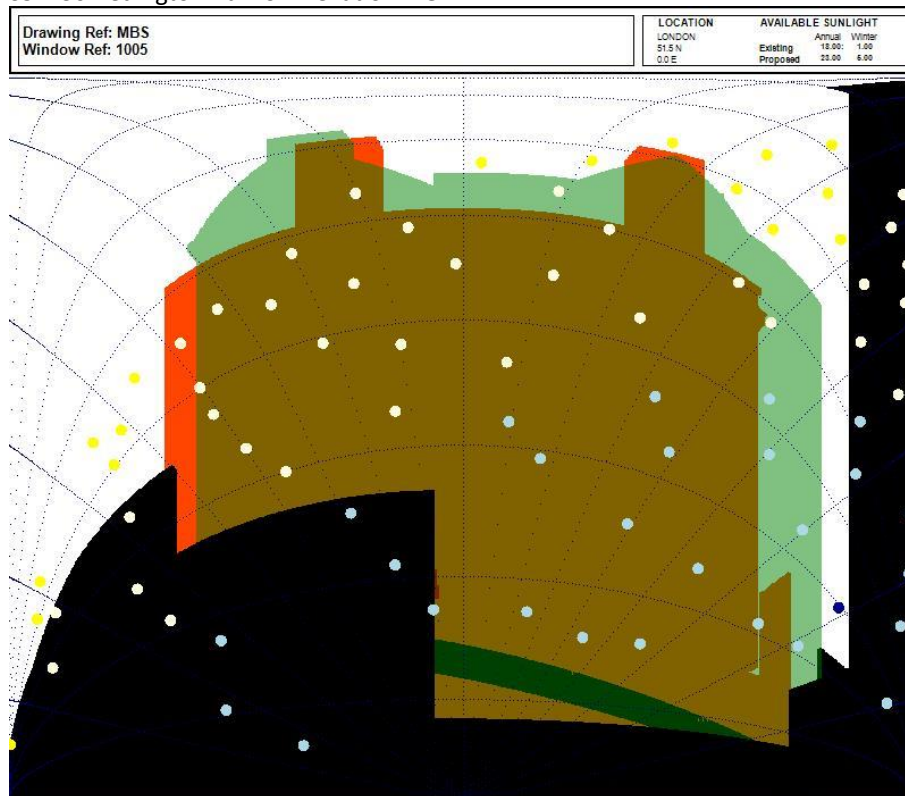


S6 – 30 Redington Rd – SE Elevation – GF

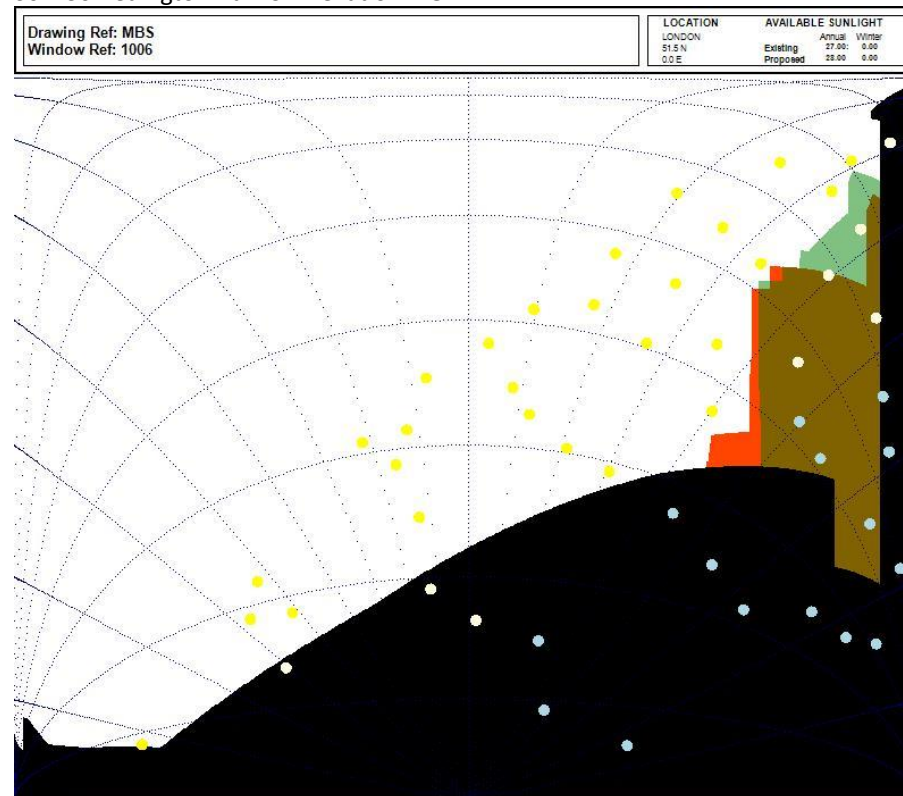


- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.
- The yellow dot represents the available sunlight during the summer months (Summer).
- The blue dot represents the available sunlight during the winter months (Winter).
- The sum of the yellow and blue dots gives the available sunlight for the whole year (Annual).
- The white dot represents the sunlight blocked by buildings.

S7 – 30 Redington Rd – SE Elevation – 1F

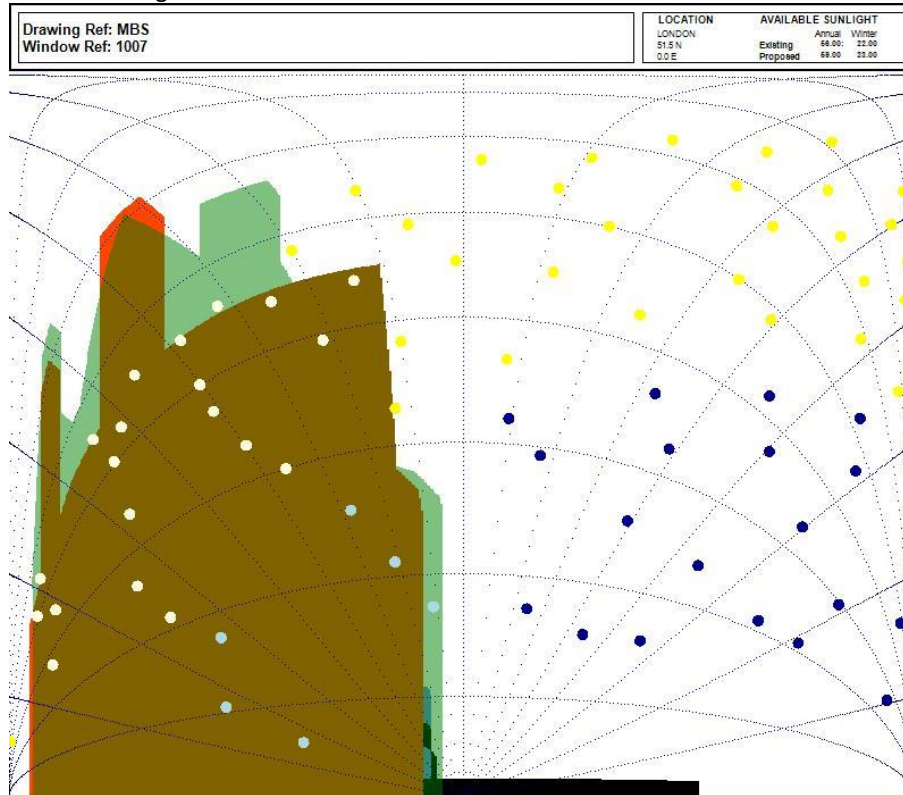


S8 – 30 Redington Rd – SE Elevation – 1F

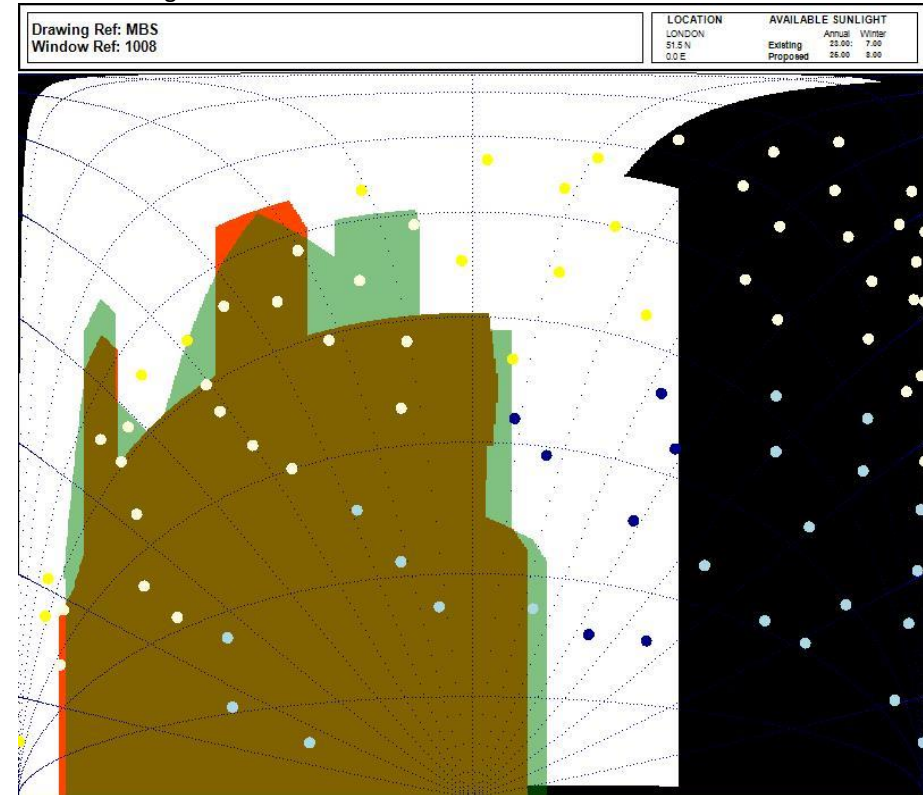


- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.
- The yellow dot represents the available sunlight during the summer months (Summer).
- The blue dot represents the available sunlight during the winter months (Winter).
- The sum of the yellow and blue dots gives the available sunlight for the whole year (Annual).
- The white dot represents the sunlight blocked by buildings.

S9 – 30 Redington Rd – SE Elevation – 1F

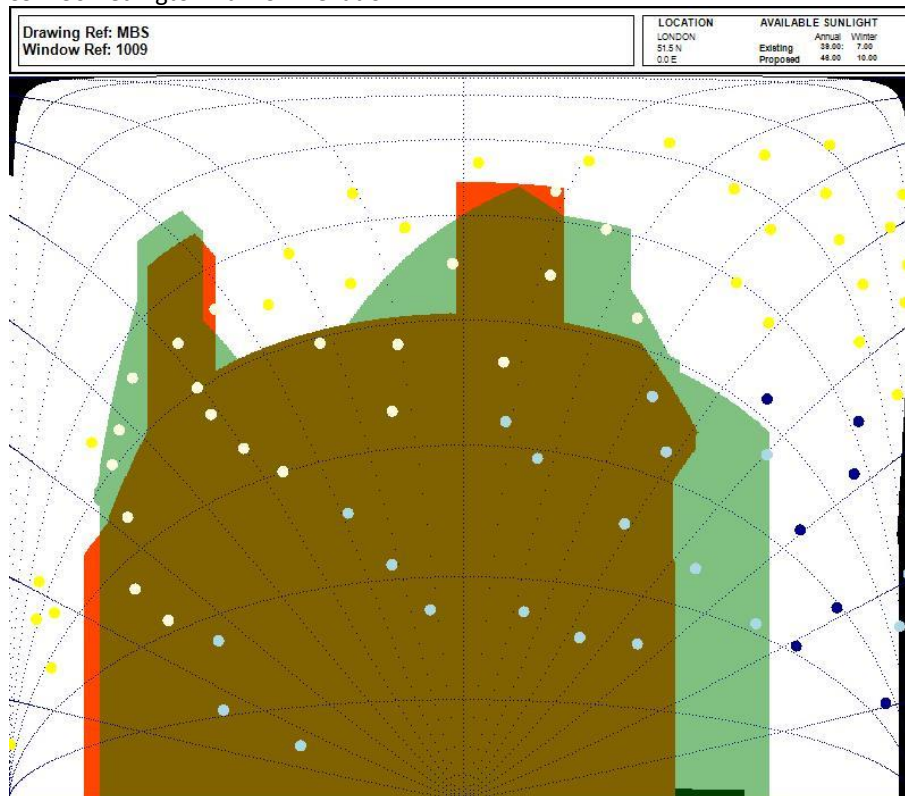


S10 – 30 Redington Rd – SE Elevation – 1F

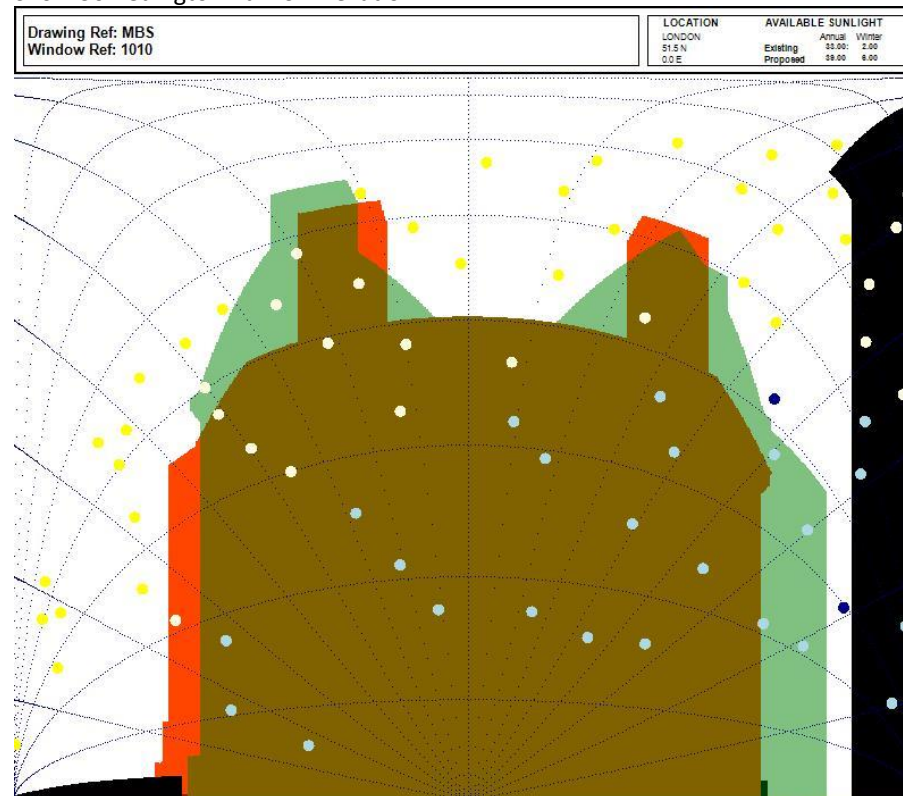

- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.
- The yellow dot represents the available sunlight during the summer months (Summer).
- The blue dot represents the available sunlight during the winter months (Winter).
- The sum of the yellow and blue dots gives the available sunlight for the whole year (Annual).
- The white dot represents the sunlight blocked by buildings.

S11 – 30 Redington Rd – SE Elevation – 2F

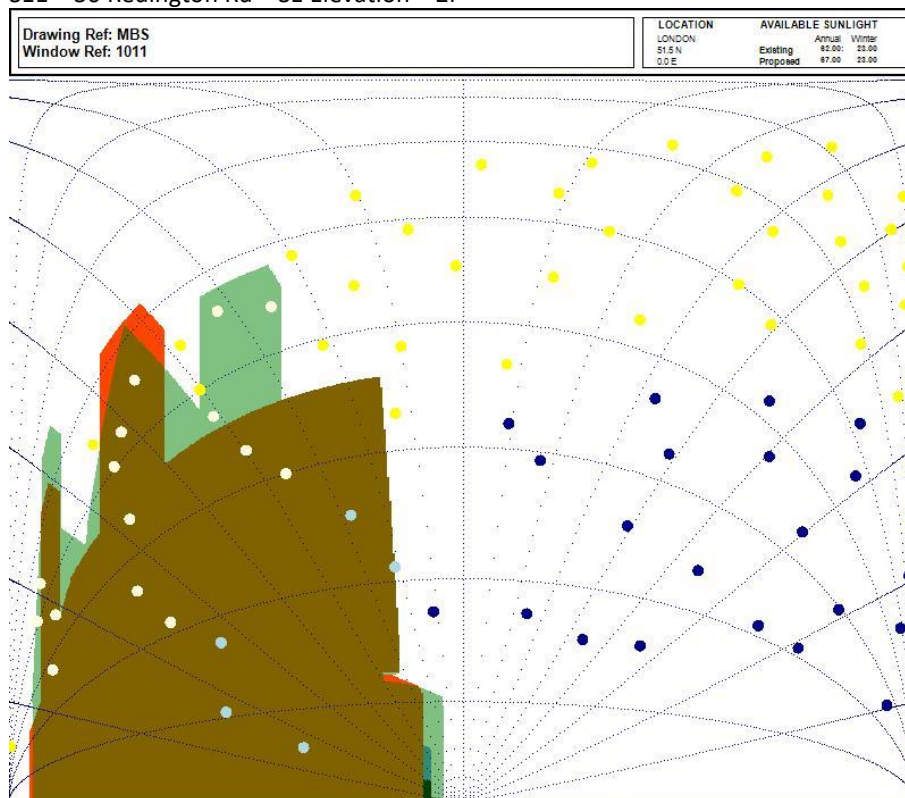

- The green contour represents the existing building.
- The orange contour represents the proposed building.
- The grey/black contour represents the surrounding buildings.
- The yellow dot represents the available sunlight during the summer months (Summer).
- The blue dot represents the available sunlight during the winter months (Winter).
- The sum of the yellow and blue dots gives the available sunlight for the whole year (Annual).
- The white dot represents the sunlight blocked by buildings.

RL1 – 26 Redington Rd - GF

Existing:

Month	04:00	05:00	06:00	07:00	08:00	09:00	10:00	11:00	12:00	13:00	14:00	15:00	16:00	17:00	18:00	19:00	20:00
Jan						0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
Feb					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	0.00			
Mar				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	69.80	0.00		
Apr		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	81.10	0.00	0.00		
May		25.40	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	53.30	99.30	54.10	0.00	0.00	0.00	
Jun	100.00	67.90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	83.90	97.40	47.00	0.00	0.00	0.00	0.00
Jul		54.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	12.80	100.00	62.00	19.90	0.00	0.00	
Aug			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	83.60	0.00	0.00	0.00	
Sep			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	99.50	97.70	0.00			
Oct				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00				
Nov					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00					
Dec						0.00	0.00	0.00	0.00	0.00	0.00	0.00					

Proposed:

Month	04:00	05:00	06:00	07:00	08:00	09:00	10:00	11:00	12:00	13:00	14:00	15:00	16:00	17:00	18:00	19:00	20:00
Jan						0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
Feb					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	0.00			
Mar				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	8.70	0.00		
Apr		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	100.00	0.00	0.00		
May		25.40	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	53.30	100.00	100.00	43.00	0.00	0.00	
Jun	100.00	67.90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	83.90	100.00	100.00	100.00	0.00	0.00	0.00
Jul		54.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	12.80	100.00	100.00	100.00	0.00	0.00	
Aug			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	100.00	0.00	0.00	0.00	
Sep			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	99.50	100.00	0.00			
Oct				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00				
Nov					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00					
Dec						0.00	0.00	0.00	0.00	0.00	0.00	0.00					

Sunlight assessment					
Total APSH (%)			Winter months APSH (%)		
Existing	Proposed	Ratio	Existing	Proposed	Ratio
12.74	15.13	1.19	2.54	2.28	0.90

RL2 – 26 Redington Rd - GF

Existing:

Month	04:00	05:00	06:00	07:00	08:00	09:00	10:00	11:00	12:00	13:00	14:00	15:00	16:00	17:00	18:00	19:00	20:00
Jan						0.00	0.00	0.00	0.00	0.00	0.00	0.00	8.70				
Feb					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	0.00			
Mar				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	10.70	100.00	12.90	0.00		
Apr		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	100.00	29.90	0.00		
May		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	60.80	100.00	100.00	0.00	0.00	0.00	
Jun	100.00	5.30	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	86.30	100.00	100.00	0.00	0.00	0.00	0.00
Jul		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	19.80	100.00	100.00	2.30	0.00	0.00	
Aug			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	100.00	55.70	0.00	0.00	
Sep			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	78.30	100.00	16.30			
Oct				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00				
Nov					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00					
Dec						0.00	0.00	0.00	0.00	0.00	0.00	0.00					

Proposed:

Month	04:00	05:00	06:00	07:00	08:00	09:00	10:00	11:00	12:00	13:00	14:00	15:00	16:00	17:00	18:00	19:00	20:00
Jan						0.00	0.00	0.00	0.00	0.00	0.00	0.00	8.70				
Feb					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	0.00			
Mar				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	10.70	100.00	5.90	0.00		
Apr		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	100.00	17.20	0.00		
May		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	60.80	100.00	100.00	0.00	0.00	0.00	
Jun	100.00	5.30	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	86.30	100.00	100.00	0.40	0.00	0.00	0.00
Jul		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	19.80	100.00	100.00	0.00	0.00	0.00	
Aug			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	100.00	41.80	0.00	0.00	
Sep			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	78.30	100.00	0.00			
Oct				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00				
Nov					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00					
Dec						0.00	0.00	0.00	0.00	0.00	0.00	0.00					

Sunlight assessment					
Total APSH (%)			Winter months APSH (%)		
Existing	Proposed	Ratio	Existing	Proposed	Ratio
13.29	12.92	0.97	2.36	2.25	0.96

RL3 – 26 Redington Rd - GF

Existing:

Month	04:00	05:00	06:00	07:00	08:00	09:00	10:00	11:00	12:00	13:00	14:00	15:00	16:00	17:00	18:00	19:00	20:00
Jan						0.00	0.00	0.00	0.00	0.00	0.00	0.00	40.00				
Feb					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	0.00			
Mar				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	6.00	100.00	20.20	0.00		
Apr		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	2.80	100.00	100.00	100.00	0.00		
May		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	75.20	100.00	100.00	39.10	0.00	0.00	
Jun	83.30	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	88.40	100.00	100.00	38.30	0.00	0.00	0.00
Jul		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	51.60	100.00	100.00	94.50	0.00	0.00	
Aug			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	100.00	100.00	0.00	0.00	
Sep			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	63.00	100.00	0.00			
Oct				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00				
Nov					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00					
Dec						0.00	0.00	0.00	0.00	0.00	0.00	0.00					

Proposed:

Month	04:00	05:00	06:00	07:00	08:00	09:00	10:00	11:00	12:00	13:00	14:00	15:00	16:00	17:00	18:00	19:00	20:00
Jan						0.00	0.00	0.00	0.00	0.00	0.00	0.00	40.00				
Feb					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	3.60			
Mar				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	6.00	100.00	17.00	0.00		
Apr		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	2.80	100.00	100.00	100.00	0.00		
May		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	75.20	100.00	100.00	19.20	0.00	0.00	
Jun	100.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	88.40	100.00	100.00	18.80	0.00	0.00	0.00
Jul		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	51.60	100.00	100.00	83.50	0.00	0.00	
Aug			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	100.00	100.00	0.00	0.00	
Sep			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	63.00	100.00	0.00			
Oct				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00				
Nov					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00					
Dec						0.00	0.00	0.00	0.00	0.00	0.00	0.00					

Sunlight assessment					
Total APSH (%)			Winter months APSH (%)		
Existing	Proposed	Ratio	Existing	Proposed	Ratio
15.51	15.28	0.98	2.37	2.37	1.00

RL1 – 26 Redington Rd - GF

Existing:

Month	04:00	05:00	06:00	07:00	08:00	09:00	10:00	11:00	12:00	13:00	14:00	15:00	16:00	17:00	18:00	19:00	20:00
Jan						0.00	0.00	0.00	0.00	0.00	0.00	0.00	78.80				
Feb					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	79.50			
Mar				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	4.40	100.00	33.30	0.00		
Apr		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	100.00	100.00	0.00		
May		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	61.90	100.00	100.00	100.00	0.00	0.00	
Jun	54.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	78.80	100.00	100.00	100.00	0.00	0.00	0.00
Jul		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	40.70	100.00	100.00	100.00	0.00	0.00	
Aug			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	100.00	100.00	0.00	0.00	
Sep			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	80.50	100.00	0.00			
Oct				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	15.30	100.00				
Nov					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00					
Dec						0.00	0.00	0.00	0.00	0.00	0.00	0.00					

Proposed:

Month	04:00	05:00	06:00	07:00	08:00	09:00	10:00	11:00	12:00	13:00	14:00	15:00	16:00	17:00	18:00	19:00	20:00
Jan						0.00	0.00	0.00	0.00	0.00	0.00	0.00	78.80				
Feb					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	89.40			
Mar				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	4.40	100.00	47.80	0.00		
Apr		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	100.00	100.00	0.00		
May		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	61.90	100.00	100.00	100.00	0.00	0.00	
Jun	100.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	78.80	100.00	100.00	100.00	0.00	0.00	0.00
Jul		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	40.70	100.00	100.00	100.00	0.00	0.00	
Aug			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	100.00	100.00	100.00	0.00	0.00	
Sep			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	80.50	100.00	0.00			
Oct				0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	15.30	100.00				
Nov					0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00					
Dec						0.00	0.00	0.00	0.00	0.00	0.00	0.00					

Sunlight assessment					
Total APSH (%)			Winter months APSH (%)		
Existing	Proposed	Ratio	Existing	Proposed	Ratio
17.09	17.59	1.03	3.10	3.21	1.04

7.6 Overshadowing results (21st March)

The results are expressed as a percentage of area receiving direct sunlight on 21st March.

A1 – 30 Redington Rd – Amenity/Garden

Existing:

Month	04:00	05:00	06:00	07:00	08:00	09:00	10:00	11:00	12:00	13:00	14:00	15:00	16:00	17:00	18:00	19:00	20:00
Jan						73.20	18.00	43.70	29.10	16.60	2.40	17.10	18.80				
Feb					80.80	52.10	72.50	64.30	55.30	44.90	35.40	45.90	63.70	46.40			
Mar				32.60	80.70	81.10	82.20	76.50	69.80	65.90	71.20	85.60	74.80	67.30	72.60		
Apr		88.00	80.60	81.90	80.90	83.30	83.90	82.40	80.60	83.90	90.60	91.60	83.80	77.30	77.70		
May		59.10	80.60	83.40	84.50	85.30	85.00	85.30	86.90	91.60	95.80	92.80	87.80	81.10	80.40	81.90	
Jun	87.90	74.30	84.30	85.40	85.50	86.00	85.60	86.10	88.90	93.30	96.50	93.60	88.90	83.10	81.00	81.80	83.40
Jul		46.10	79.80	83.30	84.30	85.30	85.10	85.30	86.50	91.40	95.40	93.60	88.50	82.20	80.20	81.80	
Aug			77.00	82.10	80.70	83.30	83.90	82.60	80.80	83.70	90.30	92.20	84.50	77.70	77.40	81.40	
Sep			89.60	31.50	80.10	81.30	82.40	75.10	68.90	66.40	74.90	86.40	71.10	66.20			
Oct				82.10	22.20	72.40	67.60	59.80	49.20	38.40	34.00	60.80	43.40				
Nov					79.80	40.70	30.80	37.40	22.10	9.70	4.10	28.70					
Dec						69.30	15.90	22.90	17.70	0.00	0.10	12.90					

Proposed:

Month	04:00	05:00	06:00	07:00	08:00	09:00	10:00	11:00	12:00	13:00	14:00	15:00	16:00	17:00	18:00	19:00	20:00
Jan						73.20	0.00	0.00	2.70	4.40	4.00	21.90	18.80				
Feb					80.30	0.00	8.50	18.50	22.20	26.00	32.30	53.40	63.70	46.40			
Mar				29.70	4.40	24.00	37.40	43.40	47.00	54.70	70.70	87.20	74.80	67.30	72.60		
Apr		88.00	0.80	23.70	38.00	48.80	56.00	60.70	67.80	79.00	90.40	91.60	83.80	77.30	77.70		
May		7.60	34.00	47.10	54.80	60.20	64.40	70.60	78.80	88.70	96.00	92.80	87.80	81.10	80.40	81.90	
Jun	87.90	34.50	47.60	54.40	59.50	63.40	67.10	73.50	81.50	90.70	96.70	93.60	88.90	83.10	81.00	81.80	83.40
Jul		4.40	32.40	46.30	54.40	59.80	64.00	69.60	77.70	87.50	95.70	93.60	88.50	82.20	80.20	81.80	
Aug			0.40	23.10	37.60	48.50	55.80	60.50	67.40	78.50	90.00	92.20	84.50	77.70	77.40	81.40	
Sep			89.20	0.00	9.90	28.90	40.20	44.70	49.10	58.50	75.40	87.30	71.10	66.20			
Oct				81.50	18.90	0.90	13.00	19.40	22.80	24.60	38.60	67.90	43.40				
Nov					79.80	37.90	0.00	0.00	2.80	2.60	9.00	35.00					
Dec						69.30	13.90	0.00	0.00	0.20	2.50	13.50					

Overshadowing assessment		
% of the amenity area receiving direct sunlight on 21 st March		
Existing	Proposed	Ratio
71.69	51.10	0.71

7.7 SunCast Images

Suncast Image (21 March 07:00)

Suncast image:

View time = 21 May 07:00


Site Latitude = 51.56

Longitude diff. = -0.19

Model Bearing = 0.00

Sun: azi = 89.04 alt = 25.31

Eye: azi = 200.00 alt = 40.00



Suncast image:

View time = 21 Mar 07:00


Site Latitude = 51.56

Longitude diff. = -0.19


Model Bearing = 0.00

Sun: azi = 100.38 alt = 7.62

Eye: azi = 200.00 alt = 40.00

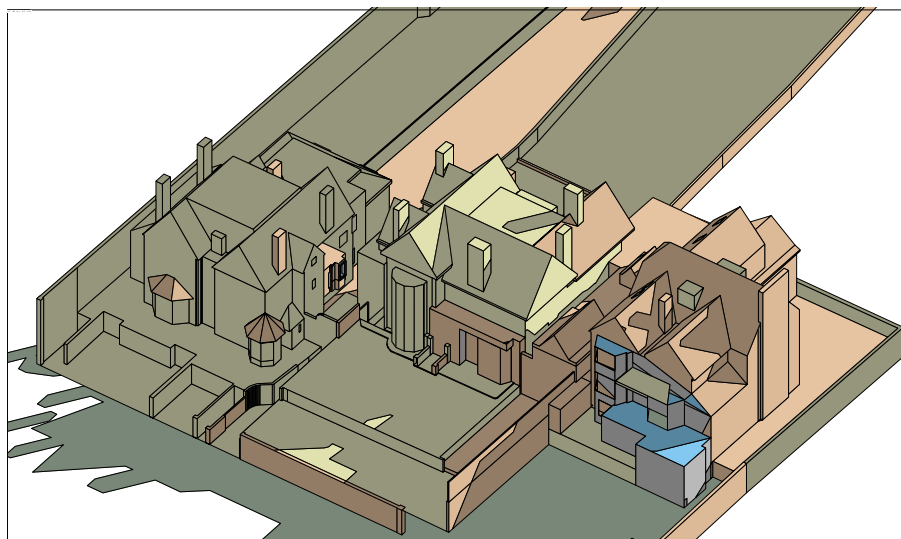

Existing

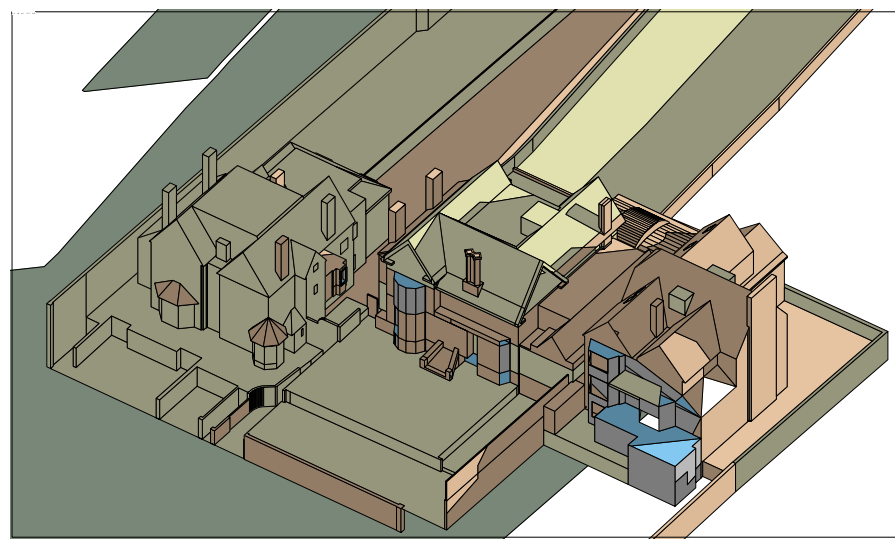


Proposed

Suncast Image (21 March 08:00)


Suncast image:

View time = 21 May 08:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 101.30 alt = 34.58
Eye: azi = 200.00 alt = 40.00




Suncast image:

View time = 21 Mar 08:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 112.73 alt = 16.55
Eye: azi = 200.00 alt = 40.00

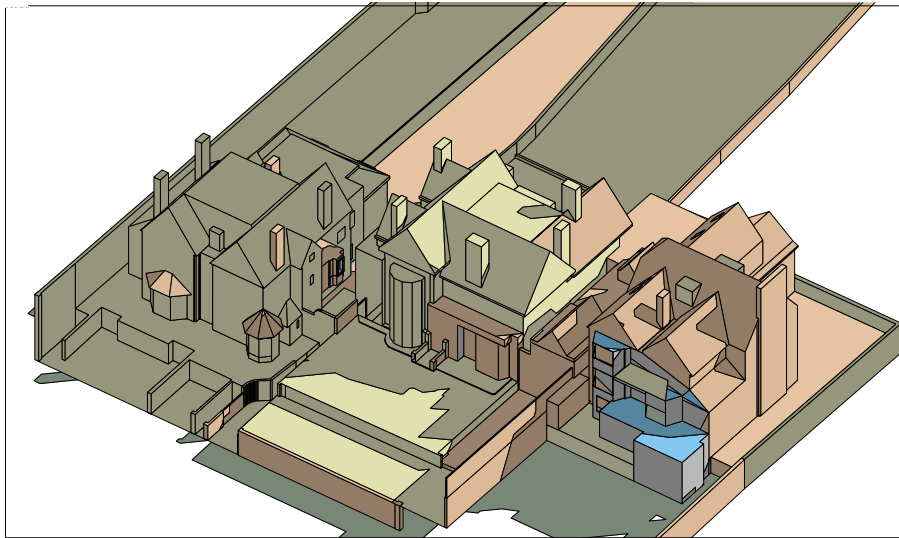

Existing

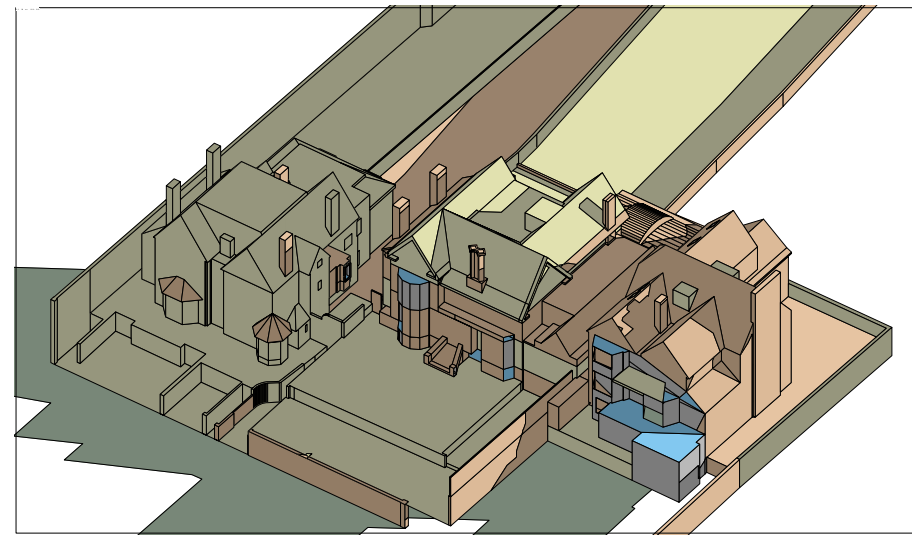


Proposed

Suncast Image (21 March 09:00)


Suncast image:

View time = 21 May 09:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 115.46 alt = 43.42
Eye: azi = 200.00 alt = 40.00




Suncast image:

View time = 21 Mar 09:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 126.23 alt = 24.66
Eye: azi = 200.00 alt = 40.00

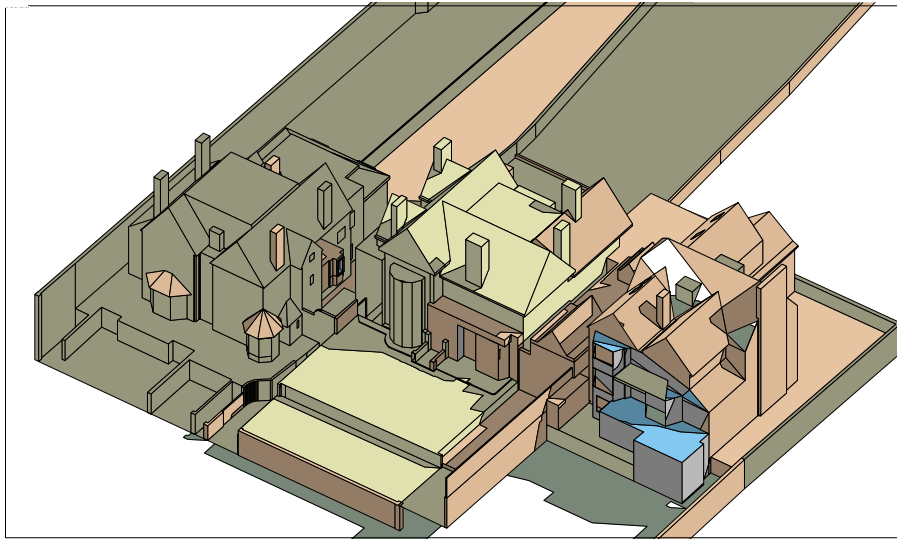

Existing

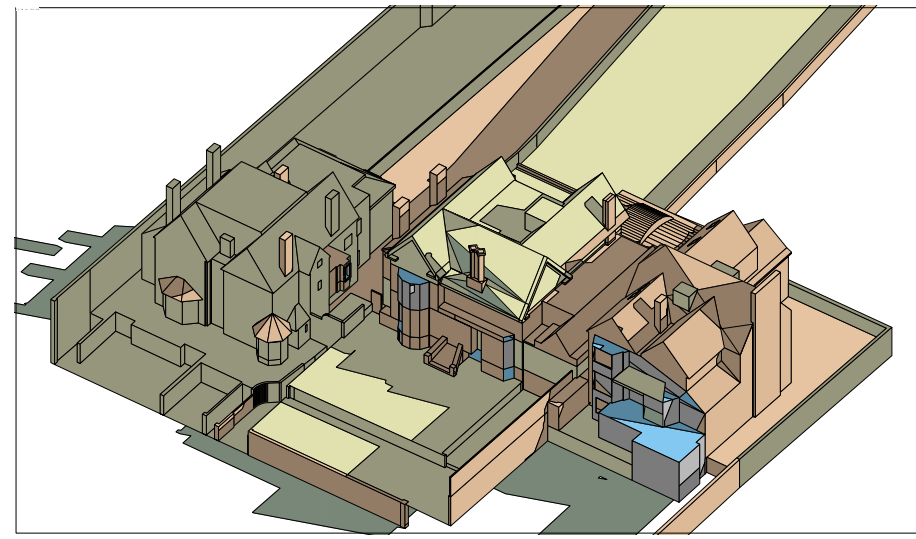


Proposed

Suncase Image (21 March 10:00)


Suncast image:

View time = 21 May 10:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 132.91 alt = 51.13
Eye: azi = 200.00 alt = 40.00




Suncast image:

View time = 21 Mar 10:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 141.44 alt = 31.38
Eye: azi = 200.00 alt = 40.00

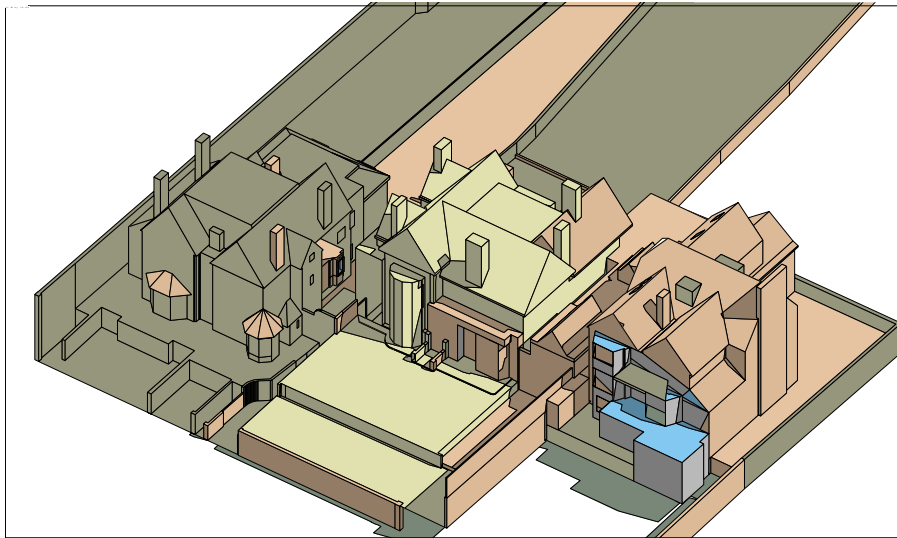

Existing

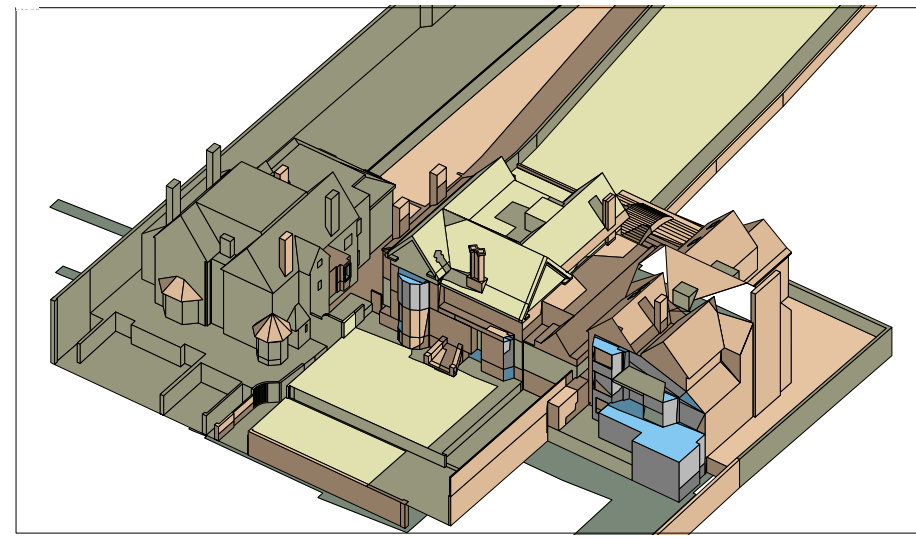


Proposed

Suncase Image (21 March 11:00)


Suncast image:

View time = 21 May 11:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 155.04 alt = 56.64
Eye: azi = 200.00 alt = 40.00




Suncast image:

View time = 21 Mar 11:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 158.61 alt = 36.05
Eye: azi = 200.00 alt = 40.00

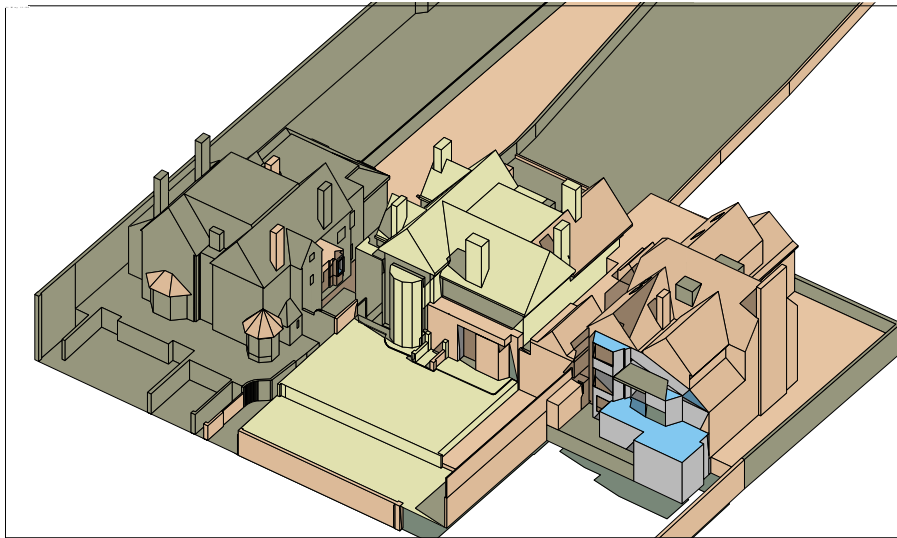

Existing

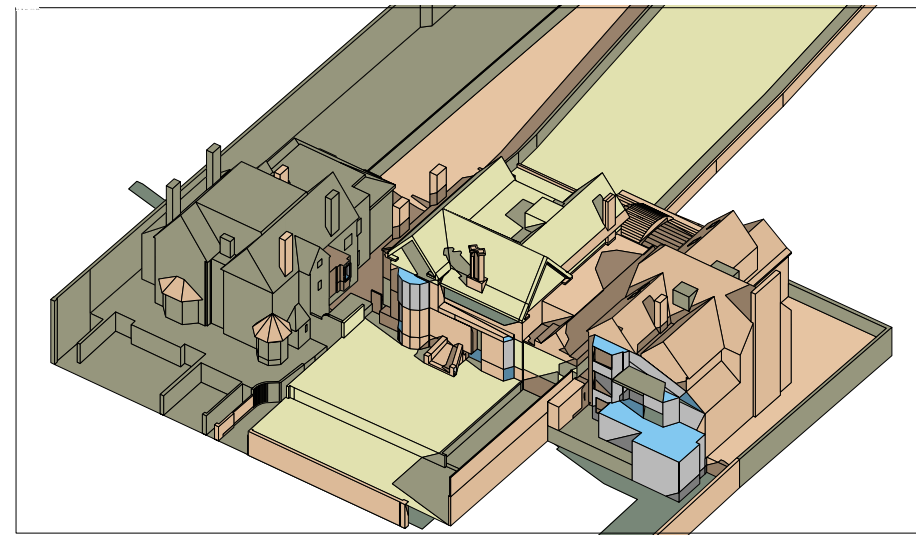


Proposed

Suncast Image (21 March 12:00)


Suncast image:

View time = 21 May 12:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 181.25 alt = 58.57
Eye: azi = 200.00 alt = 40.00




Suncast image:

View time = 21 Mar 12:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 177.27 alt = 38.00
Eye: azi = 200.00 alt = 40.00

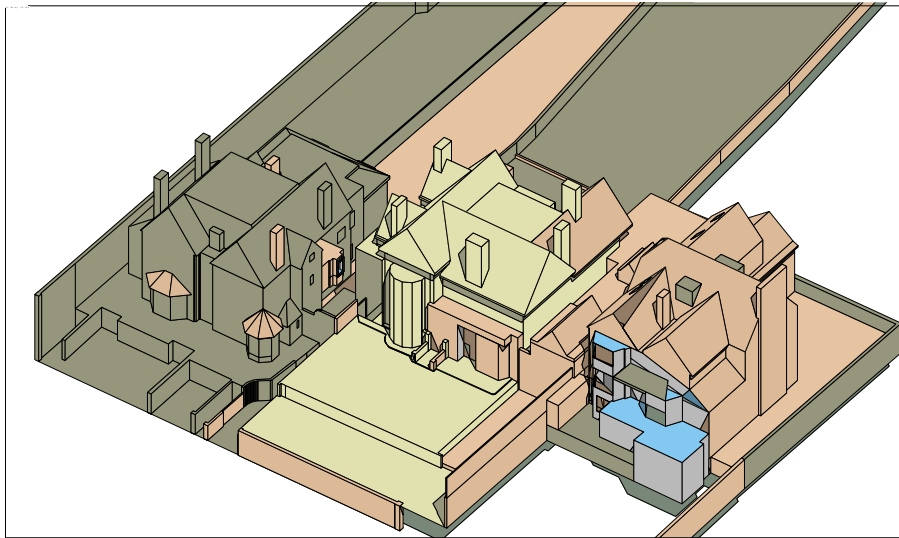

Existing

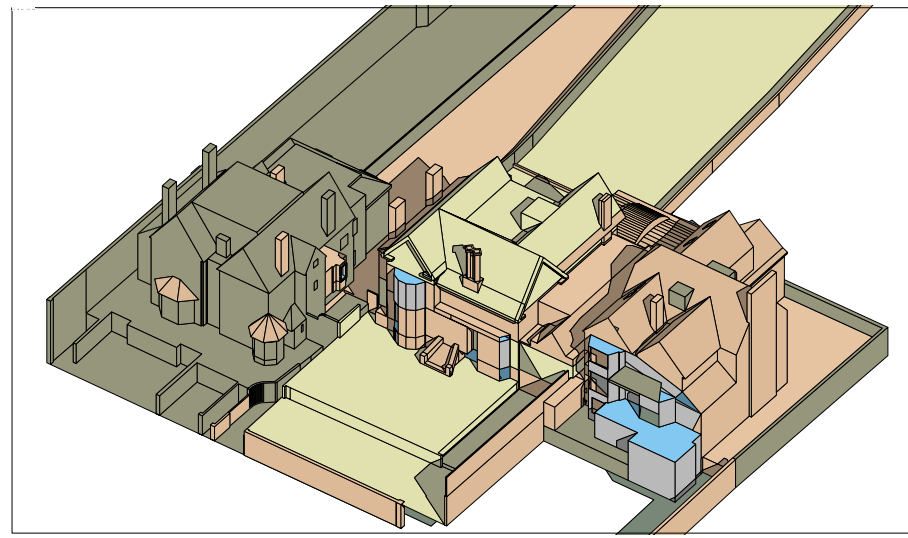


Proposed

Suncast Image (21 March 13:00)


Suncast image:

View time = 21 May 13:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 207.21 alt = 56.26
Eye: azi = 200.00 alt = 40.00




Suncast image:

View time = 21 Mar 13:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 196.15 alt = 36.91
Eye: azi = 200.00 alt = 40.00

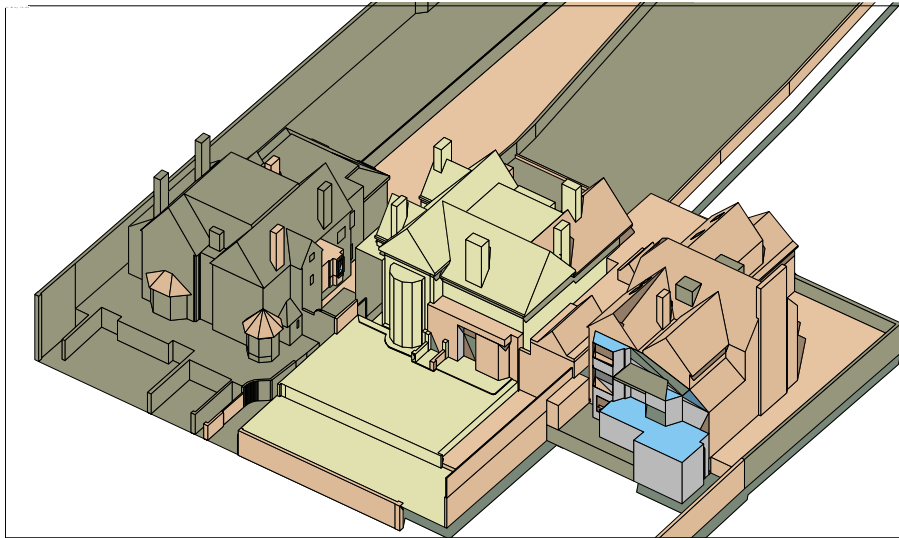

Existing

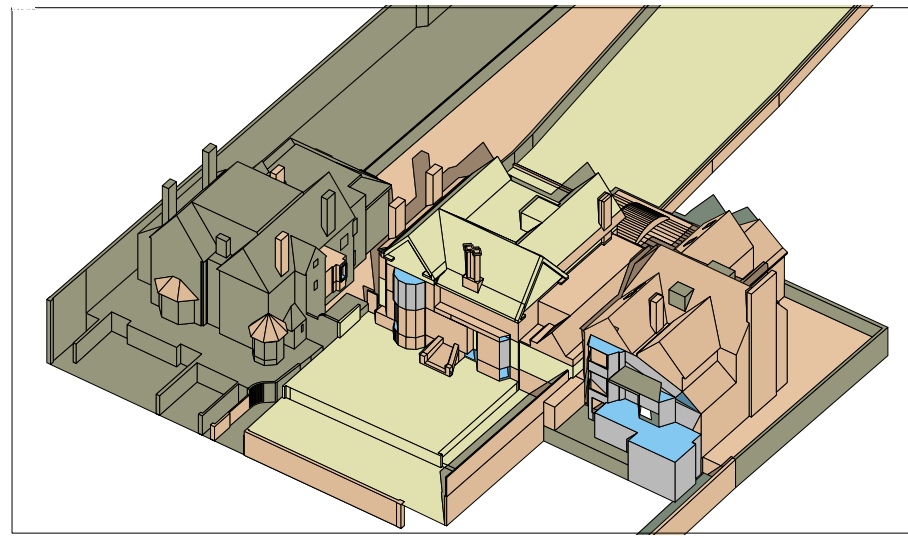


Proposed

Suncast Images (21 March 14:00)


Suncast image:

View time = 21 May 14:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 228.88 alt = 50.49
Eye: azi = 200.00 alt = 40.00




Suncast image:

View time = 21 Mar 14:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 213.83 alt = 32.96
Eye: azi = 200.00 alt = 40.00

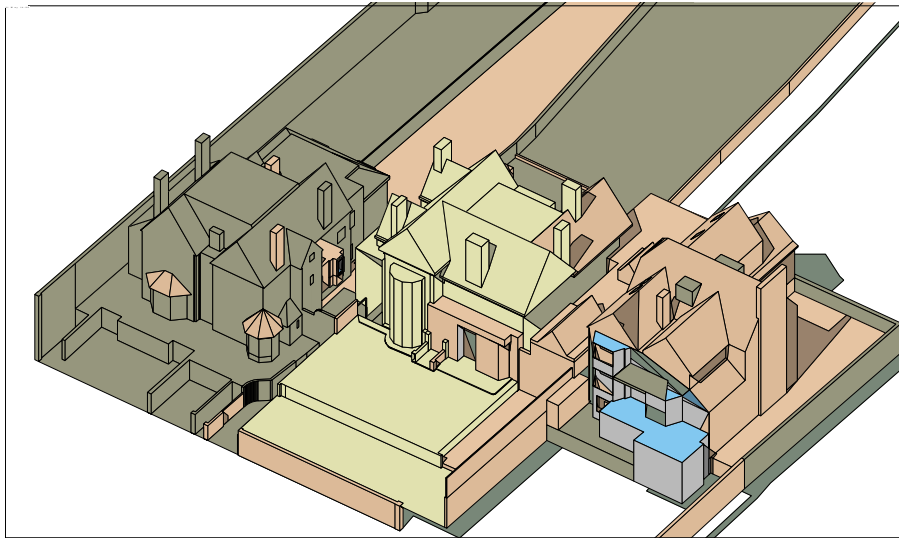

Existing

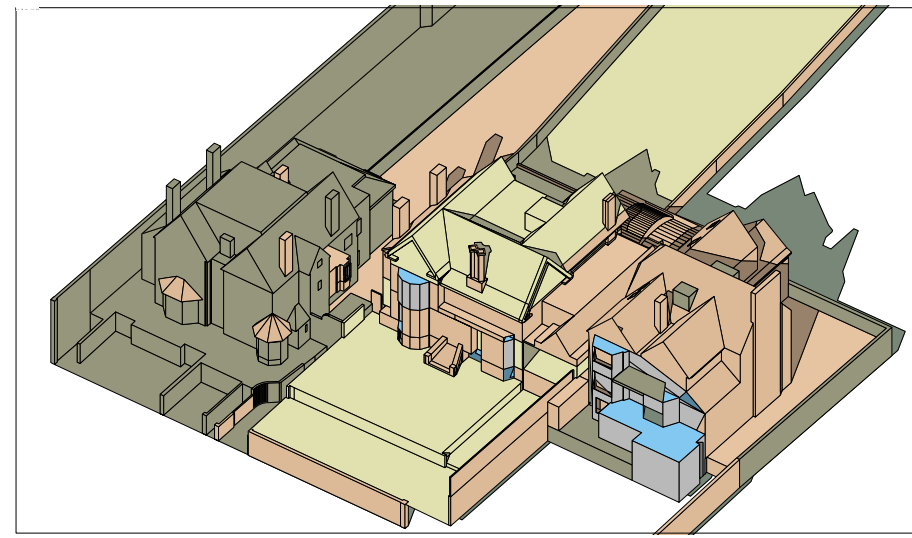


Proposed

Suncast Images (21 March 15:00)


Suncast image:

View time = 21 May 15:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 245.96 alt = 42.64
Eye: azi = 200.00 alt = 40.00




Suncast image:

View time = 21 Mar 15:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 229.61 alt = 26.76
Eye: azi = 200.00 alt = 40.00

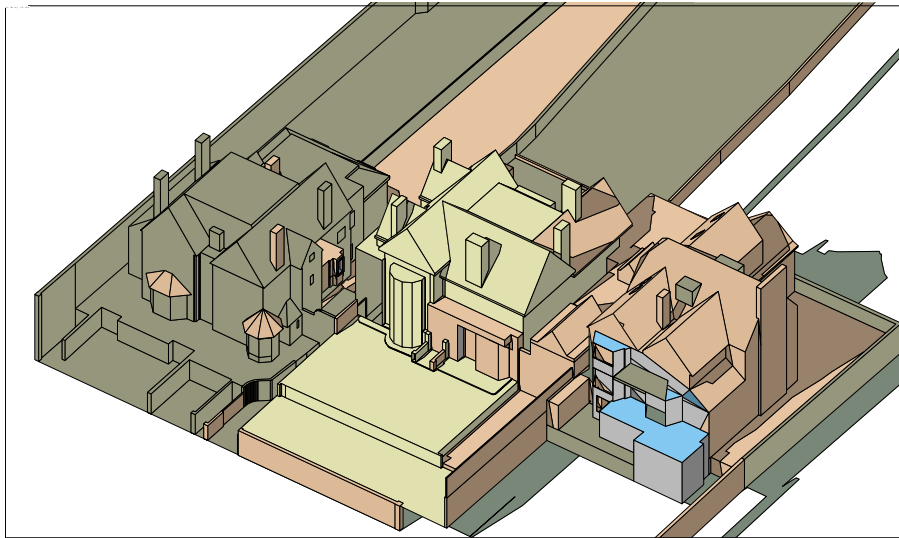

Existing

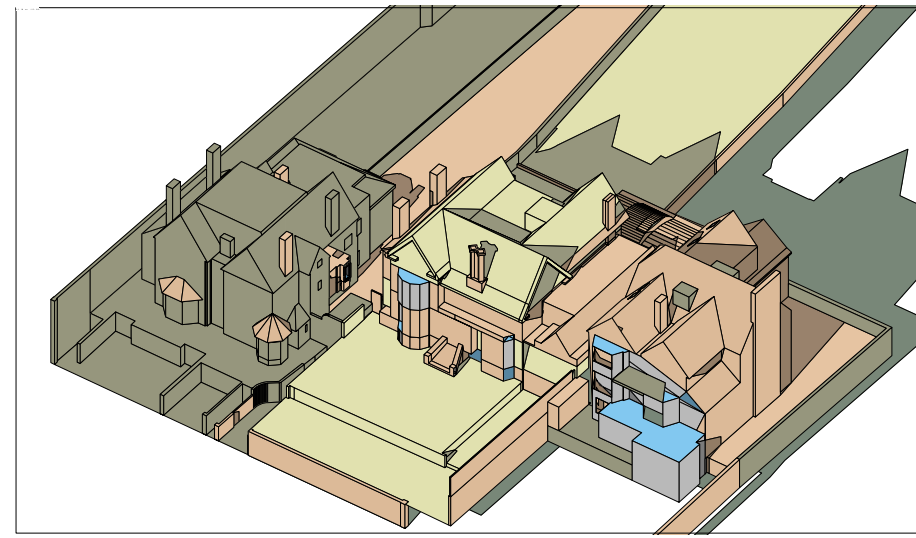


Proposed

Suncast Images (21 March 16:00)


Suncast image:

View time = 21 May 16:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 259.89 alt = 33.74
Eye: azi = 200.00 alt = 40.00




Suncast image:

View time = 21 Mar 16:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 243.55 alt = 18.98
Eye: azi = 200.00 alt = 40.00

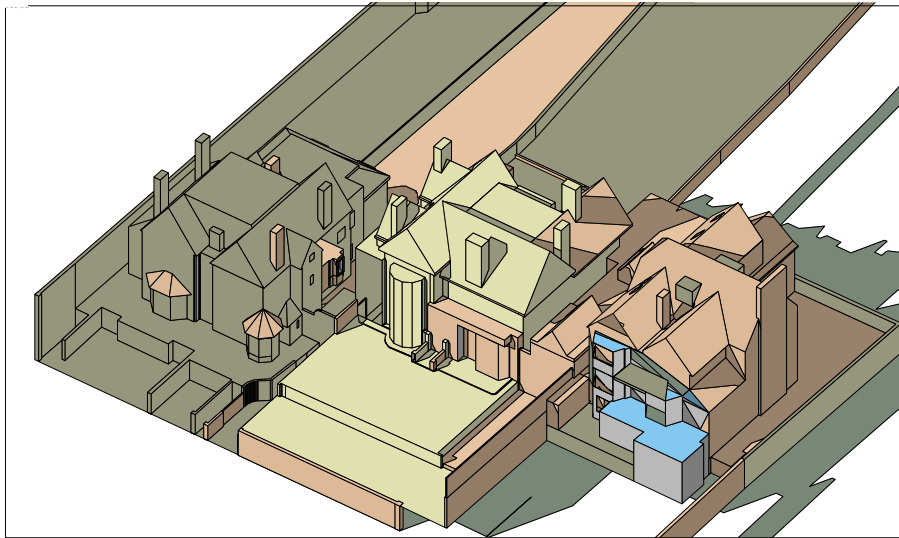

Existing

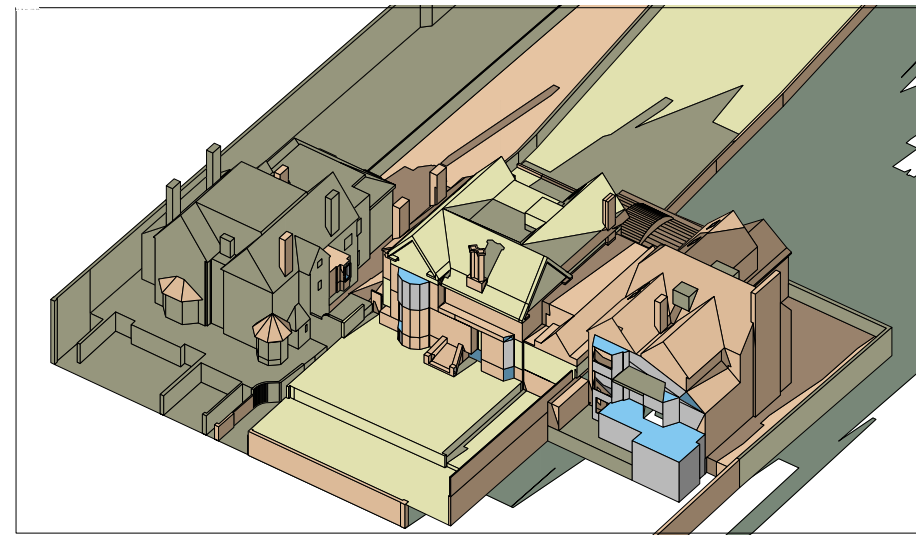


Proposed

Suncast Images (21 March 17:00)


Suncast image:

View time = 21 May 17:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 272.03 alt = 24.45
Eye: azi = 200.00 alt = 40.00




Suncast image:

View time = 21 Mar 17:00
Site Latitude = 51.56
Longitude diff. = -0.19
Model Bearing = 0.00
Sun: azi = 256.16 alt = 10.24
Eye: azi = 200.00 alt = 40.00

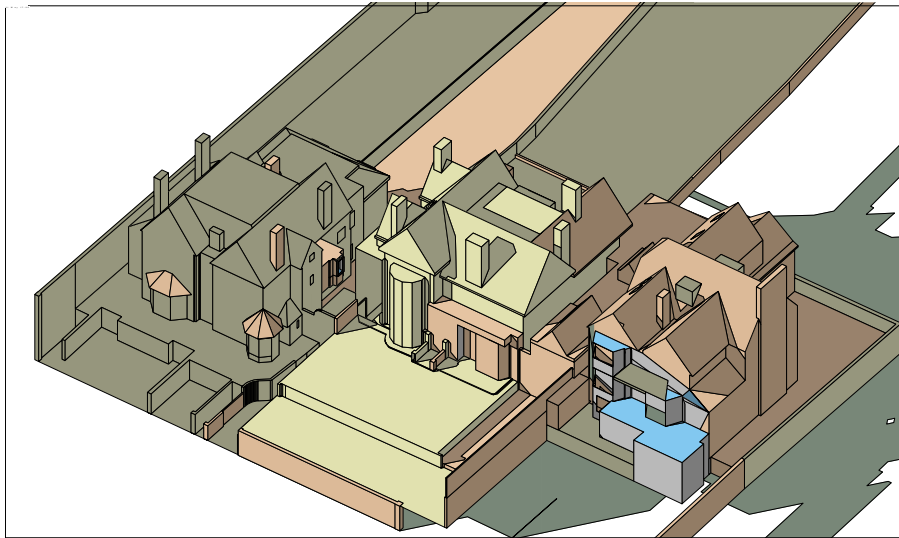

Existing

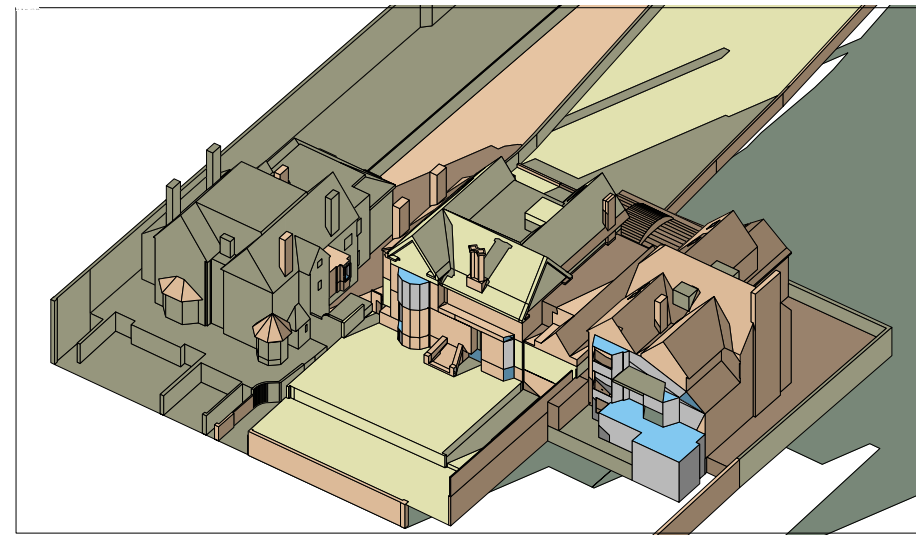

Proposed