

- References:**
- PS0009-28A-XX-ZZ-DR-A-010-Rev2_Proposed GA Plans 02-18-12-21.dwg
 - PS0009-28A-XX-ZZ-DR-A-010-Rev11_Proposed GA Plans 02-18-12-16.dwg
 - PS0009-28A-XX-01-DR-A-011-Rev11_Proposed GA Plan - First Floor 19-02-19.dwg
- Notes:**
- THIS DRAWING INDICATES ENGINEERING SERVICES INSTALLATION WORK ONLY AND MUST NOT BE TAKEN AS ACCURATELY REPRESENTING ANY OTHER DETAIL.
 - THIS DRAWING SHOWS THE DESIGN INTENT AND **MUST NOT** BE USED FOR INSTALLATION PURPOSES.
 - THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS AND SPECIFICATIONS.
 - WHERE POSSIBLE, USE EXISTING CONTAINMENT. ALLOW ALL NECESSARY ALTERATIONS AND EXTENSIONS TO JOIN EXISTING CONTAINMENT WITH NEW.
 - DADO TRUNKING SHOWN HERE IS THE SAME AS SHOWN ON THE SMALL POWER DRAWING. PLEASE DO NOT DUPLICATE COST.
 - SECONDARY CONTAINMENT AND CONDUITS ARE NOT SHOWN FOR CLARITY BUT SHOULD BE ALLOWED FOR AS REQUIRED.
 - REFER TO DATA DRAWING FOR DATA CONTAINMENT.
 - PROVIDE ADEQUATE CONTAINMENT FOR ACCESS CONTROL DOORS IN ROOM 42, 44 AS REQUIRED BY SECURITY CONTRACTOR.
 - ALLOW CONTAINMENT FOR AUDIO / VIDEO LECTERN, PROJECTOR IN ROOM 42 AND 44.

- Legend:**
- ROOM OUT OF SCOPE OF WORKS
 - 3 COMPARTMENT DADO TRUNKING MK 30 PRESTIGE 30 WHITE OR SIMILAR APPROVED
 - SUITABLE CABLE MANAGEMENT SYSTEM INSTALLED UNDER DESK, E.G. CABLE BASKET
 - LIGHTING AND POWER TRUNKING AT HIGH LEVEL
 - TRUNKING DROP POSITION
 - 7' DROP SECTION OF DADO TRUNKING, DROPPING TO FLOOR LEVEL, TO CONCENTRATE NUMBER OF POWER AND DATA SOCKETS AND KEEP CABLING TIDY
 - SCREENED TRUNKING, 2 COMPARTMENT (POWER AND DATA)

Revisions:

Ref.	Date	Description	By	App
T1	19-02-19	ISSUE FOR TENDER	MT	RS

Location Plan:
N/A




Client:
UNIVERSITY COLLEGE LONDON
ESTATES
GOWER STREET
LONDON
WC1E 6BT

Project:
BEAMS SOUTH WING LEVEL 2 ENABLING PROJECTS

Title:
PROPOSED PART FIRST FLOOR, SECOND FLOOR & SECOND FLOOR MEZZANINE CONTAINMENT REQUIREMENTS LAYOUT


Date: 02-01-19	Designed by: MT
Paper Size: A0	Approved by: RS
Scale: 1:50	Drawn by: LT
Dwg Ref: 1764-ZZ-ES-501	Rev: T1

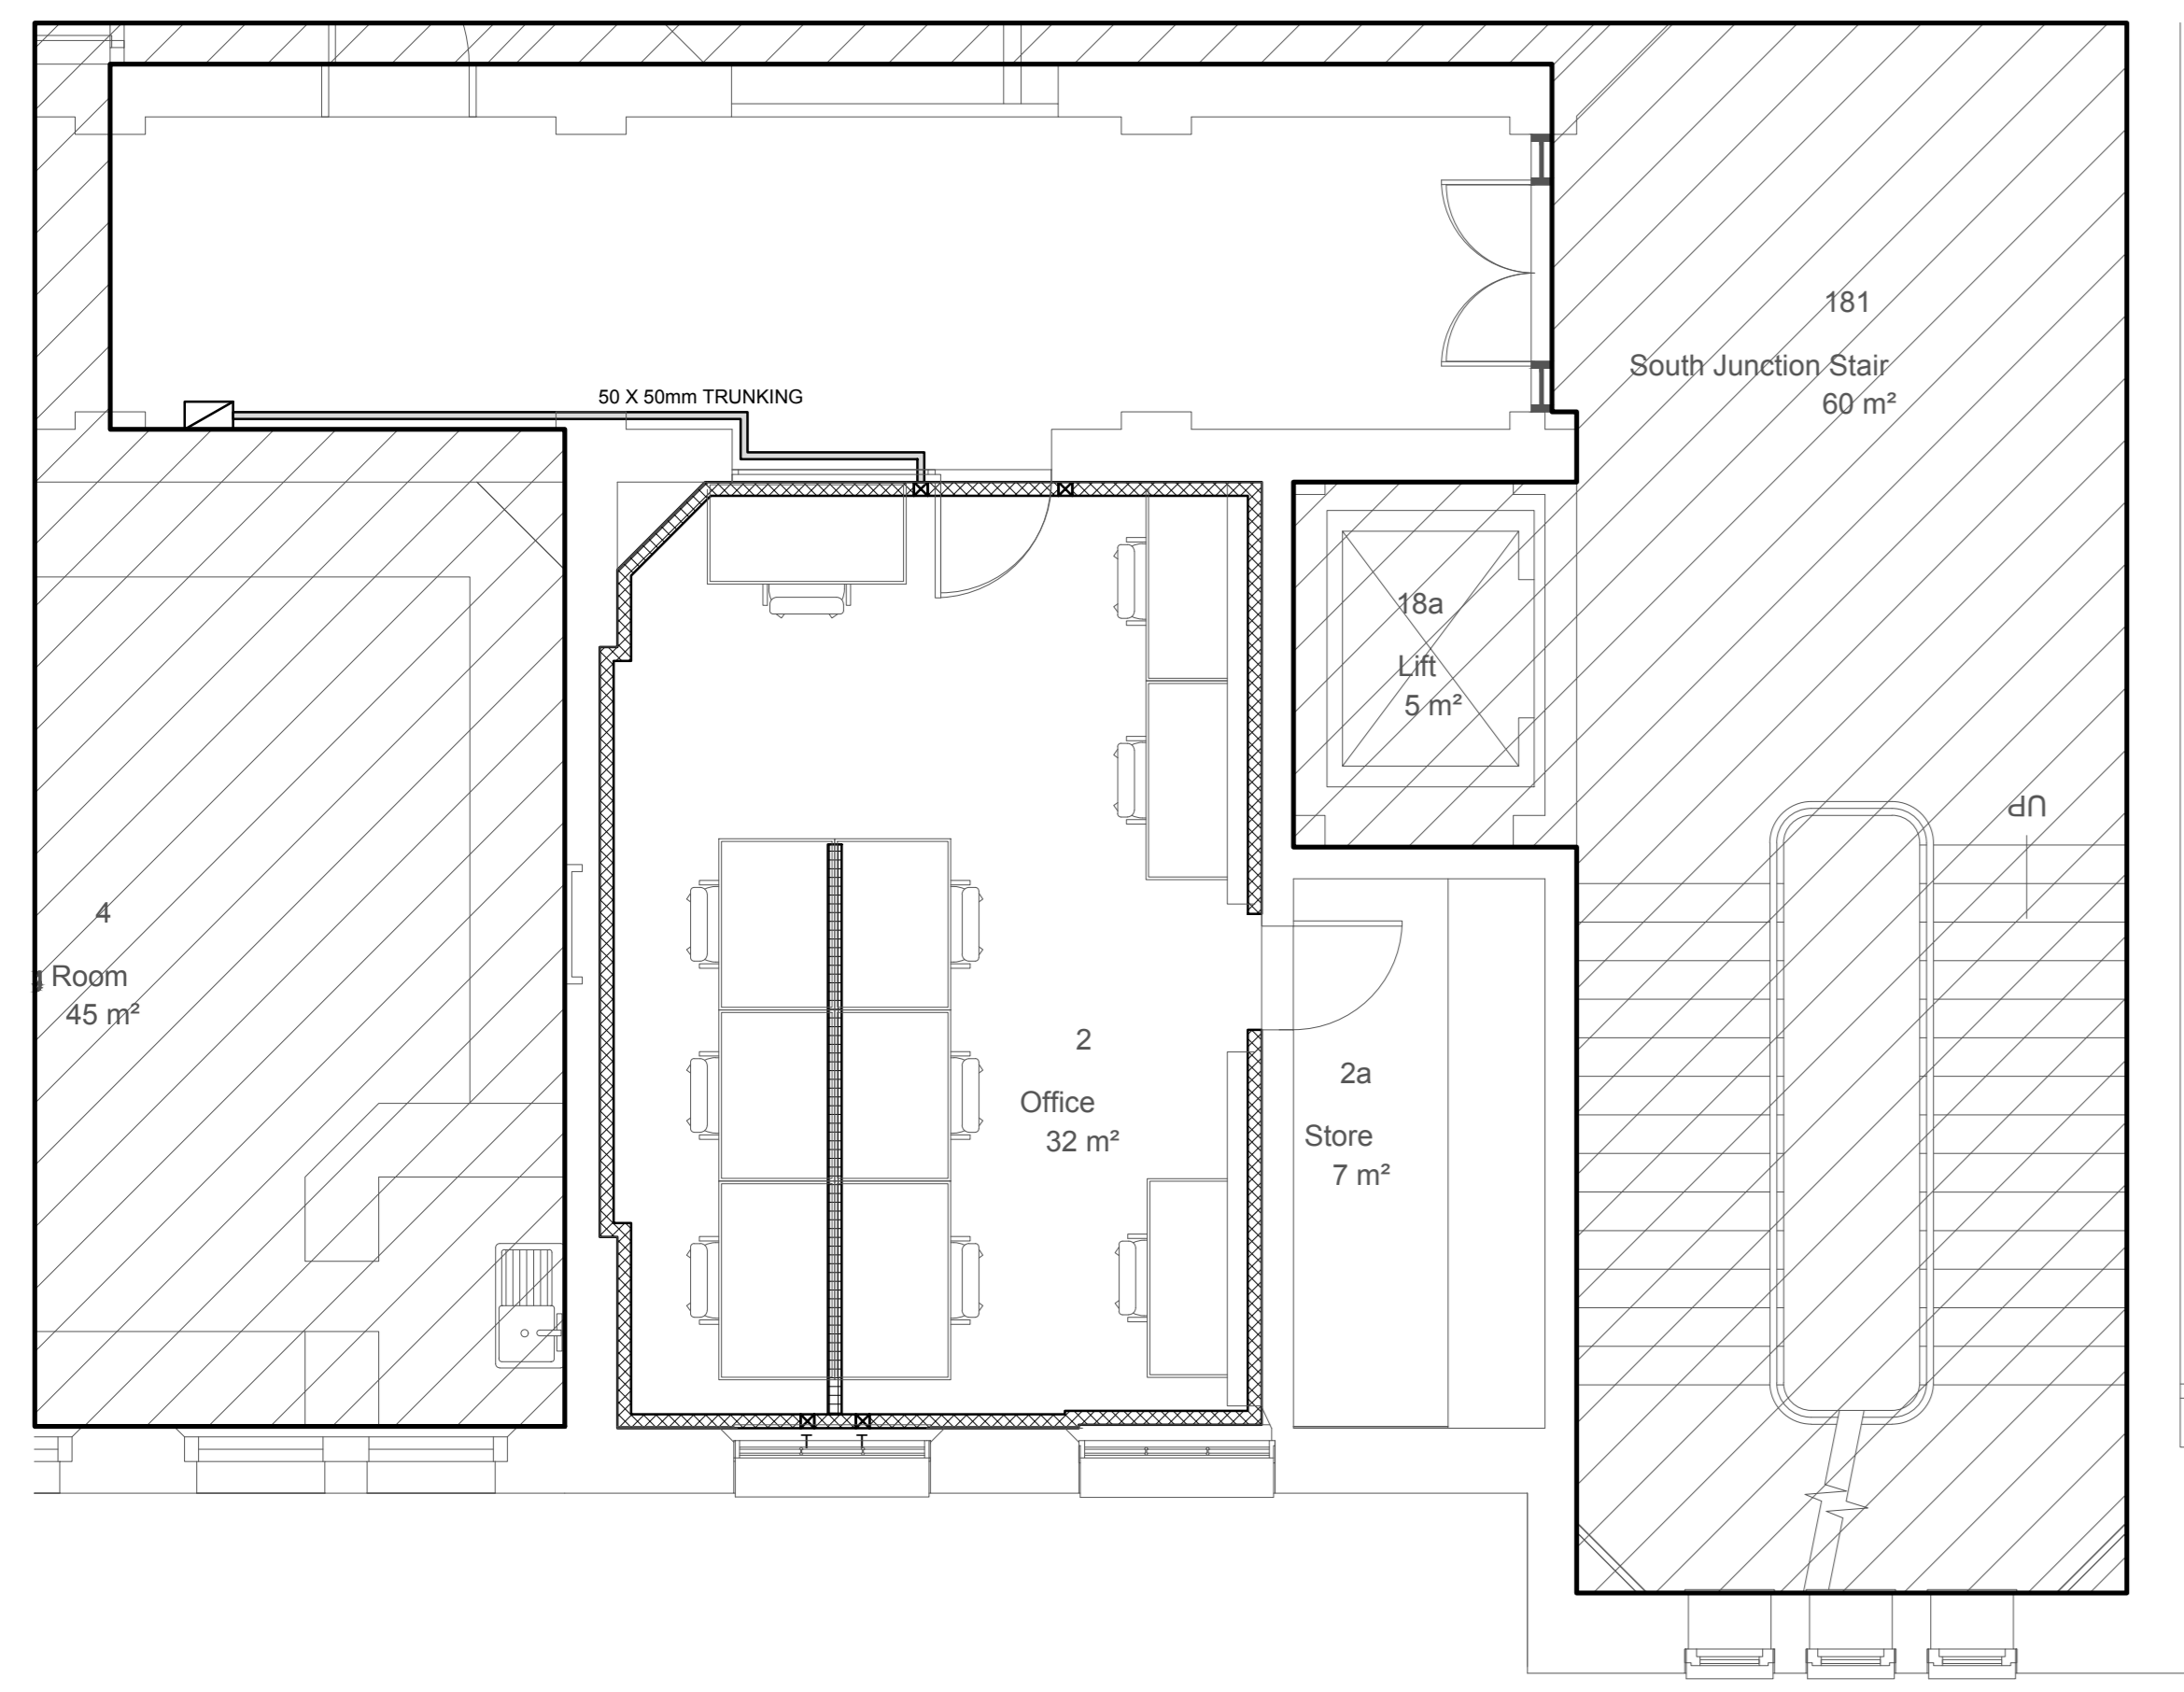

PART FIRST FLOOR



SECOND FLOOR

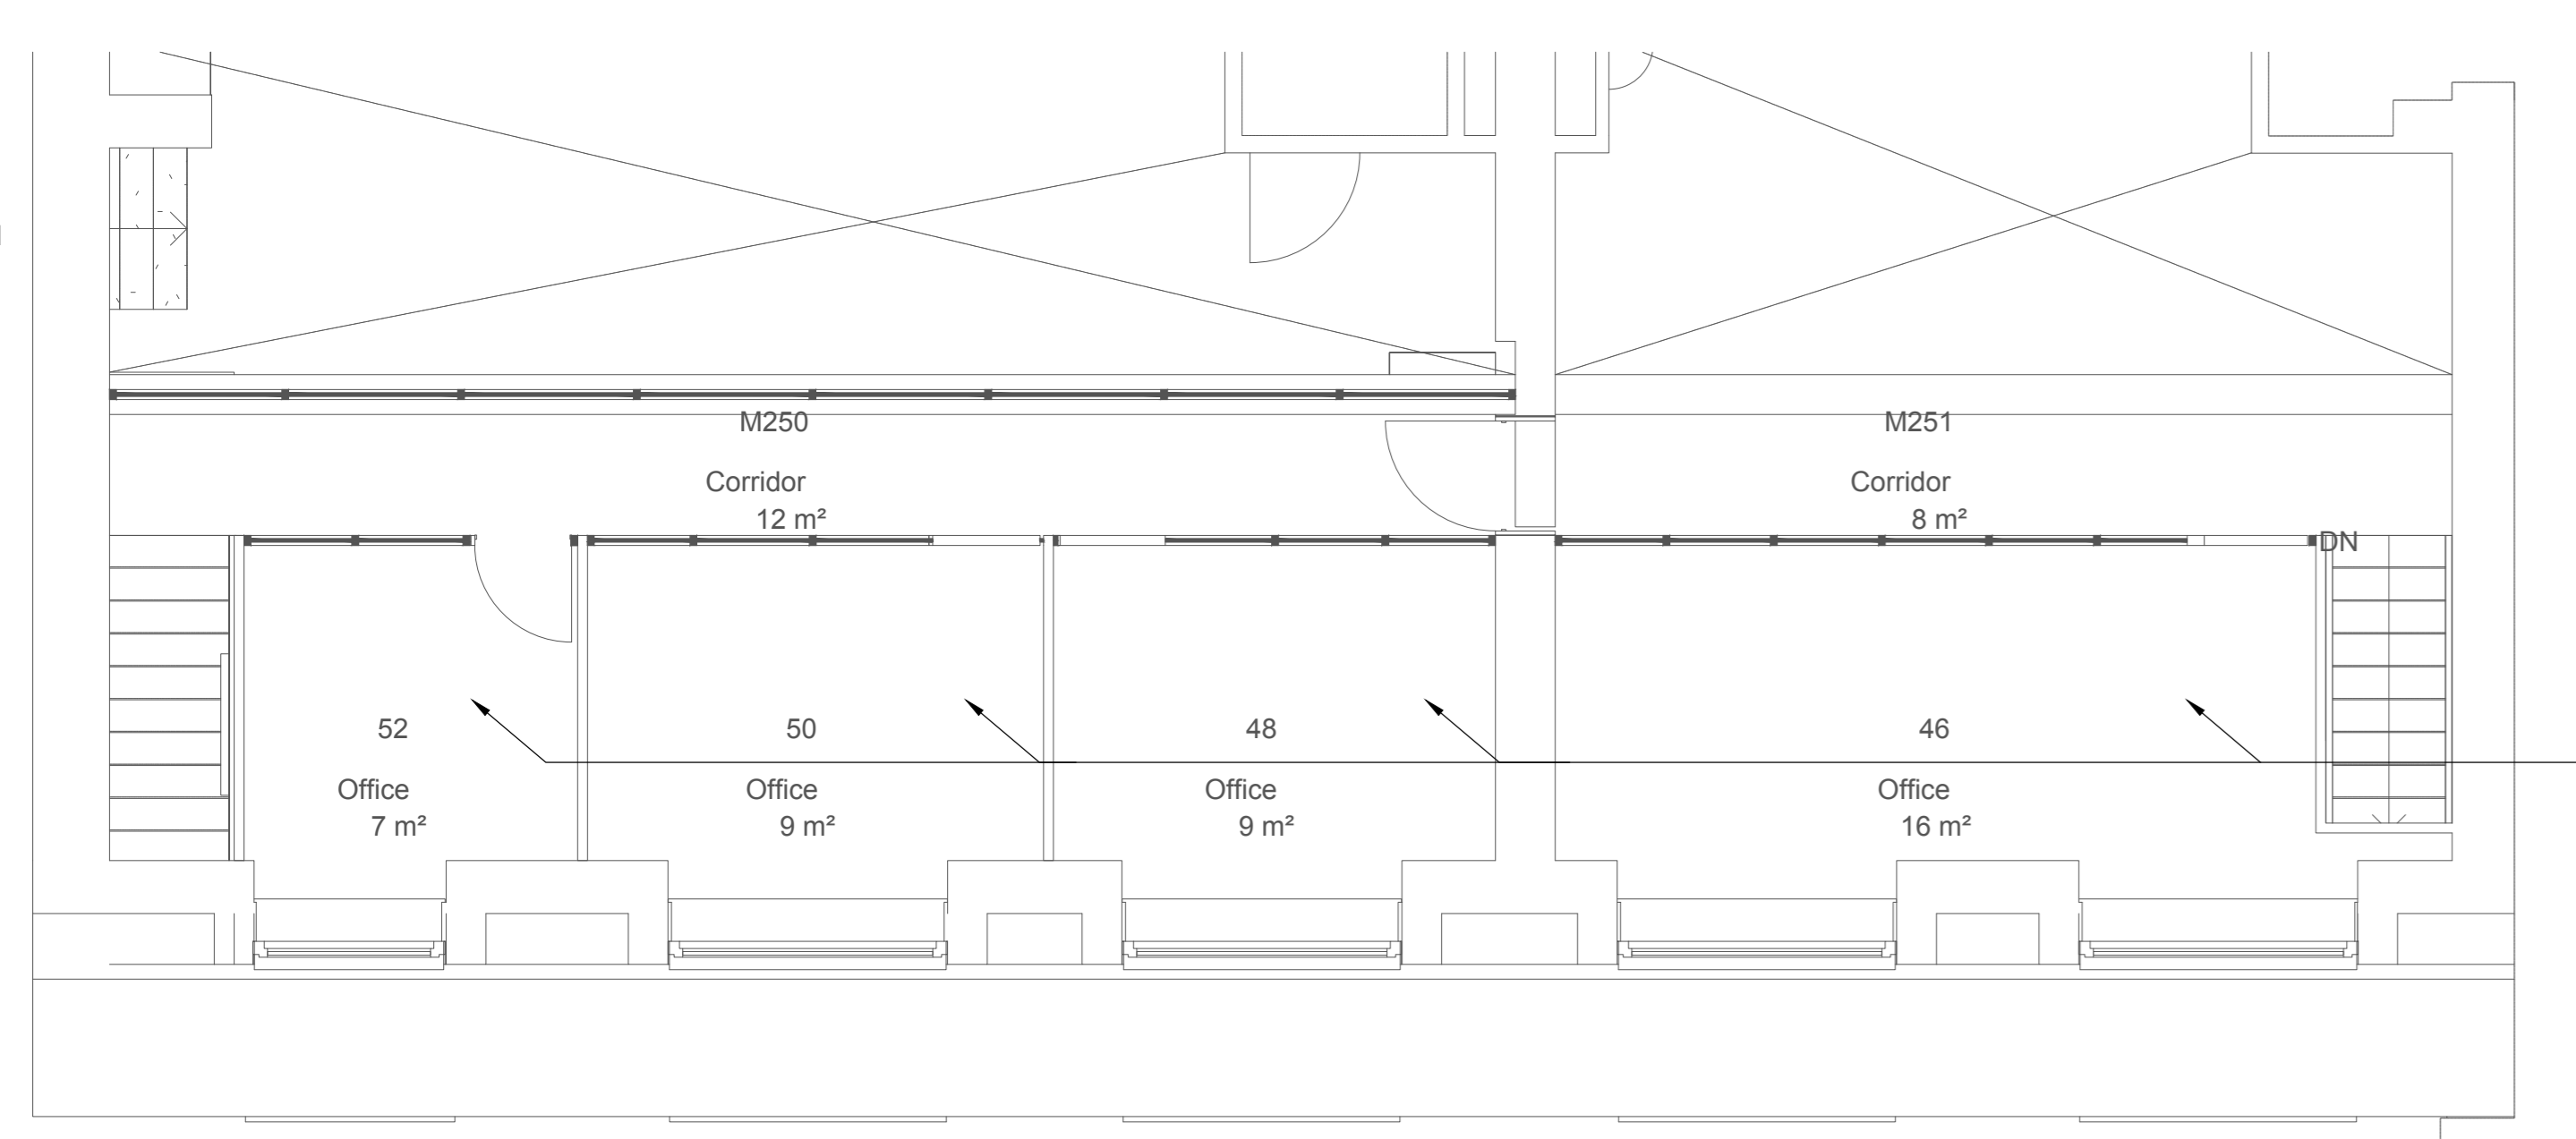

SECOND FLOOR MEZZANINE

IN ALL MEZZANINE AREAS PROVIDE SUITABLE CONTAINMENT FOR SUPPLIES TO MECHANICAL FAN COIL UNITS SHOWN ON DRAWING 1764-ZZ-ES-351.