


LEGEND	
	LANDLORDS DISTRIBUTION BOARD
	WALL MOUNTED CIRCULAR HIGH EFFICIENCY 18W - 1800 LUMEN OUTPUT COLOUR 360 LED LUMINAIRE HOUSING OF LUM. 10005000100 WHITE SELF COLOURED POLYCARBONATE BODY WITH SATIN ACRYLIC DIFFUSER, IP65 RATED. MAINTAINED WITH 3 HOURS INTEGRAL EMERGENCY FACILITY COMPLETE WITH INTEGRAL MICROWAVE PIR WITH CORRIDOR FUNCTION SIZE 3600 x 82mm DEPTH
	FIRE ALARM PANEL ANALOGUE ADDRESSABLE, GRADE A, CATEGORY LDI TO BS5839-6:2019
	OPTICAL SMOKE DETECTORS
	OPTICAL SMOKE DETECTOR WITH SOUNDER
	MANUAL CALL POINT (BREAKGLASS)
	INTERFACE UNIT FOR CONNECTION TO APARTMENTS GRADE D CATEGORY LDI TO BS5839-6:2019
	EMERGENCY LIGHTING TEST SWITCH

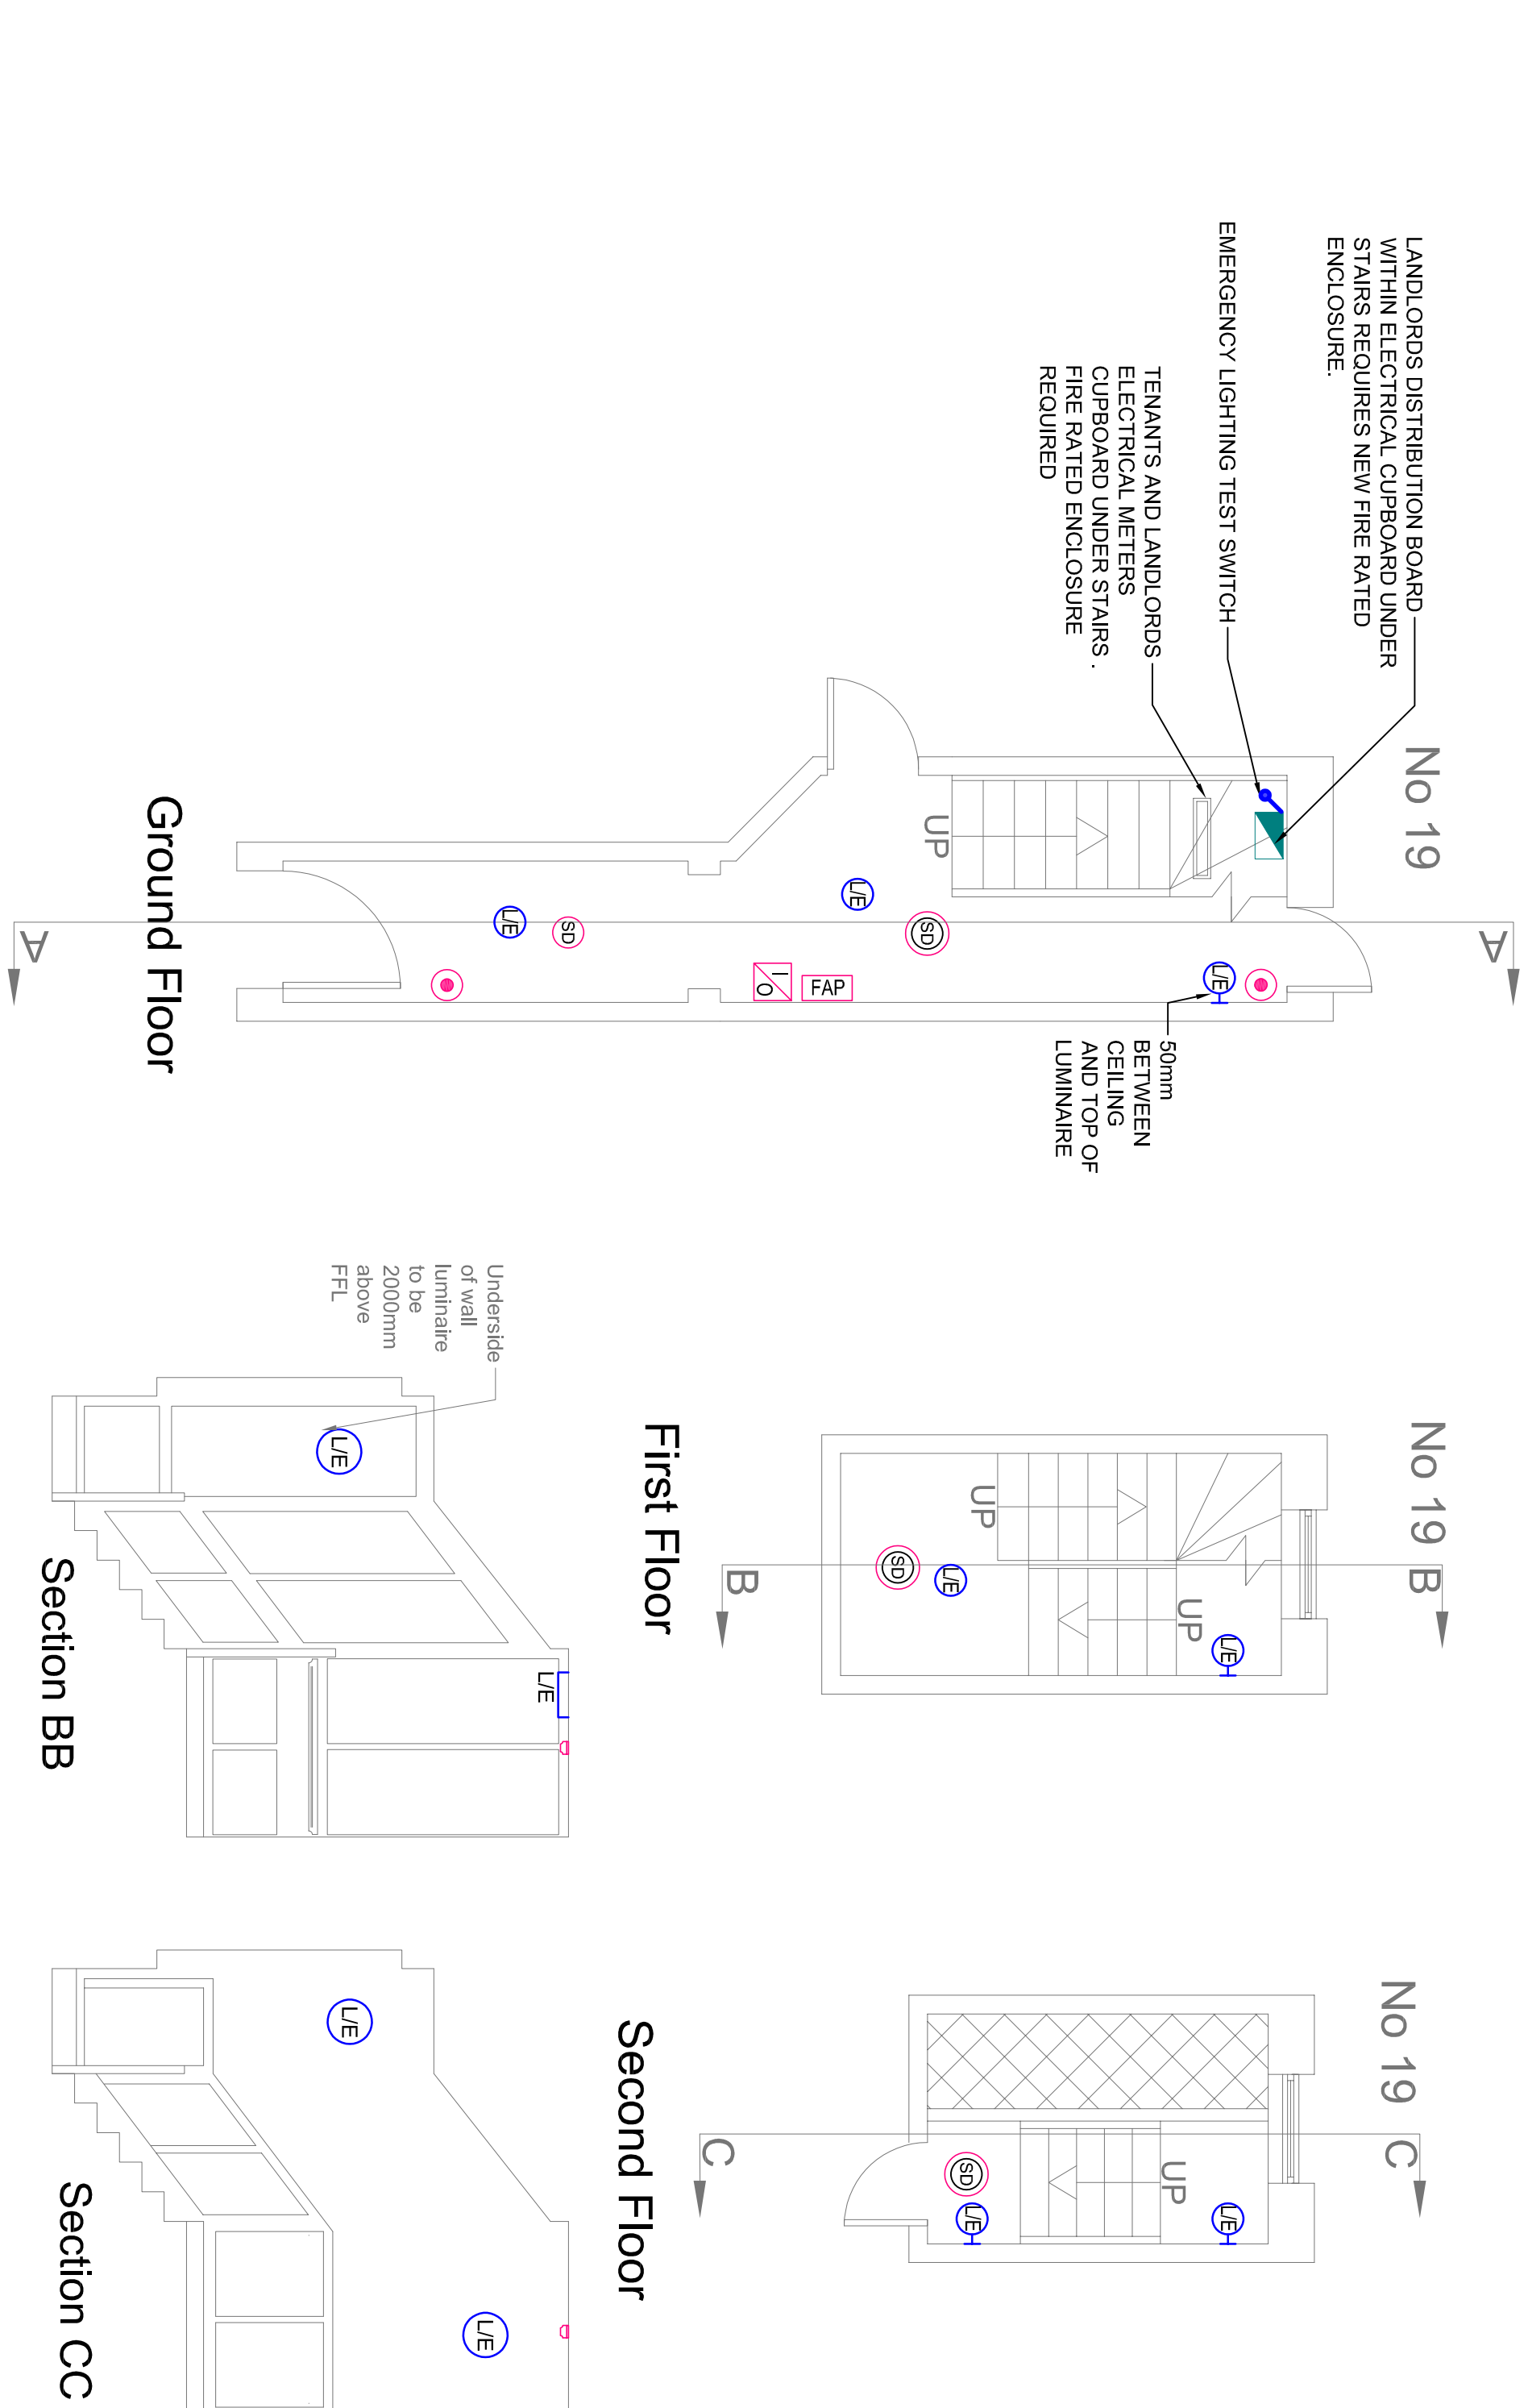

- DISCLAIMER NOTES:
- THIS DOCUMENT IS COPYRIGHT OF THE ORIGINATOR AND MUST BE TREATED AS CONFIDENTIAL.
  - THIS DOCUMENT MUST NOT BE ALTERED, REPRODUCED OR DISTRIBUTED WITHOUT PRIOR WRITTEN CONSENT OF THE ORIGINATOR.
  - THIS DOCUMENT MUST NOT BE ALTERED - THE ORIGINATOR ACCEPTS NO RESPONSIBILITY FOR ANY ERRORS OR OMISSIONS BEING THE RESULT OF THE ORIGINATOR'S INFORMATION BEING ALTERED BY OTHERS.
  - ANY DISCREPANCY MUST BE REPORTED TO THE ORIGINATOR.
  - SCALE: THIS DOCUMENT - USE FIGURED DIMENSIONS ONLY.
  - DIMENSIONS MUST BE CHECKED ON SITE PRIOR TO COMMENCEMENT OF ANY RELATED WORK.
  - THIS DOCUMENT MUST BE READ IN CONJUNCTION WITH ALL SUPPORTING DOCUMENTS PRODUCED BY THE ORIGINATOR AND OTHER PROJECT DISCIPLINES.
  - THE ORIGINATOR ACCEPTS NO RESPONSIBILITY FOR THE ACCURACY OF BACKGROUND INFORMATION PRODUCED BY THIRD PARTIES - THIS MUST BE TREATED AS INDICATIVE ONLY.
  - USERS OF THIS DOCUMENT ARE RESPONSIBLE FOR CHECKING WHICH REVISION IS CURRENT.
  - DRAWING IS FOR REFERENCE PURPOSES ONLY - THE ORIGINATOR WILL ACCEPT NO RESPONSIBILITY FOR THE COMPLETENESS OF INFORMATION UNDER THIS STATUS.
  - THE DOCUMENT STATUS 'RECORD' OR 'AS BUILT' HAS BEEN PREPARED IN PART BASED ON INFORMATION PROVIDED BY THE ORIGINATOR AND OTHER PROJECT DISCIPLINES. THE ORIGINATOR ASSUMES NO RESPONSIBILITY FOR THE ACCURACY OF THIS 'RECORD' OR 'AS BUILT' DOCUMENT FOR ANY ERRORS OR OMISSIONS THAT MAY HAVE BEEN INCORPORATED INTO IT AS A RESULT OF INCORRECT INFORMATION PROVIDED TO THE ORIGINATOR. THIS DOCUMENT IS NOT TO BE USED AS A 'RECORD' OR 'AS BUILT' DOCUMENT AND ADVISED TO OBTAIN INDEPENDENT VERIFICATION OF ITS ACCURACY.

DRAWING NOTES:

COM REGULATIONS 2015

SIGNIFICANT OR NON-OBSVIOUS RISKS AND RISKS WHICH ARE DIFFICULT TO MANAGE HAVE BEEN IDENTIFIED BY THE ORIGINATOR AND ARE LISTED IN THE RISK REGISTER. THE RIGHT WITH BRIEF ACCOMPANYING TEXT FOR FURTHER DETAILS OF THE RISKS IDENTIFIED BY DESIGNERS. REFERENCE SHOULD BE MADE TO COM HAZARD REGISTER.



REV	DESCRIPTION	DATE	BY	CHKD	
-					

ORIGINATOR:

**RIDGE**

PROPERTY & CONSTRUCTION CONSULTANTS

PARTNERSHIP HOUSE  
MOORSIDE ROAD  
WINCHESTER  
SO23 7XN

TEL: 01962 839400  
WWW.RIDGE.CO.UK

CLIENT:



IN ASSOCIATION WITH:


PROJECT:  
**9-22 DOMBEY STREET**

TITLE:  
**19 DOMBEY STREET  
PROPOSED LANDLORDS LIGHTING  
AND FIRE ALARM LAYOUT**

DRAWN BY:	DB	SCALE:	1:50	@	A1
CHECKED BY:	TN	DATE:	18/02/2020		

STATUS:

**PLANNING**



DRAWING NO:	PROJECT:	ORIG:	ZONE:	LEVEL:	TYPE:	ROLE:	NUMBER:	REV:
50103391	RDG	XX	XX	PL	E	19	-	