




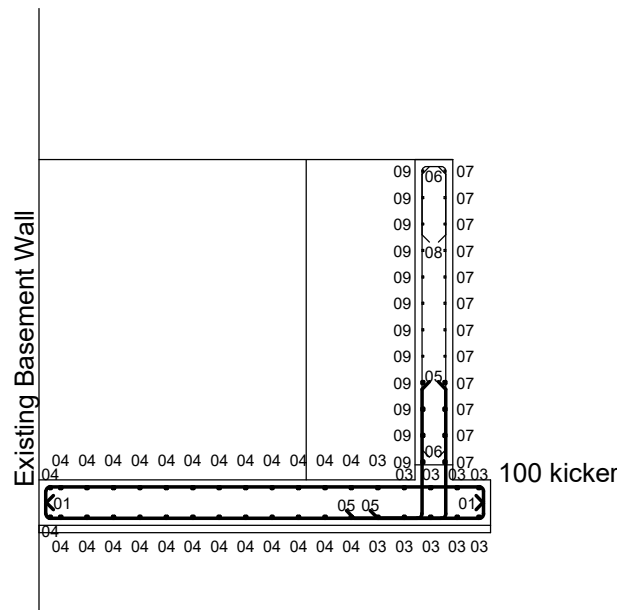


Section A-A
(wall reinforcement omitted for clarity)

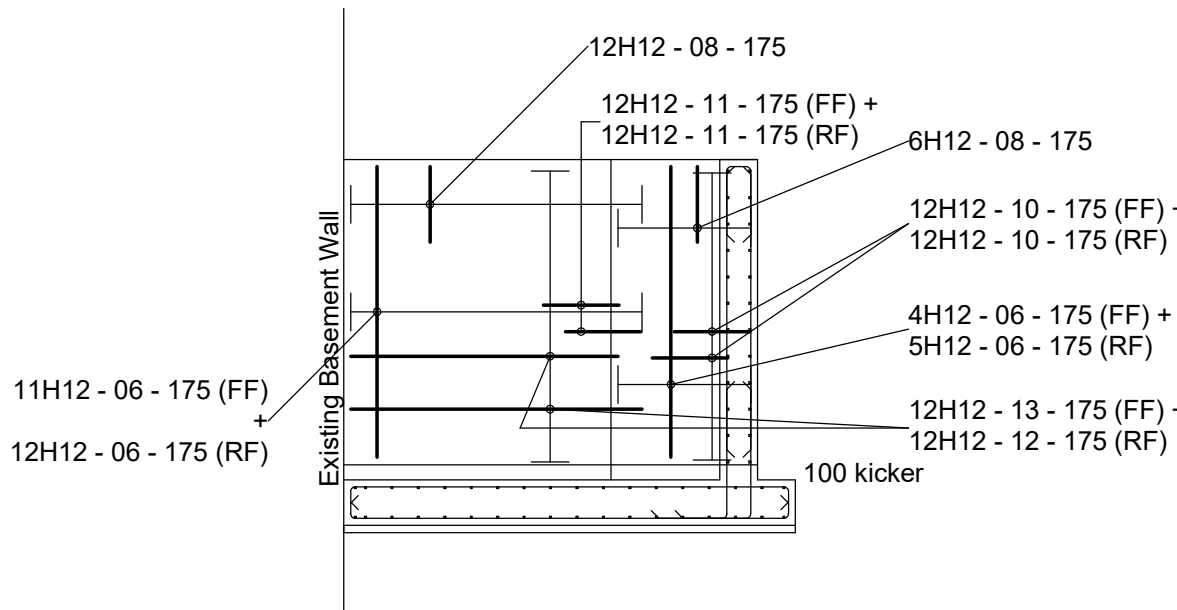


Elevation A-A
(base reinforcement omitted for clarity)

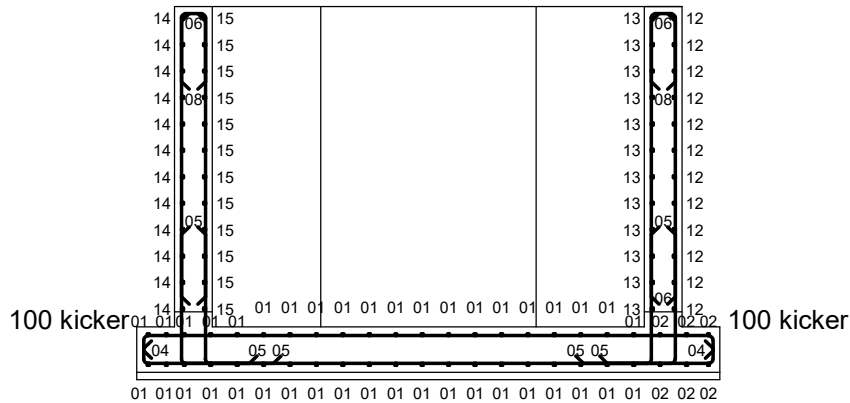

Section B-B

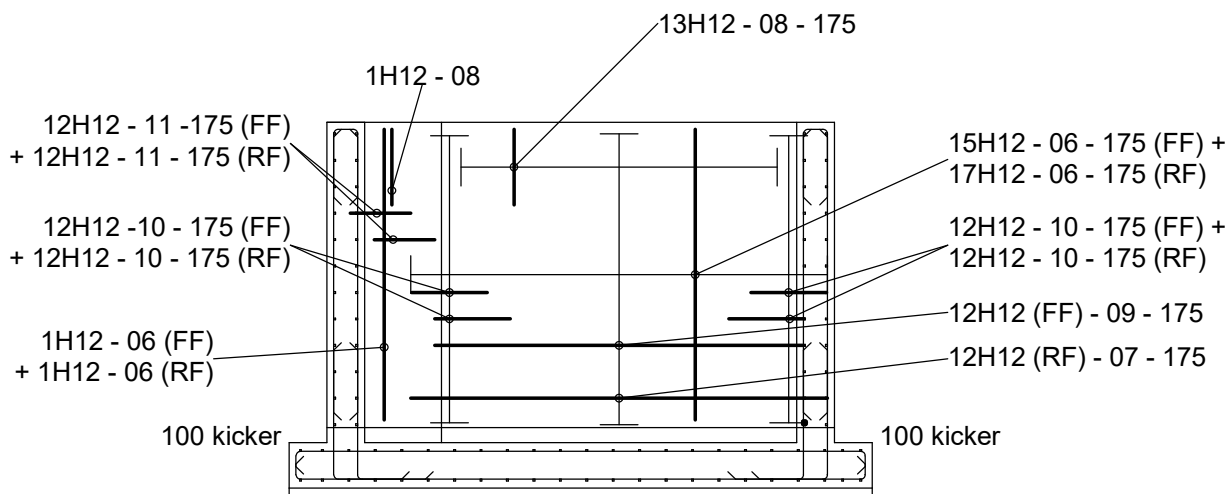

Elevation C-C
(base reinforcement omitted for clarity)

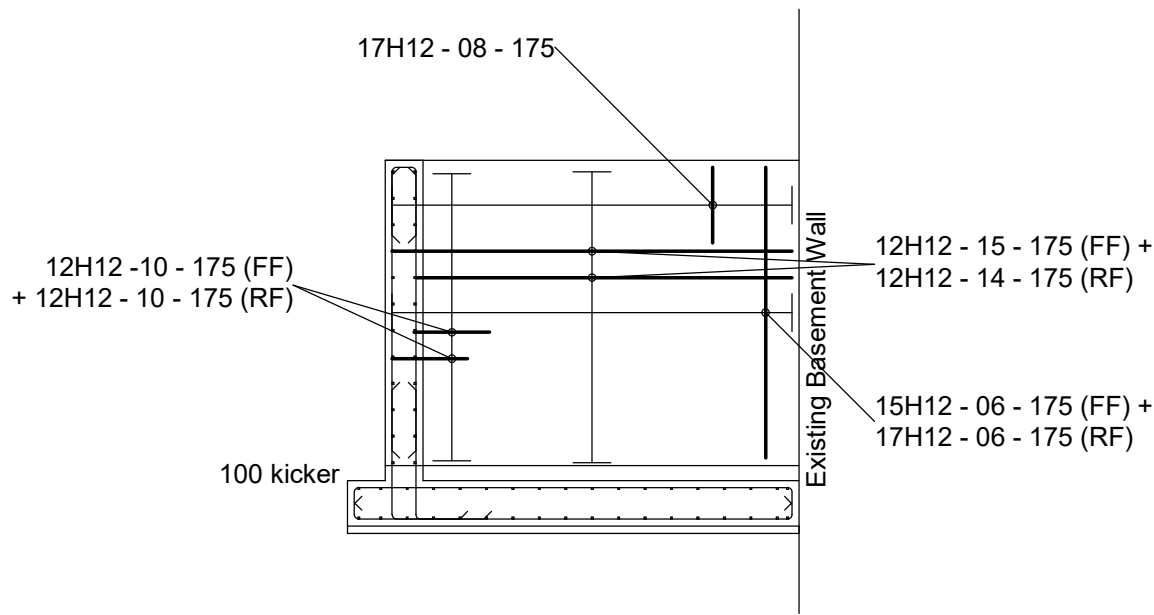

Elevation D-D
(base reinforcement omitted for clarity)

- NOTES
- 1) Concrete to be designated mix RC40.
 - 2) All steel reinforcement to have a yield stress of 500N/mm² (MIN).
 - 3) MINIMUM cover to all steel reinforcement = 40mm.
 - 4) Reinforcement can be displaced locally around RW Gully.
 - 5) Reinforcement can be cropped locally around Inspection Chamber (IC).

03	Notes regarding Inspection Chamber added.	WR	13/06/18
02	Basement bay added & upper gully removed	WR	01/05/18
01	First Issue	WR	05/04/18

Rev.	Revision Detail	Drawn	Date
03	Notes regarding Inspection Chamber added.	WR	13/06/18
02	Basement bay added & upper gully removed	WR	01/05/18
01	First Issue	WR	05/04/18

CLIENT:

COBSTAR LIMITED

PROJECT:

**28 Kylemore Road
London
NW6 2PT**

TITLE:

**Lightwell
Reinforcement Drawing
(2 of 2)**

Drawn:	IFG	Checked:	WR	Date:	03/04/18
Scale:	1:50	Original Sheet Size:	A2	Status:	DRAFT

Drawing No.	17-135-D-005	Revision:	03
-------------	--------------	-----------	----