


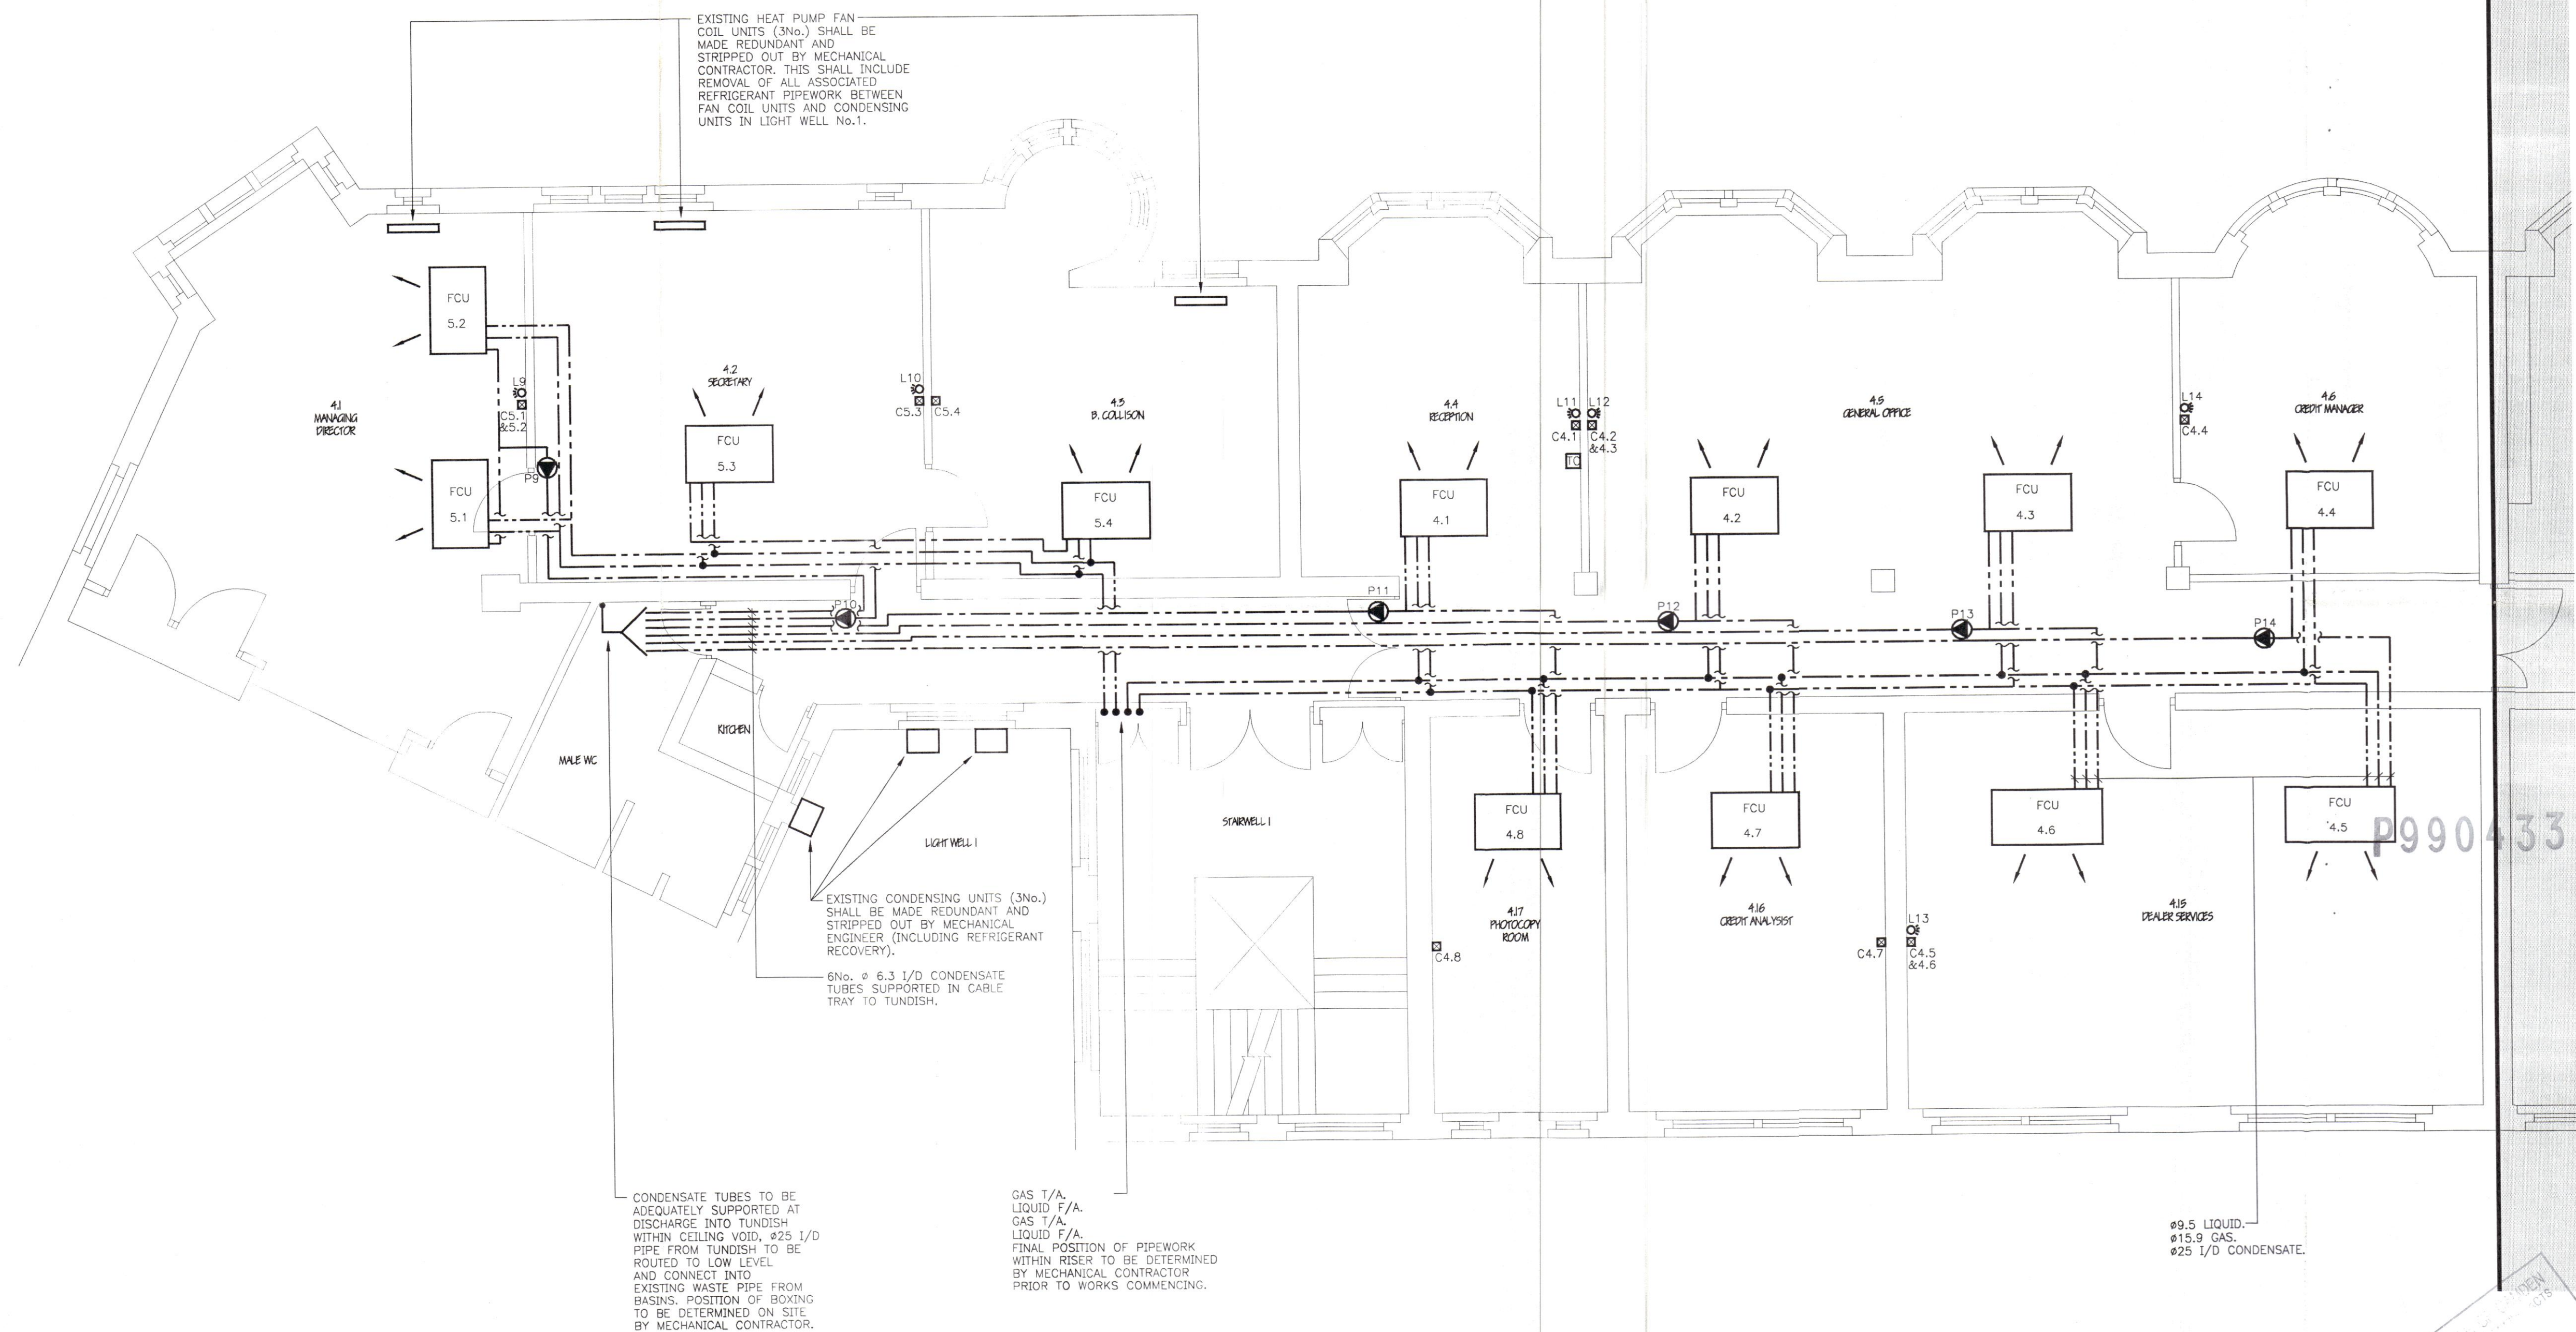

- LEGEND:-
- PIPEWORK RUN IN CEILING VOID.
 - FAN COIL UNIT.
 - DENOTES FAN COIL UNIT NUMBER.
 - DENOTES CONDENSOR NUMBER.
 - CONDENSATE PUMP.
 - TUNDISH.
 - WALL MOUNTED REMOTE CONTROLLER. (ELECTRICAL CONTRACTOR TO LIASE WITH MECHANICAL ENGINEER FOR FINAL POSITION).
 - NUMBER DENOTES FAN COIL UNIT/S THAT IS/ARE CONTROLLED BY REMOTE CONTROLLER.
 - WARNING LIGHT.
 - NUMBER RELATES TO PUMP THAT WARNING LIGHT IS CONNECTED TO.
 - TIME CLOCK.

- NOTES:-
- CONDENSATE PIPE TO LAY IN FALL BETWEEN FAN COIL UNIT AND CONDENSATE PUMP. FINAL CONDENSATE PIPE BEFORE PUMP TO BE Ø25 O/D.
 - EXCEPT WHERE NOTED OTHERWISE, ALL FINAL CONNECTIONS TO BE:
 - Ø25 1/D CONDENSATE.
 - Ø12.7 GAS.
 - Ø6.4 LIQUID.
 - ALL PIPEWORK RUN IN CEILING VOID TO BE SUPPORTED ON CABLE TRAY.
 - ALL ASSOCIATED BUILDERS WORK TO BE CARRIED OUT BY MAIN CONTRACTOR INCLUDING MAKING GOOD TO CEILING ONCE FAN COIL UNITS ARE IN PLACE.
 - WARNING LIGHTS AND REMOTE CONTROLLERS SHALL BE INSTALLED AND WIRED UP BY ELECTRICAL CONTRACTOR.

REV.	DATE	DESCRIPTION	ALT	DO	ORIG	APP

T. G. ARMSTRONG & PARTNERS
CONSULTING ENGINEERS

Durham City Tel: 0191 386 2314
Stevenage Tel: 01438 314422

Title
MECHANICAL ENGINEERING SERVICES
EXISTING STRIP OUT AND PROPOSED
COMFORT COOLING LAYOUT.
FOURTH FLOOR - VERNON HOUSE
PHASE 3 WORKS

Project
PSA WHOLESALE LTD,
SICILIAN AVENUE,
LONDON, WC1

Architect

Client
BULLEN CONSULTANTS

Drawing Number	Revision	Scale
4237/3	A1	1:50
	A3	1:100
	A4	N.T.S.

Path
G:\RPD\4237\CURRENT\4237T01

Traced	DO Check	Originator	Approved

Date
JANUARY '99

Status

This drawing is the copyright of
T. G. ARMSTRONG & PARTNERS
and must not be reproduced without their permission

FOURTH FLOOR - VERNON HOUSE

28 JAN 1999
PLANS APPROVED
ON BEHALF OF THE COUNCIL