


Distance between oxygen tanks from 2,000 litres to 20,000 litres water capacity and typical hazards.

Distances in metres

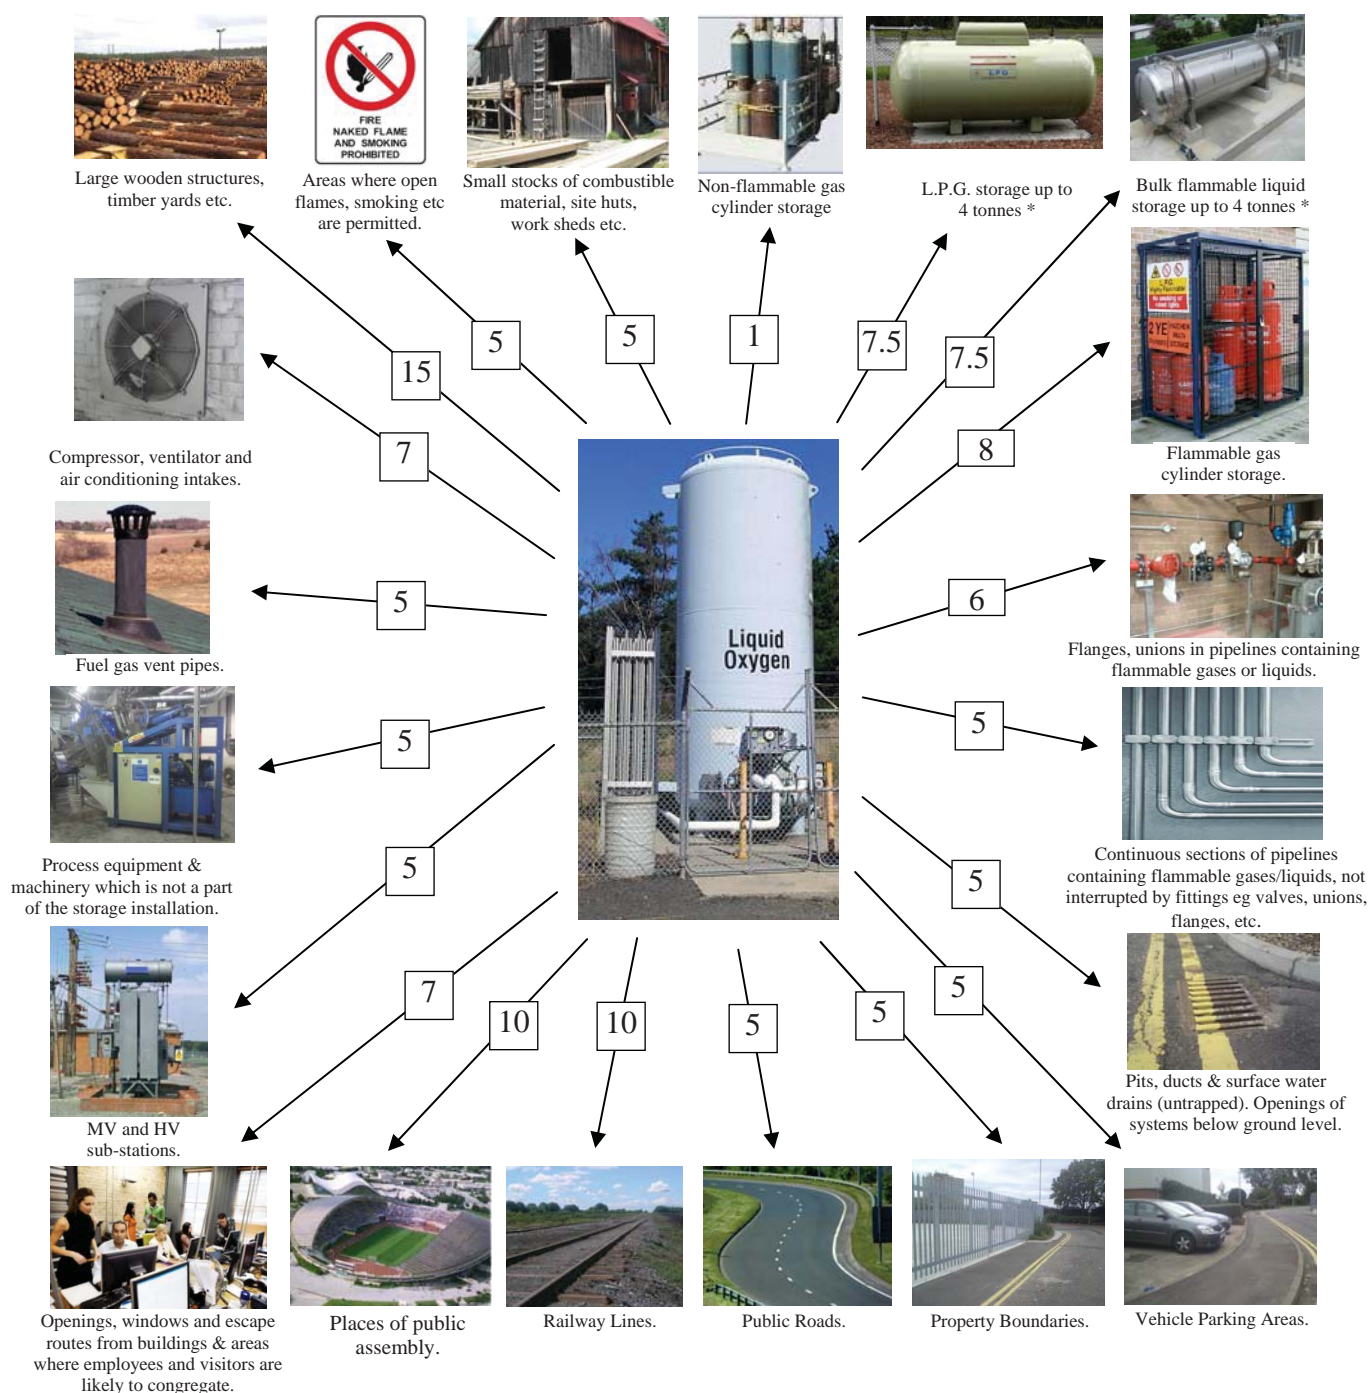

NOTE: Assumed maximum oxygen liquid phase pipework diameter DN 40 (1½" nominal bore) and flammable gas / liquid pipe up to DN25 (1" nominal bore).

* For LPG or flammable liquid tanks above 4 tonnes a risk assessment shall be carried out to establish the safe separation distance.