


Shutter Ref/No: Energy Centre Fire Shutter




HAG
THE DOOR SPECIALISTS

HAG, 1 OAK LANE, FISHPONDS,
BRISTOL BS5 7UY.
TEL 0117 9654 888
EMAIL INFO@HAG.CO.UK

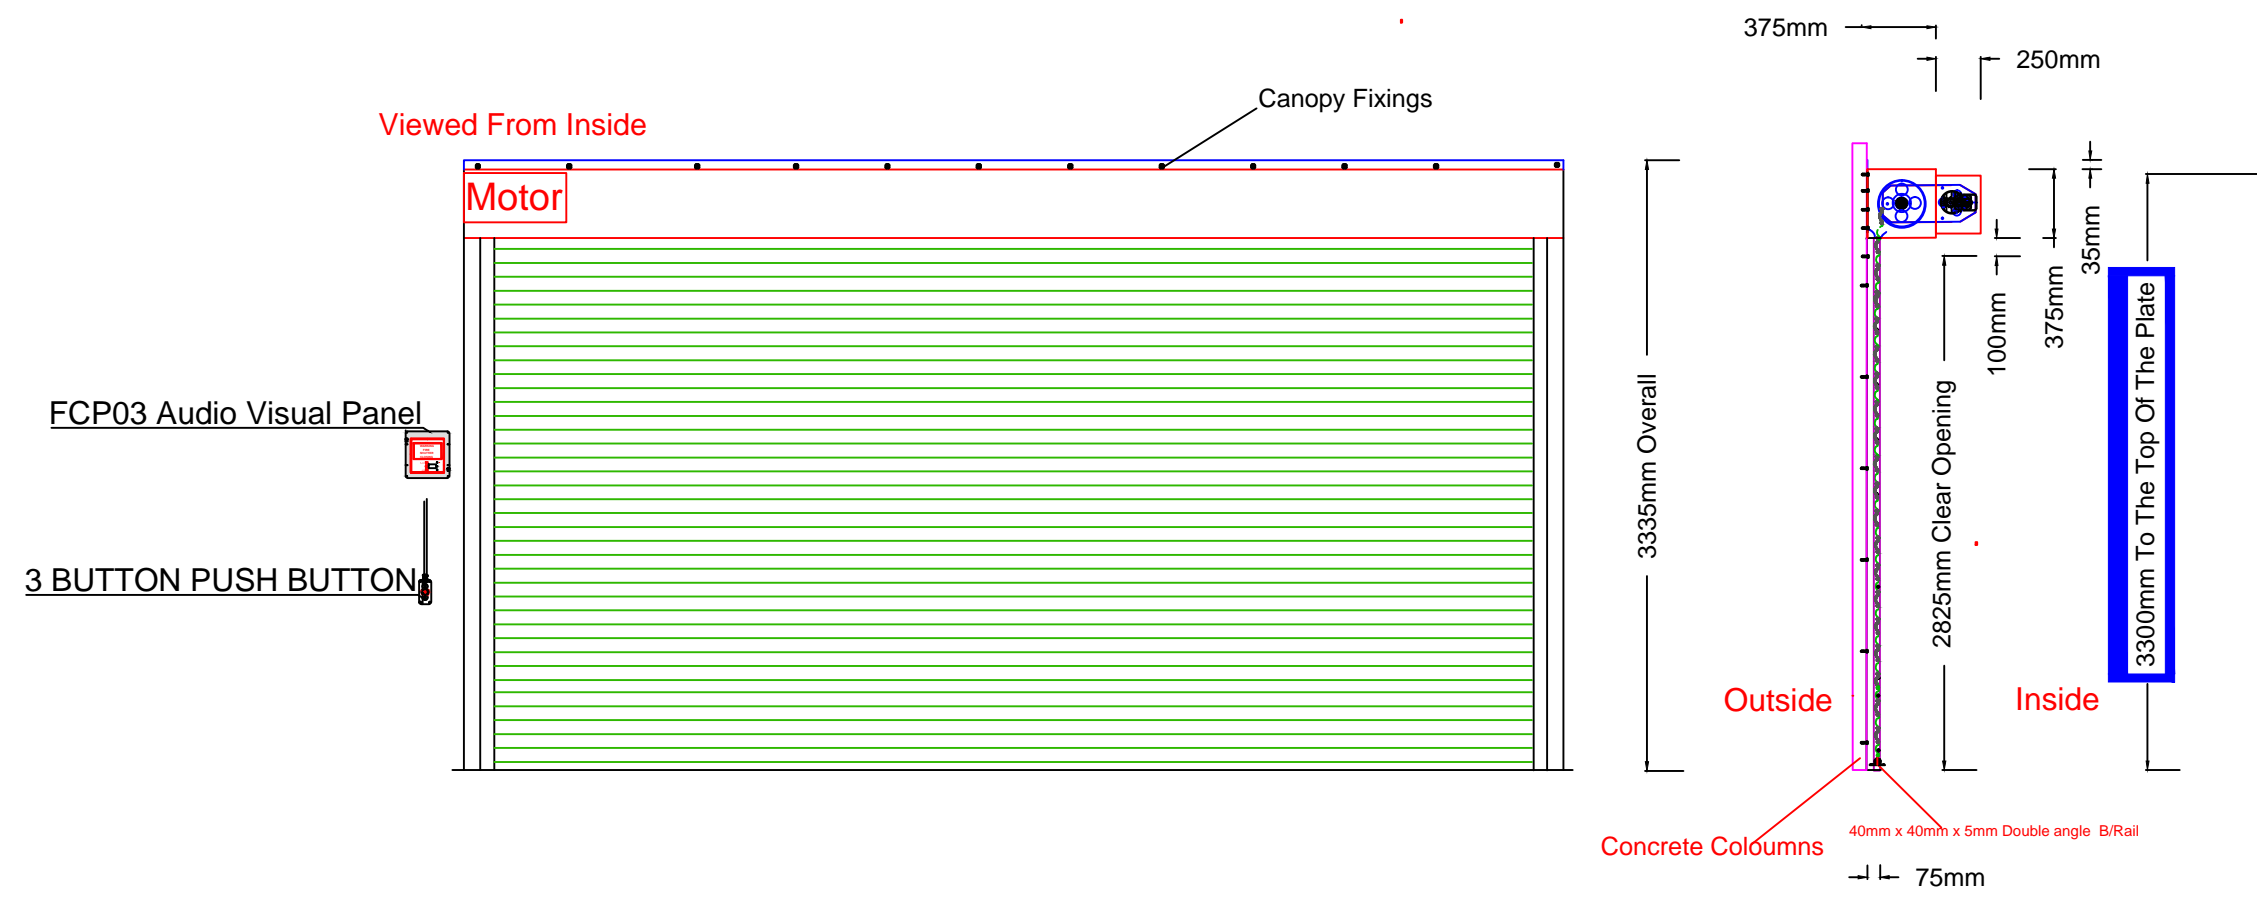

Product Ref: FG01 1 Hour Fire Shutter
Operation: Single Phase Industrial Motor
Operator: Push Button, FCP03 Audio Visual Warning Panel (1 Side), Auto Reset Solenoid (for Fail Safe Closing) & Push Button Station
Fixing: Face Fixed
Finish: PPC RAL (TBC)
Canopy & Fascia: Yes
Power Requirements: 240V Single Phase Client to provide 3 pin Female socket, Within 600mm Of Opening
Extra's: Battery Back Up
Certification: BS EN 15269-10:2011, BS EN 1634-1:2014 & EN 13501-2 2016
Notes:
 If Installing HAG Will Wire Panel & Keyswitch (If steel containment is required this is to be supplied & installed by the client not HAG). Client To Provide 240V 16amp 3 Pin Female Socket (Dedicated Supply & Alarm Engineer To Wire "0" Volt Contact To Our Panel On Installation (Return Visits, To Commission Will Be At An Extra Cost) Full Width Access Of The Shutter Is Required For Maintenance

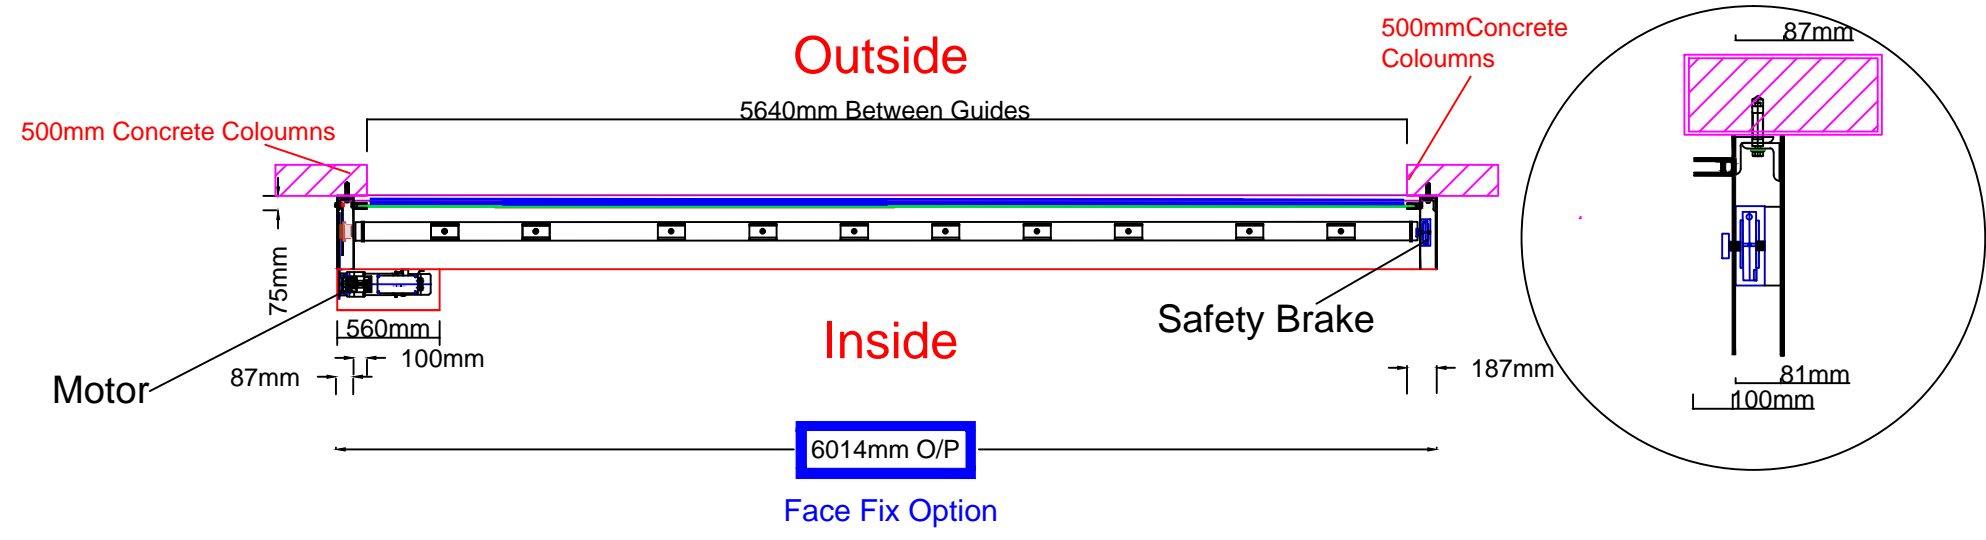

Scale: NTS

Sign.....

Print.....

Date.....

Disclamier
 HAG operates a policy of continuous improvements, product specifikation may change, and it is advisable to consult with HAG technical advisors Before specifying or ordering

SECURITY DOORS
 FIRE DOORS
 AUTOMATIC DOORS
 ENVIRONMENTAL DOORS
WWW.HAG.CO.UK

Drawn By: CK	Contractor: Bouygues		
Date: 16/04/20	Site Ref: Mount Pleasant	Drawing No: BMPFS03	Revision