



'Quietly'
Celebrating over
30 Years
of Success

Founded in 1986

Noico Limited
Landmark House
Station Road
Hook
RG27 9HA

Tel: 01256 766207
Email: sales@noico.co.uk
www.noico.co.uk

Report No. 72003022/1

**Chalk Farm Camden
Utopia Village, Chalcot Road
Primrose Hill
London
NW1 8LH**

**ENVIRONMENTAL NOISE
SURVEY REPORT
&
PLANT NOISE ASSESSMENT**

PREPARED: 4th May 2020

Presented by:

J E Redknapp

John Redknapp MBA MIOA MCMi

CONTENTS

1	Introduction
2	Instrumentation
3	Survey Details
4	Survey Results
5	Environmental Noise Level Criteria
6	BS 4142
7	BS 4142 Assessment
8	Conclusion
Appendix 1:	Glossary of Terms
Appendix 2:	Tabulated Results of Environmental Noise Survey
Appendix 3:	Acoustic Calculations
Figure 1:	Graphical Representation of Survey Results
Figure 2:	Site Plan

1.0 Introduction

- 1.1 Callisia Ltd has commissioned Noico Ltd to conduct an environmental noise survey at Chalk Farm Camden, Utopia Village, Chalcot Road, Primrose Hill, London NW1 8LH.
- 1.2 The purpose of the survey is to obtain statistical noise data and to determine the background noise levels at the site. Based on the noise survey data, noise criteria are to be established for limiting noise emission from the mechanical plant installations serving the premises. The noise criteria are to be set in accordance with the requirements of the local planning authority (The London Borough of Camden).
- 1.3 Noico Ltd have also been instructed to carry out a plant noise assessment for the proposed new equipment being installed to ensure it meets the council requirement and offer recommendations should it not.
- 1.4 The development site is located in a primarily residential area with the building layout/configuration providing some shielding to the residential properties from the surrounding roads.

2.0 Instrumentation

- 2.1 A precision grade Norsonic 140 'Type 1' Integrating Sound Level Meter was used for the survey. This was equipped with an environmental microphone and extension cable. The instrument was powered by an external battery and stored in a weatherproof case.
- 2.2 The instrument was calibrated prior and subsequent to use with no calibration drift recorded.

3.0 Survey Details

- 3.1 Location: The environmental noise analyser microphone was located externally on a flat roof of the premises adjacent to the proposed plant location. This position was chosen as it was considered to be representative of the background noise environment that exists at the nearest noise affected properties. Note, the exact position of the nearest noise-affected properties is to be confirmed by the local planning authority, prior to final design of any necessary mechanical plant noise control measures.
- 3.2 Period: Monitoring was carried out continuously from approximately 11:30 hrs on the 12th March 2020 through to 14:15 hrs on the 15th March 2020. The instrument was set up to monitor noise levels continuously and store data in fifteen minute intervals.
- 3.3 Weather: The prevailing weather condition throughout the majority of the survey period was satisfactory for noise monitoring, being mainly dry, mild and with little to moderate breeze. Windspeed, although not recorded, was considered to be less than 5 m/s throughout the survey period.
- 3.4 Site Noise Characteristics: The ambient noise level was characterised by road traffic noise around the site. It is thought that no unusual events occurred during the survey period and the data are considered to be a true representation of ambient noise levels.

4.0 Survey Results

- 4.1 The results of the environmental survey are presented in graphical and numerical format in the attached appendices, showing the recorded values of L_{Aeq} and L_{A90} .
- 4.2 See Appendix 1 for a glossary of terms.
- 4.3 With reference to the measured data, the minimum background noise level measured during the survey period was:

Daytime (07:00 to 23:00hrs)	- 40.6 L_{A90}
Night time (23:00 to 07:00hrs)	- 37.9 L_{A90}

5.0 Environmental Noise Level Criteria

- 5.1 Criteria for mechanical services noise emission are normally based upon the prevailing level of background noise in the period of concern and may be set against this to a level as normally defined by the local planning authority.
- 5.2 The London Borough of Camden Council has advised that noise arising from fixed plant installations should not cause an increase in the existing minimum background noise level (as expressed as a L_{A90}) at the nearest noise affected property. In practical terms, this means that the noise arising from the plant should be at least 10 dB(A) below the minimum background noise level.
- 5.3 To conform to the above criteria, and in accordance with the minimum background noise levels measured during the survey (detailed summarised in 4.3 above), noise from the proposed plant installations should not exceed the following value.

Daytime plant operation (07:00 to 23:00hrs)	- 30.6 dB L_{Aeq}
Night time (23:00 to 07:00hrs)	- 27.9 dB L_{Aeq}

Note: These levels must be achieved cumulatively with all plant operating, and as measured at 1 metre from the window of the nearest affected property.

6.0 BS 4142

- 6.1 Using BS 4142 the likelihood of complaints from local residents due to plant noise emissions is assessed by the difference between noise from the new source(s) and the existing background level. The noise from the new source(s) is expressed in terms of a rating level, calculated from the specific noise source(s) plus any 'acoustic feature corrections' and is given as an $L_{Aeq,T}$ noise level.
- 6.2 The acoustic feature correction is applied where the source emits a noise of a tonal, impulsive or intermittent nature.
- 6.3 The existing background noise level is expressed in terms of an $L_{A90,T}$ noise level. The rating level can be subtracted from the background noise level to determine noise impact against the design criteria.

7.0 BS 4142 Assessment

7.1 We understand the following nine new items of equipment are to be installed on an existing flat roof to the rear/side of the building – each item of plant also has the associated dB(A) level listed for reference:

1no. PURY-P200YNW-A	59dB(A) @ 1m
1no. PURY-P200YNW-A	59dB(A) @ 1m
1no. PURY-P200YNW-A	59dB(A) @ 1m
1no. PURY-P200YNW-A	59dB(A) @ 1m
1no. PURY-P300YNW-A	67dB(A) @ 1m
1no. PUZ-ZM100VKA	51dB(A) @ 1m
1no. PUZ-ZM100VKA	51dB(A) @ 1m
1no. PUZ-ZM100VKA	51dB(A) @ 1m
1no. PUZ-ZM100VKA	<u>51dB(A) @ 1m</u>
Combined Total	<u>70dB(A) @ 1m</u>

7.2 We have been advised that the plant will only operate during the day and so the limits of plant operation would be 07:00 to 23:00 hours.

7.3 A review of the plant noise level indicates that there is no evidence of any tonal content and no acoustic feature correction is required.

7.4 There are numerous residential properties in the immediate vicinity, each with direct line of sight to the proposed plant installation location. The nearest residential location is estimated to be at 15m from the proposed plant location and we have labelled this position as Assessment Location A.

7.5 Our full calculations are contained within the appendices of this report, but we can now summarise our findings for the assessment location.

Considering the plant at this location our acoustic Calculation Sheet A indicates a noise level of 49dB(A) at 1m from this nearest noise sensitive window without any mitigation measures. Once the proposed mitigation measures are put in place – a full acoustic enclosure with inlet and outlet attenuation – this level reduces to 30dB(A). The Day Time (07:00 to 23:00hours) design target is 31dB(A) – the rounded figure identified in Section 5.3 of this report – and so with the proposed mitigation measures in place this location complies with the requirements of the local authority.

8.0 Conclusion

8.1 A background noise level survey has been carried out at Chalk Farm Camden, Utopia Village, Chalcot Road, Primrose Hill, London NW1 8LH.

8.2 Based upon the survey results and discussions with the local planning authority, criteria applicable to noise from the mechanical services plant have been established.

8.3 A plant noise assessment for the proposed new equipment being installed at the above has established that the required criterion – as required by the local authority – will only be achieved with the installation of suitable mitigation measures as outlined in this acoustic report.

Appendix 1 - Glossary of Terms

Decibel, dB	A unit of level derived from the logarithm of the ratio between the value of a quantity and a reference value. For sound pressure level (L_p) the reference quantity is 2×10^{-5} N/m ² . The sound pressure level existing when microphone measured pressure is 2×10^{-5} N/m ² is 0 dB, the threshold of hearing.
L	Instantaneous value of Sound Pressure Level (L_p).
Frequency	Is related to sound pitch; frequency equals the ratio between velocity of sound and wavelength.
A weighting	Arithmetic corrections applied to values of L_p according to frequency. When logarithmically summed for all frequencies, the resulting single "A weighted value" becomes comparable with other such values from which a comparative loudness judgement can be made, then, without knowledge of frequency content of the source.
$L_{eq,T}$	Equivalent continuous level of sound pressure which, if it actually existed for the integration time period T of the measurement, would possess the same energy as the constantly varying values of L_p actually measured.
$L_{Aeq,T}$	Equivalent continuous level of A weighted sound pressure which, if it actually existed for the integration time period, T, of the measurement would possess the same energy as the constantly varying values of L_p actually measured.
$L_{n,T}$	L_p which was exceeded for n% of time, T.
$L_{An,T}$	Level in dB(A) which was exceeded for n% of time, T.
$L_{max,T}$	The instantaneous maximum sound pressure level which occurred during time, T.
$L_{Amax,T}$	The instantaneous maximum A weighted sound pressure level which occurred during time, T.
Background Noise Level	The value of $L_{A90,T}$, ref. BS4142:1997.
Traffic Noise Level	The value of $L_{A10,T}$.
Specific Noise Level	The value of $L_{Aeq,T}$ at the assessment position produced by the specific noise source, ref. BS4142:1997.
Rating Level	The specific noise level, corrected to account for any characteristic features of the noise, by adding a 5 dB(A) penalty for any tonal, impulsive or irregular qualities, ref. BS4142:1997.
Specific Noise Source	The noise source under consideration when assessing the likelihood of complaint.
Assessment Position	Unless otherwise noted, is a point at 1 m from the façade of the nearest affected sensitive property.

Appendix 2 - Environmental Noise Monitoring Data

Date	LAeq	LA90
(2020/03/12 11:30:01.00)	60.0	48.7
(2020/03/12 11:45:01.00)	51.6	48.0
(2020/03/12 12:00:01.00)	53.9	51.6
(2020/03/12 12:15:01.00)	54.8	52.3
(2020/03/12 12:30:01.00)	54.2	51.7
(2020/03/12 12:45:01.00)	52.1	47.9
(2020/03/12 13:00:01.00)	55.8	48.6
(2020/03/12 13:15:01.00)	54.8	49.9
(2020/03/12 13:30:01.00)	50.1	47.7
(2020/03/12 13:45:01.00)	50.2	47.1
(2020/03/12 14:00:01.00)	49.7	46.8
(2020/03/12 14:15:01.00)	51.1	47.8
(2020/03/12 14:30:01.00)	48.9	47.0
(2020/03/12 14:45:01.00)	49.2	47.2
(2020/03/12 15:00:01.00)	48.8	47.1
(2020/03/12 15:15:01.00)	50.7	47.7
(2020/03/12 15:30:01.00)	60.3	48.4
(2020/03/12 15:45:01.00)	49.3	46.6
(2020/03/12 16:00:01.00)	50.0	47.3
(2020/03/12 16:15:01.00)	50.2	47.4
(2020/03/12 16:30:01.00)	49.0	47.2
(2020/03/12 16:45:01.00)	53.2	47.0
(2020/03/12 17:00:01.00)	49.0	47.0
(2020/03/12 17:15:01.00)	48.8	46.7
(2020/03/12 17:30:01.00)	49.4	47.1
(2020/03/12 17:45:01.00)	50.8	47.9
(2020/03/12 18:00:01.00)	50.2	47.2
(2020/03/12 18:15:01.00)	49.4	46.7
(2020/03/12 18:30:01.00)	48.3	46.5
(2020/03/12 18:45:01.00)	48.5	46.2
(2020/03/12 19:00:01.00)	47.9	46.2
(2020/03/12 19:15:01.00)	48.1	46.1
(2020/03/12 19:30:01.00)	48.3	46.7
(2020/03/12 19:45:01.00)	48.0	46.0
(2020/03/12 20:00:01.00)	48.0	45.8
(2020/03/12 20:15:01.00)	49.2	46.6
(2020/03/12 20:30:01.00)	49.4	46.4
(2020/03/12 20:45:01.00)	47.5	44.8
(2020/03/12 21:00:01.00)	46.3	44.6
(2020/03/12 21:15:01.00)	46.1	44.2
(2020/03/12 21:30:01.00)	47.1	44.8
(2020/03/12 21:45:01.00)	46.7	44.6
(2020/03/12 22:00:01.00)	46.4	44.3

Chalk Farm Camden, Utopia Village, Chalcot Road, Primrose Hill, London NW1 8LH
Environmental Noise Survey Report

Date	LAeq	LA90
(2020/03/12 22:15:01.00)	45.9	43.1
(2020/03/12 22:30:01.00)	45.6	44.0
(2020/03/12 22:45:01.00)	48.2	44.4
(2020/03/12 23:00:01.00)	47.4	44.3
(2020/03/12 23:15:01.00)	45.5	43.1
(2020/03/12 23:30:01.00)	44.6	42.6
(2020/03/12 23:45:01.00)	44.2	42.1
(2020/03/13 00:00:02.00)	43.7	42.0
(2020/03/13 00:15:01.00)	44.2	42.2
(2020/03/13 00:30:01.00)	44.1	41.8
(2020/03/13 00:45:01.00)	43.1	41.2
(2020/03/13 01:00:01.00)	42.9	40.8
(2020/03/13 01:15:01.00)	42.5	40.2
(2020/03/13 01:30:01.00)	41.8	39.6
(2020/03/13 01:45:01.00)	42.1	39.2
(2020/03/13 02:00:01.00)	39.7	38.1
(2020/03/13 02:15:01.00)	40.3	38.5
(2020/03/13 02:30:01.00)	39.7	38.1
(2020/03/13 02:45:01.00)	40.7	38.8
(2020/03/13 03:00:01.00)	40.9	38.7
(2020/03/13 03:15:01.00)	41.4	38.7
(2020/03/13 03:30:01.00)	40.4	38.1
(2020/03/13 03:45:01.00)	39.7	38.0
(2020/03/13 04:00:01.00)	40.6	38.7
(2020/03/13 04:15:01.00)	41.4	38.6
(2020/03/13 04:30:01.00)	41.9	38.9
(2020/03/13 04:45:01.00)	42.3	39.7
(2020/03/13 05:00:01.00)	43.9	40.1
(2020/03/13 05:15:01.00)	44.1	40.7
(2020/03/13 05:30:01.00)	44.1	41.4
(2020/03/13 05:45:01.00)	45.5	42.0
(2020/03/13 06:00:01.00)	46.3	43.4
(2020/03/13 06:15:01.00)	46.6	44.5
(2020/03/13 06:30:01.00)	46.1	44.5
(2020/03/13 06:45:01.00)	46.9	45.1
(2020/03/13 07:00:01.00)	48.3	45.3
(2020/03/13 07:15:01.00)	47.9	45.8
(2020/03/13 07:30:01.00)	47.5	45.7
(2020/03/13 07:45:01.00)	48.7	46.1
(2020/03/13 08:00:01.00)	49.5	47.2
(2020/03/13 08:15:01.00)	51.3	47.4
(2020/03/13 08:30:01.00)	50.7	47.3
(2020/03/13 08:45:01.00)	49.7	47.7
(2020/03/13 09:00:01.00)	50.4	47.3
(2020/03/13 09:15:01.00)	51.0	47.7
(2020/03/13 09:30:01.00)	52.2	48.4

Chalk Farm Camden, Utopia Village, Chalcot Road, Primrose Hill, London NW1 8LH
Environmental Noise Survey Report

Date	LAeq	LA90
(2020/03/13 09:45:01.00)	49.2	47.4
(2020/03/13 10:00:01.00)	49.6	46.9
(2020/03/13 10:15:01.00)	48.5	45.9
(2020/03/13 10:30:01.00)	51.3	46.3
(2020/03/13 10:45:01.00)	49.5	45.6
(2020/03/13 11:00:01.00)	53.5	48.5
(2020/03/13 11:15:01.00)	56.7	49.0
(2020/03/13 11:30:01.00)	55.2	49.1
(2020/03/13 11:45:01.00)	54.4	47.8
(2020/03/13 12:00:01.00)	53.2	45.3
(2020/03/13 12:15:01.00)	47.9	45.4
(2020/03/13 12:30:01.00)	47.7	45.6
(2020/03/13 12:45:01.00)	48.9	45.5
(2020/03/13 13:00:01.00)	50.8	45.6
(2020/03/13 13:15:01.00)	47.6	45.6
(2020/03/13 13:30:01.00)	48.8	45.2
(2020/03/13 13:45:01.00)	48.7	46.2
(2020/03/13 14:00:01.00)	50.6	46.7
(2020/03/13 14:15:01.00)	49.0	45.6
(2020/03/13 14:30:01.00)	48.3	44.8
(2020/03/13 14:45:01.00)	48.4	46.0
(2020/03/13 15:00:01.00)	48.6	45.8
(2020/03/13 15:15:01.00)	47.7	45.2
(2020/03/13 15:30:01.00)	48.8	46.1
(2020/03/13 15:45:01.00)	51.0	49.2
(2020/03/13 16:00:01.00)	50.7	48.6
(2020/03/13 16:15:01.00)	52.9	48.7
(2020/03/13 16:30:01.00)	50.7	46.7
(2020/03/13 16:45:01.00)	46.8	42.1
(2020/03/13 17:00:01.00)	53.2	41.8
(2020/03/13 17:15:01.00)	44.3	41.1
(2020/03/13 17:30:01.00)	45.3	41.6
(2020/03/13 17:45:01.00)	49.6	43.5
(2020/03/13 18:00:01.00)	48.2	43.8
(2020/03/13 18:15:01.00)	48.8	43.5
(2020/03/13 18:30:01.00)	47.0	44.5
(2020/03/13 18:45:01.00)	49.9	45.1
(2020/03/13 19:00:01.00)	48.5	44.8
(2020/03/13 19:15:01.00)	48.0	45.3
(2020/03/13 19:30:01.00)	46.6	44.2
(2020/03/13 19:45:01.00)	47.3	43.2
(2020/03/13 20:00:01.00)	45.7	43.2
(2020/03/13 20:15:01.00)	48.2	42.7
(2020/03/13 20:30:01.00)	45.7	42.6
(2020/03/13 20:45:01.00)	49.2	43.0
(2020/03/13 21:00:01.00)	51.4	42.0

Chalk Farm Camden, Utopia Village, Chalcot Road, Primrose Hill, London NW1 8LH
Environmental Noise Survey Report

Date	LAeq	LA90
(2020/03/13 21:15:01.00)	47.4	41.9
(2020/03/13 21:30:01.00)	45.1	42.3
(2020/03/13 21:45:01.00)	44.1	41.7
(2020/03/13 22:00:01.00)	44.6	41.5
(2020/03/13 22:15:01.00)	43.3	40.6
(2020/03/13 22:30:01.00)	44.0	41.7
(2020/03/13 22:45:01.00)	43.0	40.9
(2020/03/13 23:00:01.00)	43.0	40.3
(2020/03/13 23:15:01.00)	42.1	40.2
(2020/03/13 23:30:01.00)	43.1	40.3
(2020/03/13 23:45:01.00)	43.3	40.4
(2020/03/14 00:00:02.00)	42.9	39.6
(2020/03/14 00:15:01.00)	41.0	39.0
(2020/03/14 00:30:01.00)	41.1	38.6
(2020/03/14 00:45:01.00)	41.1	39.0
(2020/03/14 01:00:01.00)	40.7	38.4
(2020/03/14 01:15:01.00)	40.2	38.2
(2020/03/14 01:30:01.00)	41.3	38.9
(2020/03/14 01:45:01.00)	41.0	38.8
(2020/03/14 02:00:01.00)	40.6	38.7
(2020/03/14 02:15:01.00)	41.8	39.0
(2020/03/14 02:30:01.00)	40.1	38.6
(2020/03/14 02:45:01.00)	39.7	38.2
(2020/03/14 03:00:01.00)	39.8	38.2
(2020/03/14 03:15:01.00)	39.8	38.2
(2020/03/14 03:30:01.00)	39.9	38.3
(2020/03/14 03:45:01.00)	46.1	37.9
(2020/03/14 04:00:01.00)	43.1	39.5
(2020/03/14 04:15:01.00)	45.3	41.6
(2020/03/14 04:30:01.00)	43.4	40.2
(2020/03/14 04:45:01.00)	47.4	42.3
(2020/03/14 05:00:01.00)	48.2	45.1
(2020/03/14 05:15:01.00)	46.7	42.2
(2020/03/14 05:30:01.00)	47.2	43.3
(2020/03/14 05:45:01.00)	45.4	41.1
(2020/03/14 06:00:01.00)	44.5	40.4
(2020/03/14 06:15:01.00)	44.2	40.9
(2020/03/14 06:30:01.00)	43.4	41.4
(2020/03/14 06:45:01.00)	45.8	42.3
(2020/03/14 07:00:01.00)	45.5	42.7
(2020/03/14 07:15:01.00)	45.8	42.8
(2020/03/14 07:30:01.00)	46.1	43.8
(2020/03/14 07:45:01.00)	46.2	43.9
(2020/03/14 08:00:01.00)	45.6	43.5
(2020/03/14 08:15:01.00)	46.8	44.3
(2020/03/14 08:30:01.00)	47.4	45.1

Chalk Farm Camden, Utopia Village, Chalcot Road, Primrose Hill, London NW1 8LH
Environmental Noise Survey Report

Date	LAeq	LA90
(2020/03/14 08:45:01.00)	47.8	45.5
(2020/03/14 09:00:01.00)	49.0	47.1
(2020/03/14 09:15:01.00)	49.1	46.0
(2020/03/14 09:30:01.00)	50.7	47.8
(2020/03/14 09:45:01.00)	49.3	47.4
(2020/03/14 10:00:01.00)	51.6	47.5
(2020/03/14 10:15:01.00)	52.6	48.9
(2020/03/14 10:30:01.00)	51.8	48.2
(2020/03/14 10:45:01.00)	50.8	47.2
(2020/03/14 11:00:01.00)	52.2	47.9
(2020/03/14 11:15:01.00)	51.1	46.3
(2020/03/14 11:30:01.00)	48.3	44.4
(2020/03/14 11:45:01.00)	45.9	44.0
(2020/03/14 12:00:01.00)	47.9	44.3
(2020/03/14 12:15:01.00)	46.7	44.9
(2020/03/14 12:30:01.00)	47.8	45.8
(2020/03/14 12:45:01.00)	47.7	45.8
(2020/03/14 13:00:01.00)	48.0	46.0
(2020/03/14 13:15:01.00)	46.7	43.0
(2020/03/14 13:30:01.00)	45.1	42.7
(2020/03/14 13:45:01.00)	46.3	42.8
(2020/03/14 14:00:01.00)	46.5	43.5
(2020/03/14 14:15:01.00)	49.4	42.7
(2020/03/14 14:30:01.00)	46.4	43.6
(2020/03/14 14:45:01.00)	46.2	43.8
(2020/03/14 15:00:01.00)	47.3	44.3
(2020/03/14 15:15:01.00)	48.7	43.9
(2020/03/14 15:30:01.00)	45.9	43.6
(2020/03/14 15:45:01.00)	46.9	44.8
(2020/03/14 16:00:01.00)	46.8	44.5
(2020/03/14 16:15:01.00)	55.0	44.5
(2020/03/14 16:30:01.00)	54.4	48.0
(2020/03/14 16:45:01.00)	49.1	45.7
(2020/03/14 17:00:01.00)	48.0	45.4
(2020/03/14 17:15:01.00)	48.5	45.6
(2020/03/14 17:30:01.00)	49.9	45.6
(2020/03/14 17:45:01.00)	47.7	44.7
(2020/03/14 18:00:01.00)	48.1	44.3
(2020/03/14 18:15:01.00)	48.2	45.1
(2020/03/14 18:30:01.00)	46.7	44.4
(2020/03/14 18:45:01.00)	46.2	44.0
(2020/03/14 19:00:01.00)	47.5	44.8
(2020/03/14 19:15:01.00)	46.3	44.0
(2020/03/14 19:30:01.00)	46.3	44.5
(2020/03/14 19:45:01.00)	48.2	44.5
(2020/03/14 20:00:01.00)	47.1	44.2

Chalk Farm Camden, Utopia Village, Chalcot Road, Primrose Hill, London NW1 8LH
Environmental Noise Survey Report

Date	LAeq	LA90
(2020/03/14 20:15:01.00)	46.3	44.3
(2020/03/14 20:30:01.00)	48.0	44.6
(2020/03/14 20:45:01.00)	46.7	44.6
(2020/03/14 21:00:01.00)	48.7	44.7
(2020/03/14 21:15:01.00)	46.6	44.5
(2020/03/14 21:30:01.00)	46.0	44.1
(2020/03/14 21:45:01.00)	45.7	43.6
(2020/03/14 22:00:01.00)	45.3	43.4
(2020/03/14 22:15:01.00)	47.2	44.1
(2020/03/14 22:30:01.00)	45.8	43.6
(2020/03/14 22:45:01.00)	45.5	43.5
(2020/03/14 23:00:01.00)	46.0	43.5
(2020/03/14 23:15:01.00)	44.7	43.0
(2020/03/14 23:30:01.00)	44.7	42.6
(2020/03/14 23:45:01.00)	44.4	42.6
(2020/03/15 00:00:02.00)	44.2	42.0
(2020/03/15 00:15:01.00)	43.6	41.5
(2020/03/15 00:30:01.00)	43.8	41.7
(2020/03/15 00:45:01.00)	43.1	41.0
(2020/03/15 01:00:01.00)	43.1	40.6
(2020/03/15 01:15:01.00)	42.9	40.7
(2020/03/15 01:30:01.00)	41.7	39.7
(2020/03/15 01:45:01.00)	42.5	40.3
(2020/03/15 02:00:01.00)	42.0	40.0
(2020/03/15 02:15:01.00)	42.0	39.7
(2020/03/15 02:30:01.00)	41.4	38.9
(2020/03/15 02:45:01.00)	50.4	39.8
(2020/03/15 03:00:01.00)	41.3	39.1
(2020/03/15 03:15:01.00)	41.3	39.2
(2020/03/15 03:30:01.00)	42.1	39.6
(2020/03/15 03:45:01.00)	42.1	39.3
(2020/03/15 04:00:01.00)	40.5	38.6
(2020/03/15 04:15:01.00)	42.0	39.4
(2020/03/15 04:30:01.00)	41.7	39.6
(2020/03/15 04:45:01.00)	42.7	39.2
(2020/03/15 05:00:01.00)	43.8	39.6
(2020/03/15 05:15:01.00)	43.3	40.2
(2020/03/15 05:30:01.00)	49.9	39.9
(2020/03/15 05:45:01.00)	43.2	39.7
(2020/03/15 06:00:01.00)	43.3	39.4
(2020/03/15 06:15:01.00)	42.8	40.0
(2020/03/15 06:30:01.00)	44.7	40.3
(2020/03/15 06:45:01.00)	43.6	40.5
(2020/03/15 07:00:01.00)	43.9	40.9
(2020/03/15 07:15:01.00)	44.4	41.0
(2020/03/15 07:30:01.00)	43.7	41.6

Chalk Farm Camden, Utopia Village, Chalcot Road, Primrose Hill, London NW1 8LH
Environmental Noise Survey Report

Date	LAeq	LA90
(2020/03/15 07:45:01.00)	50.7	42.6
(2020/03/15 08:00:01.00)	48.3	42.4
(2020/03/15 08:15:01.00)	46.3	42.3
(2020/03/15 08:30:01.00)	48.7	42.4
(2020/03/15 08:45:01.00)	48.8	43.5
(2020/03/15 09:00:01.00)	45.9	43.5
(2020/03/15 09:15:01.00)	45.8	43.8
(2020/03/15 09:30:01.00)	45.5	43.9
(2020/03/15 09:45:01.00)	48.3	44.9
(2020/03/15 10:00:01.00)	45.9	44.2
(2020/03/15 10:15:01.00)	47.1	44.5
(2020/03/15 10:30:01.00)	46.4	44.4
(2020/03/15 10:45:01.00)	47.1	44.8
(2020/03/15 11:00:01.00)	47.0	45.0
(2020/03/15 11:15:01.00)	46.8	45.3
(2020/03/15 11:30:01.00)	50.1	45.1
(2020/03/15 11:45:01.00)	46.7	44.9
(2020/03/15 12:00:01.00)	47.8	45.5
(2020/03/15 12:15:01.00)	48.1	45.1
(2020/03/15 12:30:01.00)	51.6	46.5
(2020/03/15 12:45:01.00)	48.6	45.5
(2020/03/15 13:00:01.00)	50.1	45.7
(2020/03/15 13:15:01.00)	47.2	45.2
(2020/03/15 13:30:01.00)	47.7	45.2
(2020/03/15 13:45:01.00)	48.5	45.4
(2020/03/15 14:00:01.00)	47.2	45.3
(2020/03/15 14:15:01.00)	46.9	45.3

Appendix 3 – Acoustic Calculations

CALCULATION SHEET A											
CLIENT: Callisia Ltd			PROJECT: Utopia Village Primrose Hill NW1 8LH								
Job ref: 72003022			DATE: 4th May 2020								
Plant operation: 07:00 to 23:00hours			Octave Band Centre Frequency (Hz)								
Description			63	125	250	500	1K	2K	4K	8K	dB(A)
ASSESSMENT LOCATION A											
PURY-P200YNW-A		Lp @ 1m	77	61	61	58	51	47	44	42	59
PURY-P200YNW-A		Lp @ 1m	77	61	61	58	51	47	44	42	59
PURY-P200YNW-A		Lp @ 1m	77	61	61	58	51	47	44	42	59
PURY-P200YNW-A		Lp @ 1m	77	61	61	58	51	47	44	42	59
PURY-P300YNW-A		Lp @ 1m	75	70	69	66	61	57	52	48	67
PUZ-ZM100VKA		Lp @ 1m	54	54	53	49	46	41	36	29	51
PUZ-ZM100VKA		Lp @ 1m	54	54	53	49	46	41	36	29	51
PUZ-ZM100VKA		Lp @ 1m	54	54	53	49	46	41	36	29	51
PUZ-ZM100VKA		Lp @ 1m	54	54	53	49	46	41	36	29	51
Combined Plant Total			84	72	71	68	63	59	54	51	70
Additional surface reflections		None	0	0	0	0	0	0	0	0	
Distance Loss: 1m to 15m			-24	-24	-24	-24	-24	-24	-24	-24	
Screening via existing building		None	0	0	0	0	0	0	0	0	
Façade Correction			3	3	3	3	3	3	3	3	
Lp @1m from receivers façade			63	51	50	47	42	38	33	30	49
Noise criteria external to nearest noise sensitive window for plant operating period =											31
Excess =											18
Notes											
Calculations to the nearest noise sensitive residential windows											
No allowance has been made in the above calculations for any noise/vibration transfer through the structure											
Vibration isolation should be allowed for under the new plant											
Mitigation measures: Required - in the form of an acoustic enclosure utilising 1500mm long attenuators											
Mitigation measures to provide a minimum of 18dB(A) attenuation - see below.											
Lp @1m from receivers façade		(no mitigation)	63	51	50	47	42	38	33	30	49
Attenuator performance 1500/40			-8	-12	-21	-39	-50	-43	-34	-18	
Lp @1m from receivers façade		(with mitigation)	55	39	29	8	-8	-5	-1	12	30
Noise criteria external to nearest noise sensitive window =											31
Excess =											-1

Figure 1

Environmental Noise Survey - Chalk Farm Camden



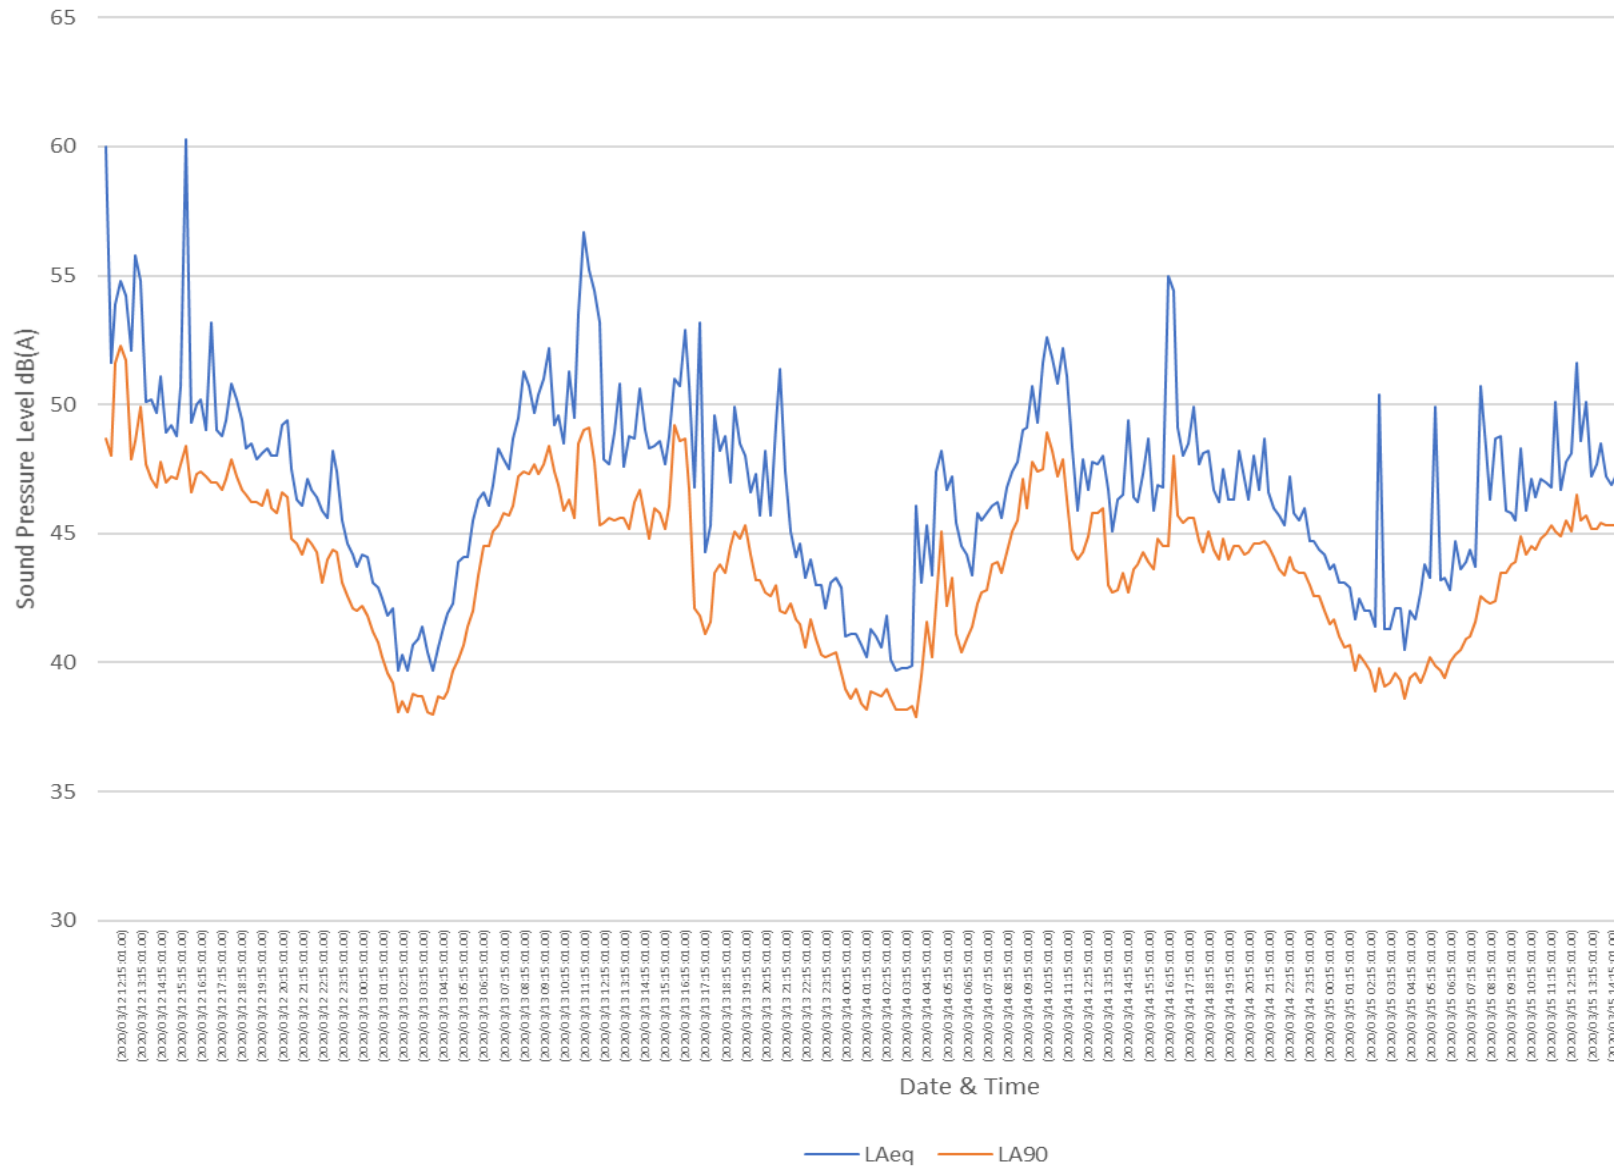


Figure 2

Noise Monitoring Position

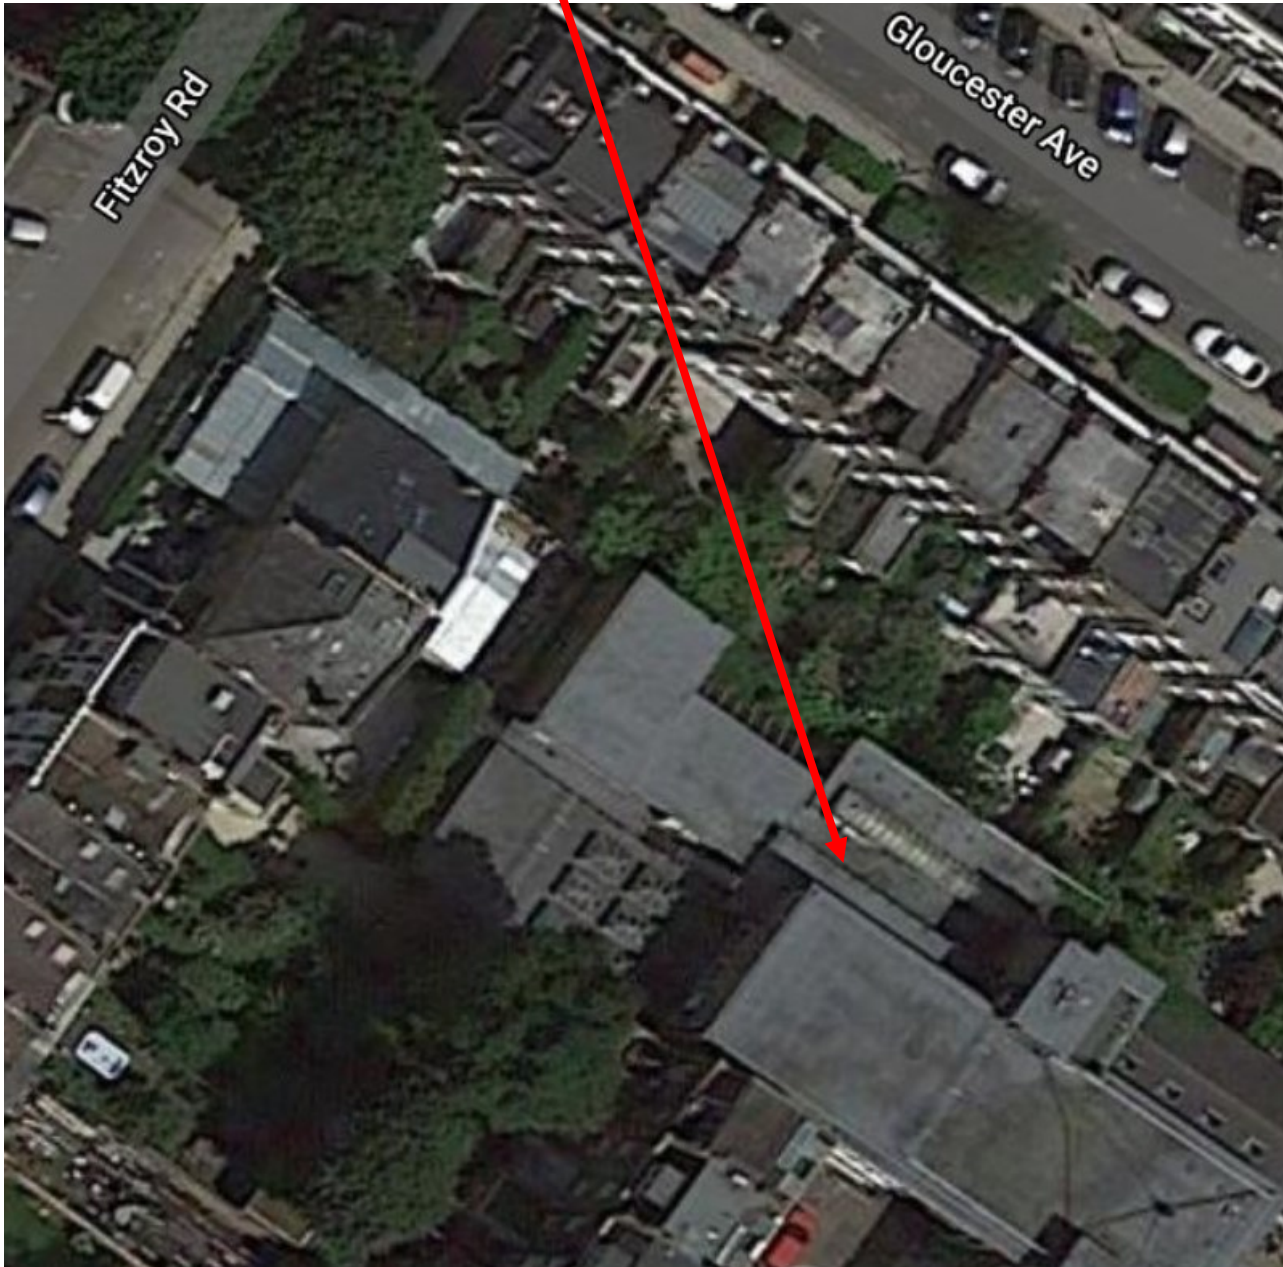

Project: Chalk Farm Camden

Title: Noise Survey Position

Dwg No: 2003022-7

Date: 4th May 2020

Landmark House, Station Road, Hook, Hampshire, RG27 9HA
Tel: 01256 766207