


NB. All dimensions shown are finished sizes – when trimming joints, an allowance will have to be made to incorporate a fitting tolerance.

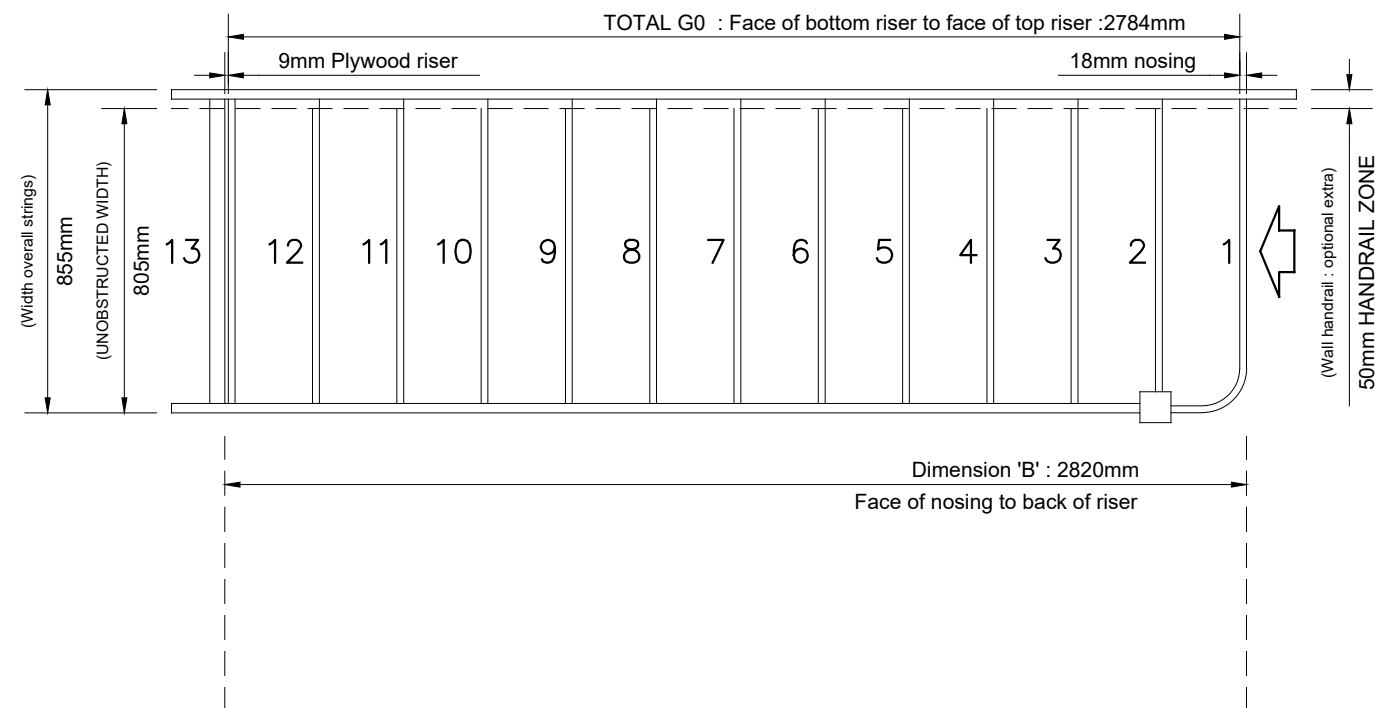


13 up Flight		12 up Flight		TABLE. 1		
R x 13	G x 12	R x 12	G x 11	Pitch	Rise	Go
2548	2640			41° 42'	196	220
2574	2640			41° 59'	198	220
2600	2676	2400	2453	41° 54'	200	223
2639	2712	2436	2486	41° 56'	203	226
2678	2748	2472	2519	41° 59'	206	229
2704	2748	2496	2552	41° 53'	208	232
<b>2743</b>	<b>2820</b>	2532	2585	41° 56'	<b>211</b>	<b>235</b>
		2568	2618	41° 58'	214	238
		2592	2651	41° 53'	216	241
		2628	2684	41° 55'	219	244
		2640	2717	41° 42'	220	247

### PROPOSED STAIRCASE


Dimensions to be checked and measured on site prior to fabrication of stairs. Timber stairs to comply with BS585 and with Part K of the Building Regulations. Max rise 220mm, min going 220mm. Two risers plus one going should be between 550 and 700mm. Tapered treads to have going in centre of tread at least the same as the going on the straight. Min 50mm going of tapered treads measured at narrow end. Pitch not to exceed 42 degrees.

The width and length of every landing should be at least as great as the smallest width of the flight. Doors which swing across a landing at the bottom of a flight should leave a clear space of at least 400mm across the full width of the flight. Min 2.0m headroom measured vertically above pitch line of stairs and landings. Handrail on staircase to be 900mm above the pitchline, handrail to be at least one side if stairs are less than 1m wide and on both sides if they are wider. Ensure a clear width between handrails of minimum 600mm. Balustrading designed to be unclimbable and should contain no space through which a 100mm sphere could pass. Allow for all structure as designed by a Structural Engineer.


Drawing & notes for design intent purposes, final design & construction to be completed by Main Contractor.

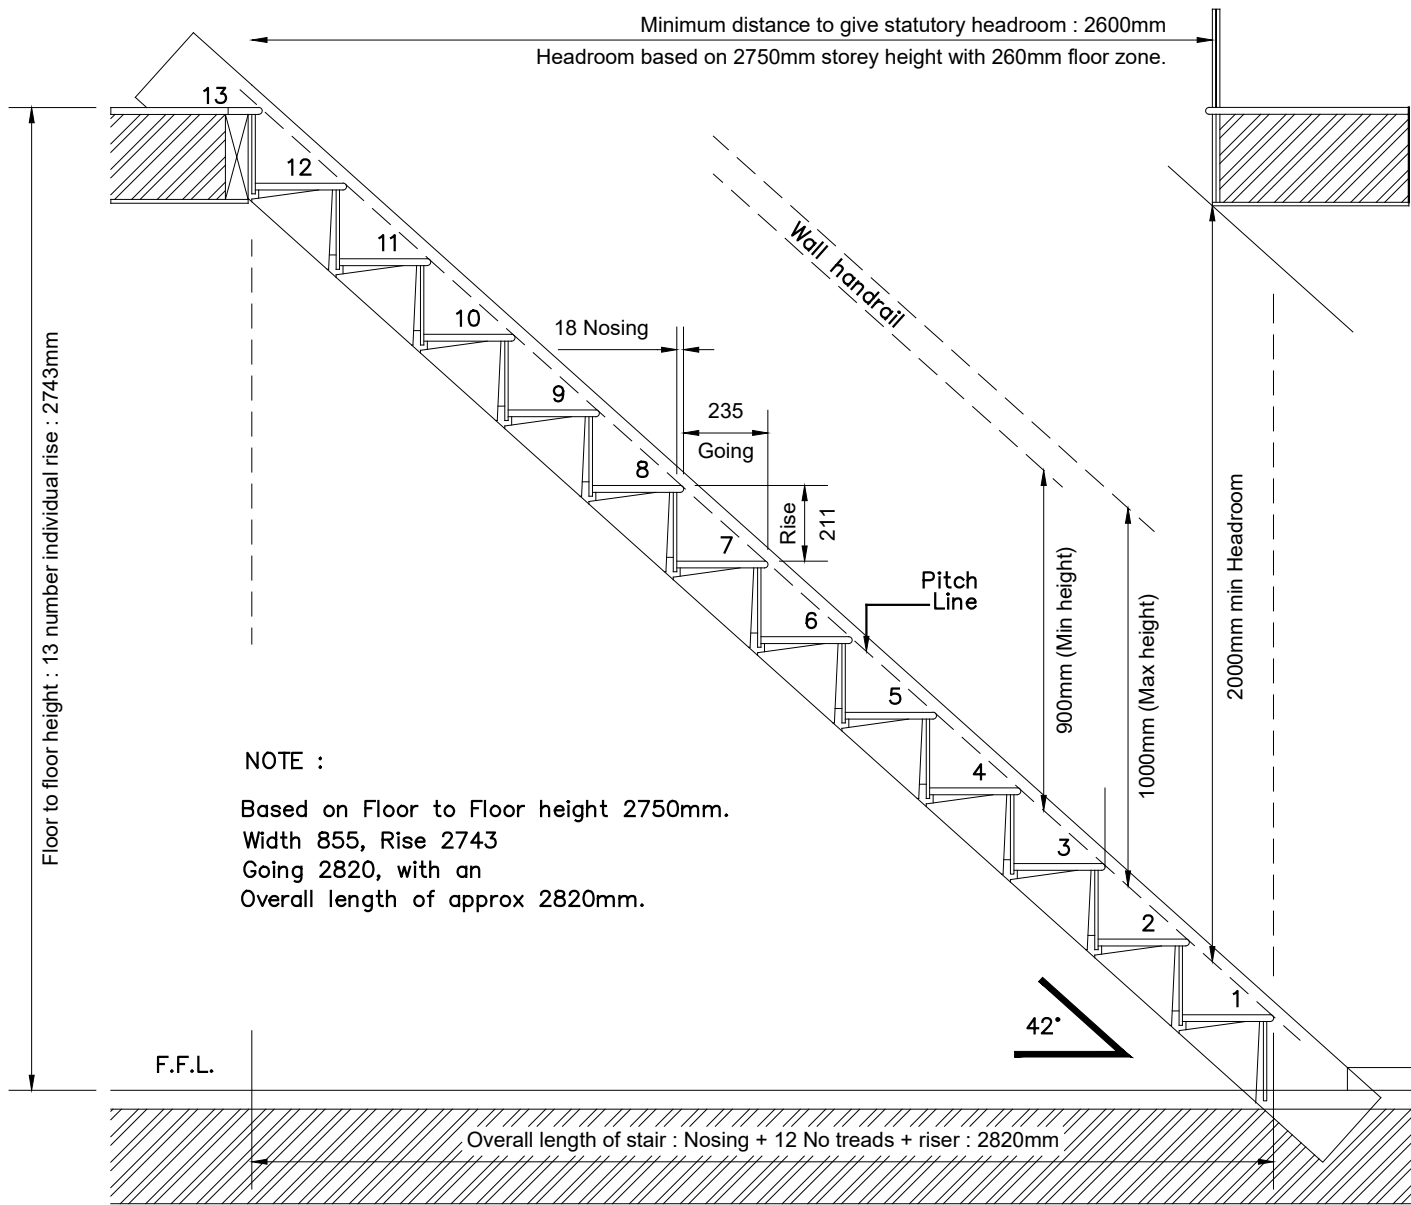

NOTE :  
Based on Floor to Floor height 2750mm.  
Width 855, Rise 2743  
Going 2820, with an  
Overall length of approx 2820mm.

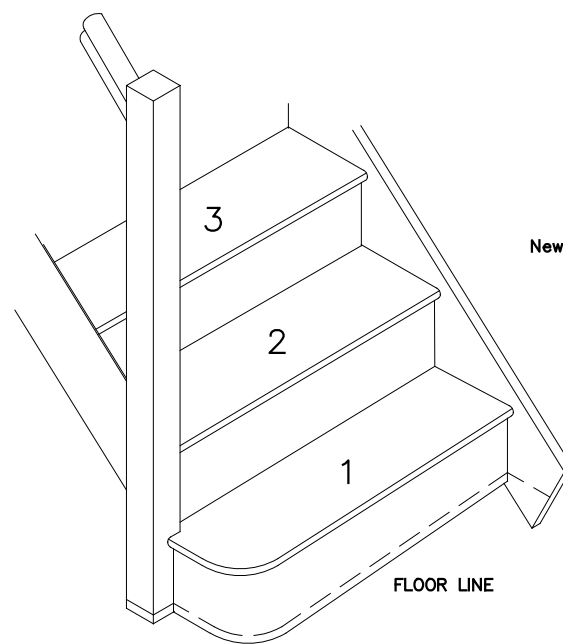

Note :  
Newels and handrail  
shown in simple  
form for reason  
of clarity.

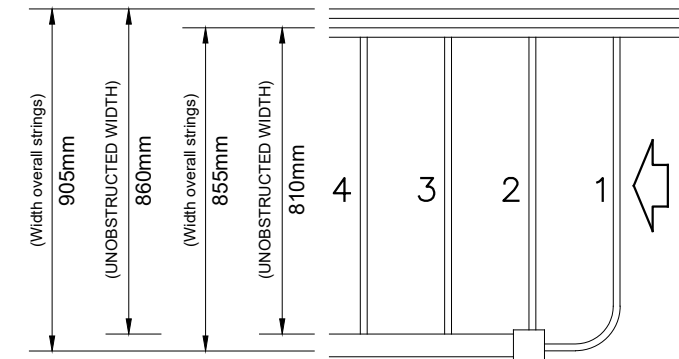

### PROPOSED STAIR DETAILS

1:20

**GENERAL NOTES:**  
Mark Yates Architects Ltd accepts no responsibility for any costs, losses or claims whatsoever arising from these drawings, specifications and related documents unless there is full compliance with the Client or any unauthorised user of the following.

- All boundaries, dimensions and levels are to be checked on site before construction and any discrepancies reported to the Architect / Designer.
- Partial Service: Any discrepancies with site or other information is to be advised to the Architect / Designer and direction and / or approval is to be sought before the implementation of the detail.
- Block and site plans are reproduced under license from the Ordnance Survey.
- Do not scale this drawing.
- For the purpose of coordination, all relevant parties must check this information prior to implementation and report any discrepancies to the Architect / Designer.

**DRAWING NOTES:**

STATUS	REVISION	DATE
P1	Issued for information	19.05.2020

CLIENT	PROJECT

PROPOSED STAIR DETAILS		
SCALE	1:20	PAPER SIZE
		A2
DATE	19.05.2020	DRAWN BY
		MY
DWG No.	AA-20-002	REVISION
		P1
		PROJECT No.
		121-20
DRAWING STATUS		
INFORMATION		
Information contained on this drawing is the sole copyright of Mark Yates Architects Ltd. and is not to be reproduced without their permission.		



Mark Yates Architects Ltd  
www.myarchitects.uk  
info@myarchitects.uk