



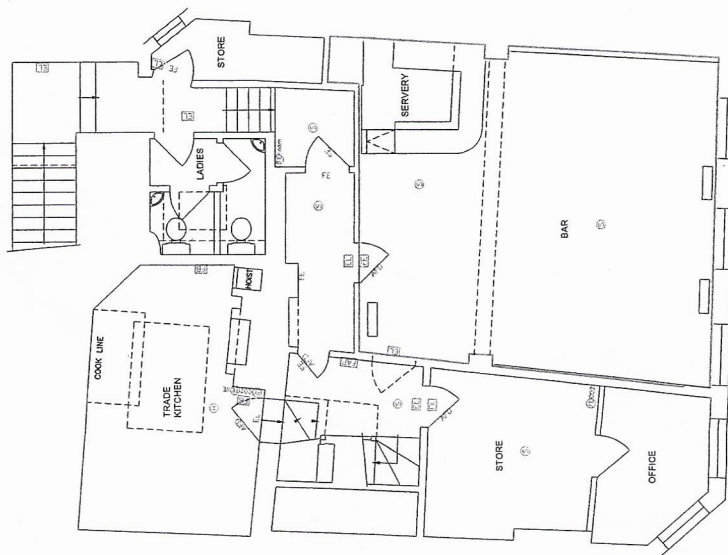


First Floor Plan

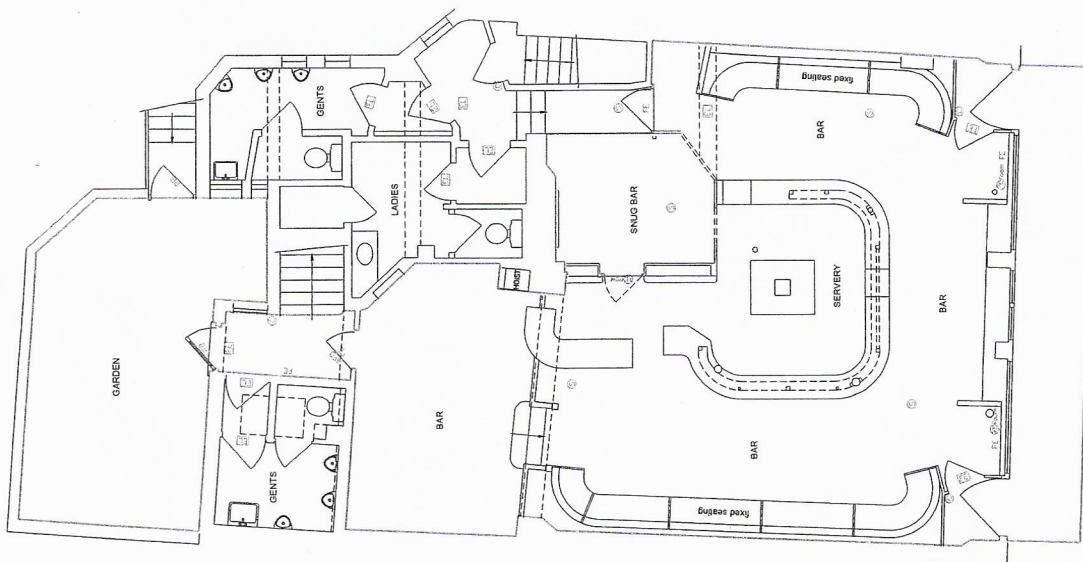


Ground Floor Plan


File Protection Legend:								
F	E	D	C	B	A	P	R	S
File deletion system is compliant to BS 6039 Part 1								
Fire extinguisher category is comply to BS 6200 Part 1								
Fire extinguisher category is comply to BS 6200 Part 1								
NOTE: Star ratings always shown in up direction unless otherwise stated.								
7/25	7/25	7/25	7/25	7/25	7/25	7/25	7/25	7/25
File Alarm Control Panel	Smoke Detector	Hall Detector	Emergency Light	Remanent Fire Exit Sign	Fire Exit Sign	Jr. Exit Sign glowing red during fire alarm condition	Automatic Fire Door	Push Bar / Push Pad Door Release
File Blanket	Break Glass Call Point	Fire Extinguisher CO ₂	Fire Extinguisher Water	Fire Extinguisher Foam	Fire Extinguisher Wet Chemical	Fire Extinguisher Powder	Sounder	

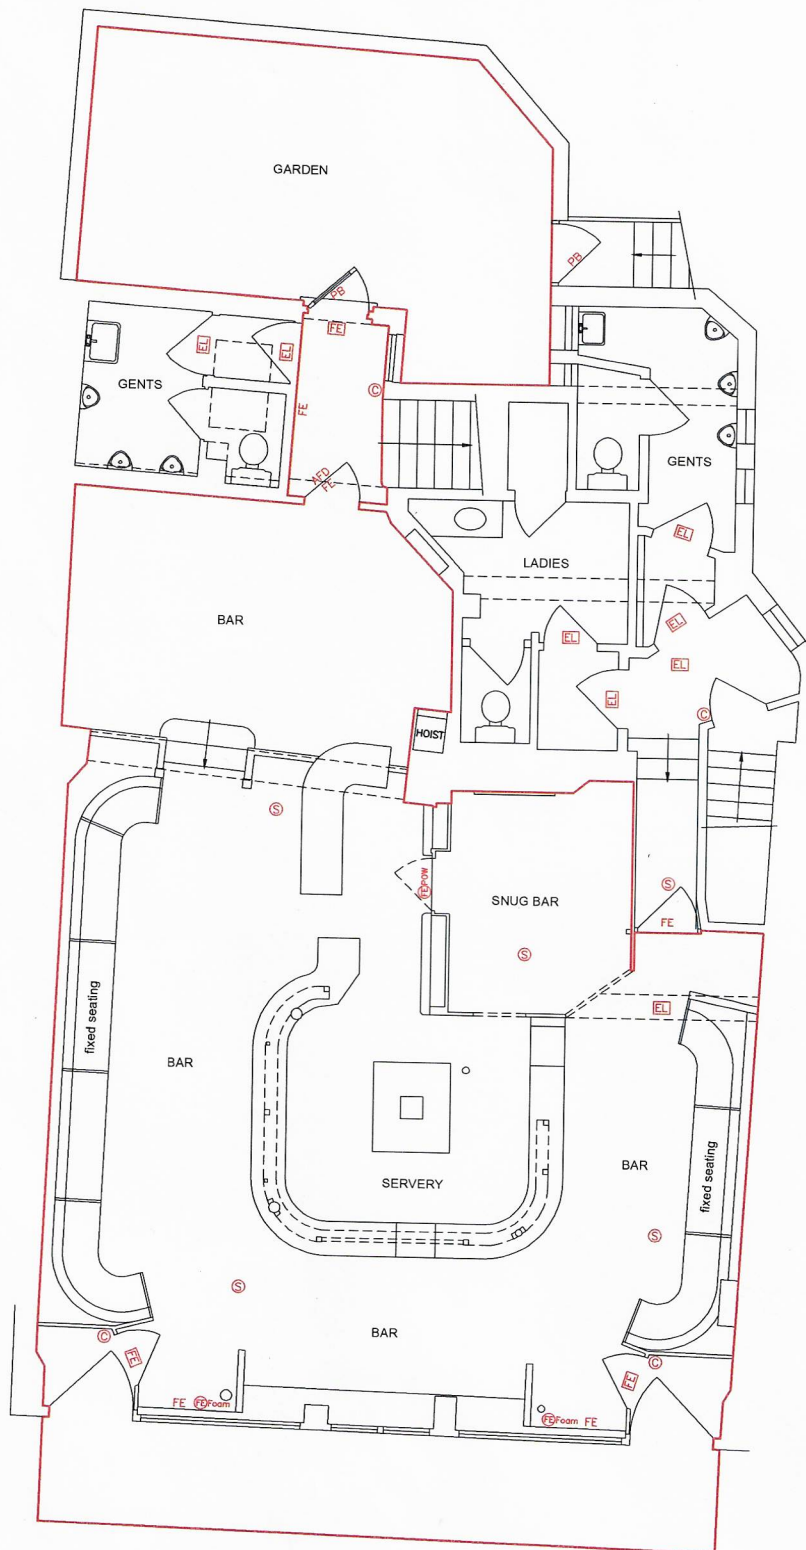

Ground Floor Plan

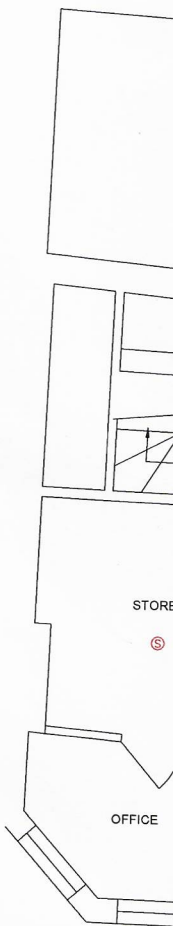

First Floor Plan

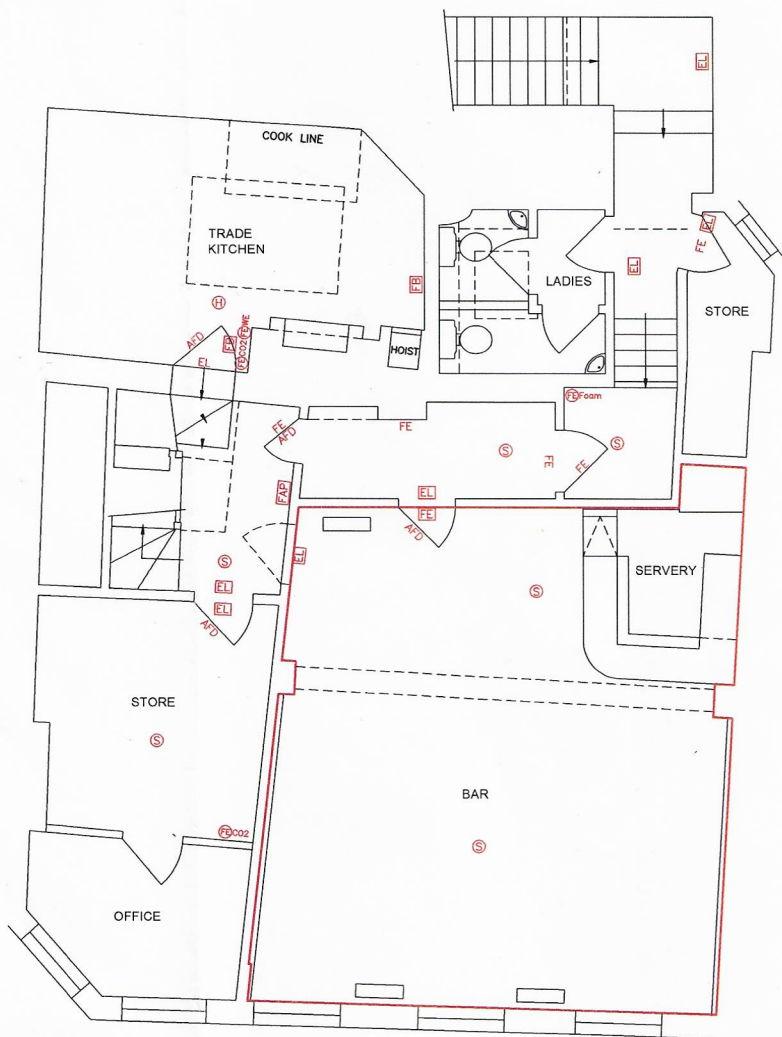

First Floor Plan

Fire Precaution Legend

Fire detection system to comply to BS 5839:Part 1

Emergency lighting to comply to BS 5266:Part 1

NOTE: Stair arrows always shown in up direction unless otherwise noted.

FAP	Fire Alarm Control Panel
S	Smoke Detector
H	Heat Detector
EL	Emergency Light
FE	Illuminated Fire Exit Sign
FE	Fire Exit Sign
FD	1/2 Hour self closing fire door with cold smoke seals to door edge.
AFD	Automatic Fire Door
PB	Push Bar / Push Pad Door Release
FB	Fire Blanket
C	Break Glass Call Point
FE/CO2	Fire Extinguisher CO ₂
FE/Water	Fire Extinguisher Water
FE/Foam	Fire Extinguisher Foam
FE/WE	Fire Extinguisher Wet Chemical
FE/POW	Fire Extinguisher Powder
SP	Sounder

— ALL LICENSABLE AREAS