
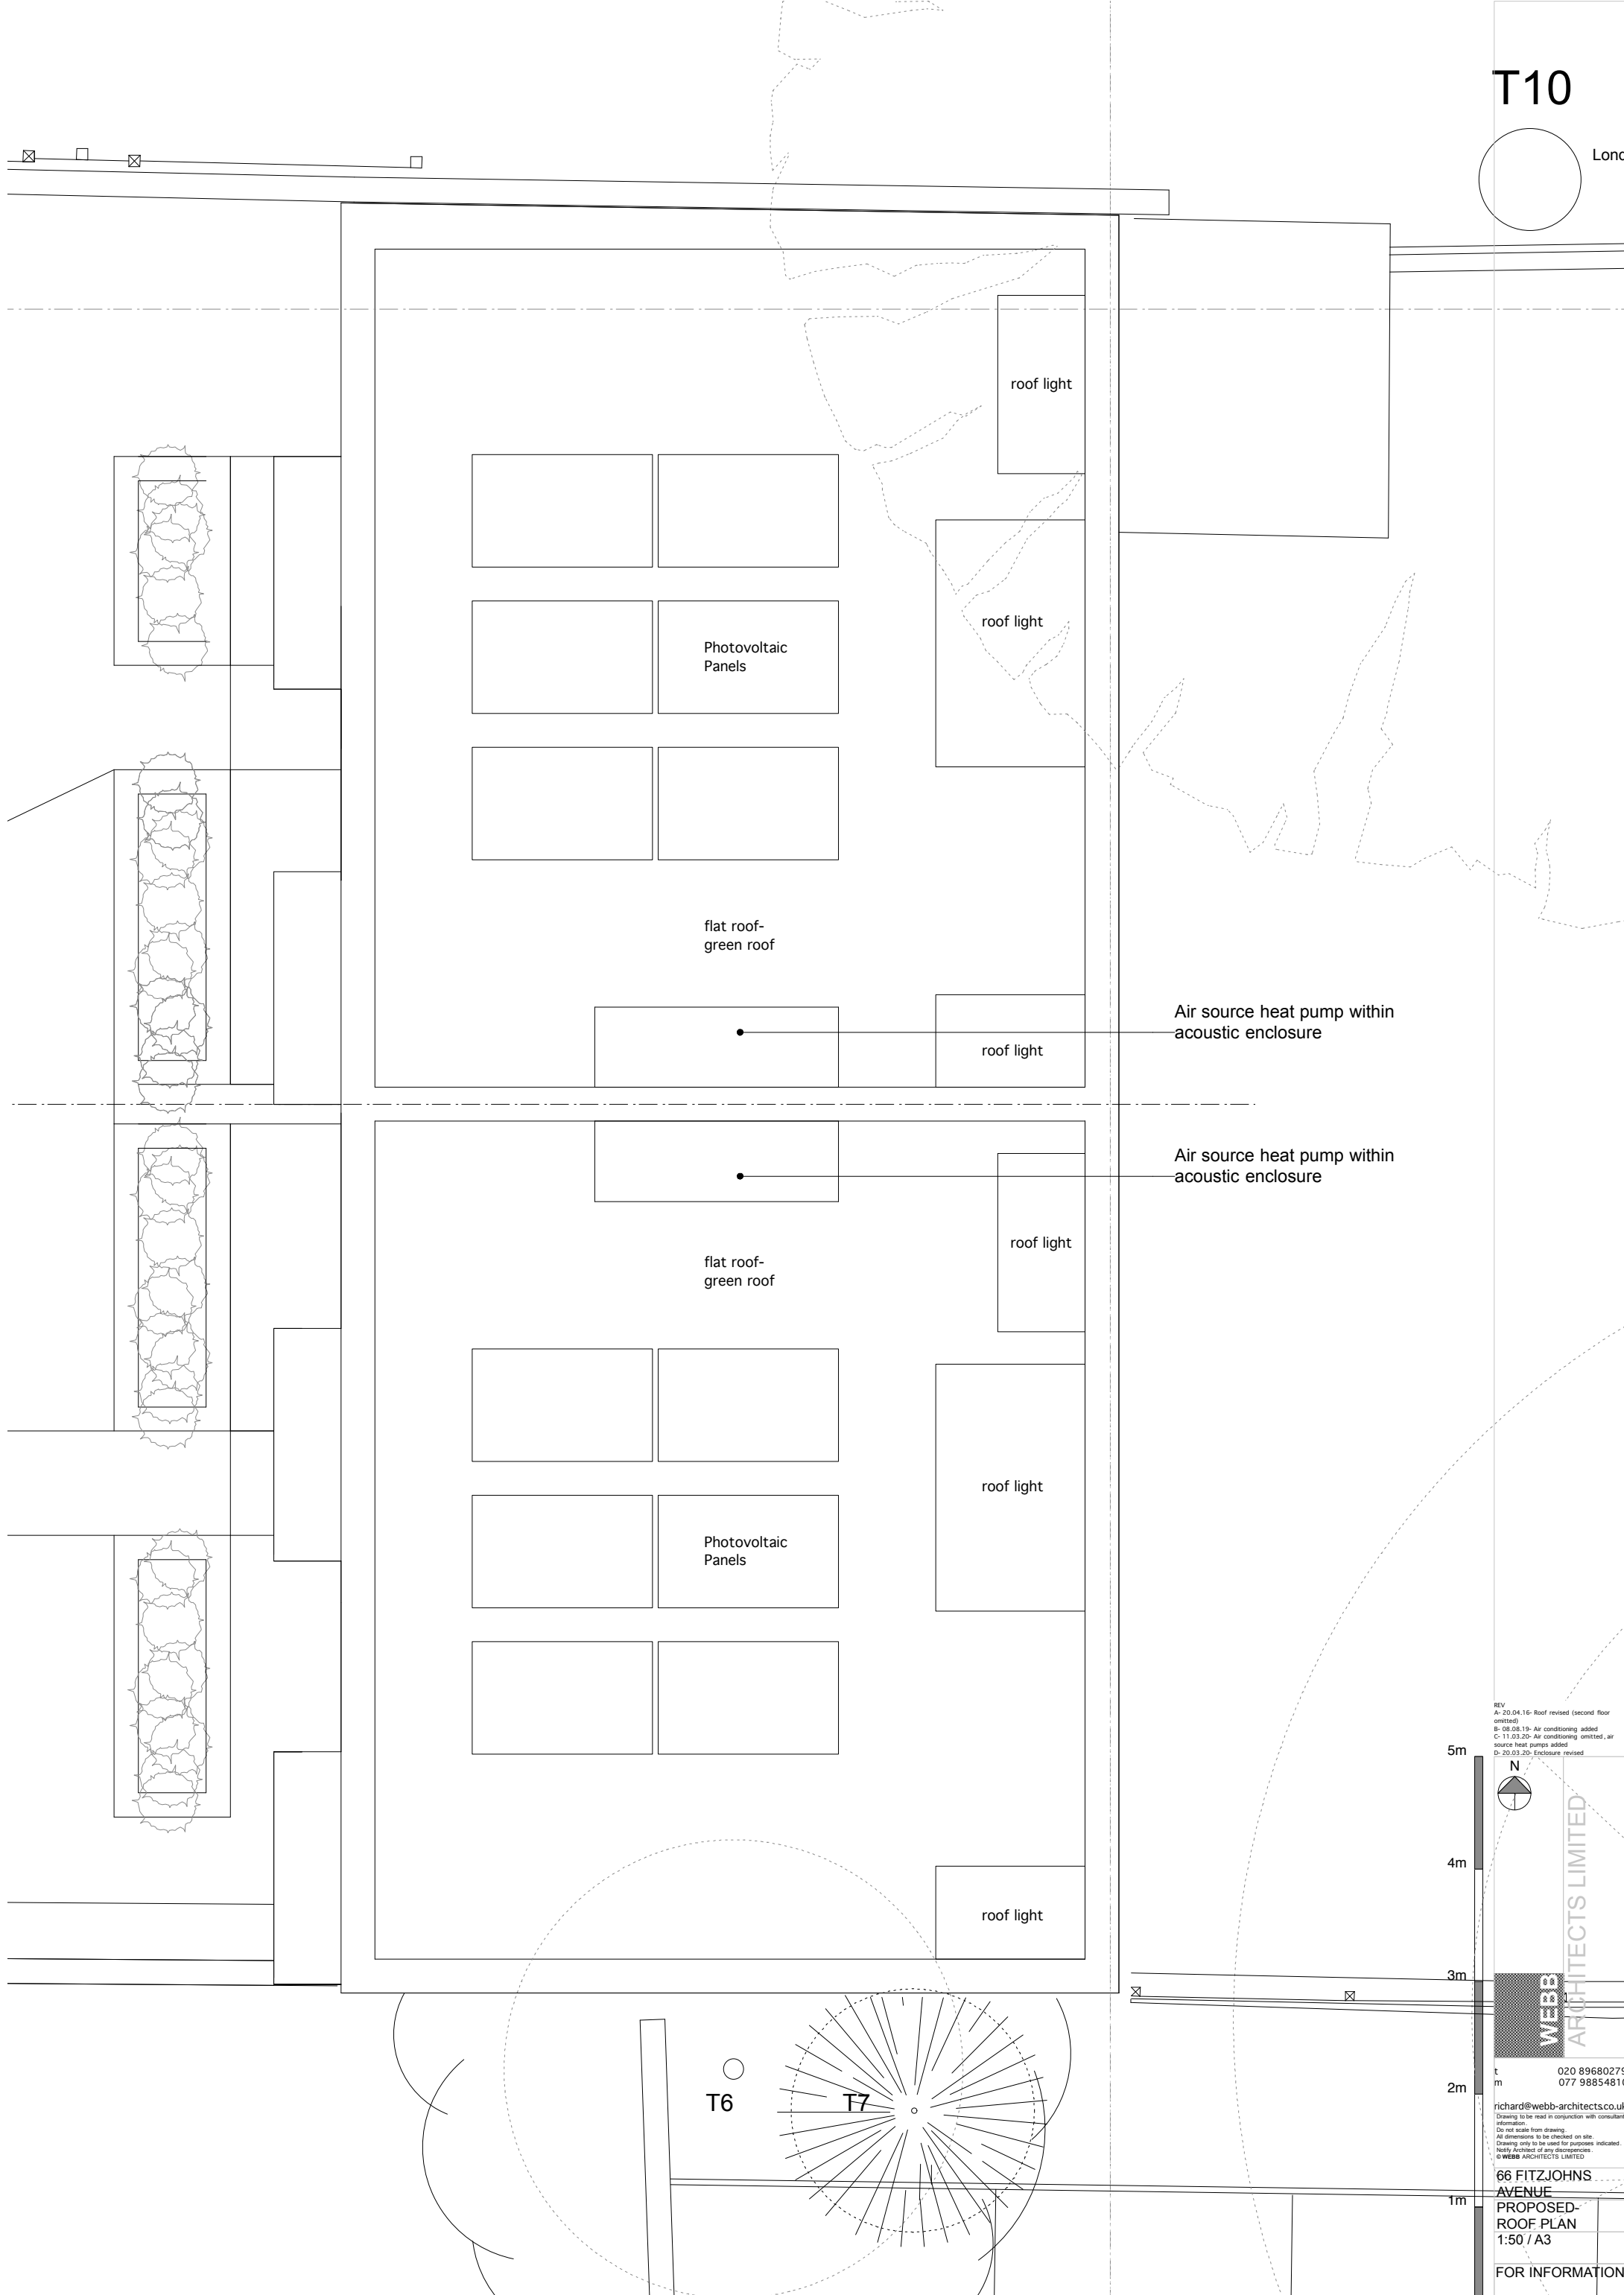


T10

London



Air source heat pump within acoustic enclosure

Air source heat pump within acoustic enclosure

REV  
A- 20.04.16- Roof revised (second floor omitted)  
B- 08.08.19- Air conditioning added  
C- 11.03.20- Air conditioning omitted, air source heat pumps added  
D- 20.03.20- Enclosure revised



5m  
4m  
3m  
2m  
1m  
0m

WEBB ARCHITECTS LIMITED

t 020 89680279  
m 077 98854810

richard@webb-architects.co.uk  
Drawing to be read in conjunction with consultants information.  
Do not scale from drawing.  
All dimensions to be checked on site.  
Drawing only to be used for purposes indicated.  
Not to be used for any other purposes.  
© WEBB ARCHITECTS LIMITED

66 FITZJOHNS AVENUE  
PROPOSED-ROOF PLAN  
1:50 / A3

FOR INFORMATION

1169.01.16(D)

T6

T7