



~THIRD FLOOR~ (HVAC)

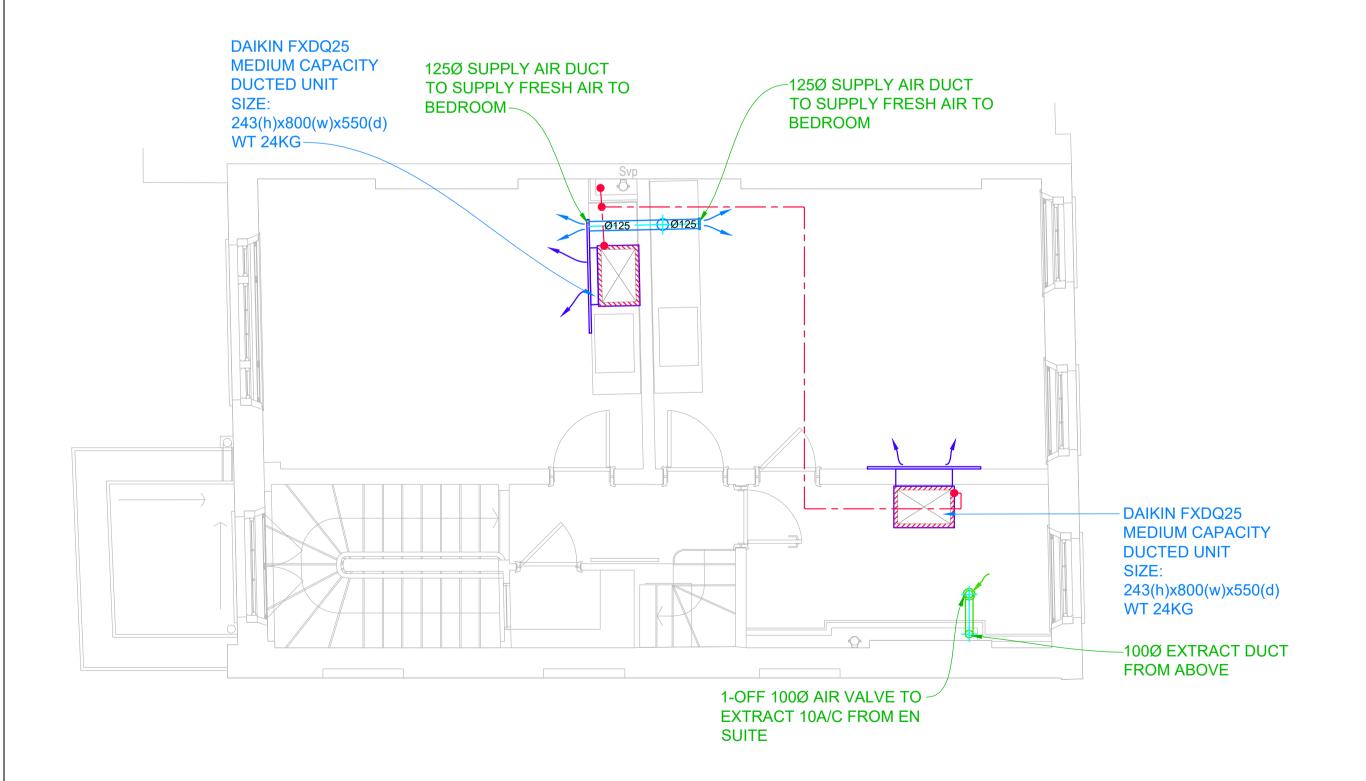

~SECOND FLOOR~ (HVAC)

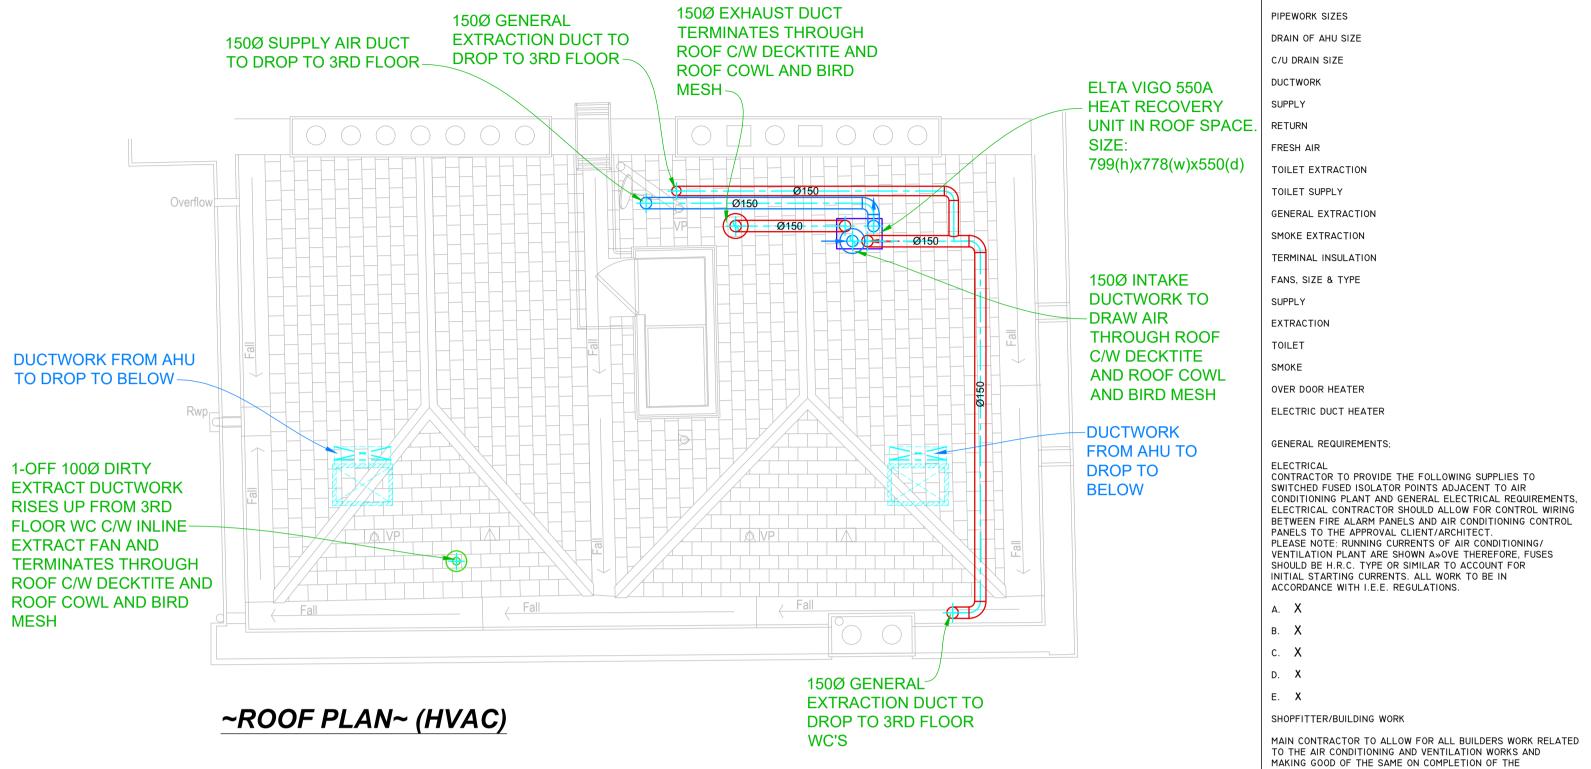

HORIZON AIR CONDITIONING PARTS AND GENERAL SPECIFICATION AIR CONDITIONING EQUIPMENT & TYPE AHU MODEL C/U MODEL UNIT HANGING METHOD REFRIGERATION PIPEWORK SIZES DRAIN OF AHU SIZE C/U DRAIN SIZE DUCTWORK SUPPLY FRESH AIR TOILET EXTRACTION TOILET SUPPLY GENERAL EXTRACTION SMOKE EXTRACTION TERMINAL INSULATION FANS, SIZE & TYPE SUPPLY EXTRACTION TOILET SMOKE OVER DOOR HEATER ELECTRIC DUCT HEATER GENERAL REQUIREMENTS; CONTRACTOR TO PROVIDE THE FOLLOWING SUPPLIES TO SWITCHED FUSED ISOLATOR POINTS ADJACENT TO AIR CONDITIONING PLANT AND GENERAL ELECTRICAL REQUIREMENTS, ELECTRICAL CONTRACTOR SHOULD ALLOW FOR CONTROL WIRING BETWEEN FIRE ALARM PANELS AND AIR CONDITIONING CONTROL PANELS TO THE APPROVAL CLIENT/ARCHITECT.
PLEASE NOTE: RUNNING CURRENTS OF AIR CONDITIONING/ VENTILATION PLANT ARE SHOWN A»OVE THEREFORE, FUSES SHOULD BE H.R.C. TYPE OR SIMILAR TO ACCOUNT FOR INITIAL STARTING CURRENTS. ALL WORK TO BE IN ACCORDANCE WITH I.E.E. REGULATIONS. SHOPFITTER/BUILDING WORK



INSTALLATION TO ALLOW FOR POSITIONING OF DUCTWORK. PIPEWORK, ELECTRICAL CABLE AND OTHER ASSOCIATED WORKS.

HORIZON AIR CONDITIONING LTD UNIT 8,EMBASSY INDUSTRIAL ESTATE ATTWOOD STREET,LYE STOURBRIDGE WEST MIDLANDS,DY9 8RY TEL: 01384 893139 WEB: WWW.HORIZONAC.CO.UK FAX: 01384 892854 E-MAIL: CONTACT@HORIZONAC.CO.UK

TAMARES MAIN CONTRACTOR

19 FITZROY SQUARE LONDON DRAWING TITLE HVAC - 2ND, 3RD AND ROOF

CHECKED BY JRM 1:50@AI 1:100@A3 31/05/2020

DRAWING No J 200000 - 04 ROOF REVISIONS

Α. Χ

B. **X**

c. X

THIS DRAWING IS THE PROPERTY OF HORIZON AIR CONDITIONING LTD. COPYRIGHT IS RESERVED BY THEM AND THE DRAWING IS ISSUED ON CONDITION THAT IT IS NOT COPIED, REPRODUCED, RETAINED OR DISCLOSED TO ANY UNAUTHORISED PERSON. EITHER WHOLLY OR IN PART WITHOUT THE CONSENT IN WRITING OF HORIZON AIR CONDITIONING LTD.