

Notes


1. Drawing to be read in conjunction with all relevant consultants drawings and specifications.
2. Any dimensions detailed in this drawing are to be in millimeters.
3. Do not scale from this drawing.
4. This drawing is protected by copyright

Legend


-  Distribution Board
-  UKPN Service head and meter
-  Switched twin socket outlet
-  Switched fused connection unit
-  IP65 Isolator
-  Shaver socket outlet
-  Commando type socket outlet
-  DDA Toilet alarm power supply
-  DDA Toilet alarm pull cord
-  DDA Toilet alarm reset button
-  DDA Toilet alarm flash beacon sounder

CABLE RISER TO FLOOR ABOVE - TO BE REVIEWED

CABLE RISER - BASEMENT TO 4TH FLOOR
 - 300mm TRAY - POWER
 - 225mm BASKET - DATA/AV
 - 75mm BASKET - FIRE

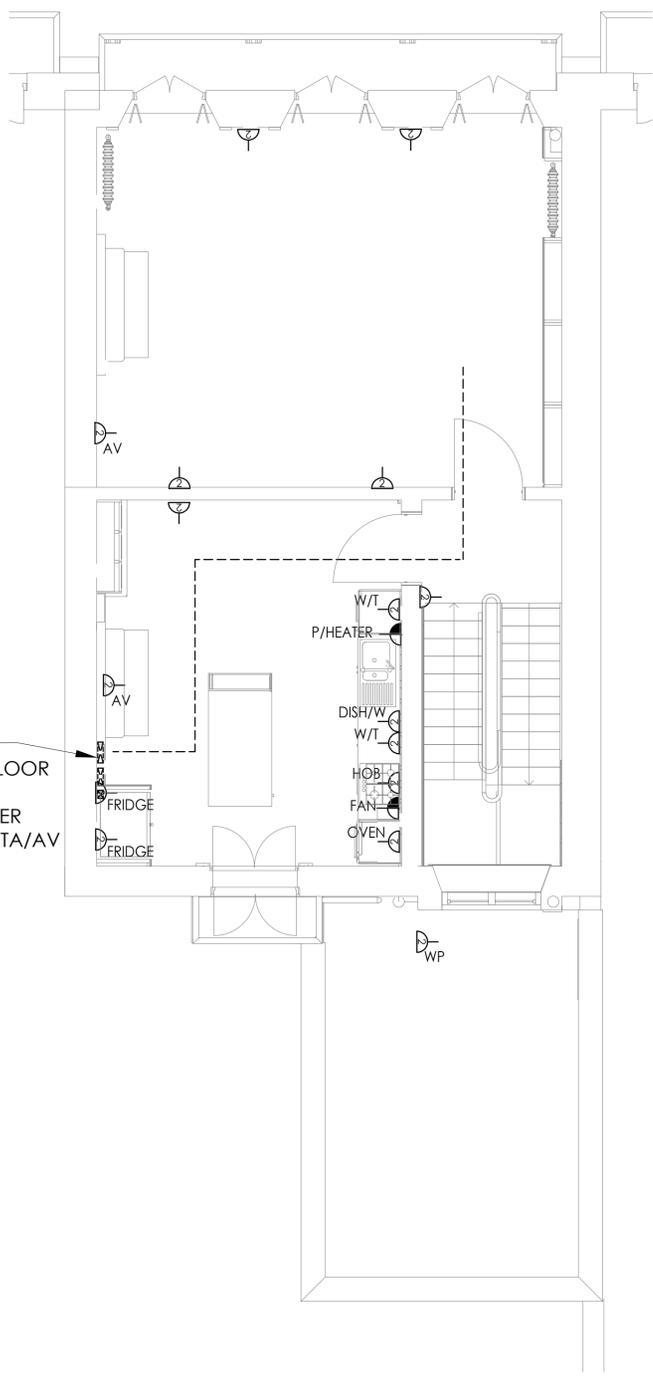

CABLE RISER - BASEMENT TO 4TH FLOOR
 - 300mm TRAY - POWER
 - 225mm BASKET - DATA/AV
 - 75mm BASKET - FIRE

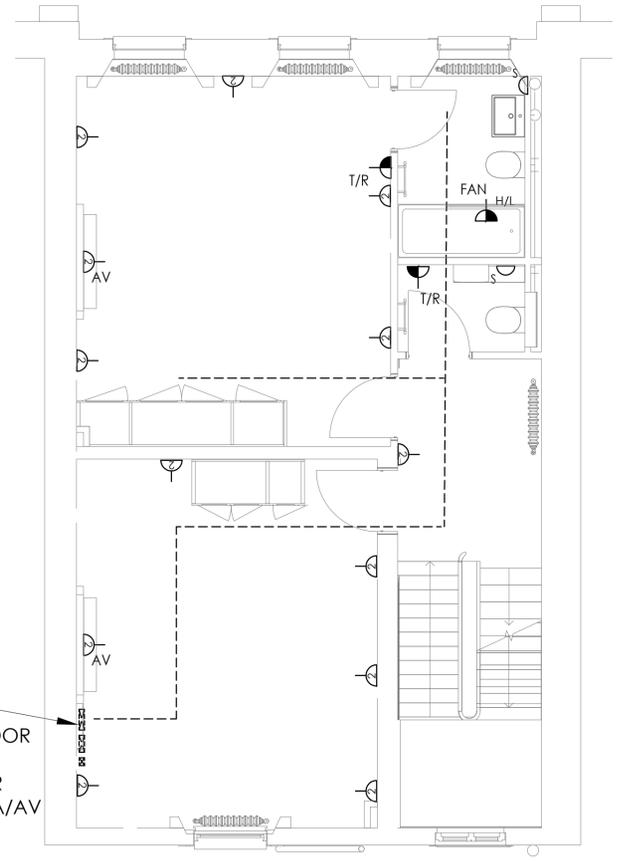

Rev	Date	Description	Drwn	Chkd
C	27-08-20	PLANNING ISSUE	LB	LB
B	25-08-20	PLANNING ISSUE	LB	LB
T1	21-08-20	TENDER ISSUE	LB	LB
A	24-07-20	ISSUED FOR INFORMATION	LB	LB

The Anslow Partnership
 Consulting Engineers

tap CONSULTING ENGINEERS

1st Floor
 John Stow House
 18 Bevis Marks
 London, EC3A 7JB
 Telephone: (020) 7553 2050
 email: initialsurname@anslowconsulting.co.uk

Project 14 ENDSLEIGH STREET

Client

Architect

Title			
ELECTRICAL SERVICES FIRST AND SECOND FLOOR PROPOSED POWER LAYOUT			
Drawn	Checked	Verified	
JT	LB	DA	
Issue	Date	Scale	
PLANNING	JULY 2020	1:50	
Drawing Number			Revision
220039/E/2201			C

