



mes
buildingsolutions
Part of the **FOCUS** consultancy group



Daylight & Sunlight Report 9 Briary Close, Camden NW3 3JZ

11th November 2020

Newark (Head) Office:

Newark Beacon, Beacon Hill Office Park,
Cafferata Way, Newark, Notts, NG24 2TN.
Tel: 01636 653 055

London Office:

344-354 Gray's Inn Road, King's Cross,
London WC1X 8BP.
Tel: 0207 033 3757

Birmingham Office:

2nd Floor Quayside Tower, 252-260 Broad St,
Birmingham B1 2HF.
Tel: 0121 285 2785

info@mesbuildingsolutions.co.uk | www.mesbuildingsolutions.co.uk

DAYLIGHT & SUNLIGHT REPORT

Client: Boyer Planning Limited

Project: 9 Briary Close, Camden NW3 3JZ

Report date: 11th November 2020

Authors: Chris Jones BEng (Hons) MSc ACIOB
Andrew Pickersgill BSc (Hons), AssocRICS



mes
buildingsolutions
Part of the **FOCUS** consultancy group

About *MES Building Solutions*

***MES Building Solutions (MES)* is an established consultancy practice specialising in providing building solutions throughout the UK.**

We offer a full range of services for both residential and commercial buildings from small individual properties through to highly complex mixed use developments.

We are an industry leader in delivering a professional, accredited and certified service to a wide range of clients including architects, developers, builders, housing associations, the public sector and private householders.

Employing highly qualified staff, our team comes from a variety of backgrounds within the construction industry with combined knowledge of building design, engineering, assessment, construction, development, research and surveying.

MES Building Solutions maintains its position at the forefront of changes in building regulations as well as technological advances. Our clients, large or small are therefore assured of a cost effective, cohesive and fully integrated professional service.

About the Authors

Chris Jones is the Technical Director at *MES Building Solutions*. Chris has a Masters Degree in Energy Efficient & Sustainable Building, as well as an Honours degree in Mechanical Engineering. Chris has over 15 years' experience in providing sustainable building solutions and leads the Neighbourly Matters team at MES. He undertakes daylighting, sunlight and shadow cast analysis for planning applications. Chris is also a qualified BREEAM and Code for Sustainable Homes assessor and has worked with some of the UK's top developers, as well as housing associations and local authorities.

Andrew Pickersgill is an Associate member of the Royal Institution of Chartered Surveyors and is a member of our neighbourly matters team. He has a BSc (Hons) degree in Building Surveying. Andrew undertakes daylighting, sunlight and shadow analysis for planning applications. He is also involved in party wall issues and carries out other building surveying services for our clients.

Contents

1. Executive Summary
2. Introduction
3. Description of Development
4. Assessment Process
5. Daylight
6. Sunlight
7. *Appendices*

Vertical Sky Component Results
Available Sunlight Hours Results
Daylight Distribution Results

Window and Room References

8. *Notes*



1. Executive Summary

- 1.1 We have carried out calculations following guidance in Site Layout Planning for Daylight & Sunlight (SLPDS), PJ Littlefair 2011 to ascertain the impact of the proposed rooftop extension of 9 Briary Close, Camden NW3 3JZ, on the daylight and sunlight of the neighbouring properties.
- 1.2 We have assessed 70 windows, serving 54 habitable rooms, within 16 neighbouring residential properties. In this case all of the neighbouring windows and rooms comfortably fulfil all the planning guidance.
- 1.3 In our opinion the proposals accord fully with the intent and context of the planning guidance in this case.




2. Introduction

- 2.1 The purpose of this report is to assess the impact of the proposed rooftop extension of 9 Briary Close, Camden NW3 3JZ, on the daylight and sunlight of the neighbouring properties.
- 2.2 This report considers the daylight and sunlight issues against the criteria set out for national guidance in the following publications:
- Site Layout Planning for Daylight & Sunlight (SLPDS), PJ Littlefair 2011 published by the BRE (Building Research Establishment).
- The SLPDS is the culmination of research undertaken by the BRE to determine whether or not a new development will adversely affect the light to nearby properties. The BRE tests are approved by the Department of the Environment and are widely used by local authorities when deciding on development applications.
- BS 8206-2- Code of practice for skylighting.
- 2.3 There are no minimum mandatory requirements for sunlight & skylight in Building Regulations for England & Wales but the guidance set out in SLPDS is widely accepted as the approved methodology when calculating sunlight & skylight.
- 2.4 It is worthy of note that SLPDS was first published in 1991 and BS 8206-2 in 1992. However SLPDS was updated in Oct 2011 and we have therefore undertaken this study on the basis of this guidance document.

3. Description of Development

- 3.1 The scheme comprises of a rooftop extension to the existing residential property to provide an additional floor of accomodation.
- 3.2 The property is located on the south side of Briary Close and is situated within a block of other similarly sized houses adjoining the road.

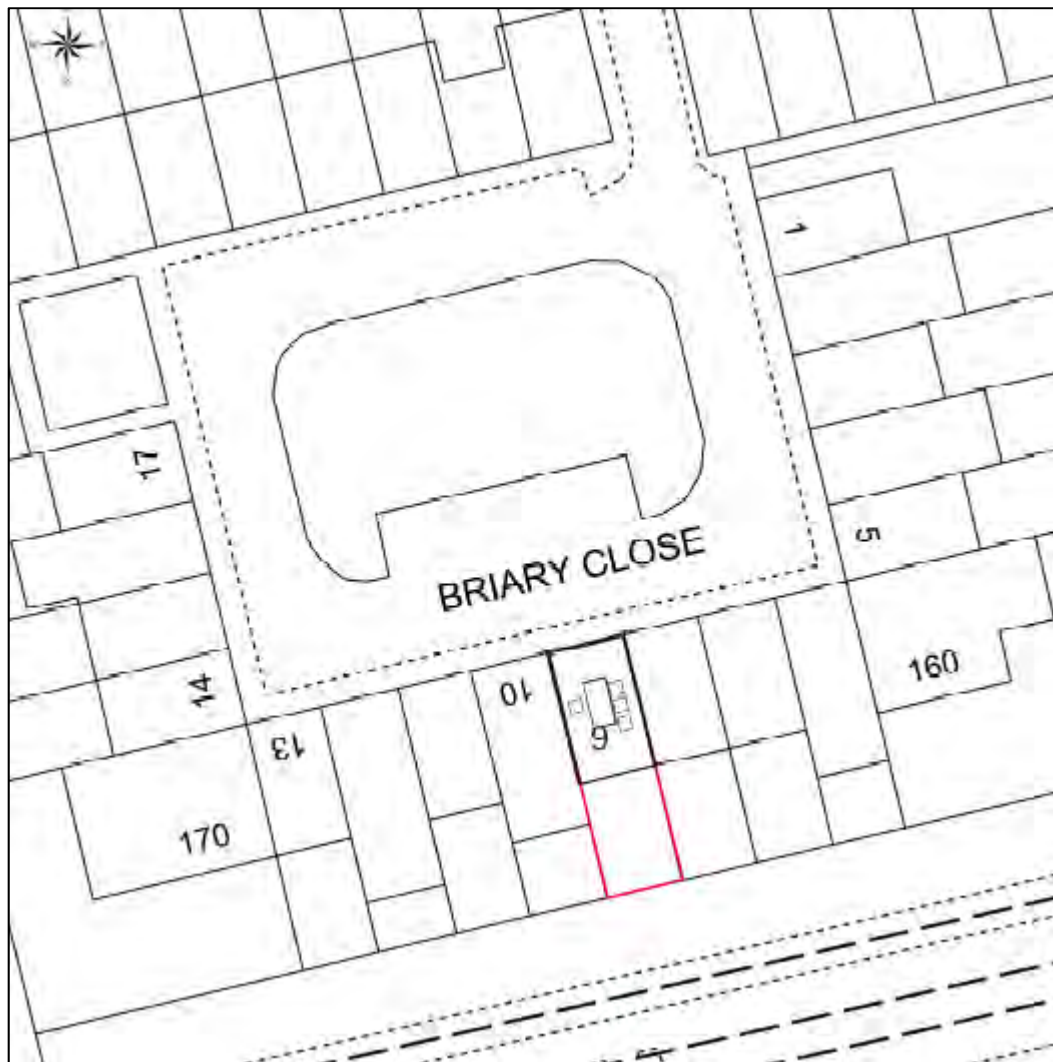

Site Plan



4. Assessment Process

The effect on neighbouring properties:

4.1 The SLPDS describes three parameters to be assessed in order to measure the impact of the proposed new building on Daylight/Sunlight availability to the key adjacent properties. The three parameters to be assessed are as follows:

1) Daylight:

Vertical Sky Component (VSC)
Daylight Distribution (DD)

2) Sunlight:

Annual Probable Sunlight Hours (APSH)

3) Overshadowing (Amenity Space)

On relevant open spaces

4.2 The guidance states that rooms to be assessed should be living rooms, kitchens and bedrooms in residential properties. In non-domestic buildings rooms where occupants 'have a reasonable expectation of daylight' should be assessed. Although these spaces are not defined, examples are given of the type of non-domestic buildings that would normally fall into this category. These include schools, hospitals, hotels and hostels, small workshops and *some* offices.

4.3 As it is difficult to be sure of the specific use of neighbouring spaces we have taken a view on the relevance of the spaces adjacent to the proposed development. If we have been in any doubt we have carried out the assessment. However it should be noted some of the spaces we have assessed could fall outside the test requirement criteria.

4.4 It is important to note that the numerical values in the guidance are advisory and different criteria may be used based on the requirements for daylighting in an area viewed against other site layout constraints.

4.5 The neighbouring properties we have assessed are as follows:

- 1 Briary Close
- 2 Briary Close
- 3 Briary Close
- 4 Briary Close
- 5 Briary Close
- 6 Briary Close
- 7 Briary Close
- 8 Briary Close
- 10 Briary Close
- 11 Briary Close
- 12 Briary Close
- 13 Briary Close
- 14 Briary Close
- 15 Briary Close
- 16 Briary Close
- 17 Briary Close


4.6 The assessment is based on the following drawings, provided by ZED Architect:

- 9 Briary close Block plan rev01
- 9 Briary Close Existing Elevations 101rev01
- 9 Briary Close Existing Roof Layout and Section 100
- 9 Briary Close Proposed Front and Rear Elevations 111rev02
- 9 Briary Close Proposed roof scale 1to500
- 9 Briary Close Proposed Side Elevations 112rev02
- 9 Briary Close Proposed Third floor and Roof Layout and Section 110 rev04



5. Daylight

5.1 Site Layout Planning for Daylight & Sunlight contains the following flow chart showing the steps which should be taken in order to establish whether a building will receive adequate daylight:

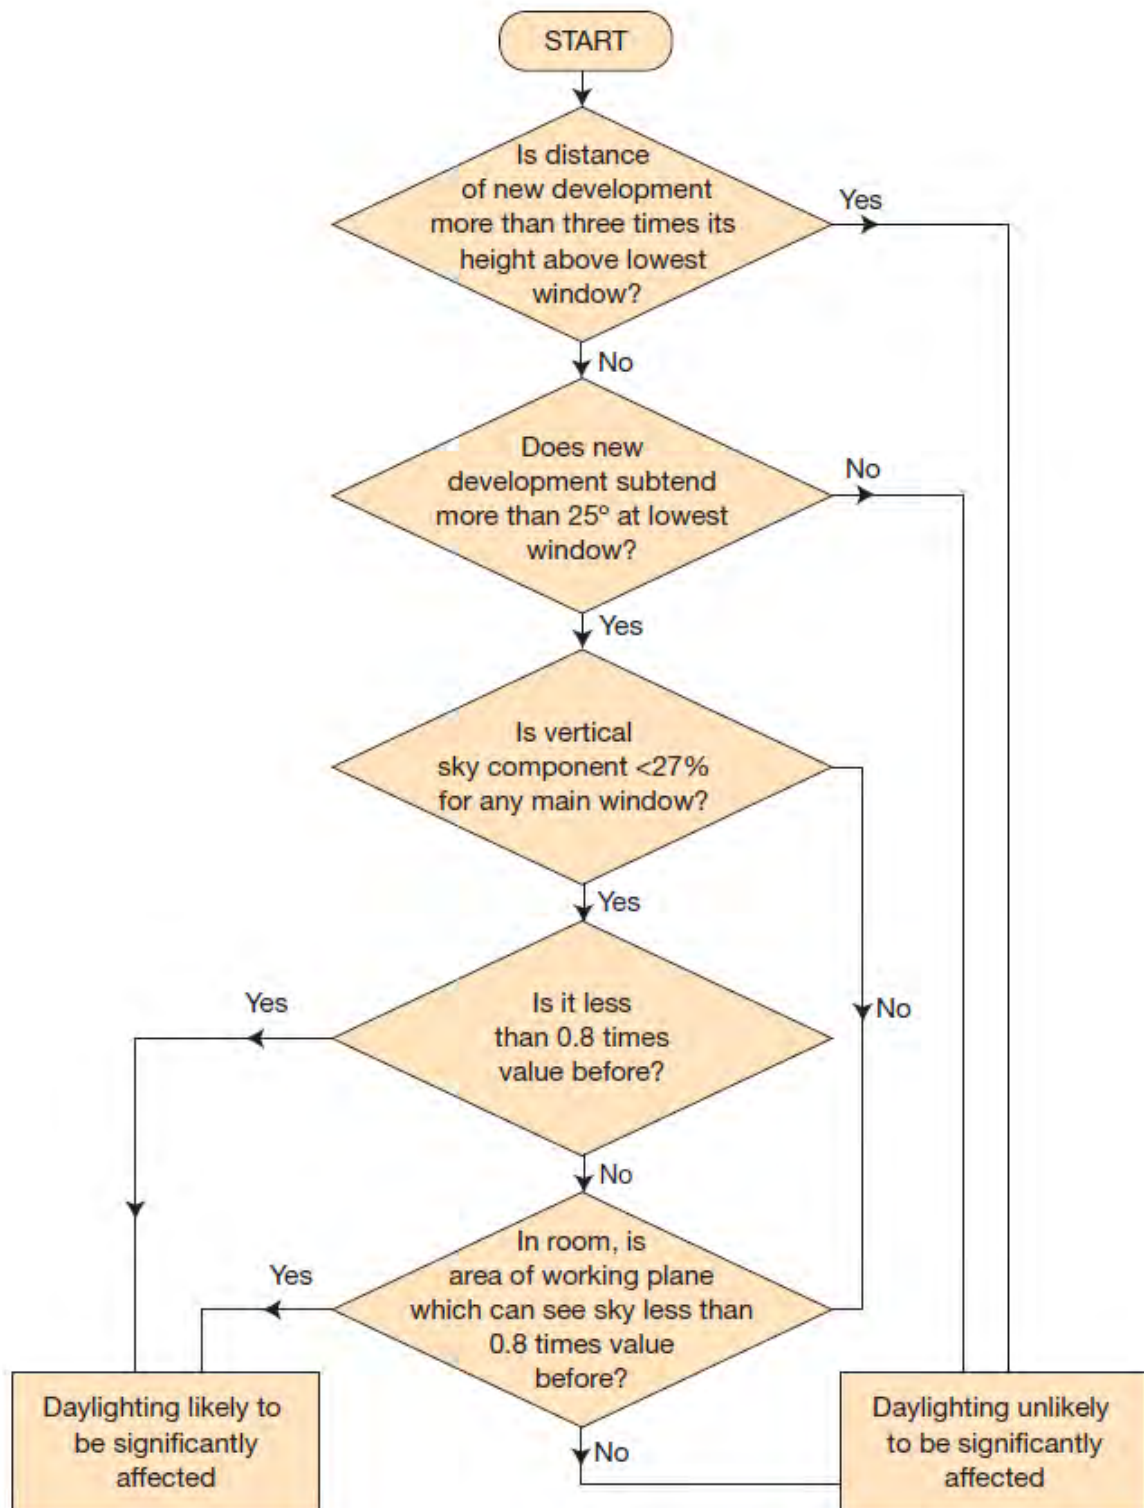

Distance Check:


- 5.2 Site Layout Planning for Daylight & Sunlight (2011) states: "Loss of light to existing windows need not be analysed if the distance of each part of the new development from the existing window is three or more times its height above the centre of the existing window."

Distance Check Results

- 5.3 On this occasion the ratio of the height of the proposed building to its distance from the centre of the lowest existing window is likely to be less than 1:3 and the 25° rule must be applied.

25° Rule:

- 5.4 The angle to the horizontal subtended by the new development at the level of the centre of the lowest affected window should be no greater than 25°. If this is the case then it is unlikely to have a noticeable effect on diffuse skylight enjoyed by the existing building.

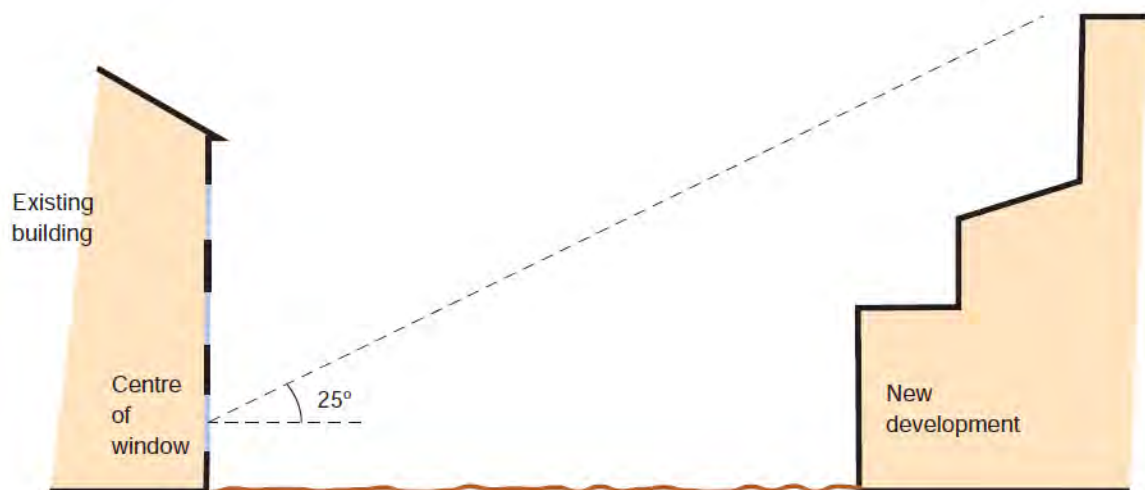

- 5.5 If, for any part of the development, the angle is more than 25°, a more detailed check is needed to find the loss of skylight to the existing building:

25° Rule Results

- 5.6 On this occasion the angle to the horizontal subtended by the new development at the level of the centre of the lowest affected window is likely to be greater than 25° and more detailed checks are necessary:

Vertical Sky Component:

- 5.7 Daylight is the light received from the sun which is diffused through the sky's clouds. Even on a cloudy day when the sun is not visible a room will continue to be lit with light from the sky. This is also known as 'diffuse light'. Any reduction in the total amount of daylight can be calculated by finding the 'Vertical Sky Component'.
- 5.8 The Vertical Sky Component (VSC) is the ratio of the direct skylight illuminance falling on a vertical face at a reference point (usually the centre of a window), to the simultaneous horizontal illuminance under an unobstructed sky.
- 5.9 The guidance states that the VSC will be adversely affected if after a development it is both less than 27% of the overall available diffuse light and less than 0.8 times its former value.
- 5.10 Therefore if the VSC is more than 27% then enough light would still be reaching the window of the neighbouring building. However if the VSC is less than 27% as well as less than 0.8 times its former value the occupants will notice the reduction in the amount of skylight.

VSC Results


- 5.11 Calculations were undertaken in accordance with the planning guidance contained in BRE document 209 'Site Layout Planning for Daylight & Sunlight' - PJ Littlefair 2011.

Detailed results are in Section 7.

- 5.12 As can be seen the proposed development has very little impact on neighbouring properties with all of the 70 windows serving habitable rooms in the 16 neighbouring properties assessed comfortably meeting the BRE guidance for vertical sky component.

Daylight Distribution:

- 5.13 Where room layouts are known (or estimated) the impact on daylighting distribution can be found by plotting what is known as the 'no sky line' in each of the main rooms. These are the same rooms as used for the VSC test.
- 5.14 The no sky line effectively divides the points on the working plane (0.85m high for residential properties and 0.7m high for offices) that cannot see the sky. Therefore areas beyond the no sky line will receive no direct daylight but will instead be lit from reflected light.

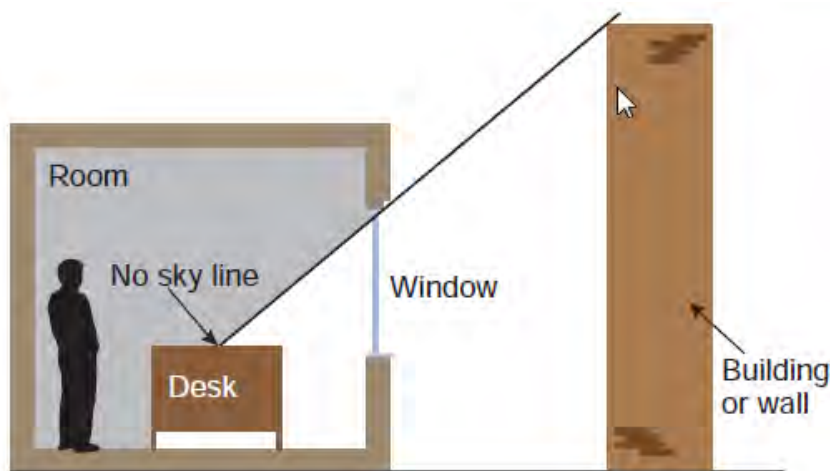

BRE 209

- 5.15 If, following the construction of a new development, the no sky line moves so that the area of the existing room, which does not receive direct skylight, is reduced to less than 0.8 times its former value, this will be noticeable to the occupants.
- 5.16 We have estimated internal layouts to assess the Daylight Distribution in rooms adjacent to the development.

Daylight Distribution Results

- 5.17 Calculations were undertaken in accordance with the planning guidance contained in BRE document 209 'Site Layout Planning for Daylight & Sunlight' - PJ Littlefair 2011.

Detailed results are in Section 7.

- 5.18 As can be seen the proposed development has very little impact on neighbouring properties with all of the 54 habitable rooms in the 16 neighbouring properties assessed comfortably meeting the BRE guidance for daylight distribution.

6. Sunlight

Available Sunlight Hours

- 6.1 Guidance for minimum sunlight values can be found in Section 3 of Site Layout Planning for Daylight and Sunlight (SLPDS).
- 6.2 Habitable rooms in domestic buildings that face within 90° of due south are tested, as are rooms in non-domestic buildings that have a particular requirement for sunlight.
- 6.3 The recommendations are that applicable windows should receive a minimum of 25% of the total annual probable sunshine hours, to include a minimum of 5% of that which is available during the winter months between 21st September to the 21st March (the approximate dates of the spring and autumn equinoxes).
- 6.4 However if this is not possible (or the amount of sunlight is already reduced because of the effect of existing obstructions) then a further reduction in sunlight availability will be noticeable to an occupier if the total number of sunlight hours is below the target 25% of the total annual probable sunshine hours, to include a minimum of 5% of that which is available during the winter months, *and* is less than 0.8 times its former value prior to the development.
- 6.5 There is no requirement for windows that face within 90° of due north so windows that fall into this category have not been considered for sunlight calculations.

Available Sunlight Hours Results

- 6.6 Calculations were undertaken in accordance with the planning guidance contained in BRE document 209 'Site Layout Planning for Daylight & Sunlight' - PJ Littlefair 2011.

Detailed results are in Section 7.

- 6.7 As can be seen the proposed development has very little impact on neighbouring properties with all of the 70 windows serving habitable rooms in the 16 neighbouring properties assessed comfortably meeting the BRE guidance for annual probable sunlight hours.

7. Appendices

Results:

*Vertical Sky Component
Available Sunlight Hours*

Daylight Distribution



Project Name: 201020 9 Briary Close
 Report Title: Daylight & Sunlight - Neighbour Analysis
 Date of Analysis: 10/11/2020

Floor Ref.	Room Ref.	Room Use.	Window Ref.		VSC	Pr/Ex	Meets BRE Guidance	Annual	Pr/Ex	Meets BRE Guidance	Winter	Pr/Ex	Meets BRE Guidance
1 Briary Close													
Gnd	R1	Living Room	W1	Existing Proposed	28.46 28.25	0.99	YES	42.00 40.00	0.95	YES	14.00 12.00	0.86	YES
1st	R1	Living Room	W1	Existing Proposed	30.28 30.12	0.99	YES	47.00 47.00	1.00	YES	18.00 18.00	1.00	YES
			W2	Existing Proposed	31.06 30.87	0.99	YES	42.00 42.00	1.00	YES	15.00 15.00	1.00	YES
2nd	R1	Bedroom	W1	Existing Proposed	32.41 32.27	1.00	YES	49.00 49.00	1.00	YES	18.00 18.00	1.00	YES
	R2	Bedroom	W2	Existing Proposed	32.85 32.67	0.99	YES	44.00 44.00	1.00	YES	16.00 16.00	1.00	YES
2 Briary Close													
Gnd	R1	Living Room	W1	Existing Proposed	28.68 28.43	0.99	YES	40.00 39.00	0.98	YES	12.00 11.00	0.92	YES
1st	R1	Living Room	W1	Existing Proposed	31.00 30.74	0.99	YES	46.00 46.00	1.00	YES	17.00 17.00	1.00	YES
			W2	Existing Proposed	31.08 30.76	0.99	YES	42.00 41.00	0.98	YES	14.00 13.00	0.93	YES
2nd	R1	Bedroom	W1	Existing Proposed	33.09 32.85	0.99	YES	49.00 49.00	1.00	YES	18.00 18.00	1.00	YES
	R2	Bedroom	W2	Existing Proposed	33.20 32.92	0.99	YES	45.00 45.00	1.00	YES	16.00 16.00	1.00	YES
3 Briary Close													
Gnd	R1	Living Room	W1	Existing Proposed	28.79 28.37	0.99	YES	39.00 38.00	0.97	YES	9.00 8.00	0.89	YES
1st	R1	Living Room	W1	Existing Proposed	30.96 30.55	0.99	YES	46.00 46.00	1.00	YES	16.00 16.00	1.00	YES
			W2	Existing Proposed	30.95 30.48	0.99	YES	40.00 39.00	0.98	YES	11.00 10.00	0.91	YES
2nd	R1	Bedroom	W1	Existing Proposed	33.21 32.83	0.99	YES	49.00 48.00	0.98	YES	18.00 17.00	0.94	YES
	R2	Bedroom	W2	Existing Proposed	33.36 32.90	0.99	YES	45.00 44.00	0.98	YES	16.00 15.00	0.94	YES

Project Name: 201020 9 Briary Close
 Report Title: Daylight & Sunlight - Neighbour Analysis
 Date of Analysis: 10/11/2020

Floor Ref.	Room Ref.	Room Use.	Window Ref.		VSC	Pr/Ex	Meets BRE Guidance	Annual	Pr/Ex	Meets BRE Guidance	Winter	Pr/Ex	Meets BRE Guidance
4 Briary Close													
1st	R1	Living Room	W1	Existing	30.02	0.98	YES	42.00	0.95	YES	12.00	0.83	YES
				Proposed	29.50			40.00			10.00		
			W2	Existing	29.17	0.98	YES	35.00	0.97	YES	7.00	0.86	YES
				Proposed	28.66			34.00			6.00		
2nd	R1	Bedroom	W1	Existing	33.05	0.98	YES	49.00	0.96	YES	18.00	0.89	YES
				Proposed	32.45			47.00			16.00		
	R2	Bedroom	W2	Existing	32.86	0.98	YES	43.00	0.98	YES	15.00	0.93	YES
				Proposed	32.18			42.00			14.00		
5 Briary Close													
1st	R1	Living Room	W1	Existing	25.54	0.99	YES	28.00	1.00	YES	1.00	1.00	YES
				Proposed	25.19			28.00			1.00		
			W2	Existing	20.83	0.99	YES	11.00	0.91	YES	0.00	1.00	YES
				Proposed	20.66			10.00			0.00		
2nd	R1	Bedroom	W1	Existing	31.54	0.98	YES	43.00	1.00	YES	12.00	1.00	YES
				Proposed	30.88			43.00			12.00		
	R2	Bedroom	W2	Existing	27.56	0.99	YES	31.00	0.94	YES	3.00	0.33	YES
				Proposed	27.25			29.00			1.00		
6 Briary Close													
1st	R1	Living Room	W1	Existing	22.28	1.00	YES	*North*		*North*			
				Proposed	22.28								
			W2	Existing	27.02	1.00	YES	*North*		*North*			
				Proposed	27.02								
2nd	R1	Bedroom	W1	Existing	28.78	1.00	YES	*North*		*North*			
				Proposed	28.78								
	R2	Bedroom	W2	Existing	32.87	1.00	YES	*North*		*North*			
				Proposed	32.87								

Project Name: 201020 9 Briary Close
 Report Title: Daylight & Sunlight - Neighbour Analysis
 Date of Analysis: 10/11/2020

Floor Ref.	Room Ref.	Room Use.	Window Ref.	VSC	Pr/Ex	Meets BRE Guidance	Annual	Pr/Ex	Meets BRE Guidance	Winter	Pr/Ex	Meets BRE Guidance
7 Briary Close												
1st	R1	Living Room	W1	Existing	30.62	1.00	YES					
				Proposed	30.62							
			W2	Existing	31.29	1.00	YES					
				Proposed	31.29							
2nd	R1	Bedroom	W1	Existing	34.26	1.00	YES					
				Proposed	34.26							
	R2	Bedroom	W2	Existing	34.21	1.00	YES					
				Proposed	34.21							
8 Briary Close												
Gnd	R1	Utility Room	W1	Existing	29.62	1.00	YES					
				Proposed	29.62							
1st	R1	Living Room	W1	Existing	32.19	1.00	YES					
				Proposed	32.19							
			W2	Existing	32.28	1.00	YES					
				Proposed	32.28							
2nd	R1	Bedroom	W1	Existing	34.51	1.00	YES					
				Proposed	34.49							
	R2	Bedroom	W2	Existing	34.40	1.00	YES					
				Proposed	34.40							
10 Briary Close												
Gnd	R1	Bedroom	W1	Existing	29.30	1.00	YES					
				Proposed	29.30							
1st	R1	Living Room	W1	Existing	31.75	1.00	YES					
				Proposed	31.75							
			W2	Existing	31.54	1.00	YES					
				Proposed	31.54							
2nd	R1	Bedroom	W1	Existing	33.51	1.00	YES					
				Proposed	33.51							
	R2	Bedroom	W2	Existing	33.30	1.00	YES					
				Proposed	33.27							

Project Name: 201020 9 Briary Close
 Report Title: Daylight & Sunlight - Neighbour Analysis
 Date of Analysis: 10/11/2020

Floor Ref.	Room Ref.	Room Use.	Window Ref.	VSC	Pr/Ex	Meets BRE Guidance	Annual	Pr/Ex	Meets BRE Guidance	Winter	Pr/Ex	Meets BRE Guidance
11 Briary Close												
1st	R1	Living Room	W1	Existing	31.39	1.00	YES					
				Proposed	31.39							
			W2	Existing	30.94	1.00	YES					
				Proposed	30.94							
2nd	R1	Bedroom	W1	Existing	32.94	1.00	YES					
				Proposed	32.94							
	R2	Bedroom	W2	Existing	32.56	1.00	YES					
				Proposed	32.56							
12 Briary Close												
Gnd	R1	Kitchen	W1	Existing	26.08	1.00	YES					
				Proposed	26.08							
1st	R1	Living Room	W1	Existing	29.60	1.00	YES					
				Proposed	29.60							
			W2	Existing	29.36	1.00	YES					
				Proposed	29.36							
2nd	R1	Bedroom	W1	Existing	31.82	1.00	YES					
				Proposed	31.82							
	R2	Bedroom	W2	Existing	31.43	1.00	YES					
				Proposed	31.43							
13 Briary Close												
1st	R1	Living Room	W1	Existing	26.80	1.00	YES					
				Proposed	26.80							
			W2	Existing	23.57	1.00	YES					
				Proposed	23.57							
2nd	R1	Bedroom	W1	Existing	30.22	1.00	YES					
				Proposed	30.22							
	R2	Bedroom	W2	Existing	28.10	1.00	YES					
				Proposed	28.10							

Project Name: 201020 9 Briary Close
 Report Title: Daylight & Sunlight - Neighbour Analysis
 Date of Analysis: 10/11/2020

Floor Ref.	Room Ref.	Room Use.	Window Ref.	VSC	Pr/Ex	Meets BRE Guidance	Annual	Pr/Ex	Meets BRE Guidance	Winter	Pr/Ex	Meets BRE Guidance
14 Briary Close												
1st	R1	Living Room	W1	Existing	24.29	1.00	YES					
				Proposed	24.20							
			W2	Existing	29.20	0.99	YES					
				Proposed	29.00							
2nd	R1	Bedroom	W1	Existing	32.50	0.99	YES					
				Proposed	32.26							
	R2	Bedroom	W2	Existing	34.63	0.99	YES					
				Proposed	34.23							
15 Briary Close												
1st	R1	Living Room	W1	Existing	32.28	0.99	YES					
				Proposed	31.96							
			W2	Existing	33.22	0.99	YES					
				Proposed	32.87							
2nd	R1	Bedroom	W1	Existing	36.04	0.99	YES					
				Proposed	35.60							
	R2	Bedroom	W2	Existing	36.37	0.99	YES					
				Proposed	35.96							
16 Briary Close												
1st	R1	Living Room	W1	Existing	34.10	0.99	YES					
				Proposed	33.75							
			W2	Existing	34.35	0.99	YES					
				Proposed	34.03							
2nd	R1	Bedroom	W1	Existing	36.56	0.99	YES					
				Proposed	36.21							
	R2	Bedroom	W2	Existing	36.70	0.99	YES					
				Proposed	36.39							

Project Name: 201020 9 Briary Close
 Report Title: Daylight & Sunlight - Neighbour Analysis
 Date of Analysis: 10/11/2020

Floor Ref.	Room Ref.	Room Use.	Window Ref.	VSC	Pr/Ex	Meets BRE Guidance	Annual	Pr/Ex	Meets BRE Guidance	Winter	Pr/Ex	Meets BRE Guidance
17 Briary Close												
1st	R1	Living Room	W1	Existing	34.79	0.99	YES					
				Proposed	34.52							
			W2	Existing	34.53	0.99	YES					
				Proposed	34.29							
2nd	R1	Bedroom	W1	Existing	36.63	0.99	YES					
				Proposed	36.38							
	R2	Bedroom	W2	Existing	36.69	0.99	YES					
				Proposed	36.48							

Project Name: 201020 9 Briary Close
 Report Title: Daylight Distribution - Neighbour Analysis
 Date of Analysis: 10/11/2020

Floor Ref.	Room Ref.	Room Use.		Room Area	Lit Area Existing	Lit Area Proposed	Pr/Ex	Meets BRE Guidance
1 Briary Close								
Gnd	R1	Living Room	Area m2	10.17	10.02	10.02		
			% of room		98%	98%	100.00%	YES
1st	R1	Living Room	Area m2	21.70	21.38	21.38		
			% of room		99%	99%	100.00%	YES
2nd	R1	Bedroom	Area m2	7.34	7.18	7.18		
			% of room		98%	98%	100.00%	YES
	R2	Bedroom	Area m2	9.92	9.58	9.58		
			% of room		97%	97%	100.00%	YES
2 Briary Close								
Gnd	R1	Living Room	Area m2	10.17	9.98	9.98		
			% of room		98%	98%	100.00%	YES
1st	R1	Living Room	Area m2	21.75	21.47	21.47		
			% of room		99%	99%	100.00%	YES
2nd	R1	Bedroom	Area m2	9.92	9.62	9.62		
			% of room		97%	97%	100.00%	YES
	R2	Bedroom	Area m2	7.34	7.16	7.16		
			% of room		98%	98%	100.00%	YES
3 Briary Close								
Gnd	R1	Living Room	Area m2	10.19	0.00	0.00		
			% of room		0%	0%	100.00%	YES
1st	R1	Living Room	Area m2	21.70	21.41	21.41		
			% of room		99%	99%	100.00%	YES
2nd	R1	Bedroom	Area m2	7.34	7.18	7.18		
			% of room		98%	98%	100.00%	YES
	R2	Bedroom	Area m2	9.92	9.56	9.56		
			% of room		96%	96%	100.00%	YES
4 Briary Close								
1st	R1	Living Room	Area m2	21.75	21.43	21.43		
			% of room		98%	98%	100.00%	YES
2nd	R1	Bedroom	Area m2	9.92	9.74	9.74		
			% of room		98%	98%	100.00%	YES
	R2	Bedroom	Area m2	7.34	7.16	7.16		
			% of room		98%	98%	100.00%	YES
5 Briary Close								
1st	R1	Living Room	Area m2	21.70	21.36	21.36		
			% of room		98%	98%	100.00%	YES
2nd	R1	Bedroom	Area m2	7.34	7.18	7.18		
			% of room		98%	98%	100.00%	YES
	R2	Bedroom	Area m2	9.92	9.69	9.69		
			% of room		98%	98%	100.00%	YES

Project Name: 201020 9 Briary Close
 Report Title: Daylight Distribution - Neighbour Analysis
 Date of Analysis: 10/11/2020

Floor Ref.	Room Ref.	Room Use.		Room Area	Lit Area Existing	Lit Area Proposed	Pr/Ex	Meets BRE Guidance
6 Briary Close								
1st	R1	Living Room	Area m2 % of room	21.70	21.27 98%	21.27 98%	100.00%	YES
2nd	R1	Bedroom	Area m2 % of room	7.34	7.19 98%	7.19 98%	100.00%	YES
	R2	Bedroom	Area m2 % of room	9.92	9.73 98%	9.73 98%	100.00%	YES
7 Briary Close								
1st	R1	Living Room	Area m2 % of room	21.80	21.49 99%	21.49 99%	100.00%	YES
2nd	R1	Bedroom	Area m2 % of room	9.92	9.74 98%	9.74 98%	100.00%	YES
	R2	Bedroom	Area m2 % of room	7.34	7.17 98%	7.17 98%	100.00%	YES
8 Briary Close								
Gnd	R1	Utility Room	Area m2 % of room	7.01	6.84 98%	6.84 98%	100.00%	YES
1st	R1	Living Room	Area m2 % of room	21.70	21.43 99%	21.43 99%	100.00%	YES
2nd	R1	Bedroom	Area m2 % of room	7.34	7.19 98%	7.19 98%	100.00%	YES
	R2	Bedroom	Area m2 % of room	9.92	9.76 98%	9.76 98%	100.00%	YES
10 Briary Close								
Gnd	R1	Bedroom	Area m2 % of room	13.01	12.93 99%	12.93 99%	100.00%	YES
1st	R1	Living Room	Area m2 % of room	21.70	21.41 99%	21.41 99%	100.00%	YES
2nd	R1	Bedroom	Area m2 % of room	7.34	7.20 98%	7.20 98%	100.00%	YES
	R2	Bedroom	Area m2 % of room	9.92	9.76 98%	9.76 98%	100.00%	YES
11 Briary Close								
1st	R1	Living Room	Area m2 % of room	21.80	21.39 98%	21.39 98%	100.00%	YES
2nd	R1	Bedroom	Area m2 % of room	9.92	9.67 98%	9.67 98%	100.00%	YES
	R2	Bedroom	Area m2 % of room	7.34	7.17 98%	7.17 98%	100.00%	YES

Project Name: 201020 9 Briary Close
 Report Title: Daylight Distribution - Neighbour Analysis
 Date of Analysis: 10/11/2020

Floor Ref.	Room Ref.	Room Use.		Room Area	Lit Area Existing	Lit Area Proposed	Pr/Ex	Meets BRE Guidance
12 Briary Close								
Gnd	R1	Kitchen	Area m2 % of room	13.71	13.61 99%	13.61 99%	100.00%	YES
1st	R1	Living Room	Area m2 % of room	21.70	21.39 99%	21.39 99%	100.00%	YES
2nd	R1	Bedroom	Area m2 % of room	7.34	7.09 97%	7.09 97%	100.00%	YES
	R2	Bedroom	Area m2 % of room	9.92	9.78 99%	9.78 99%	100.00%	YES
13 Briary Close								
1st	R1	Living Room	Area m2 % of room	21.80	21.18 97%	21.18 97%	100.00%	YES
2nd	R1	Bedroom	Area m2 % of room	9.92	9.45 95%	9.45 95%	100.00%	YES
	R2	Bedroom	Area m2 % of room	7.34	7.15 98%	7.15 98%	100.00%	YES
14 Briary Close								
1st	R1	Living Room	Area m2 % of room	21.70	21.35 98%	21.35 98%	100.00%	YES
2nd	R1	Bedroom	Area m2 % of room	7.34	7.19 98%	7.19 98%	100.00%	YES
	R2	Bedroom	Area m2 % of room	9.92	9.75 98%	9.75 98%	100.00%	YES
15 Briary Close								
1st	R1	Living Room	Area m2 % of room	21.80	21.51 99%	21.51 99%	100.00%	YES
2nd	R1	Bedroom	Area m2 % of room	9.92	9.78 99%	9.78 99%	100.00%	YES
	R2	Bedroom	Area m2 % of room	7.34	7.20 98%	7.20 98%	100.00%	YES
16 Briary Close								
1st	R1	Living Room	Area m2 % of room	21.86	21.56 99%	21.56 99%	100.00%	YES
2nd	R1	Bedroom	Area m2 % of room	7.34	7.19 98%	7.19 98%	100.00%	YES
	R2	Bedroom	Area m2 % of room	9.92	9.77 99%	9.77 99%	100.00%	YES


Project Name: 201020 9 Briary Close
 Report Title: Daylight Distribution - Neighbour Analysis
 Date of Analysis: 10/11/2020

Floor Ref.	Room Ref.	Room Use.		Room Area	Lit Area Existing	Lit Area Proposed	Pr/Ex	Meets BRE Guidance
17 Briary Close								
1st	R1	Living Room	Area m2 % of room	21.80	21.46 98%	21.46 98%	100.00%	YES
2nd	R1	Bedroom	Area m2 % of room	9.92	9.76 98%	9.76 98%	100.00%	YES
	R2	Bedroom	Area m2 % of room	7.34	7.20 98%	7.20 98%	100.00%	YES


Window & Room References:



mes
buildingsolutions
Part of the **FOCUS** consultancy group

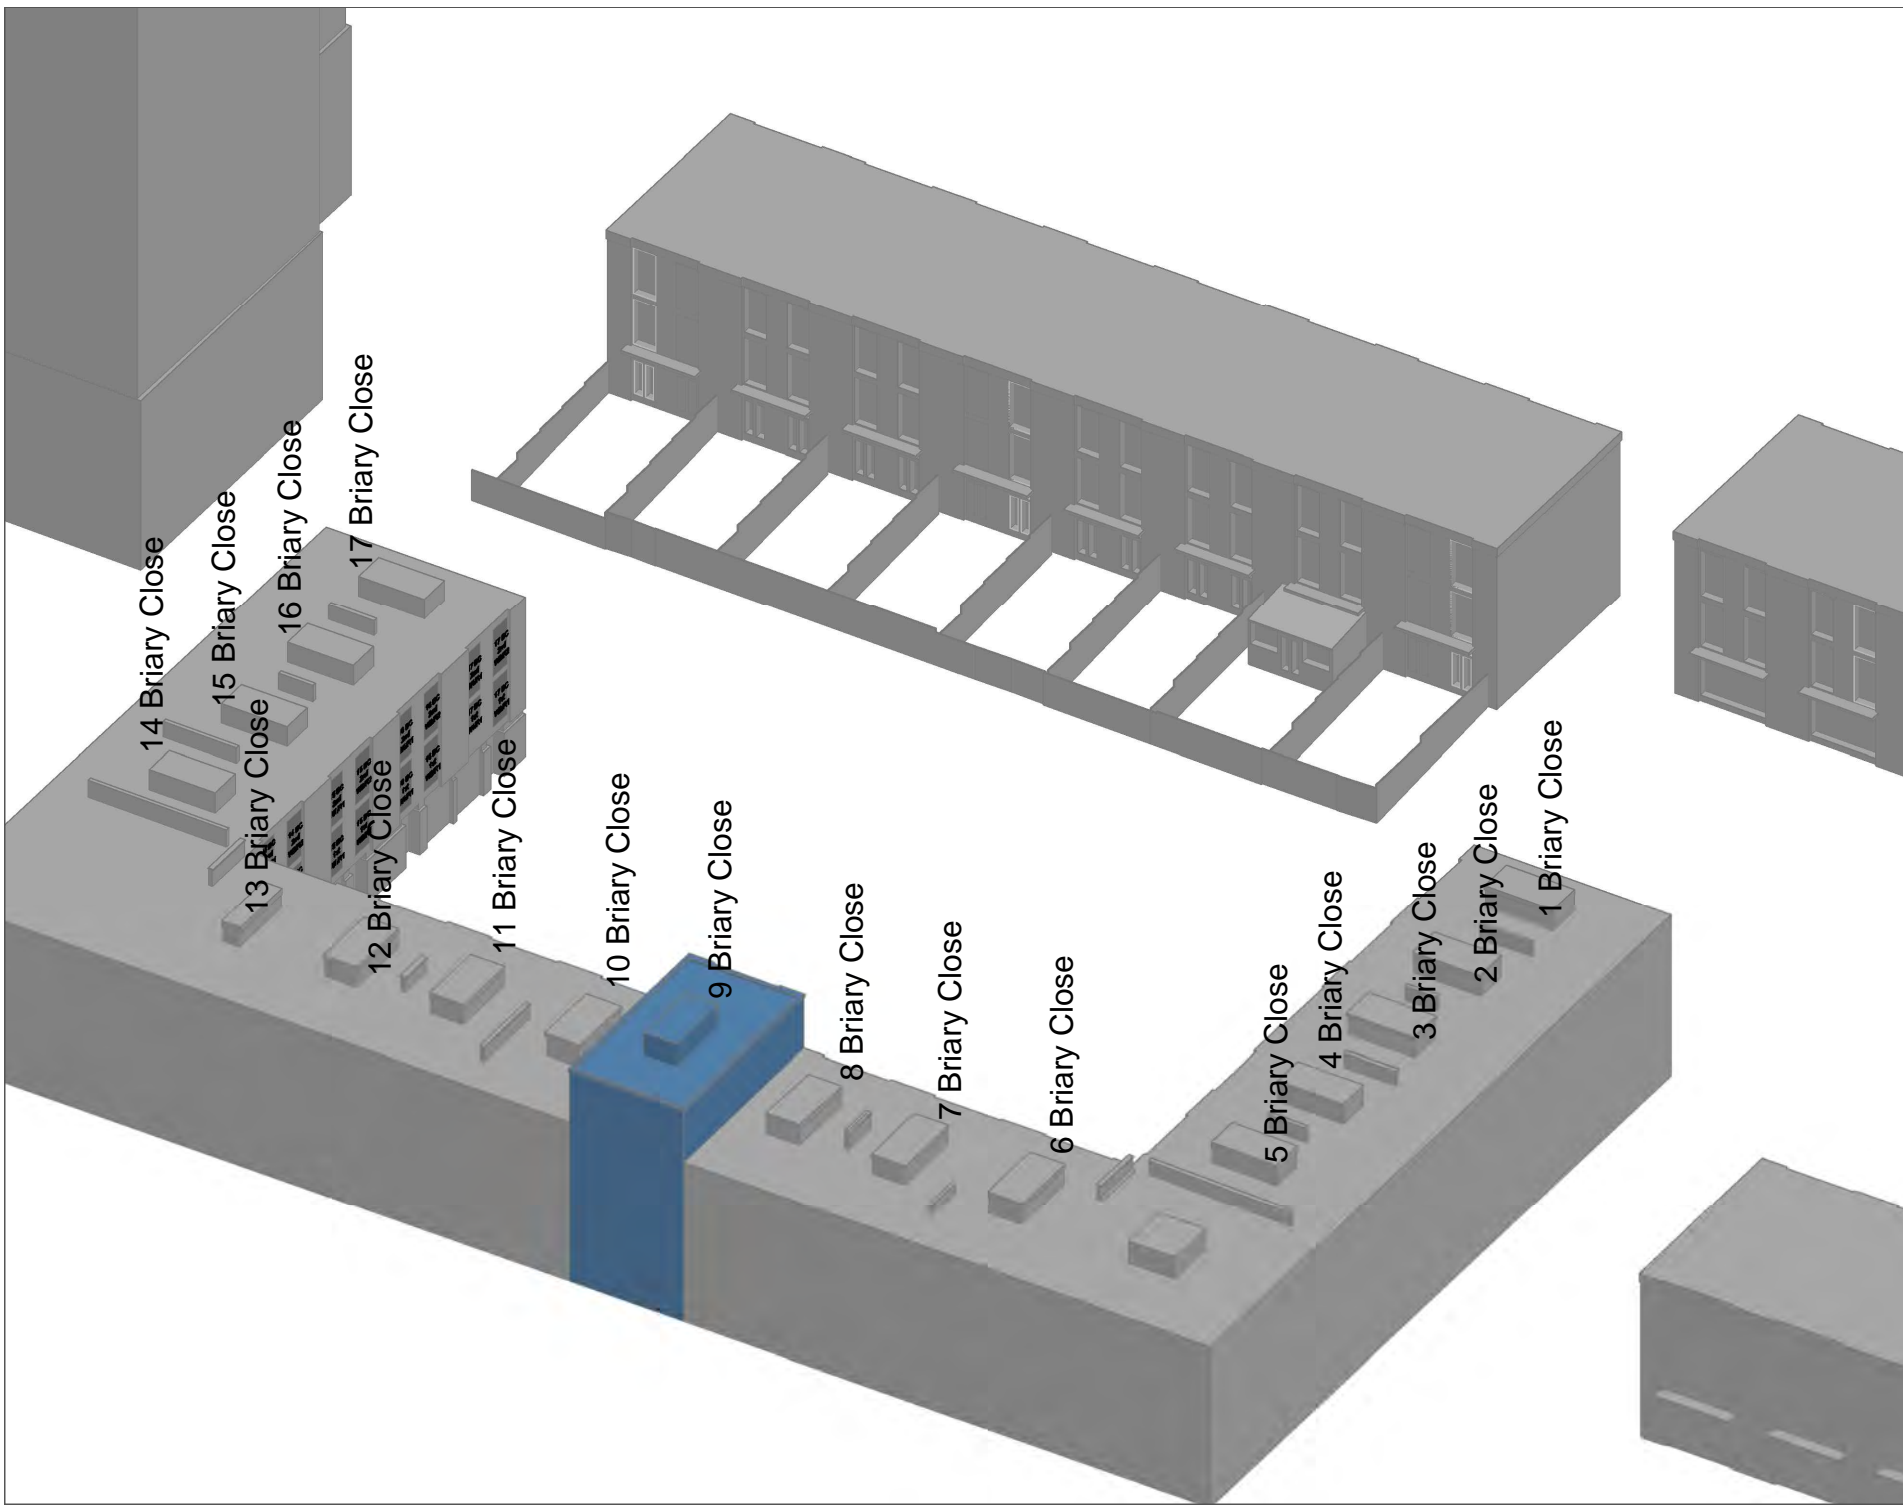

NOTES



NO.	REVISION	DATE
A	-	-
B	-	-
C	-	-
D	-	-





MES Building Solutions
 Newark Beacon
 Beacon Hill Office Park
 Newark
 Notts. NG24 2TN
 01636 653 055
 www.mesbuildingsolutions.co.uk

CLIENT
 Boyer Planning Limited

PROJECT
 9 Briary Close

DRAWING TITLE
 3D Overview

DRAWN BY JB/AP	CHECKED BY CJ
DATE 10/11/2020	DRAWING NO. -
SCALE NTS	

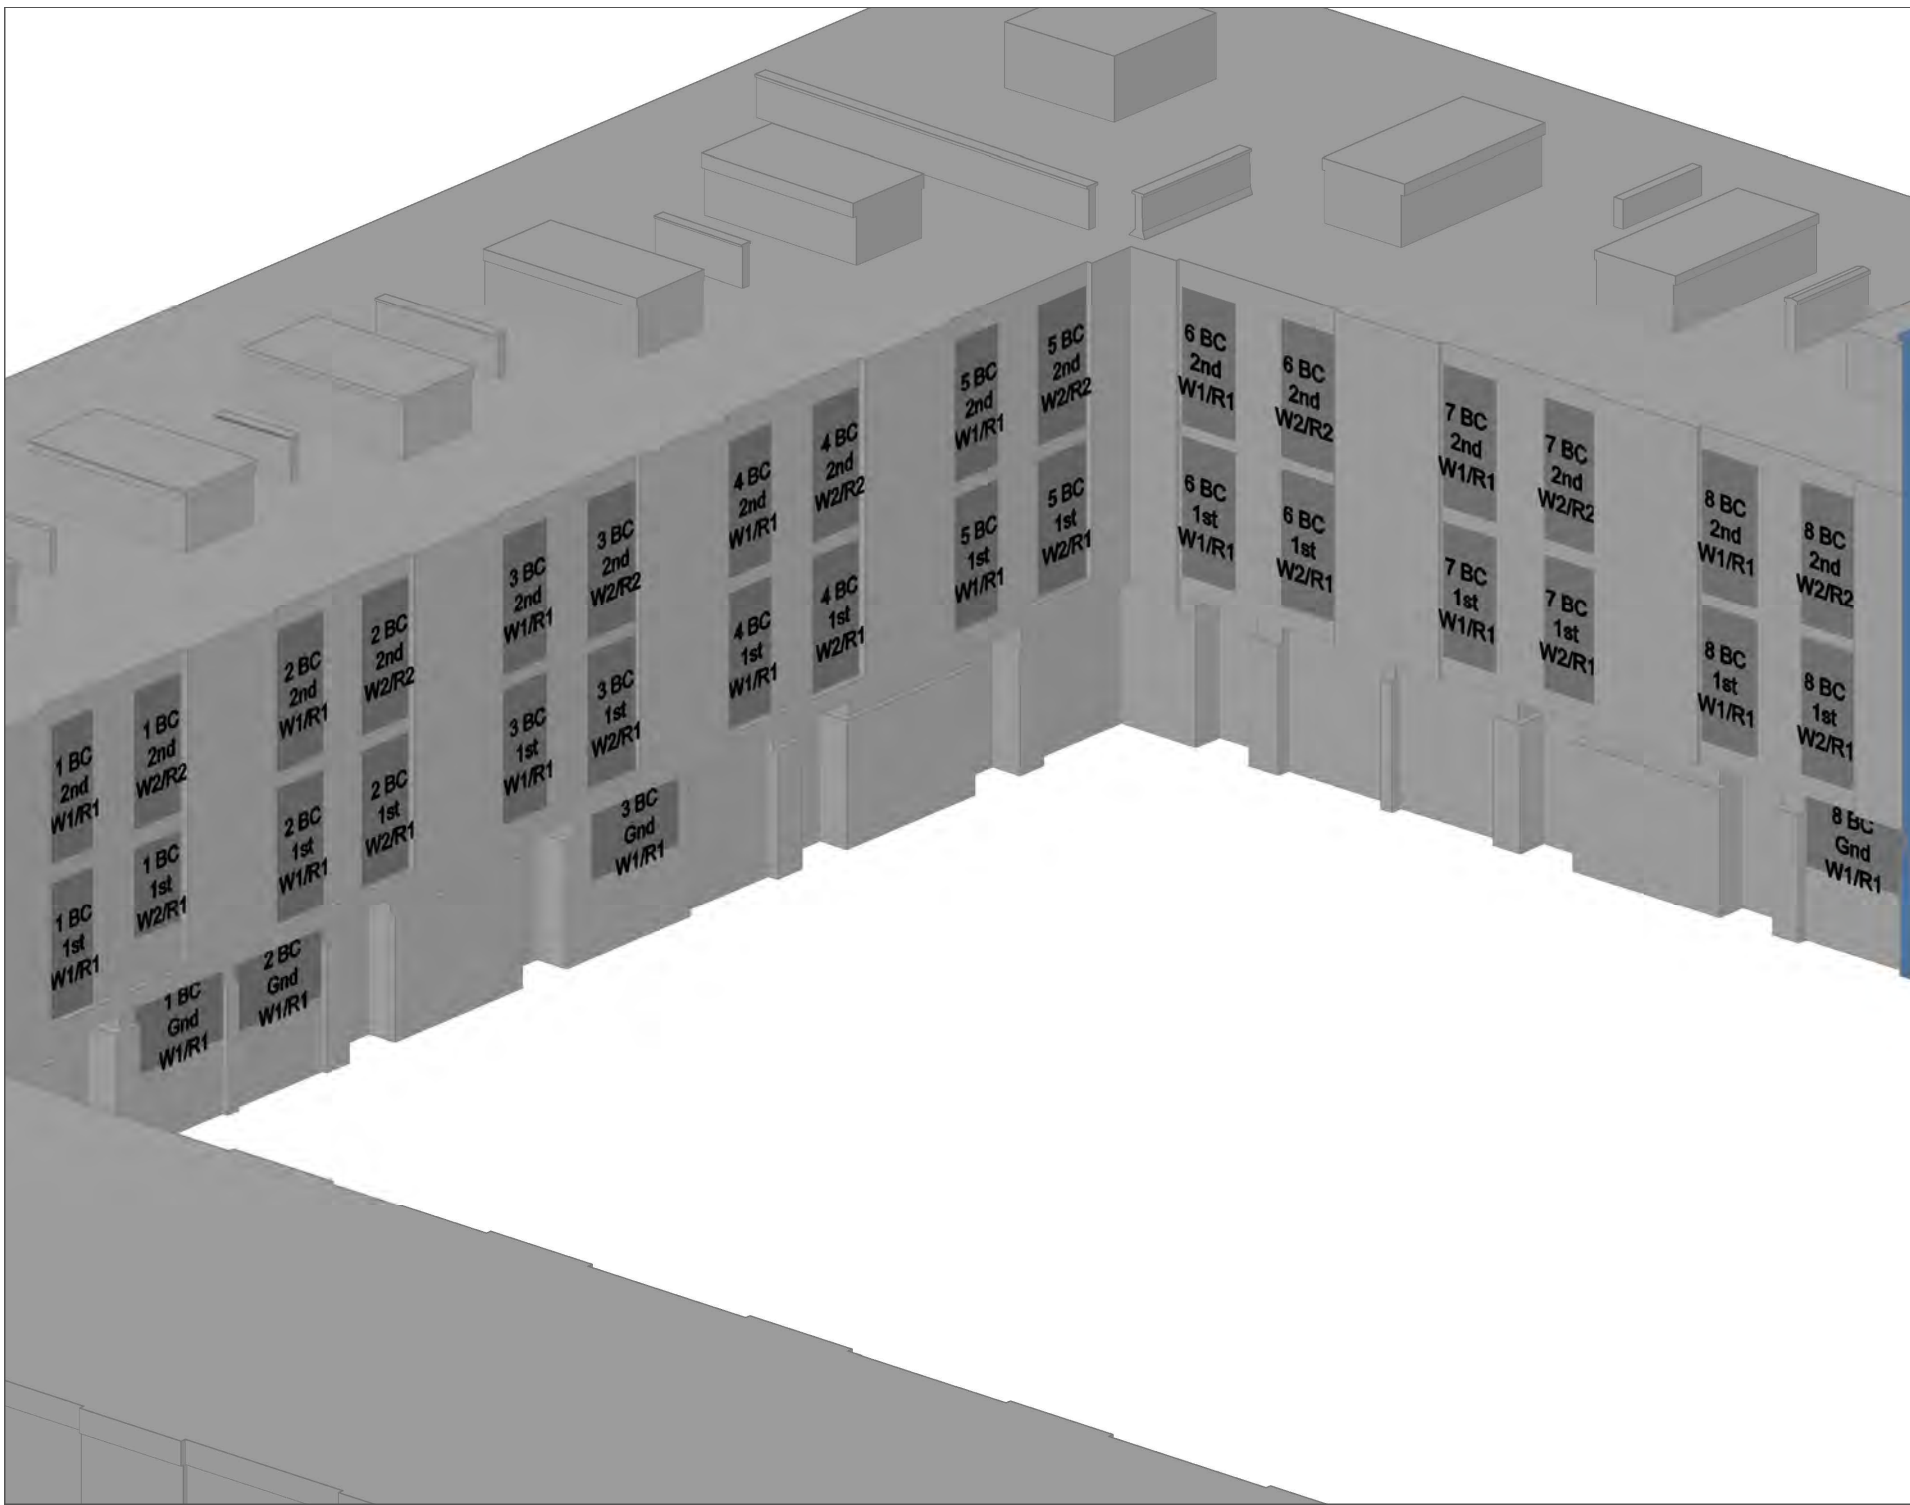

NO.	REVISION	DATE
A	-	-
B	-	-
C	-	-
D	-	-




MES Building Solutions
 Newark Beacon
 Beacon Hill Office Park
 Newark
 Notts. NG24 2TN
 01636 653 055
www.mesbuildingsolutions.co.uk

CLIENT
 Boyer Planning Limited


PROJECT
 9 Briary Close

DRAWING TITLE
 Window Labels
 1-8 Briary Close

DRAWN BY JB/AP	CHECKED BY CJ
DATE 10/11/2020	DRAWING NO. -
SCALE NTS	

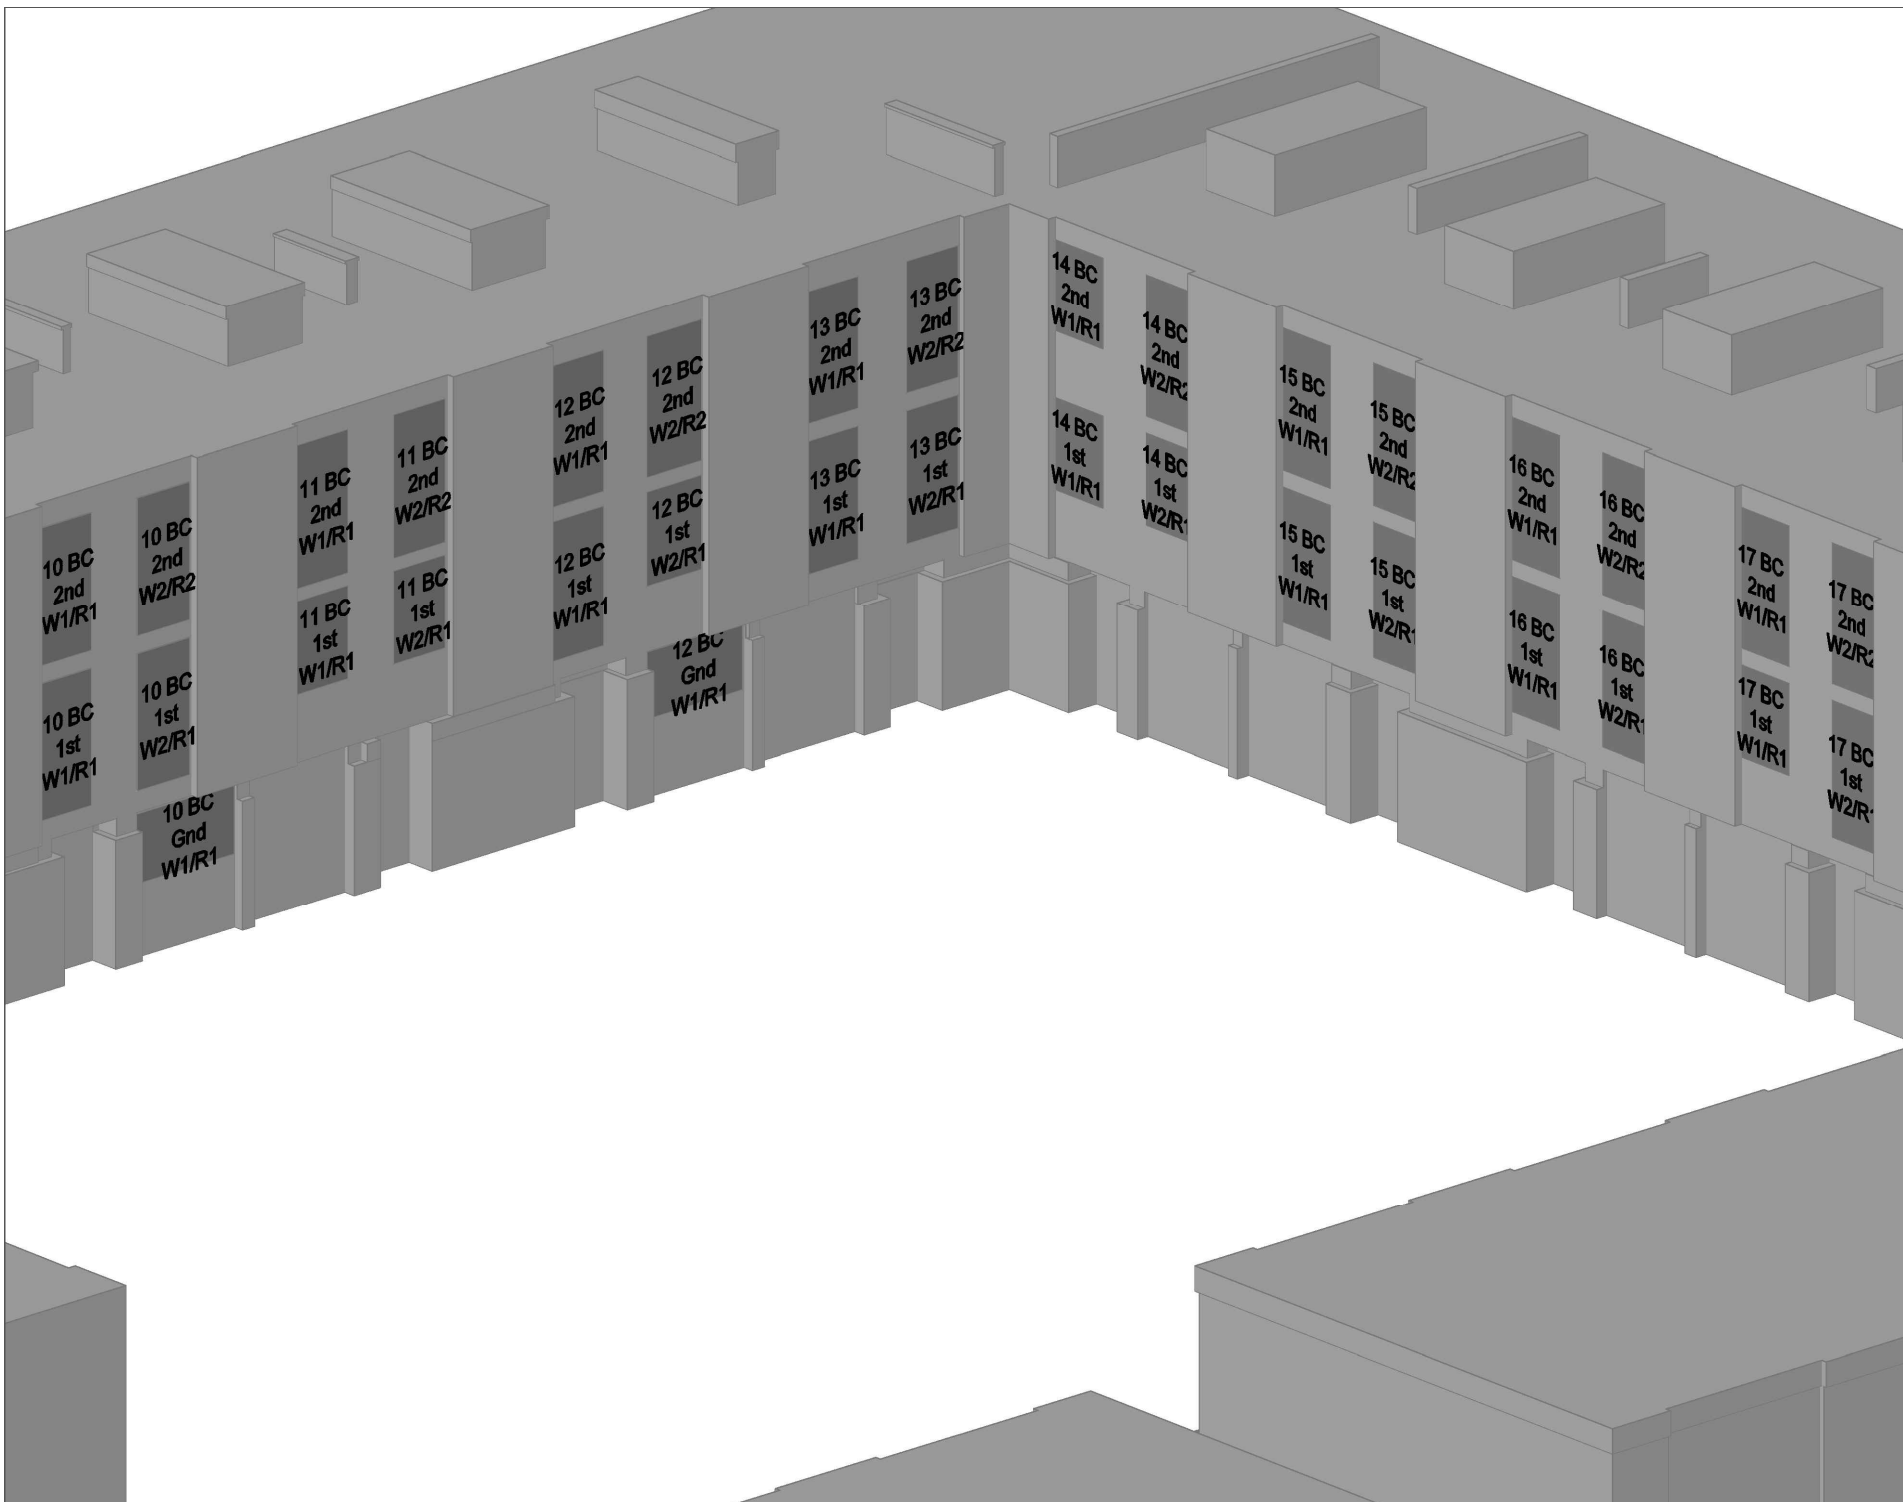

NOTES



NO.	REVISION	DATE
A	-	-
B	-	-
C	-	-
D	-	-



MES Building Solutions
 Newark Beacon
 Beacon Hill Office Park
 Newark
 Notts. NG24 2TN
 01636 653 055
www.mesbuildingsolutions.co.uk

CLIENT
 Boyer Planning Limited

PROJECT
 9 Briary Close

DRAWING TITLE
 Window Labels
 9-17 Briary Close

DRAWN BY JB/AP	CHECKED BY CJ
DATE 10/11/2020	DRAWING NO. -
SCALE NTS	

8. Notes

- 8.1 This report has been prepared for the sole use of the Client. No representation or warranty (expressed or implied) is given to any other parties. Therefore this report should not be relied upon by any third party and we accept no liability from the use of this report by any other party.
- 8.2 Where full access was not available we have made reasonable estimations of internal layouts, floor areas, window sizes and positions etc.
- 8.3 Our calculations model has been built from a combination of architect's plans, partial site survey, site and aerial photographs.
- 8.4 We are not aware of any conflicts of interest between ourselves and any other party concerning this project.