

Air Conditioning
Technical Data

RXM-N9



TABLE OF CONTENTS

RXM-N9

1	Features	2
2	Specifications	3
	Capacity and Power input	3
	Capacity and Power input	5
	Capacity and Power input	8
	Capacity and Power input	11
	Capacity and Power input	14
	Capacity and Power input	16
	Capacity and Power input	19
	Capacity and Power input	21
	Technical Specifications	24
	Electrical Specifications	25
3	Electrical data	26
4	Capacity tables	28
	Cooling/Heating Capacity Tables	28
5	Dimensional drawings	43
6	Centre of gravity	44
7	Piping diagrams	45
8	Wiring diagrams	46
	Wiring Diagrams - Single Phase	46
9	Sound data	48
	Sound Pressure Spectrum	48
10	Operation range	51

1 Features

- Choosing for an R-32 product, reduces the environmental impact with 68% compared to R-410A and leads directly to lower energy consumption thanks to its high energy efficiency
- Daikin outdoor units are neat, sturdy and can easily be mounted on a roof or terrace or simply placed against an outside wall
- Outdoor units are fitted with a swing compressor, renowned for its low noise and high energy efficiency
- Outdoor units for pair application
- Anti-corrosion treated outdoor heat exchanger fin



1



Outdoor unit
silent operation

2 Specifications

2-1 Capacity and Power input				FTXM20N/ RXM20N9	FTXM25N/ RXM25N9	FTXM35N/ RXM35N9	FTXM42N/ RXM42N9	FTXM50N/ RXM50N9	FTXM60N/ RXM60N9	
Indoor unit				FTXM20N2V1 B	FTXM25N2V1 B	FTXM35N2V1 B	FTXM42N2V1 B	FTXM50N2V1 B	FTXM60N2V1 B	
Outdoor unit				RXM20N2V1B 9	RXM25N2V1B 9	RXM35N2V1B 9	RXM42N2V1B 9	RXM50N2V1B 9	RXM60N2V1B 9	
Cooling capacity	Min.		kW	1.30		1.40	1.70			
			Btu/h	4,400		4,800	5,800			
			kcal/h	1,118		1,204	1,462			
	Nom.		kW	2.00	2.50	3.40	4.20	5.00	6.00	
			Btu/h	6,800	8,500	11,600	14,300	17,100	20,500	
			kcal/h	1,720	2,150	2,923	3,611	4,299	5,159	
	Max.		kW	2.60	3.20	4.00	5.00	6.00	7.00	
			Btu/h	8,900	10,900	13,600	17,100	20,500	23,900	
			kcal/h	2,236	2,752	3,439	4,299	5,159	6,019	
Heating capacity	Min.		kW	1.30		1.40	1.70			
			Btu/h	4,400		4,800	5,800			
			kcal/h	1,100		1,200	1,462			
	Nom.		kW	2.50	2.80	4.00	5.40	5.80	7.00	
			Btu/h	8,500	9,600	13,600	18,400	19,800	23,900	
			kcal/h	2,150	2,408	3,439	4,643	4,987	6,019	
	Max.		kW	3.50	4.70	5.20	6.00	7.70	8.00	
			Btu/h	11,900	16,000	17,700	20,500	26,300	27,300	
			kcal/h	3,009	4,041	4,471	5,159	6,621	6,879	
Power input	Cooling	Nom.	kW	0.44	0.56	0.80	0.97	1.36	1.77	
	Heating	Nom.	kW	0.50	0.56	0.99	1.31	1.45	1.94	
Space cooling	Capacity	Pdesign	kW	2.00	2.50	3.40	4.20	5.00	6.00	
	Energy efficiency class			A+++				A++		
	SEER			8.65			7.85	7.41	6.90	
	Annual energy consumption			kWh/a	81	101	138	187	236	304
	A Condition (35°C - 27/19)	Pdc	kW	2.00	2.50	3.40	4.20	5.00	6.00	
		EERd		4.57	4.50	4.23	4.33	3.68	3.39	
		Power input		kW	0.44	0.56	0.80	0.97	1.36	1.77
	B Condition (30°C - 27/19)	Pdc	kW	1.47	1.84	2.51	3.09	3.68	4.42	
		EERd		6.88	6.60	6.25	6.21	5.55	4.82	
		Power input		kW	0.21	0.28	0.40	0.50	0.66	0.92
	C Condition (25°C - 27/19)	Pdc	kW	1.18		1.61	1.99	2.37	2.84	
		EERd		10.52	10.03	10.19	9.22	8.29	7.99	
		Power input		kW	0.11	0.12	0.16	0.22	0.29	0.36
	D Condition (20°C - 27/19)	Pdc	kW	1.05		1.07	1.82	1.83		
		EERd		16.53	16.37	16.36	12.72	14.55	13.49	
Power input		kW	0.06		0.07	0.14	0.13	0.14		

2 Specifications

2

2-1 Capacity and Power input				FTXM20N/ RXM20N9	FTXM25N/ RXM25N9	FTXM35N/ RXM35N9	FTXM42N/ RXM42N9	FTXM50N/ RXM50N9	FTXM60N/ RXM60N9		
Space heating (Average climate)	Capacity	Pdesign	kW	2.30	2.40	2.50	4.00	4.60	4.80		
	Energy efficiency class			A+++			A++		A+		
	SCOP/A			5.10			4.71		4.30		
	SCOPnet/A			5.14			4.75		4.34		
	Pdh Heating capacity at -10°		kW	2.24	2.30	2.35	3.67	4.09	4.11		
	Annual energy consumption		kWh/a	632	659	687	1,189	1,369	1,562		
	Required back up heating cap at design conditions		kW	0.06	0.10	0.15	0.33	0.51	0.69		
	TOL	Tol (temperature operating limit)	°C	-20							
		Pdh (declared heating cap)	kW	2.14			2.67	3.12			
		COPd (declared COP)		2.29	2.49	1.99	2.04	2.05			
		Power input	kW	0.93	0.86	1.34	1.53	1.52			
	TBivalent	Tbiv (bivalent temperature)	°C	-7							
		Pdh (declared heating cap)	kW	2.03	2.12	2.21	3.54	4.07	4.25		
		COPd (declared COP)		3.64	3.60	3.50	2.72	2.90	2.68		
		Power input	kW	0.56	0.59	0.63	1.30	1.40	1.59		
	A Condition (-7°C)	Pdh (declared heating cap)	kW	2.03	2.12	2.21	3.54	4.07	4.25		
		COPd (declared COP)		3.64	3.60	3.50	2.72	2.90	2.68		
		Power input	kW	0.56	0.59	0.63	1.30	1.40	1.59		
	B Condition (2°C)	Pdh (declared heating cap)	kW	1.24	1.29	1.34	2.15	2.48	2.58		
		COPd (declared COP)		5.10	5.13		4.80	4.67	4.31		
		Power input	kW	0.24	0.25	0.26	0.45	0.53	0.60		
	C Condition (7°C)	Pdh (declared heating cap)	kW	0.93	0.94	0.95	1.38	1.61	1.66		
		COPd (declared COP)		6.28	6.22		6.30	6.47	5.64		
		Power input	kW	0.15			0.22	0.25	0.29		
	D Condition (12°C)	Pdh (declared heating cap)	kW	0.97	0.98	1.09	1.54	1.80	1.95		
		COPd (declared COP)		7.99	7.81		7.64	7.18	6.82		
		Power input	kW	0.12		0.14	0.20	0.25	0.29		
Current	Nominal running current (RLA) - 50Hz	Cooling	A	2.10	2.60	4.40	5.20	6.22	8.01		
		Heating	A	2.20	2.50	4.80	5.95	6.56	8.50		
Cooling	Cdc (Degradation cooling)		0.25								
Heating	Cdh (Degradation heating)		0.25								
Cooling function included			Yes								
Heating function included			Yes								
Average climate included			Yes								
Cold season included			No								
Warm season included			Yes								
Ecolabel logo			No								
Eurovent	Sound power level outdoor	Cooling	Nom.	dBA	59	58	61	62		63	
	Sound power level indoor	Cooling	Nom.	dBA	57			58	60	58	60
	Piping length	Cooling	Measuring condition	m	5.00						
Nominal efficiency	EER			4.57	4.50	4.23	4.33	3.68	3.39		
	COP			5.00			4.04	4.12	4.00	3.61	
	Annual energy consumption		kWh	219	278	402	485	679	885		
	Energy labeling Directive	Cooling		A							
Heating		A									

4

2 Specifications

2-1 Capacity and Power input				FTXM20N/ RXM20N9	FTXM25N/ RXM25N9	FTXM35N/ RXM35N9	FTXM42N/ RXM42N9	FTXM50N/ RXM50N9	FTXM60N/ RXM60N9				
Power consumption in other than active mode	Thermostat-off mode	PTO	Cooling	W	6			12					
			Heating	W	7			13					
	Crankcase heater mode	PCK	W	0									
	Off mode	POFF	W	1									
	Standby mode	Cooling	PSB	W	1								
Heating		PSB	W	1									
Power factor	Nominal	Cooling	%	91.10	93.90	79.90	93.70	95.00	96.10				
		Heating	%	97.60	98.20	90.00	95.70	96.10	99.20				
Space heating (Warm climate)	Capacity	Pdesignh	kW	1.24	1.29	1.35	2.15	2.48	2.58				
	Energy efficiency class			A+++									
	SCOP			6.19	6.15	6.18	6.15	6.02	5.51				
	SCOPnet			6.31	6.26	6.30	6.27	6.13	5.59				
	Annual energy consumption			kWh/a	280	294	305	490	576	656			
	Required back up heating cap at design conditions			kW	0.00								
	TOL	Tol (temperature operating limit)	°C	-20									
				Pdh (declared heating cap)	kW	2.14		2.59	2.67	3.12			
				COPd (declared COP)			2.29		2.49	1.99	2.04	2.05	
				Power input			0.93		1.04	1.34	1.53	1.52	
	TBivalent	Tbiv (bivalent temperature)	°C	2									
				Pdh (declared heating cap)	kW	1.24	1.29	1.34	3.54	2.48	2.58		
				COPd (declared COP)			5.10		5.13		2.72	4.67	4.31
				Power input			0.24		0.25	0.26	1.30	0.53	0.60
	B Condition (2°C)	Pdh (declared heating cap)	kW	1.24		1.29	1.34	2.15	2.48	2.58			
				COPd (declared COP)			5.10		5.13		4.80	4.67	4.31
				Power input			0.24		0.25	0.26	0.45	0.53	0.60
C Condition (7°C)	Pdh (declared heating cap)	kW	0.93		0.94	0.95	1.38	1.61	1.66				
			COPd (declared COP)			6.28		6.22		6.30	6.47	5.64	
			Power input			0.15			0.22	0.25	0.29		
D Condition (12°C)	Pdh (declared heating cap)	kW	0.97		0.98	1.09	1.54	1.80	1.95				
			COPd (declared COP)			7.99		7.81		7.64	7.18	6.82	
			Power input			0.12		0.14	0.20	0.25	0.29		

Notes

See separate drawing for operation range

See separate drawing for electrical data

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

2-2 Capacity and Power input	FDXM25F9/RXM25N9	FDXM35F9/RXM35N9	FDXM50F9/RXM50N9	FDXM60F9/RXM60N9
Indoor unit	FDXM25F3V1B9	FDXM35F3V1B9	FDXM50F3V1B9	FDXM60F3V1B9
Outdoor unit	RXM25N2V1B9	RXM35N2V1B9	RXM50N2V1B9	RXM60N2V1B9

2 Specifications

2

2-2 Capacity and Power input			FDXM25F9/RXM25N9	FDXM35F9/RXM35N9	FDXM50F9/RXM50N9	FDXM60F9/RXM60N9		
Cooling capacity	Min.	kW	1.30	1.40	1.70			
		Btu/h	4,435	4,800	5,800			
		kcal/h	1,117	1,204	1,462			
	Nom.	kW	2.40	3.40	5.00	6.00		
		Btu/h	8,189	11,600	17,100	20,500		
		kcal/h	2,064	2,923	4,299	5,159		
	Max.	kW	3.00	3.80	5.30	6.50		
		Btu/h	10,236	13,000	18,100	22,200		
		kcal/h	2,579	3,267	4,557	5,589		
Heating capacity	Min.	kW	1.30	1.40	1.70			
		Btu/h	4,435	4,800	5,800			
		kcal/h	1,117	1,200	1,500			
	Nom.	kW	3.20	4.00	5.80	7.00		
		Btu/h	10,919	13,600	19,800	23,900		
		kcal/h	2,752	3,439	4,987	6,019		
	Max.	kW	4.50	5.00	6.00	7.10		
		Btu/h	15,354	17,100	20,500	24,200		
		kcal/h	3,869	4,299	5,159	6,105		
Power input	Cooling	Nom.	kW	0.64	1.14	1.63	2.05	
	Heating	Nom.	kW	0.80	1.15	1.87	2.18	
Space cooling	Energy efficiency class			A+	A	A+	A	
	Capacity	Pdesign	kW	2.40	3.40	5.00	6.00	
	SEER			5.68	5.26	5.77	5.56	
	Annual energy consumption		kWh/a	148	226	303	378	
	A Condition (35°C - 27/19)	Pdc	kW	2.40	3.40	5.00	6.00	
		EERd			3.77	2.98	3.06	2.93
		Power input	kW	0.64	1.14	1.63	2.05	
	B Condition (30°C - 27/19)	Pdc	kW	1.76	2.50	3.67	4.43	
		EERd			5.38	4.08	4.96	4.64
		Power input	kW	0.33	0.61	0.74	0.95	
	C Condition (25°C - 27/19)	Pdc	kW	1.27	1.61	2.37	2.85	
		EERd			8.92	8.05	8.21	6.96
		Power input	kW	0.14	0.20	0.29	0.41	
	D Condition (20°C - 27/19)	Pdc	kW	1.31	1.46	2.26		
		EERd			10.90	9.65	9.47	10.44
Power input		kW	0.12	0.15	0.24	0.22		

2 Specifications

2-2 Capacity and Power input					FDXM25F9/RXM25N9	FDXM35F9/RXM35N9	FDXM50F9/RXM50N9	FDXM60F9/RXM60N9	
Space heating (Average climate)	Energy efficiency class				A+		A		
	Capacity	Pdesign	kW	2.60	2.90	4.00	4.60		
	SCOP/A				4.24	3.88	3.93	3.80	
	SCOPnet/A				4.27	3.91	3.95	3.83	
	Pdh Heating capacity at -10°			kW	2.16	2.41	3.56	3.94	
	Annual energy consumption				kWh/a	858	1,046	1,424	1,693
	Required back up heating cap at design conditions				kW	0.44	0.49	0.44	0.66
	TOL	Tol (temperature operating limit)		°C	-15				
		Pdh (declared heating cap)		kW	1.93	2.15	3.59	3.72	
		COPd (declared COP)				2.20	2.01	1.89	1.91
		Power input		kW	0.88	1.07	1.90	1.95	
	TBivalent	Tbiv (bivalent temperature)		°C	-7				
		Pdh (declared heating cap)		kW	2.30	2.57	3.54	4.07	
		COPd (declared COP)				2.81	2.60	2.87	2.58
		Power input		kW	0.82	0.99	1.23	1.58	
	A Condition (-7°C)	Pdh (declared heating cap)		kW	2.30	2.57	3.54	4.07	
		COPd (declared COP)				2.81	2.60	2.87	2.58
		Power input		kW	0.82	0.99	1.23	1.58	
	B Condition (2°C)	Pdh (declared heating cap)		kW	1.40	1.57	2.13	2.48	
		COPd (declared COP)				4.21	3.84	4.10	3.92
		Power input		kW	0.33	0.41	0.52	0.63	
	C Condition (7°C)	Pdh (declared heating cap)		kW	1.00	1.02	1.62		
		COPd (declared COP)				5.54	4.94	4.56	4.52
		Power input		kW	0.18	0.21	0.36		
	D Condition (12°C)	Pdh (declared heating cap)		kW	1.17	1.19	1.92		
		COPd (declared COP)				6.84	6.08	5.49	5.46
		Power input		kW	0.17	0.20	0.35		
Cooling	Cdc (Degradation cooling)				0.25				
Heating	Cdh (Degradation heating)				0.25				
Cooling function included					Yes				
Heating function included					Yes				
Average climate included					Yes				
Cold season included					No				
Warm season included					Yes				
Ecolabel logo					No	-			
Eurovent	Sound power level outdoor	Cooling	Nom.	dBA	59	61	62	63	
	Sound power level indoor	Cooling	Nom.	dBA	53		55	56	
	Piping length	Cooling	Measuring condition	m	5.0				
Nominal efficiency	EER				3.77	2.98	3.06	2.93	
	COP				4.00	3.48	3.10	3.21	
	Annual energy consumption			kWh	318	570	817	1,024	
	Energy labeling Directive	Cooling				A	C	B	C
		Heating				A	B	D	C

2 Specifications

2

2-2 Capacity and Power input				FDXM25F9/RXM25N9	FDXM35F9/RXM35N9	FDXM50F9/RXM50N9	FDXM60F9/RXM60N9	
Power consumption in other than active mode	Off mode	Cooling	POFF	kW	14.0	0.014	0.015	
		Heating	POFF	kW	14.0	0.014	0.015	
	Standby mode	Cooling	PSB	kW	14.0	0.014	0.015	
		Heating	PSB	kW	14.0	0.014	0.015	
	Thermostat-off mode	Cooling	PTO	kW	7.0	0.007	0.009	
		Heating	PTO	kW	7.0	0.007	0.009	
Space heating (Warm climate)	Energy efficiency class			A+++	A++	A+		
	Capacity	Pdesignh	kW	1.40	1.57	2.13	2.48	
	SCOP			5.38	4.88	4.40	4.47	
	SCOPnet			5.46	4.95	4.45	4.51	
	Annual energy consumption			kWh/a	365	450	679	777
	Required back up heating cap at design conditions			kW	0.00			
	TOL	Tol (temperature operating limit)		°C	-15			
		Pdh (declared heating cap)		kW	1.93	2.15	3.59	3.72
		COPd (declared COP)			2.20	2.01	1.89	1.91
		Power input		kW	0.88	1.07	1.90	1.95
	TBivalent	Tbiv (bivalent temperature)		°C	2			
		Pdh (declared heating cap)		kW	1.40	1.57	2.13	2.48
		COPd (declared COP)			4.21	3.84	4.10	3.92
		Power input		kW	0.33	0.41	0.52	0.63
	B Condition (2°C)	Pdh (declared heating cap)		kW	1.40	1.57	2.13	2.48
		COPd (declared COP)			4.21	3.84	4.10	3.92
		Power input		kW	0.33	0.41	0.52	0.63
C Condition (7°C)	Pdh (declared heating cap)		kW	1.00	1.02	1.62		
	COPd (declared COP)			5.54	4.94	4.56	4.52	
	Power input		kW	0.18	0.21	0.36		
D Condition (12°C)	Pdh (declared heating cap)		kW	1.17	1.19	1.92		
	COPd (declared COP)			6.84	6.08	5.49	5.46	
	Power input		kW	0.17	0.20	0.35		

Notes

See separate drawing for electrical data

See separate drawing for operation range

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

2-3 Capacity and Power input				FVXM25F/RXM25N9	FVXM35F/RXM35N9	FVXM50F/RXM50N9	
Indoor unit				FVXM25FV1B	FVXM35FV1B	FVXM50FV1B	
Outdoor unit				RXM25N2V1B9	RXM35N2V1B9	RXM50N2V1B9	
Cooling capacity	Min.	kW		1.30	1.40		
		Btu/h		4,435	4,776		
		kcal/h		1,117	1,203		
	Nom.	kW		2.50	3.50	5.00	
		Btu/h		8,530	11,943	17,061	
		kcal/h		2,150	3,009	4,299	
	Max.	kW		3.00	3.80	5.60	
		Btu/h		10,236	12,966	19,107	
		kcal/h		2,579	3,267	4,815	

2 Specifications

2-3 Capacity and Power input			FVXM25F/RXM25N9	FVXM35F/RXM35N9	FVXM50F/RXM50N9		
Heating capacity	Min.	kW	1.30	1.40			
		Btu/h	4,435	4,776			
		kcal/h	1,117	1,203			
	Nom.	kW	3.40	4.50	5.80		
		Btu/h	11,601	15,355	19,790		
		kcal/h	2,923	3,869	4,987		
	Max.	kW	4.50	5.00	8.10		
		Btu/h	15,354	17,060	27,638		
		kcal/h	3,869	4,299	6,964		
Power input	Cooling	Nom.	kW	0.60	1.09	1.55	
	Heating	Nom.	kW	0.77	1.19	1.60	
Space cooling	Capacity	Pdesign	kW	2.50	3.50	5.00	
	Energy efficiency class			A++			
	SEER			7.20	6.43	6.80	
	Annual energy consumption			kWh/a	120	190	257
	A Condition (35°C - 27/19)	Pdc	kW	2.50	3.50	5.00	
		EERd		4.20	3.21	3.23	
		Power input	kW	0.60	1.09	1.55	
	B Condition (30°C - 27/19)	Pdc	kW	1.84	2.58	3.68	
		EERd		6.36	4.75	5.07	
		Power input	kW	0.29	0.54	0.73	
	C Condition (25°C - 27/19)	Pdc	kW	1.17	1.68	2.38	
		EERd		8.43	7.62	8.44	
		Power input	kW	0.14	0.22	0.28	
	D Condition (20°C - 27/19)	Pdc	kW	0.98	0.95	2.29	
		EERd		11.48	11.50	11.88	
Power input		kW	0.09	0.08	0.19		

2 Specifications

2

2-3 Capacity and Power input					FVXM25F/RXM25N9	FVXM35F/RXM35N9	FVXM50F/RXM50N9	
Space heating (Average climate)	Capacity	Pdesign	kW		2.40	2.90	4.20	
	Energy efficiency class				A+			
	SCOP/A				4.56	4.00		
	SCOPnet/A				4.59	4.03	4.01	
	Pd _h Heating capacity at -10°		kW		2.23	2.40	2.23	
	Annual energy consumption		kWh/a		737	1,015	1,471	
	Required back up heating cap at design conditions		kW		0.17	0.50	1.97	
	TOL	Tol (temperature operating limit)	°C		-15			
		Pd _h (declared heating cap)	kW		2.09	2.12	3.96	
		COP _d (declared COP)				2.24	1.94	1.82
		Power input	kW		0.93	1.09	2.18	
	TBivalent	Tbiv (bivalent temperature)	°C		-7			
		Pd _h (declared heating cap)	kW		2.12	2.57	3.72	
		COP _d (declared COP)				3.25	2.40	2.20
		Power input	kW		0.65	1.07	1.69	
	A Condition (-7°C)	Pd _h (declared heating cap)	kW		2.12	2.57	3.72	
		COP _d (declared COP)				3.25	2.40	2.20
		Power input	kW		0.65	1.07	1.69	
	B Condition (2°C)	Pd _h (declared heating cap)	kW		1.29	1.56	2.27	
		COP _d (declared COP)				4.39	4.03	4.32
		Power input	kW		0.29	0.39	0.53	
	C Condition (7°C)	Pd _h (declared heating cap)	kW		0.83	1.03	1.80	
		COP _d (declared COP)				5.79	5.11	5.13
		Power input	kW		0.14	0.20	0.35	
	D Condition (12°C)	Pd _h (declared heating cap)	kW		0.78	1.08	1.91	
		COP _d (declared COP)				7.27	7.24	6.25
		Power input	kW		0.11	0.15	0.31	
Cooling	Cdc (Degradation cooling)				0.25			
Heating	Cdh (Degradation heating)				0.25			
Cooling function included					Yes			
Heating function included					Yes			
Average climate included					Yes			
Cold season included					No			
Warm season included					Yes			
Ecolabel logo					No			
Eurovent	Sound power level outdoor	Cooling	Nom.	dB _A	59	61	62	
	Sound power level indoor	Cooling	Nom.	dB _A	52		57	
	Piping length	Cooling	Measuring condition	m	5.0			
Nominal efficiency	EER				4.20	3.21	3.23	
	COP				4.42	3.78	3.63	
	Annual energy consumption		kWh		298	545	773	
	Energy labeling Directive	Cooling				A		
		Heating				A		

2 Specifications

2-3 Capacity and Power input				FVXM25F/RXM25N9	FVXM35F/RXM35N9	FVXM50F/RXM50N9		
Power consumption in other than active mode	Thermostat-off mode	PTO	Cooling	W	8.0			
			Heating	W	8.0			
	Off mode	POFF	W	2.0				
	Standby mode	Cooling	PSB	W	2.0			
			Heating	PSB	W	2.0		
Space heating (Warm climate)	Capacity	Pdesignh	kW	1.29	1.56	2.27		
	Energy efficiency class			A+++				
	SCOP			5.81	5.44	4.96		
	SCOPnet			5.93	5.52	5.01		
	Annual energy consumption			kWh/a	311	402	641	
	Required back up heating cap at design conditions			kW	0.00			
	TOL	Tol (temperature operating limit)		°C	-15			
				Pdh (declared heating cap)	kW	2.09	2.12	3.96
				COPd (declared COP)		2.24	1.94	1.82
				Power input	kW	0.93	1.09	2.18
	TBivalent	Tbiv (bivalent temperature)		°C	2			
				Pdh (declared heating cap)	kW	1.29	1.56	2.27
				COPd (declared COP)		4.39	4.03	4.32
				Power input	kW	0.29	0.39	0.53
	B Condition (2°C)	Pdh (declared heating cap)		kW	1.29	1.56	2.27	
				COPd (declared COP)		4.39	4.03	4.32
				Power input	kW	0.29	0.39	0.53
	C Condition (7°C)	Pdh (declared heating cap)		kW	0.83	1.03	1.80	
				COPd (declared COP)		5.79	5.11	5.13
				Power input	kW	0.14	0.20	0.35
D Condition (12°C)	Pdh (declared heating cap)		kW	0.78	1.08	1.91		
			COPd (declared COP)		7.27	7.24	6.25	
			Power input	kW	0.11	0.15	0.31	

Notes

See separate drawing for electrical data

See separate drawing for operation range

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

2-4 Capacity and Power input				FCAG35B/RXM35N9	FCAG50B/RXM50N9	FCAG60B/RXM60N9
Indoor unit				FCAG35BVEB	FCAG50BVEB	FCAG60BVEB
Outdoor unit				RXM35N2V1B9	RXM50N2V1B9	RXM60N2V1B9
Cooling capacity	Nom.		kW	3.50	5.00	5.70
			Btu/h	11,900	17,100	19,400
			kcal/h	3,009	4,299	4,901
Heating capacity	Nom.		kW	4.20	6.00	7.00
			Btu/h	14,300	20,500	23,900
			kcal/h	3,611	5,159	6,019
Power input	Cooling	Nom.	kW	0.94	1.40	1.72
	Heating	Nom.	kW	1.11	1.62	2.07

2 Specifications

2-4 Capacity and Power input			FCAG35B/RXM35N9	FCAG50B/RXM50N9	FCAG60B/RXM60N9	
Space cooling	Energy efficiency class		A++			
	Capacity	Pdesign kW	3.50	5.00	5.70	
	SEER		6.35	6.54	6.40	
	Annual energy consumption kWh/a		193	266	312	
	A Condition (35°C - 27/19)	Pdc kW	3.50	5.00	5.68	
		EERd		3.72	3.58	3.31
		Power input kW	0.94	1.40	1.72	
	B Condition (30°C - 27/19)	Pdc kW	2.60	3.67	4.16	
		EERd		5.33	5.17	4.67
		Power input kW	0.49	0.71	0.89	
	C Condition (25°C - 27/19)	Pdc kW	1.68	2.37	2.70	
		EERd		9.52	8.52	7.87
		Power input kW	0.18	0.28	0.34	
	D Condition (20°C - 27/19)	Pdc kW	1.49	1.87	1.62	
		EERd		12.25	10.69	12.03
Power input kW		0.12	0.17	0.13		
Space heating (Average climate)	Energy efficiency class		A++	A+		
	Capacity	Pdesign kW	3.32	4.36	4.71	
	SCOP/A		4.90	4.30	4.20	
	SCOPnet/A		4.96	4.33	4.22	
	Pdh Heating capacity at -10° kW		2.60	3.87	4.12	
	Annual energy consumption kWh/a		948	1,419	1,569	
	Required back up heating cap at design conditions kW		0.72	0.49	0.59	
	TOL	Tol (temperature operating limit) °C	-15			
		Pdh (declared heating cap) kW	2.04	3.89	4.04	
		COPd (declared COP)		2.50	2.04	2.08
		Power input kW	0.82	1.91	1.94	
	TBivalent	Tbiv (bivalent temperature) °C	-7			
		Pdh (declared heating cap) kW	2.94	3.86	4.17	
		COPd (declared COP)		3.10	2.81	2.56
		Power input kW	0.95	1.37	1.63	
	A Condition (-7°C)	Pdh (declared heating cap) kW	2.94	3.86	4.17	
		COPd (declared COP)		3.10	2.81	2.56
		Power input kW	0.95	1.37	1.63	
	B Condition (2°C)	Pdh (declared heating cap) kW	1.79	2.34	2.53	
		COPd (declared COP)		4.98	4.38	4.30
		Power input kW	0.36	0.53	0.59	
	C Condition (7°C)	Pdh (declared heating cap) kW	1.15	1.54	1.64	
		COPd (declared COP)		6.20	5.31	5.28
		Power input kW	0.19	0.29	0.31	
	D Condition (12°C)	Pdh (declared heating cap) kW	1.24	1.79	1.46	
		COPd (declared COP)		7.88	6.47	6.51
		Power input kW	0.16	0.28	0.22	
Cooling	Cdc (Degradation cooling)		0.25			
Heating	Cdh (Degradation heating)		0.25			
Cooling function included			Yes			
Heating function included			Yes			
Average climate included			Yes			
Cold season included			No			
Warm season included			Yes			

2 Specifications

2-4 Capacity and Power input					FCAG35B/RXM35N9	FCAG50B/RXM50N9	FCAG60B/RXM60N9	
Eurovent	Sound power level outdoor	Cooling	Nom.	dBA	61	62	63	
	Sound power level indoor	Cooling	Nom.	dBA	49		51	
	Piping length	Cooling	Measuring condition	m	5.00			
Nominal efficiency	EER				3.72	3.58	3.31	
	COP				3.77	3.70	3.38	
	Annual energy consumption			kWh	470	698	861	
	Energy labeling Directive	Cooling		A				
Heating		A		C				
Power consumption in other than active mode	Off mode	Cooling	POFF	kW	0.014	0.007		
		Heating	POFF	kW	0.014	0.007		
	Standby mode	Cooling	PSB	kW	0.014	0.007		
		Heating	PSB	kW	0.014	0.007		
	Thermostat-off mode	Cooling	PTO	kW	0.007			
		Heating	PTO	kW	0.007			
Space heating (Warm climate)	Energy efficiency class				A+++			
	Capacity	Pdesignh		kW	1.79	2.34	2.53	
	SCOP				6.27	5.26	5.36	
	SCOPnet				6.36	5.31	5.41	
	Annual energy consumption			kWh/a	400	623	661	
	Required back up heating cap at design conditions				0.00			
	TOL	Tol (temperature operating limit)		°C		-15		
		Pdh (declared heating cap)		kW		2.04	3.89	4.04
		COPd (declared COP)				2.50	2.04	2.08
		Power input		kW		0.82	1.91	1.94
	TBivalent	Tbiv (bivalent temperature)		°C		2		
		Pdh (declared heating cap)		kW		1.79	2.34	2.53
		COPd (declared COP)				4.98	4.38	4.30
		Power input		kW		0.36	0.53	0.59
	B Condition (2°C)	Pdh (declared heating cap)		kW		1.79	2.34	2.53
		COPd (declared COP)				4.98	4.38	4.30
		Power input		kW		0.36	0.53	0.59
	C Condition (7°C)	Pdh (declared heating cap)		kW		1.15	1.54	1.64
		COPd (declared COP)				6.20	5.31	5.28
		Power input		kW		0.19	0.29	0.31
	D Condition (12°C)	Pdh (declared heating cap)		kW		1.24	1.79	1.46
		COPd (declared COP)				7.88	6.47	6.51
		Power input		kW		0.16	0.28	0.22

Notes

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

See separate drawing for operation range

See separate drawing for electrical data

2 Specifications

2-5 Capacity and Power input				FFA25A9/RXM25N9	FFA35A9/RXM35N9	FFA50A9/RXM50N9	FFA60A9/RXM60N9	
Indoor unit				FFA25A2VEB9	FFA35A2VEB9	FFA50A2VEB9	FFA60A2VEB9	
Outdoor unit				RXM25N2V1B9	RXM35N2V1B9	RXM50N2V1B9	RXM60N2V1B9	
Cooling capacity	Nom.		kW	2.50	3.40	5.00	5.70	
			Btu/h	8,530	11,600	17,100	19,400	
			kcal/h	2,150	2,923	4,299	4,901	
Heating capacity	Nom.		kW	3.20	4.20	5.80	7.00	
			Btu/h	10,919	14,300	19,800	23,900	
			kcal/h	2,752	3,611	4,987	6,019	
Power input	Cooling	Nom.	kW	0.55	0.89	1.54	1.87	
	Heating	Nom.	kW	0.82	1.20	1.66	2.05	
Space cooling	Energy efficiency class			A++		A+		
	Capacity	Pdesign	kW	2.50	3.40	5.00	5.70	
	SEER			6.17	6.38	5.98	5.76	
	Annual energy consumption			kWh/a	142	186	292	347
	A Condition (35°C - 27/19)	Pdc	kW	2.50	3.40	5.00	5.70	
		EERd		4.57	3.81	3.24	3.05	
		Power input	kW	0.55	0.89	1.54	1.87	
	B Condition (30°C - 27/19)	Pdc	kW	1.84	2.51	3.69	4.20	
		EERd		6.60	5.79	5.38	5.34	
		Power input	kW	0.28	0.43	0.69	0.79	
	C Condition (25°C - 27/19)	Pdc	kW	1.41	1.45	2.37	2.70	
		EERd		9.11	9.13	7.85	7.24	
		Power input	kW	0.16		0.30	0.37	
	D Condition (20°C - 27/19)	Pdc	kW	1.24	1.26	2.15	2.27	
		EERd		11.95	11.99	10.67	9.66	
Power input		kW	0.10	0.11	0.20	0.23		

2 Specifications

2-5 Capacity and Power input					FFA25A9/RXM25N9	FFA35A9/RXM35N9	FFA50A9/RXM50N9	FFA60A9/RXM60N9		
Space heating (Average climate)	Energy efficiency class				A+				A	A+
	Capacity	Pdesign	kW	2.31	3.10	3.84	3.96			
	SCOP/A				4.24	4.10	3.90	4.04		
	SCOPnet/A				4.27	4.19	3.92	4.06		
	Pdh Heating capacity at -10°			kW	2.03	2.04	3.50	3.66		
	Annual energy consumption				kWh/a	762	1,058	1,377	1,372	
	Required back up heating cap at design conditions				kW	0.28	1.06	0.34	0.30	
	TOL	Tol (temperature operating limit)		°C	-15					
		Pdh (declared heating cap)		kW	2.03		3.68	3.93		
		COPd (declared COP)				2.23	2.10	1.99	2.05	
		Power input		kW	0.91	0.97	1.85	1.92		
	TBivalent	Tbiv (bivalent temperature)		°C	-7					
		Pdh (declared heating cap)		kW	2.04		3.40	3.50		
		COPd (declared COP)				3.00	2.89	2.62	2.84	
		Power input		kW	0.68	0.71	1.30	1.23		
	A Condition (-7°C)	Pdh (declared heating cap)		kW	2.04		3.40	3.50		
		COPd (declared COP)				3.00	2.89	2.62	2.84	
		Power input		kW	0.68	0.71	1.30	1.23		
	B Condition (2°C)	Pdh (declared heating cap)		kW	1.24		2.09	2.14		
		COPd (declared COP)				4.16	4.00	3.97	4.12	
		Power input		kW	0.30	0.31	0.53	0.52		
	C Condition (7°C)	Pdh (declared heating cap)		kW	1.03		1.47	1.49		
		COPd (declared COP)				5.57	5.37	4.81	4.74	
		Power input		kW	0.19		0.31			
	D Condition (12°C)	Pdh (declared heating cap)		kW	1.21		1.71	1.74		
		COPd (declared COP)				6.90	6.65	5.94	5.88	
		Power input		kW	0.18		0.29	0.30		
Cooling	Cdc (Degradation cooling)				0.25					
Heating	Cdh (Degradation heating)				0.25					
Cooling function included					Yes					
Heating function included					Yes					
Average climate included					Yes					
Cold season included					No					
Warm season included					Yes					
Ecolabel logo					No	-				
Eurovent	Sound power level outdoor	Cooling	Nom.	dBA	59	61	62	63		
	Sound power level indoor	Cooling	Nom.	dBA	48	51	56	60		
	Piping length	Cooling	Measuring condition	m	5.0					
Nominal efficiency	EER				4.57	3.81	3.24	3.05		
	COP				3.90	3.50	3.49	3.41		
	Annual energy consumption			kWh	273	446	772	934		
	Energy labeling Directive	Cooling				A			B	
		Heating				A	B			

2 Specifications

2

2-5 Capacity and Power input				FFA25A9/RXM25N9	FFA35A9/RXM35N9	FFA50A9/RXM50N9	FFA60A9/RXM60N9	
Power consumption in other than active mode	Off mode	Cooling	POFF	kW	14.0	0.014	0.015	
		Heating	POFF	kW	14.0	0.014	0.015	
	Standby mode	Cooling	PSB	kW	14.0	0.014	0.015	
		Heating	PSB	kW	14.0	0.014	0.015	
	Thermostat-off mode	Cooling	PTO	kW	7.0	0.007		
		Heating	PTO	kW	7.0	0.007		
Space heating (Warm climate)	Energy efficiency class			A+++		A++		
	Capacity	Pdesignh	kW	1.24		2.09	2.14	
	SCOP			5.29	5.10	4.78	4.74	
	SCOPnet			5.37	5.18	4.83	4.79	
	Annual energy consumption			kWh/a	329	341	612	632
	Required back up heating cap at design conditions			kW	0.00			
	TOL	Tol (temperature operating limit)		°C	-15			
		Pdh (declared heating cap)		kW	2.03		3.68	3.93
		COPd (declared COP)			2.23	2.10	1.99	2.05
		Power input		kW	0.91	0.97	1.85	1.92
	TBivalent	Tbiv (bivalent temperature)		°C	2			
		Pdh (declared heating cap)		kW	1.24		2.09	2.14
		COPd (declared COP)			4.16	4.00	3.97	4.12
		Power input		kW	0.30	0.31	0.53	0.52
	B Condition (2°C)	Pdh (declared heating cap)		kW	1.24		2.09	2.14
		COPd (declared COP)			4.16	4.00	3.97	4.12
		Power input		kW	0.30	0.31	0.53	0.52
	C Condition (7°C)	Pdh (declared heating cap)		kW	1.03		1.47	1.49
		COPd (declared COP)			5.57	5.37	4.81	4.74
		Power input		kW	0.19		0.31	
D Condition (12°C)	Pdh (declared heating cap)		kW	1.21		1.71	1.74	
	COPd (declared COP)			6.90	6.65	5.94	5.88	
	Power input		kW	0.18		0.29	0.30	

Notes

See separate drawing for electrical data

See separate drawing for operation range

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

2-6 Capacity and Power input				FBA35A9/RXM35N9	FBA50A9/RXM50N9	FBA60A9/RXM60N9
Indoor unit				FBA35A2VEB9	FBA50A2VEB9	FBA60A2VEB9
Outdoor unit				RXM35N2V1B9	RXM50N2V1B9	RXM60N2V1B9
Cooling capacity	Nom.	kW		3.40	5.00	5.70
		Btu/h		11,600	17,100	19,400
		kcal/h		2,923	4,299	4,901
Heating capacity	Nom.	kW		4.00	5.50	7.00
		Btu/h		13,600	18,800	23,900
		kcal/h		3,439	4,729	6,019
Power input	Cooling	Nom.	kW	0.85	1.41	1.64
	Heating	Nom.	kW	1.00	1.44	1.89

2 Specifications

2-6 Capacity and Power input				FBA35A9/RXM35N9	FBA50A9/RXM50N9	FBA60A9/RXM60N9
Space cooling	Energy efficiency class			A++		
	Capacity	Pdesign	kW	3.40	5.00	5.70
	SEER			6.23	6.27	5.91
	Annual energy consumption			191	279	337
	A Condition (35°C - 27/19)	Pdc	kW	3.40	5.00	5.70
		EERd		4.02	3.55	3.48
		Power input	kW	0.85	1.41	1.64
	B Condition (30°C - 27/19)	Pdc	kW	2.51	3.64	4.20
		EERd		5.54	5.26	5.05
		Power input	kW	0.45	0.69	0.83
	C Condition (25°C - 27/19)	Pdc	kW	1.73	2.36	2.70
		EERd		8.13	8.41	7.97
		Power input	kW	0.21	0.28	0.34
	D Condition (20°C - 27/19)	Pdc	kW	1.61	1.98	2.13
		EERd		9.06	10.52	8.54
		Power input	kW	0.18	0.19	0.25
Space heating (Average climate)	Energy efficiency class			A+		
	Capacity	Pdesign	kW	2.90	4.40	4.60
	SCOP/A			4.07	4.06	4.01
	SCOPnet/A			4.11	4.08	4.03
	Pdh Heating capacity at -10°		kW	2.41	3.73	3.99
	Annual energy consumption			996	1,517	1,607
	Required back up heating cap at design conditions			0.49	0.67	0.61
	TOL	Tol (temperature operating limit)		°C		
				-15		
		Pdh (declared heating cap)	kW	2.15	3.47	3.85
		COPd (declared COP)		2.37	1.95	2.11
	TBivalent	Power input		kW	0.91	1.78
		Tbiv (bivalent temperature)		°C		
				-7		
		Pdh (declared heating cap)	kW	2.57	3.89	4.09
	A Condition (-7°C)	COPd (declared COP)		2.73	3.09	3.01
		Power input	kW	0.94	1.26	1.36
		Pdh (declared heating cap)	kW	2.57	3.89	4.09
	B Condition (2°C)	COPd (declared COP)		2.73	3.09	3.01
		Power input	kW	0.94	1.26	1.36
		Pdh (declared heating cap)	kW	1.57	2.37	2.44
	C Condition (7°C)	COPd (declared COP)		4.03	4.20	4.18
		Power input	kW	0.39	0.56	0.58
		Pdh (declared heating cap)	kW	1.02	1.61	1.60
	D Condition (12°C)	COPd (declared COP)		5.18	4.55	4.41
		Power input	kW	0.20	0.35	0.36
		Pdh (declared heating cap)	kW	1.19	1.58	1.79
	Cooling	COPd (declared COP)		6.38	5.23	5.32
		Power input	kW	0.19	0.30	0.34
		Cdc (Degradation cooling)			0.25	
Heating			Cdh (Degradation heating)			
			0.25			
Cooling function included				Yes		
Heating function included				Yes		
Average climate included				Yes		
Cold season included				No		
Warm season included				Yes		

2 Specifications

2

2-6 Capacity and Power input					FBA35A9/RXM35N9	FBA50A9/RXM50N9	FBA60A9/RXM60N9	
Eurovent	Sound power level outdoor	Cooling	Nom.	dBA	61	62	63	
	Sound power level indoor	Cooling	Nom.	dBA	60		56	
	Piping length	Cooling	Measuring condition	m	5.00			
Nominal efficiency	EER				4.02	3.55	3.48	
	COP				4.02	3.83	3.71	
	Annual energy consumption			kWh	423	704	819	
	Energy labeling Directive	Cooling			A			
Heating			A					
Power consumption in other than active mode	Off mode	Cooling	POFF	kW	0.007	0.013		
		Heating	POFF	kW	0.007	0.013		
	Standby mode	Cooling	PSB	kW	0.007	0.013		
		Heating	PSB	kW	0.007	0.013		
	Thermostat-off mode	Cooling	PTO	kW	0.007	0.002		
		Heating	PTO	kW	0.007	0.002		
Space heating (Warm climate)	Energy efficiency class				A+++		A+	
	Capacity	Pdesignh	kW		1.57	2.37	2.44	
	SCOP				5.12	4.47	4.43	
	SCOPnet				5.19	4.49	4.44	
	Annual energy consumption			kWh/a	429	741	770	
	Required back up heating cap at design conditions				0.00			
	TOL	Tol (temperature operating limit)		°C		-15		
		Pdh (declared heating cap)		kW		2.15	3.47	3.85
		COPd (declared COP)				2.37	1.95	2.11
		Power input		kW		0.91	1.78	1.82
	TBivalent	Tbiv (bivalent temperature)		°C		2		
		Pdh (declared heating cap)		kW		1.57	2.37	2.44
		COPd (declared COP)				4.03	4.20	4.18
		Power input		kW		0.39	0.56	0.58
	B Condition (2°C)	Pdh (declared heating cap)		kW		1.57	2.37	2.44
		COPd (declared COP)				4.03	4.20	4.18
		Power input		kW		0.39	0.56	0.58
	C Condition (7°C)	Pdh (declared heating cap)		kW		1.02	1.61	1.60
		COPd (declared COP)				5.18	4.55	4.41
		Power input		kW		0.20	0.35	0.36
	D Condition (12°C)	Pdh (declared heating cap)		kW		1.19	1.58	1.79
		COPd (declared COP)				6.38	5.23	5.32
		Power input		kW		0.19	0.30	0.34

Notes

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

See separate drawing for operation range

See separate drawing for electrical data

2 Specifications

2-7 Capacity and Power input				FHA35A9/RXM35N9	FHA50A9/RXM50N9	FHA60A9/RXM60N9	
Indoor unit				FHA35AVEB9	FHA50AVEB9	FHA60AVEB9	
Outdoor unit				RXM35N2V1B9	RXM50N2V1B9	RXM60N2V1B9	
Cooling capacity	Nom.		kW	3.40	5.00	5.70	
			Btu/h	11,600	17,100	19,400	
			kcal/h	2,923	4,299	4,901	
Heating capacity	Nom.		kW	4.00	6.00	7.20	
			Btu/h	13,600	20,500	24,600	
			kcal/h	3,439	5,159	6,191	
Power input	Cooling	Nom.	kW	0.91	1.56	1.73	
	Heating	Nom.	kW	0.98	1.79	2.17	
Space cooling	Energy efficiency class			A++	A+		
	Capacity	Pdesign	kW	3.40	5.00	5.70	
	SEER			6.24	5.92	6.08	
	Annual energy consumption			kWh/a	191	295	328
	A Condition (35°C - 27/19)	Pdc		kW	3.40	5.00	5.70
			EERd		3.73	3.21	3.29
			Power input	kW	0.91	1.56	1.73
	B Condition (30°C - 27/19)	Pdc		kW	2.51	3.69	4.43
			EERd		5.28	5.04	4.88
			Power input	kW	0.48	0.73	0.91
	C Condition (25°C - 27/19)	Pdc		kW	1.68	2.37	2.85
			EERd		9.59	8.25	8.34
			Power input	kW	0.18	0.29	0.34
	D Condition (20°C - 27/19)	Pdc		kW	1.64	2.31	2.26
EERd			11.71	10.39	10.97		
Power input			kW	0.14	0.22	0.21	

2 Specifications

2

2-7 Capacity and Power input					FHA35A9/RXM35N9	FHA50A9/RXM50N9	FHA60A9/RXM60N9	
Space heating (Average climate)	Energy efficiency class				A+			
	Capacity				A			
		Pdesign	kW		3.10	4.35	4.71	
	SCOP/A				4.43	3.86	3.87	
	SCOPnet/A				4.47	3.88	3.89	
	Pdh Heating capacity at -10°				2.64	3.85	4.08	
	Annual energy consumption				979	1,578	1,704	
	Required back up heating cap at design conditions				0.46	0.50	0.63	
	TOL	Tol (temperature operating limit)		°C	-15			
		Pdh (declared heating cap)		kW	2.47	3.86	3.92	
		COPd (declared COP)				2.23	1.97	
		Power input		kW	1.11	1.96	1.99	
	TBivalent	Tbiv (bivalent temperature)		°C	-7			
		Pdh (declared heating cap)		kW	2.74	3.85	4.12	
		COPd (declared COP)				2.94	2.61	2.64
		Power input		kW	0.93	1.48	1.56	
	A Condition (-7°C)	Pdh (declared heating cap)		kW	2.74	3.85	4.12	
		COPd (declared COP)				2.94	2.61	2.64
		Power input		kW	0.93	1.48	1.56	
	B Condition (2°C)	Pdh (declared heating cap)		kW	1.67	2.33	2.54	
		COPd (declared COP)				4.32	3.95	3.96
		Power input		kW	0.39	0.59	0.64	
	C Condition (7°C)	Pdh (declared heating cap)		kW	1.14	1.54	1.63	
		COPd (declared COP)				5.83	4.62	4.60
		Power input		kW	0.20	0.33	0.35	
	D Condition (12°C)	Pdh (declared heating cap)		kW	1.34	1.80	1.74	
		COPd (declared COP)				7.24	5.65	
Power input		kW	0.19	0.32	0.31			
Cooling	Cdc (Degradation cooling)				0.25			
Heating	Cdh (Degradation heating)				0.25			
Cooling function included					Yes			
Heating function included					Yes			
Average climate included					Yes			
Cold season included					No			
Warm season included					Yes			
Eurovent	Sound power level outdoor	Cooling	Nom.	dBa	61	62	63	
	Sound power level indoor	Cooling	Nom.	dBa	53	54		
	Piping length	Cooling	Measuring condition	m	5.00			
Nominal efficiency	EER				3.73	3.21	3.29	
	COP				4.08	3.35	3.32	
	Annual energy consumption				456	779	866	
	Energy labeling Directive	Cooling				A		
Heating				A	C			

2 Specifications

2-7 Capacity and Power input				FHA35A9/RXM35N9	FHA50A9/RXM50N9	FHA60A9/RXM60N9	
Power consumption in other than active mode	Off mode	Cooling	POFF	kW	0.014	0.015	
		Heating	POFF	kW	0.014	0.015	
	Standby mode	Cooling	PSB	kW	0.014	0.015	
		Heating	PSB	kW	0.014	0.015	
	Thermostat-off mode	Cooling	PTO	kW	0.010		
		Heating	PTO	kW	0.010		
Space heating (Warm climate)	Energy efficiency class			A+++	A+	A++	
	Capacity	Pdesignh	kW	1.67	2.33	2.54	
	SCOP			5.72	4.59	4.61	
	SCOPnet			5.83	4.64	4.67	
	Annual energy consumption			kWh/a	409	711	771
	Required back up heating cap at design conditions			kW	0.00		
	TOL	Tol (temperature operating limit)		°C	-15		
		Pdh (declared heating cap)		kW	2.47	3.86	3.92
		COPd (declared COP)			2.23	1.97	
		Power input		kW	1.11	1.96	1.99
	TBivalent	Tbiv (bivalent temperature)		°C	2		
		Pdh (declared heating cap)		kW	1.67	2.33	2.54
		COPd (declared COP)			4.32	3.95	3.96
		Power input		kW	0.39	0.59	0.64
	B Condition (2°C)	Pdh (declared heating cap)		kW	1.67	2.33	2.54
		COPd (declared COP)			4.32	3.95	3.96
		Power input		kW	0.39	0.59	0.64
	C Condition (7°C)	Pdh (declared heating cap)		kW	1.14	1.54	1.63
		COPd (declared COP)			5.83	4.62	4.60
		Power input		kW	0.20	0.33	0.35
D Condition (12°C)	Pdh (declared heating cap)		kW	1.34	1.80	1.74	
	COPd (declared COP)			7.24	5.65		
	Power input		kW	0.19	0.32	0.31	

Notes

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

See separate drawing for operation range

See separate drawing for electrical data

2-8 Capacity and Power input				FNA25A9/RXM25N9	FNA35A9/RXM35N9	FNA50A9/RXM50N9	FNA60A9/RXM60N9	
Indoor unit				FNA25A2VEB9	FNA35A2VEB9	FNA50A2VEB9	FNA60A2VEB9	
Outdoor unit				RXM25N2V1B9	RXM35N2V1B9	RXM50N2V1B9	RXM60N2V1B9	
Cooling capacity	Nom.			kW	2.60	3.40	5.00	6.00
				Btu/h	8,872	11,600	17,100	20,500
				kcal/h	2,236	2,923	4,299	5,159
Heating capacity	Nom.			kW	3.20	4.00	5.80	7.00
				Btu/h	10,919	13,600	19,800	23,900
				kcal/h	2,752	3,439	4,987	6,019
Power input	Cooling	Nom.	kW	0.68	1.10	1.48	2.22	
	Heating	Nom.	kW	0.80	1.15	1.74	2.25	

2 Specifications

2

2-8 Capacity and Power input				FNA25A9/RXM25N9	FNA35A9/RXM35N9	FNA50A9/RXM50N9	FNA60A9/RXM60N9	
Space cooling	Energy efficiency class			A+				A
	Capacity	Pdesign	kW	2.60	3.40	5.00	6.00	
	SEER			5.68	5.70	5.77	5.56	
	Annual energy consumption			160	209	303	378	
	A Condition (35°C - 27/19)	Pdc	kW	2.60	3.40	5.00	6.00	
		EERd		3.80	3.09	3.38	2.70	
		Power input	kW	0.68	1.10	1.48	2.22	
	B Condition (30°C - 27/19)	Pdc	kW	1.92	2.50	3.68	4.42	
		EERd		5.17	4.41	5.02	4.64	
		Power input	kW	0.37	0.57	0.73	0.95	
	C Condition (25°C - 27/19)	Pdc	kW	1.27	1.61	2.37	2.84	
		EERd		8.97	9.38	7.23	7.20	
		Power input	kW	0.14	0.17	0.33	0.39	
	D Condition (20°C - 27/19)	Pdc	kW	1.33	1.46	1.74	2.34	
		EERd		10.18	10.14	10.72	10.44	
		Power input	kW	0.13	0.14	0.16	0.22	
Space heating (Average climate)	Energy efficiency class			A+				
	Capacity	Pdesign	kW	2.80	2.90	4.00	4.60	
	SCOP/A			4.24	4.05	4.09	4.16	
	SCOPnet/A			4.28	4.08	4.12	4.19	
	Pdh Heating capacity at -10°		kW	2.16	2.41	3.56	3.94	
	Annual energy consumption			924	1,002	1,369	1,547	
	Required back up heating cap at design conditions			0.64	0.49	0.44	0.66	
	TOL	Tol (temperature operating limit)		°C	-15			
		Pdh (declared heating cap)		kW	1.93	2.15	3.59	3.72
		COPd (declared COP)			2.20	2.21	1.88	1.78
		Power input		kW	0.88	0.97	1.91	2.09
	TBivalent	Tbiv (bivalent temperature)		°C	-7			
		Pdh (declared heating cap)		kW	2.48	2.57	3.54	4.07
		COPd (declared COP)			2.80	2.71	2.90	2.82
		Power input		kW	0.89	0.95	1.22	1.44
	A Condition (-7°C)	Pdh (declared heating cap)		kW	2.48	2.57	3.54	4.07
		COPd (declared COP)			2.80	2.71	2.90	2.82
		Power input		kW	0.89	0.95	1.22	1.44
	B Condition (2°C)	Pdh (declared heating cap)		kW	1.51	1.57	2.15	2.48
		COPd (declared COP)			4.18	4.01	4.13	4.22
		Power input		kW	0.36	0.39	0.52	0.59
	C Condition (7°C)	Pdh (declared heating cap)		kW	1.00	1.02	1.66	1.59
		COPd (declared COP)			5.51	5.16	5.08	
		Power input		kW	0.18	0.20	0.33	0.31
	D Condition (12°C)	Pdh (declared heating cap)		kW	1.17	1.19	1.96	1.95
		COPd (declared COP)			6.80	6.35	6.16	6.19
		Power input		kW	0.17	0.19	0.32	
	Cooling	Cdc (Degradation cooling)			0.25			
	Heating	Cdh (Degradation heating)			0.25			
	Cooling function included				Yes			
Heating function included				Yes				
Average climate included				Yes				
Cold season included				No				
Warm season included				Yes				
Ecolabel logo				No	-			

2 Specifications

2-8 Capacity and Power input					FNA25A9/RXM25N9	FNA35A9/RXM35N9	FNA50A9/RXM50N9	FNA60A9/RXM60N9	
Eurovent	Sound power level outdoor	Cooling	Nom.	dBA	59	61	62	63	
	Sound power level indoor	Cooling	Nom.	dBA	53		56		
	Piping length	Cooling	Measuring condition	m	5.0				
Nominal efficiency	EER				3.80	3.09	3.38	2.70	
	COP				4.00	3.48	3.34	3.11	
	Annual energy consumption			kWh	342	550	740	1,111	
	Energy labeling Directive	Cooling			A	B	A	D	
Heating			A	B	C	D			
Power consumption in other than active mode	Off mode	Cooling	POFF	kW	14.0	0.014	0.015		
		Heating	POFF	kW	14.0	0.014	0.015		
	Standby mode	Cooling	PSB	kW	14.0	0.014	0.015		
		Heating	PSB	kW	14.0	0.014	0.015		
	Thermostat-off mode	Cooling	PTO	kW	7.0	0.007	0.009		
		Heating	PTO	kW	7.0	0.007	0.009		
Space heating (Warm climate)	Energy efficiency class				A+++		A++		
	Capacity	Pdesignh	kW		1.51	1.57	2.15	2.48	
	SCOP				5.43	5.10	4.87	5.02	
	SCOPnet				5.50	5.17	4.93	5.08	
	Annual energy consumption			kWh/a	389	431	618	691	
	Required back up heating cap at design conditions				kW				0.00
	TOL	Tol (temperature operating limit)		°C		-15			
		Pdh (declared heating cap)		kW		1.93	2.15	3.59	3.72
		COPd (declared COP)				2.20	2.21	1.88	1.78
		Power input		kW		0.88	0.97	1.91	2.09
	TBivalent	Tbiv (bivalent temperature)		°C		2			
		Pdh (declared heating cap)		kW		1.51	1.57	2.15	2.48
		COPd (declared COP)				4.18	4.01	4.13	4.22
		Power input		kW		0.36	0.39	0.52	0.59
	B Condition (2°C)	Pdh (declared heating cap)		kW		1.51	1.57	2.15	2.48
		COPd (declared COP)				4.18	4.01	4.13	4.22
		Power input		kW		0.36	0.39	0.52	0.59
	C Condition (7°C)	Pdh (declared heating cap)		kW		1.00	1.02	1.66	1.59
		COPd (declared COP)				5.51	5.16	5.08	
		Power input		kW		0.18	0.20	0.33	0.31
D Condition (12°C)	Pdh (declared heating cap)		kW		1.17	1.19	1.96	1.95	
	COPd (declared COP)				6.80	6.35	6.16	6.19	
	Power input		kW		0.17	0.19	0.32		

Notes

See separate drawing for electrical data

See separate drawing for operation range

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

2 Specifications

2-9 Technical Specifications				RXM20N9	RXM25N9	RXM35N9	RXM42N9	RXM50N9	RXM60N9	
Capacity control	Method			Variable (inverter)						
Casing	Colour			Ivory white						
Dimensions	Unit	Height	mm	550			734			
		Width	mm	765			870			
		Depth	mm	285			373			
	Packed unit	Height	mm	612			820			
		Width	mm	906			1,050			
		Depth	mm	402			480			
Weight	Unit		kg	32			50			
	Packed unit		kg	34			54			
Packing	Weight		kg	-			4			
Heat exchanger	Length		mm	805			920			
	Rows	Quantity		2						
	Fin pitch		mm	1.4						
	Stages	Quantity		24			32			
	Passes	Quantity		3.1			2.2			
	Tube type			ø7 Hi-XD						
	Fin		Type	Waffle fin (PE)						
	Compressor	Model			1YC25GXD#C			2YC40JXD#C		
Oil Amount		cm ³	-			650				
Type			Hermetically sealed swing compressor							
Output		W	800			1,300				
Oil Type			-			FW68DA				
Fan	Type			Propeller fan						
	Air flow rate	Cooling	Nom.	m ³ /min	36.0	28.3	36.0	46.6		
				cfm	1,271	999	1,271	1,645		
		Heating	Nom.	m ³ /min	28.3			44.1		
				cfm	999			1,557		
Fan motor	Model			DFC05A3VA			D55F-31			
	Output		W	50			55			
	Speed	Cooling	High	rpm	920	860	920	760		
			Nom.	rpm	860			740		
			Low	rpm	400			640		
		Heating	High	rpm	860			720		
			Nom.	rpm	800			690	720	
			Low	rpm	400			500	660	
Sound power level	Cooling		dBA	59	58	61	62	63		
	Heating		dBA	59		61	62	63		
Sound pressure level	Cooling	Nom.	dBA	46		49	48			
	Heating	Nom.	dBA	47		49	48	49		
Refrigerant	Type			R-32						
	Charge			kg	0.76			1.10	1.15	
				TCO _{2eq}	0.52			0.75	0.78	
	Control			Expansion valve						
	GWP			675						
Piping connections	Liquid	OD	mm	6,35			6,4			
	Gas	OD	mm	9.50			12.7			
	Drain	OD	mm	18			16			
	Piping length	OU - IU	Max.	m	20			30		
		System	Chargeless	m	10			-		
	Additional refrigerant charge			kg/m	0.02 (for piping length exceeding 10m)					
	Level difference	IU - OU	Max.	m	15			20		
	Heat insulation			Both liquid and gas pipes						

2 Specifications

Standard Accessories : Drain plug; Quantity : 1;

Standard Accessories : Installation manual; Quantity : 1;

Standard Accessories : Refrigerant charge label; Quantity : 1;

Standard Accessories : Multilingual fluorinated greenhouse gases labels; Quantity : 1;

Standard Accessories : Drain cap (1); Quantity : 6;

Standard Accessories : Drain cap (2); Quantity : 3;

2-10 Electrical Specifications			RXM20N9	RXM25N9	RXM35N9	RXM42N9	RXM50N9	RXM60N9
Power supply	Phase		1~					
	Frequency	Hz	50					
	Voltage	V	220-240					
Wiring connections	For power supply	Quantity	3					
		Remark	Earth wire included					
	For connection with indoor	Quantity	4					
		Remark	Earth wire included					

Notes

Contains fluorinated greenhouse gases

See separate drawing for operation range

See separate drawing for electrical data

3 Electrical data

3 - 1 Electrical Data

RXM20-35N9

Unit combination restrictions		Power supply				COMP		OFM		IFM		
Outdoor unit	Indoor unit	Hz	Voltage	Voltage range	MCA	MFA	RHz	RLA	kW	FLA	kW	FLA
RXM20N2V1B9	FTXM20N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	9,88	10	35	2,0	0,048	0,32	0,022	0,22
		50	230					2,1				
		50	240					2,2				
RXM25N2V1B9	FTXM25N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	10,82	13	46	2,6	0,040	0,28	0,022	0,22
		50	230					2,7				
		50	240					2,8				
RXM25N2V1B9	FFA25A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	10,79	13	40	2,3	0,040	0,28	0,050	0,20
		50	230					2,5				
		50	240					2,6				
RXM25N2V1B9	FDXM25F3V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	10,92	13	39	2,1	0,040	0,28	0,034	0,30
		50	230					2,2				
		50	240					2,3				
RXM25N2V1B9	FNA25A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	11,17	13	43	2,3	0,040	0,28	0,034	0,50
		50	230					2,4				
		50	240					2,5				
RXM35N2V1B9	FTXM35N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	10,86	13	60	4,2	0,048	0,32	0,027	0,25
		50	230					4,4				
		50	240					4,6				
RXM35N2V1B9	FCAG35AVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	10,92	13	63	3,6	0,048	0,32	0,048	0,30
		50	230					3,8				
		50	240					4,0				
RXM35N2V1B9	FBA35A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	12,29	13	56	3,3	0,048	0,32	0,089	1,40
		50	230					3,5				
		50	240					3,6				
RXM35N2V1B9	FHA35AVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	11,29	13	64	3,8	0,048	0,32	0,090	0,60
		50	230					4,0				
		50	240					4,2				
RXM35N2V1B9	FFA35A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	10,79	13	64	3,6	0,048	0,32	0,050	0,20
		50	230					3,8				
		50	240					4,0				
RXM35N2V1B9	FDXM35F3V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	10,92	13	65	3,6	0,048	0,32	0,034	0,30
		50	230					3,8				
		50	240					3,9				
RXM35N2V1B9	FNA35A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	11,17	13	65	3,6	0,048	0,32	0,034	0,50
		50	230					3,8				
		50	240					3,9				
ARXM25N2V1B9	ATXM25N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	10,82	13	46	2,6	0,040	0,28	0,022	0,22
		50	230					2,7				
		50	240					2,8				
ARXM35N2V1B9	ATXM35N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	10,86	13	60	4,2	0,048	0,32	0,027	0,25
		50	230					4,4				
		50	240					4,6				

Notes

- 1) The RLA is based on the following conditions.
Outdoor temperature 35°C DB
Indoor temperature 27°C DB / 19°C WB
- 2) Select the wire size according to the MCA.
- 3) The maximum allowable voltage that is unbalanced between phases is 2%.
- 4) Use a circuit breaker instead of a fuse.

Symbols

- MCA: Minimum Circuit Ampere [A]
- MFA: Maximum Fuse Ampere [A]
- RLA: Rated load amps [A]
- OFM: Outdoor fan motor
- IFM: Indoor fan motor
- FLA: Full Load Ampere [A]
- kW: Fan motor rated output [kW]
- RHz: Rated operating frequency [Hz]

3 Electrical data

3 - 1 Electrical Data

RXM42-60N9

Unit combination restrictions		Power supply					COMP		OFM		IFM	
Outdoor unit	Indoor unit	Hz	Voltage	Voltage range	MCA	MFA	RHz	RLA	kW	FLA	kW	FLA
RXM42N2V1B9	FTXM42N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	11,62	13	49	4,4	0,056	0,37	0,028	0,22
		50	230					4,2				
		50	240					3,9				
RXM50N2V1B9	FTXM50N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	12,00	13	52	3,8	0,056	0,37	0,046	0,6
		50	230					3,5				
		50	240					3,2				
ARXM50N2V1B9	ATXM50N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	12,00	13	52	3,8	0,056	0,37	0,046	0,6
		50	230					3,5				
		50	240					3,2				
RXM50N2V1B9	FCAG50AVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	11,70	13	58	5,2	0,056	0,37	0,048	0,3
		50	230					5,0				
		50	240					4,8				
RXM50N2V1B9	FBA50AVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	12,80	13	55	5,2	0,056	0,37	0,089	1,4
		50	230					5,0				
		50	240					4,8				
RXM50N2V1B9	FHA50AVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	12,00	13	64	5,5	0,056	0,37	0,090	0,6
		50	230					5,3				
		50	240					5,2				
RXM50N2V1B9	FFA50A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	11,80	13	62	5,6	0,056	0,37	0,050	0,4
		50	230					5,4				
		50	240					5,3				
RXM50N2V1B9	FDXM50F3V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	12,30	13	55	4,9	0,056	0,37	0,060	0,9
		50	230					4,7				
		50	240					4,5				
RXM50N2V1B9	FNA50A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	11,90	13	55	4,9	0,056	0,37	0,060	0,5
		50	230					4,7				
		50	240					4,5				
RXM50N2V1B9	FVXM50FV1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	11,50	13	60	5,4	0,056	0,37	0,048	0,1
		50	230					5,2				
		50	240					5,0				
RXM60N2V1B9	FTXM60N2V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,13	16	66	5,9	0,056	0,37	0,046	0,6
		50	230					5,7				
		50	240					5,5				
RXM60N2V1B9	FCAG60AVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	14,83	16	71	6,5	0,056	0,37	0,048	0,3
		50	230					6,3				
		50	240					6,2				
RXM60N2V1B9	FBA60AVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,83	16	66	6,1	0,056	0,37	0,070	1,3
		50	230					6,0				
		50	240					5,8				
RXM60N2V1B9	FHA60AVEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,13	16	62	5,5	0,056	0,37	0,091	0,6
		50	230					5,3				
		50	240					5,1				
RXM60N2V1B9	FFA60A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,13	16	70	6,5	0,056	0,37	0,050	0,6
		50	230					6,3				
		50	240					6,2				
RXM60N2V1B9	FDXM60F3V1B	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,43	16	73	6,7	0,056	0,37	0,060	0,9
		50	230					6,5				
		50	240					6,4				
RXM60N2V1B9	FNA60A2VEB	50	220	MAX. 50Hz 264V MIN. 50Hz 198V	15,13	16	73	6,7	0,056	0,37	0,060	0,6
		50	230					6,5				
		50	240					6,4				

Notes

- 1) The RLA is based on the following conditions.
Outdoor temperature 35°C DB
Indoor temperature 27°C DB / 19°C WB
- 2) Select the wire size according to the MCA.
- 3) The maximum allowable voltage that is unbalanced between phases is 2%.
- 4) Use a circuit breaker instead of a fuse.

Symbols

- MCA: Minimum Circuit Ampere [A]
- MFA: Maximum Fuse Ampere [A]
- RLA: Rated load amps [A]
- OFM: Outdoor fan motor
- IFM: Indoor fan motor
- FLA: Full Load Ampere [A]
- kW: Fan motor rated output [kW]
- RHz: Rated operating frequency [Hz]

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

4

FBA35A9 / RXM35N9

Cooling 50 Hz 220 - 240 V

AFR	15,0
BF	0,08

Indoor temperature		Outdoor temperature [°C DB]																		
EWB	EDB	20			25			30			32			35			40			
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	
14,0	20	3,59	3,18	0,67	3,42	3,11	0,73	3,26	3,03	0,80	3,19	3,00	0,82	3,10	2,96	0,86	3,10	2,93	2,89	0,93
16,0	22	3,75	3,13	0,67	3,58	3,06	0,74	3,42	2,99	0,80	3,36	2,97	0,83	3,26	2,92	0,86	3,10	2,86	2,89	0,93
18,0	25	3,91	3,35	0,68	3,75	3,29	0,74	3,58	3,22	0,80	3,52	3,20	0,83	3,42	3,16	0,87	3,26	3,10	3,10	0,93
19,0	27	3,99	3,60	0,68	3,83	3,54	0,74	3,66	3,48	0,81	3,60	3,45	0,83	3,50	3,42	0,87	3,34	3,36	3,36	0,93
22,0	30	4,23	3,50	0,68	4,07	3,44	0,75	3,90	3,39	0,81	3,84	3,37	0,84	3,74	3,34	0,88	3,58	3,28	3,28	0,94
24,0	32	4,39	3,43	0,69	4,23	3,38	0,75	4,07	3,33	0,82	4,00	3,31	0,84	3,90	3,28	0,88	3,74	3,23	3,23	0,94

Heating 50 Hz 220 - 240 V

AFR	15,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	15,0	1,86	0,80	2,23	0,84	2,61	0,88	2,98	0,92	4,14	0,97	4,50	1,01
20,0	20,0	1,75	0,82	2,12	0,86	2,50	0,90	2,87	0,95	4,00	1,00	4,36	1,03
22,0	22,0	1,70	0,83	2,07	0,87	2,45	0,91	2,82	0,95	3,94	1,00	4,31	1,04
24,0	24,0	1,65	0,84	2,03	0,88	2,40	0,92	2,78	0,96	3,89	1,01	4,25	1,05
25,0	25,0	1,63	0,85	2,01	0,89	2,38	0,93	2,76	0,97	3,86	1,02	4,22	1,05
27,0	27,0	1,59	0,85	1,96	0,90	2,33	0,94	2,71	0,98	3,81	1,03	4,17	1,06

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110072A

FBA50A9 / RXM50N9

Cooling 50 Hz 220 - 240 V

AFR	15,0
BF	0,13

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,12	3,84	1,08	4,89	3,72	1,18	4,66	3,61	1,29	4,56	3,56	1,33	4,42	3,49	1,39	4,19	3,38	1,50
16,0	22	5,35	3,77	1,09	5,12	3,66	1,19	4,89	3,55	1,29	4,79	3,51	1,34	4,65	3,45	1,40	4,42	3,34	1,50
18,0	25	5,58	3,95	1,09	5,35	3,85	1,20	5,12	3,75	1,30	5,02	3,71	1,34	4,88	3,66	1,40	4,65	3,56	1,51
19,0	27	5,70	4,18	1,10	5,47	4,08	1,20	5,23	3,98	1,30	5,14	3,94	1,35	5,00	3,89	1,41	4,77	3,79	1,51
22,0	30	6,04	4,03	1,11	5,81	3,94	1,21	5,58	3,86	1,31	5,49	3,82	1,35	5,35	3,77	1,42	5,11	3,69	1,52
24,0	32	6,27	3,92	1,11	6,04	3,85	1,22	5,81	3,77	1,32	5,72	3,74	1,36	5,58	3,69	1,42	5,34	3,62	1,53

Heating 50 Hz 220 - 240 V

AFR	15,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	15,0	2,56	1,16	3,07	1,21	3,59	1,27	4,10	1,33	5,69	1,40	6,19	1,45
20,0	20,0	2,40	1,19	2,92	1,25	3,43	1,31	3,95	1,37	5,50	1,44	6,00	1,48
22,0	22,0	2,34	1,20	2,85	1,26	3,37	1,32	3,88	1,38	5,42	1,45	5,92	1,50
24,0	24,0	2,27	1,21	2,79	1,27	3,30	1,33	3,82	1,39	5,35	1,46	5,84	1,51
25,0	25,0	2,24	1,22	2,76	1,28	3,27	1,34	3,79	1,40	5,31	1,47	5,81	1,52
27,0	27,0	2,18	1,23	2,69	1,29	3,21	1,35	3,73	1,41	5,23	1,48	5,73	1,53

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110073B

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

FBA60A9 / RXM60N9

Cooling 50 Hz 220 - 240 V

AFR	18,0
BF	0,15

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,84	4,42	1,26	5,57	4,28	1,38	5,31	4,16	1,50	5,20	4,10	1,55	5,04	4,03	1,62	4,78	3,90	1,74
16,0	22	6,10	4,34	1,26	5,84	4,22	1,38	5,57	4,09	1,51	5,47	4,05	1,55	5,31	3,97	1,63	5,04	3,86	1,75
18,0	25	6,36	4,56	1,27	6,10	4,44	1,39	5,83	4,33	1,51	5,73	4,29	1,56	5,57	4,22	1,63	5,30	4,11	1,76
19,0	27	6,50	4,82	1,27	6,23	4,71	1,40	5,97	4,60	1,52	5,86	4,56	1,57	5,70	4,49	1,64	5,43	4,39	1,76
22,0	30	6,89	4,65	1,29	6,62	4,55	1,41	6,36	4,46	1,53	6,25	4,42	1,58	6,09	4,36	1,65	5,83	4,27	1,77
24,0	32	7,15	4,53	1,29	6,89	4,44	1,41	6,62	4,36	1,54	6,52	4,32	1,58	6,36	4,27	1,66	6,09	4,18	1,78

Heating 50 Hz 220 - 240 V

AFR	18,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	15,0	3,39	1,52	4,08	1,60	4,76	1,67	5,44	1,75	7,24	1,84	7,87	1,91
20,0	20,0	3,18	1,56	3,87	1,64	4,55	1,72	5,23	1,79	7,00	1,89	7,63	1,95
22,0	22,0	3,10	1,58	3,78	1,66	4,47	1,73	5,15	1,81	6,90	1,90	7,54	1,97
24,0	24,0	3,02	1,59	3,70	1,67	4,38	1,75	5,07	1,83	6,81	1,92	7,44	1,98
25,0	25,0	2,97	1,60	3,66	1,68	4,34	1,76	5,03	1,84	6,76	1,93	7,39	1,99
27,0	27,0	2,89	1,62	3,57	1,70	4,26	1,78	4,94	1,85	6,66	1,95	7,29	2,01

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110074B

FCAG35B / RXM35N9

Cooling 50 Hz 220 - 240 V

AFR	12,5
BF	0,4

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	3,08	2,27	0,63	3,08	2,27	0,72	3,08	2,27	0,81	3,08	2,27	0,85	3,01	2,24	0,89	2,85	2,16	0,96
16,0	22	3,64	2,44	0,70	3,48	2,36	0,76	3,32	2,28	0,83	3,26	2,25	0,86	3,17	2,21	0,90	3,01	2,13	0,96
18,0	25	3,80	2,54	0,70	3,64	2,46	0,77	3,48	2,39	0,83	3,42	2,36	0,86	3,32	2,32	0,90	3,16	2,25	0,97
19,0	27	3,87	2,66	0,70	3,72	2,59	0,77	3,56	2,52	0,84	3,49	2,49	0,86	3,40	2,45	0,90	3,24	2,39	0,97
22,0	30	4,11	2,56	0,71	3,95	2,50	0,77	3,79	2,44	0,84	3,73	2,41	0,87	3,63	2,38	0,91	3,48	2,32	0,97
24,0	32	4,27	2,49	0,71	4,11	2,43	0,78	3,95	2,37	0,85	3,89	2,35	0,87	3,79	2,32	0,91	3,63	2,26	0,98

Heating 50 Hz 220 - 240 V

AFR	12,5
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	15,0	1,95	0,97	2,35	1,01	2,74	1,06	3,13	1,11	4,34	1,17	4,72	1,21
20,0	20,0	1,83	0,99	2,23	1,04	2,62	1,09	3,01	1,14	4,20	1,20	4,58	1,24
22,0	22,0	1,78	1,00	2,18	1,05	2,57	1,10	2,97	1,15	4,14	1,21	4,52	1,25
24,0	24,0	1,74	1,01	2,13	1,06	2,52	1,11	2,92	1,16	4,08	1,22	4,46	1,26
25,0	25,0	1,71	1,02	2,11	1,07	2,50	1,12	2,89	1,17	4,06	1,23	4,43	1,27
27,0	27,0	1,66	1,03	2,06	1,08	2,45	1,13	2,85	1,18	4,00	1,24	4,38	1,28

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110075A

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

4

FCAG50B / RXM50N9

Cooling 50 Hz 220 - 240 V

AFR	12,6
BF	0,22

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	4,03	2,98	0,91	4,03	2,98	1,04	4,03	2,98	1,17	4,03	2,98	1,23	4,03	2,98	1,31	4,03	2,98	1,46
16,0	22	5,13	3,37	1,05	5,12	3,37	1,18	4,89	3,25	1,28	4,79	3,21	1,33	4,65	3,14	1,39	4,42	3,03	1,49
18,0	25	5,58	3,61	1,08	5,35	3,50	1,19	5,12	3,39	1,29	5,02	3,35	1,33	4,88	3,28	1,39	4,65	3,18	1,50
19,0	27	5,70	3,77	1,09	5,47	3,66	1,19	5,23	3,55	1,29	5,14	3,51	1,34	5,00	3,45	1,40	4,77	3,35	1,50
22,0	30	6,04	3,62	1,10	5,81	3,52	1,20	5,58	3,43	1,30	5,49	3,39	1,34	5,35	3,34	1,41	5,11	3,25	1,51
24,0	32	6,27	3,51	1,10	6,04	3,42	1,21	5,81	3,34	1,31	5,72	3,30	1,35	5,58	3,25	1,41	5,34	3,17	1,52

Heating 50 Hz 220 - 240 V

AFR	12,6
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	2,79	1,30	3,35	1,37	3,91	1,44	4,48	1,50	6,21	1,59	6,75	1,64	6,75
20,0	2,62	1,34	3,18	1,41	3,74	1,47	4,31	1,54	6,00	1,62	6,54	1,68	6,54
22,0	2,55	1,36	3,11	1,42	3,67	1,49	4,24	1,56	5,92	1,64	6,31	1,69	6,31
24,0	2,48	1,37	3,04	1,44	3,61	1,50	4,17	1,57	5,83	1,65	6,18	1,70	6,18
25,0	2,45	1,38	3,01	1,44	3,57	1,51	4,13	1,58	5,63	1,66	6,03	1,71	6,03
27,0	2,38	1,39	2,94	1,46	3,50	1,53	4,06	1,59	5,18	1,67	5,18	1,73	5,18

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature [°C WB]
- EDB : Entering dry-bulb temperature [°C DB]
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110076B

FCAG60B / RXM60N9

Cooling 50 Hz 220 - 240 V

AFR	13,6
BF	0,2

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	4,47	3,30	1,12	4,47	3,30	1,28	4,47	3,30	1,44	4,47	3,30	1,51	4,47	3,30	1,61	4,47	3,30	1,78
16,0	22	5,68	3,73	1,27	5,68	3,73	1,43	5,57	3,68	1,58	5,47	3,63	1,63	5,31	3,55	1,71	5,04	3,42	1,84
18,0	25	6,36	4,09	1,34	6,10	3,96	1,16	5,83	3,83	1,59	5,73	3,78	1,64	5,57	3,71	1,72	5,30	3,59	1,85
19,0	27	6,50	4,26	1,34	6,23	4,14	1,47	5,97	4,01	1,59	5,86	3,97	1,65	5,70	3,89	1,72	5,43	3,78	1,85
22,0	30	6,89	4,09	1,35	6,62	3,98	1,48	6,36	3,87	1,61	6,25	3,83	1,66	6,09	3,76	1,73	5,83	3,66	1,86
24,0	32	7,15	3,96	1,36	6,89	3,86	1,49	6,62	3,76	1,61	6,52	3,73	1,66	6,36	3,67	1,74	6,09	3,57	1,87

Heating 50 Hz 220 - 240 V

AFR	13,6
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	3,39	1,67	4,08	1,75	4,76	1,84	5,44	1,92	7,24	2,02	7,87	2,09	7,87
20,0	3,18	1,71	3,87	1,80	4,55	1,88	5,23	1,97	7,00	2,07	7,63	2,14	7,63
22,0	3,10	1,73	3,78	1,82	4,47	1,90	5,15	1,99	6,90	2,09	7,54	2,16	7,54
24,0	3,02	1,75	3,70	1,84	4,38	1,92	5,07	2,01	6,81	2,11	7,38	2,18	7,38
25,0	2,97	1,76	3,66	1,84	4,34	1,93	5,03	2,02	6,76	2,12	7,13	2,19	7,13
27,0	2,89	1,78	3,57	1,86	4,26	1,95	4,94	2,03	6,64	2,14	6,64	2,20	6,64

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature [°C WB]
- EDB : Entering dry-bulb temperature [°C DB]
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110077B

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

FDXM25F9 / RXM25N9

Cooling 50 Hz 220 - 240 V

AFR	8,7
BF	0,17

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	2,46	1,94	0,49	2,35	1,88	0,54	2,24	1,83	0,59	2,19	1,81	0,61	2,12	1,78	0,63	2,01	1,73	0,68
16,0	22	2,57	1,91	0,50	2,46	1,86	0,54	2,35	1,81	0,59	2,30	1,79	0,61	2,23	1,76	0,64	2,12	1,71	0,68
18,0	25	2,68	2,01	0,50	2,57	1,97	0,55	2,46	1,92	0,59	2,41	1,90	0,61	2,34	1,87	0,64	2,23	1,83	0,69
19,0	27	2,74	2,14	0,50	2,62	2,09	0,55	2,51	2,05	0,59	2,47	2,03	0,61	2,40	2,00	0,64	2,29	1,96	0,69
22,0	30	2,90	2,07	0,50	2,79	2,03	0,55	2,68	1,99	0,60	2,63	1,97	0,62	2,57	1,95	0,65	2,45	1,91	0,69
24,0	32	3,01	2,02	0,51	2,90	1,98	0,55	2,79	1,95	0,60	2,74	1,93	0,62	2,68	1,91	0,65	2,56	1,88	0,70

Heating 50 Hz 220 - 240 V

AFR	8,7
-----	-----

Indoor temperature		Outdoor temperature [°C WB]											
EDB		-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0		1,49	0,64	1,79	0,68	2,09	0,71	2,39	0,74	3,31	0,78	3,60	0,81
20,0		1,40	0,66	1,70	0,69	2,00	0,73	2,30	0,76	3,20	0,80	3,49	0,83
22,0		1,36	0,67	1,66	0,70	1,96	0,73	2,26	0,77	3,16	0,81	3,44	0,83
24,0		1,32	0,68	1,62	0,71	1,92	0,74	2,22	0,77	3,11	0,81	3,40	0,84
25,0		1,30	0,68	1,60	0,71	1,90	0,75	2,20	0,78	3,09	0,82	3,38	0,84
27,0		1,27	0,69	1,57	0,72	1,87	0,75	2,17	0,79	3,05	0,83	3,33	0,85

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110078A

FDXM35F9 / RXM35N9

Cooling 50 Hz 220 - 240 V

AFR	8,7
BF	0,17

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	2,96	2,19	0,78	2,96	2,19	0,89	2,96	2,19	1,01	2,96	2,19	1,05	2,96	2,19	1,13	2,85	2,13	1,22
16,0	22	3,64	2,42	0,89	3,48	2,34	0,97	3,32	2,26	1,06	3,26	2,23	1,09	3,17	2,18	1,14	3,01	2,11	1,23
18,0	25	3,80	2,51	0,89	3,64	2,43	0,98	3,48	2,36	1,06	3,42	2,33	1,10	3,32	2,29	1,15	3,16	2,22	1,23
19,0	27	3,87	2,63	0,89	3,72	2,55	0,98	3,56	2,48	1,06	3,49	2,46	1,10	3,40	2,42	1,15	3,24	2,35	1,23
22,0	30	4,11	2,52	0,90	3,95	2,46	0,99	3,79	2,40	1,07	3,73	2,38	1,11	3,63	2,34	1,16	3,48	2,28	1,24
24,0	32	4,27	2,45	0,91	4,11	2,39	0,99	3,95	2,34	1,08	3,89	2,32	1,11	3,79	2,28	1,16	3,63	2,23	1,25

Heating 50 Hz 220 - 240 V

AFR	8,7
-----	-----

Indoor temperature		Outdoor temperature [°C WB]											
EDB		-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0		1,86	0,92	2,23	0,97	2,61	1,02	2,98	1,07	4,14	1,12	4,50	1,16
20,0		1,75	0,95	2,12	1,00	2,50	1,05	2,87	1,09	4,00	1,15	4,36	1,19
22,0		1,70	0,96	2,07	1,01	2,45	1,06	2,82	1,10	3,94	1,16	4,31	1,20
24,0		1,65	0,97	2,03	1,02	2,40	1,07	2,78	1,11	3,89	1,17	4,25	1,21
25,0		1,63	0,98	2,01	1,02	2,38	1,07	2,76	1,12	3,86	1,18	4,22	1,21
27,0		1,59	0,99	1,96	1,03	2,33	1,08	2,71	1,13	3,81	1,19	4,02	1,21

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110079A

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

4

FDXM50F9 / RXM50N9

Cooling 50 Hz 220 - 240 V

AFR	15,8
BF	0,11

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	4,38	3,24	1,15	4,38	3,24	1,30	4,38	3,24	1,46	4,38	3,24	1,53	4,38	3,24	1,61	4,17	3,13	1,75
16,0	22	5,35	3,56	1,27	5,12	3,44	1,40	4,89	3,33	1,52	4,79	3,28	1,57	4,65	3,22	1,62	4,37	3,08	1,75
18,0	25	5,58	3,70	1,28	5,35	3,59	1,40	5,12	3,48	1,52	5,02	3,44	1,57	4,88	3,38	1,63	4,58	3,24	1,75
19,0	27	5,70	3,87	1,28	5,47	3,76	1,41	5,23	3,66	1,53	5,14	3,62	1,58	5,00	3,56	1,63	4,68	3,42	1,75
22,0	30	6,04	3,72	1,30	5,81	3,63	1,42	5,58	3,54	1,54	5,49	3,50	1,59	5,35	3,45	1,65	4,97	3,31	1,75
24,0	32	6,27	3,61	1,30	6,04	3,53	1,42	5,81	3,45	1,55	5,72	3,41	1,60	5,58	3,36	1,66	5,17	3,22	1,75

Heating 50 Hz 220 - 240 V

AFR	15,8
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB		-15		-10		-5		0		6		10	
°C		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0		2,70	1,51	3,24	1,58	3,78	1,66	4,33	1,74	6,00	1,83	6,52	1,89
20,0		2,53	1,55	3,07	1,62	3,62	1,70	4,16	1,78	5,80	1,87	6,32	1,93
22,0		2,46	1,56	3,01	1,64	3,55	1,72	4,10	1,80	5,72	1,89	6,24	1,95
24,0		2,40	1,58	2,94	1,66	3,49	1,74	4,03	1,81	5,64	1,90	5,96	1,97
25,0		2,36	1,59	2,91	1,67	3,45	1,74	4,00	1,82	5,60	1,91	5,73	1,97
27,0		2,30	1,61	2,84	1,68	3,39	1,76	3,93	1,84	5,27	1,93	5,27	1,99

Symbols
 AFR : Air flow rate [m³/min]
 BF : Bypass factor
 EWB : Entering wet-bulb temperature (°C WB)
 EDB : Entering dry-bulb temperature (°C DB)
 TC : Total capacity [kW]
 SHC : Sensible heat capacity [kW]
 PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
 Corresponding refrigerant piping length: 5 m
 Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110080B

FDXM60F9 / RXM60N9

Cooling 50 Hz 220 - 240 V

AFR	16,0
BF	0,12

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,78	4,27	1,53	5,78	4,27	1,72	5,59	4,17	1,89	5,48	4,11	1,95	5,31	4,03	2,03	4,37	3,58	2,01
16,0	22	6,42	4,38	1,59	6,14	4,24	1,74	5,86	4,11	1,90	5,75	4,06	1,96	5,59	3,98	2,04	4,59	3,53	2,01
18,0	25	6,70	4,57	1,60	6,42	4,44	1,75	6,14	4,32	1,91	6,03	4,27	1,97	5,86	4,20	2,05	4,81	3,75	2,01
19,0	27	6,84	4,80	1,60	6,56	4,68	1,76	6,28	4,56	1,91	6,17	4,51	1,97	6,00	4,44	2,05	4,92	4,00	2,01
22,0	30	7,25	4,62	1,62	6,97	4,52	1,77	6,69	4,41	1,92	6,58	4,37	1,98	6,41	4,31	2,07	5,24	3,89	2,01
24,0	32	7,53	4,50	1,63	7,25	4,40	1,78	6,97	4,30	1,93	6,86	4,26	1,99	6,69	4,21	2,07	5,46	3,80	2,01

Heating 50 Hz 220 - 240 V

AFR	16,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB		-15		-10		-5		0		6		10	
°C		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0		3,39	1,75	4,08	1,84	4,76	1,93	5,44	2,02	7,24	2,13	7,87	2,20
20,0		3,18	1,80	3,87	1,89	4,55	1,98	5,23	2,07	7,00	2,18	7,63	2,25
22,0		3,10	1,82	3,78	1,91	4,47	2,00	5,15	2,09	6,90	2,20	7,54	2,27
24,0		3,02	1,84	3,70	1,93	4,38	2,02	5,07	2,11	6,81	2,22	7,44	2,29
25,0		2,97	1,85	3,66	1,94	4,34	2,03	5,03	2,12	6,76	2,23	7,39	2,30
27,0		2,89	1,87	3,57	1,96	4,26	2,05	4,94	2,14	6,66	2,25	7,29	2,32

Symbols
 AFR : Air flow rate [m³/min]
 BF : Bypass factor
 EWB : Entering wet-bulb temperature (°C WB)
 EDB : Entering dry-bulb temperature (°C DB)
 TC : Total capacity [kW]
 SHC : Sensible heat capacity [kW]
 PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
 Corresponding refrigerant piping length: 5 m
 Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110081B

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

FFA25A9 / RXM25N9

Cooling

50 Hz 220 - 240 V

AFR	9,0
BF	0,24

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	2,56	1,95	0,42	2,44	1,89	0,46	2,33	1,84	0,50	2,28	1,81	0,52	2,21	1,78	0,54	2,10	1,72	0,58
16,0	22	2,68	1,92	0,42	2,56	1,86	0,46	2,44	1,81	0,50	2,40	1,79	0,52	2,33	1,76	0,54	2,21	1,71	0,58
18,0	25	2,79	2,01	0,42	2,68	1,96	0,46	2,56	1,92	0,51	2,51	1,90	0,52	2,44	1,87	0,55	2,33	1,82	0,59
19,0	27	2,85	2,13	0,43	2,73	2,08	0,47	2,62	2,04	0,51	2,57	2,02	0,52	2,50	1,99	0,55	2,38	1,94	0,59
22,0	30	3,02	2,06	0,43	2,91	2,02	0,47	2,79	1,97	0,51	2,74	1,96	0,53	2,67	1,93	0,55	2,56	1,89	0,59
24,0	32	3,14	2,01	0,43	3,02	1,97	0,47	2,90	1,93	0,51	2,86	1,91	0,53	2,79	1,89	0,55	2,67	1,85	0,59

Heating

50 Hz 220 - 240 V

AFR	9,0
-----	-----

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	15,0	1,49	0,66	1,79	0,69	2,09	0,73	2,39	0,76	3,31	0,80	3,60	0,83
20,0	20,0	1,40	0,68	1,70	0,71	2,00	0,75	2,30	0,78	3,20	0,82	3,49	0,85
22,0	22,0	1,36	0,69	1,66	0,72	1,96	0,75	2,26	0,79	3,16	0,83	3,44	0,85
24,0	24,0	1,32	0,69	1,62	0,73	1,92	0,76	2,22	0,79	3,11	0,84	3,40	0,86
25,0	25,0	1,30	0,70	1,60	0,73	1,90	0,76	2,20	0,80	3,09	0,84	3,38	0,87
27,0	27,0	1,27	0,70	1,57	0,74	1,87	0,77	2,17	0,81	3,05	0,85	3,33	0,87

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110082A

FFA35A9 / RXM35N9

Cooling

50 Hz 220 - 240 V

AFR	10,0
BF	0,25

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	3,08	2,27	0,62	3,08	2,27	0,71	3,08	2,27	0,80	3,08	2,27	0,84	3,01	2,24	0,88	2,85	2,16	0,95
16,0	22	3,64	2,44	0,69	3,48	2,36	0,75	3,32	2,28	0,82	3,26	2,25	0,85	3,17	2,21	0,89	3,01	2,13	0,95
18,0	25	3,80	2,54	0,69	3,64	2,46	0,76	3,48	2,39	0,82	3,42	2,36	0,85	3,32	2,32	0,89	3,16	2,25	0,96
19,0	27	3,87	2,66	0,69	3,72	2,59	0,76	3,56	2,52	0,83	3,49	2,49	0,85	3,40	2,45	0,89	3,24	2,39	0,96
22,0	30	4,11	2,56	0,70	3,95	2,50	0,77	3,79	2,44	0,83	3,73	2,41	0,86	3,63	2,38	0,90	3,48	2,32	0,96
24,0	32	4,27	2,49	0,70	4,11	2,43	0,77	3,95	2,37	0,84	3,89	2,35	0,86	3,79	2,32	0,90	3,63	2,26	0,97

Heating

50 Hz 220 - 240 V

AFR	10,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	15,0	1,95	0,97	2,35	1,01	2,74	1,06	3,13	1,11	4,34	1,17	4,72	1,21
20,0	20,0	1,83	0,99	2,23	1,04	2,62	1,09	3,01	1,14	4,20	1,20	4,58	1,24
22,0	22,0	1,78	1,00	2,18	1,05	2,57	1,10	2,97	1,15	4,14	1,21	4,52	1,25
24,0	24,0	1,74	1,01	2,13	1,06	2,52	1,11	2,92	1,16	4,08	1,22	4,46	1,26
25,0	25,0	1,71	1,02	2,11	1,07	2,50	1,12	2,89	1,17	4,06	1,23	4,43	1,27
27,0	27,0	1,66	1,03	2,06	1,08	2,45	1,13	2,85	1,18	4,00	1,24	4,38	1,28

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110083A

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

4

FFA50A9 / RXM50N9

Cooling

50 Hz 220 - 240 V

AFR	12,7
BF	0,16

Indoor temperature		Outdoor temperature [°C DB]																	
EWB °C	EDB °C	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	4,14	3,06	1,03	4,14	3,06	1,17	4,14	3,06	1,32	4,14	3,06	1,38	4,14	3,06	1,47	4,14	3,06	1,63
16,0	22	5,26	3,46	1,18	5,12	3,39	1,30	4,89	3,27	1,42	4,79	3,23	1,46	4,65	3,16	1,53	4,42	3,05	1,65
18,0	25	5,58	3,64	1,20	5,35	3,53	1,31	5,12	3,42	1,43	5,02	3,37	1,47	4,88	3,31	1,54	4,65	3,21	1,65
19,0	27	5,70	3,80	1,20	5,47	3,69	1,31	5,23	3,59	1,43	5,14	3,54	1,47	5,00	3,48	1,54	4,77	3,38	1,66
22,0	30	6,04	3,65	1,21	5,81	3,55	1,33	5,58	3,46	1,44	5,49	3,42	1,48	5,35	3,37	1,55	5,11	3,28	1,67
24,0	32	6,27	3,54	1,22	6,04	3,45	1,33	5,81	3,37	1,45	5,72	3,34	1,49	5,58	3,29	1,56	5,34	3,20	1,67

Heating

50 Hz 220 - 240 V

AFR	12,7
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB °C	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	2,70	1,34	3,24	1,41	3,78	1,47	4,33	1,54	6,00	1,62	6,52	1,68	
20,0	2,53	1,37	3,07	1,44	3,62	1,51	4,16	1,58	5,80	1,66	6,32	1,72	
22,0	2,46	1,39	3,01	1,46	3,55	1,53	4,10	1,59	5,72	1,68	6,21	1,73	
24,0	2,40	1,40	2,94	1,47	3,49	1,54	4,03	1,61	5,64	1,69	6,11	1,75	
25,0	2,36	1,41	2,91	1,48	3,45	1,55	4,00	1,62	5,55	1,70	6,02	1,75	
27,0	2,30	1,43	2,84	1,50	3,39	1,56	3,93	1,63	5,10	1,71	5,10	1,77	

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110085B

FFA60A9 / RXM60N9

Cooling

50 Hz 220 - 240 V

AFR	14,5
BF	0,11

Indoor temperature		Outdoor temperature [°C DB]																	
EWB °C	EDB °C	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,30	3,91	1,36	5,30	3,91	1,53	5,30	3,91	1,71	5,20	3,86	1,77	5,04	3,78	1,85	4,78	3,65	1,99
16,0	22	6,10	4,12	1,44	5,84	3,99	1,58	5,57	3,86	1,72	5,47	3,81	1,77	5,31	3,73	1,86	5,04	3,61	1,99
18,0	25	6,36	4,29	1,45	6,10	4,17	1,59	5,83	4,05	1,73	5,73	4,00	1,78	5,57	3,93	1,86	5,30	3,82	2,00
19,0	27	6,50	4,50	1,45	6,23	4,38	1,59	5,97	4,27	1,73	5,86	4,22	1,79	5,70	4,16	1,87	5,43	4,05	2,01
22,0	30	6,89	4,33	1,47	6,62	4,23	1,61	6,36	4,13	1,74	6,25	4,09	1,80	6,09	4,03	1,88	5,78	3,91	2,01
24,0	32	7,15	4,21	1,48	6,89	4,12	1,61	6,62	4,02	1,75	6,52	3,99	1,81	6,36	3,93	1,89	6,01	3,82	2,01

Heating

50 Hz 220 - 240 V

AFR	14,5
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB °C	°C	-15		-10		-5		0		6		10	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	3,39	1,65	4,08	1,74	4,76	1,82	5,44	1,91	7,24	2,01	7,87	2,07	
20,0	3,18	1,70	3,87	1,78	4,55	1,87	5,23	1,95	7,00	2,05	7,63	2,12	
22,0	3,10	1,72	3,78	1,80	4,47	1,89	5,15	1,97	6,90	2,07	7,54	2,14	
24,0	3,02	1,73	3,70	1,82	4,38	1,90	5,07	1,99	6,81	2,09	7,44	2,16	
25,0	2,97	1,74	3,66	1,83	4,34	1,91	5,03	2,00	6,76	2,10	7,39	2,17	
27,0	2,89	1,76	3,57	1,85	4,26	1,93	4,94	2,02	6,66	2,12	7,29	2,19	

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110084B

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

FHA35A9 / RXM35N9

Cooling

50 Hz 220 - 240 V

AFR	14,0
BF	0,17

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	3,48	2,89	0,70	3,33	2,82	0,77	3,17	2,75	0,83	3,10	2,72	0,86	3,01	2,67	0,90	2,85	2,60	0,97
16,0	22	3,64	2,85	0,70	3,48	2,78	0,77	3,32	2,71	0,84	3,26	2,68	0,87	3,17	2,64	0,91	3,01	2,57	0,97
18,0	25	3,80	3,03	0,71	3,64	2,96	0,77	3,48	2,90	0,84	3,42	2,87	0,87	3,32	2,83	0,91	3,16	2,77	0,98
19,0	27	3,87	3,23	0,71	3,72	3,17	0,78	3,56	3,11	0,84	3,49	3,08	0,87	3,40	3,05	0,91	3,24	2,99	0,98
22,0	30	4,11	3,13	0,72	3,95	3,08	0,78	3,79	3,02	0,85	3,73	3,00	0,88	3,63	2,97	0,92	3,48	2,92	0,98
24,0	32	4,27	3,06	0,72	4,11	3,01	0,79	3,95	2,96	0,85	3,89	2,95	0,88	3,79	2,92	0,92	3,63	2,87	0,99

Heating

50 Hz 220 - 240 V

AFR	14,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	15,0	1,86	0,79	2,23	0,83	2,61	0,87	2,98	0,91	4,14	0,96	4,50	0,99
20,0	20,0	1,75	0,81	2,12	0,85	2,50	0,89	2,87	0,93	4,00	0,98	4,36	1,01
22,0	22,0	1,70	0,82	2,07	0,86	2,45	0,90	2,82	0,94	3,94	0,99	4,31	1,02
24,0	24,0	1,65	0,83	2,03	0,87	2,40	0,91	2,78	0,95	3,89	1,00	4,25	1,03
25,0	25,0	1,63	0,83	2,01	0,87	2,38	0,91	2,76	0,95	3,86	1,00	4,22	1,03
27,0	27,0	1,59	0,84	1,96	0,88	2,33	0,92	2,71	0,96	3,81	1,01	4,17	1,04

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110086A

FHA50A9 / RXM50N9

Cooling

50 Hz 220 - 240 V

AFR	15,0
BF	0,18

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,05	3,73	1,18	4,89	3,65	1,31	4,66	3,53	1,43	4,56	3,49	1,47	4,42	3,42	1,54	4,19	3,30	1,66
16,0	22	5,35	3,70	1,20	5,12	3,59	1,32	4,89	3,48	1,43	4,79	3,44	1,48	4,65	3,37	1,55	4,42	3,27	1,66
18,0	25	5,58	3,87	1,21	5,35	3,77	1,32	5,12	3,66	1,44	5,02	3,62	1,49	4,88	3,56	1,55	4,65	3,47	1,67
19,0	27	5,70	4,08	1,21	5,47	3,98	1,33	5,23	3,88	1,44	5,14	3,84	1,49	5,00	3,78	1,56	4,77	3,69	1,67
22,0	30	6,04	3,93	1,22	5,81	3,84	1,34	5,58	3,75	1,45	5,49	3,72	1,50	5,35	3,67	1,57	5,11	3,58	1,68
24,0	32	6,27	3,82	1,23	6,04	3,74	1,34	5,81	3,66	1,46	5,72	3,63	1,51	5,58	3,59	1,58	5,34	3,51	1,69

Heating

50 Hz 220 - 240 V

AFR	15,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	15,0	2,79	1,44	3,35	1,51	3,91	1,59	4,48	1,66	6,21	1,75	6,75	1,81
20,0	20,0	2,62	1,48	3,18	1,56	3,74	1,63	4,31	1,70	6,00	1,79	6,54	1,85
22,0	22,0	2,55	1,50	3,11	1,57	3,67	1,64	4,24	1,72	5,92	1,81	6,46	1,87
24,0	24,0	2,48	1,51	3,04	1,59	3,61	1,66	4,17	1,73	5,83	1,82	6,38	1,88
25,0	25,0	2,45	1,52	3,01	1,60	3,57	1,67	4,13	1,74	5,79	1,83	6,33	1,89
27,0	27,0	2,38	1,54	2,94	1,61	3,50	1,69	4,06	1,76	5,71	1,85	6,25	1,91

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110087B

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

4

FHA60A9/ RXM60N9

Cooling 50 Hz 220 - 240 V

AFR	19,5
BF	0,2

Indoor temperature		Outdoor temperature [°C DB]																	
EWB °C	EDB °C	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,84	4,45	1,33	5,57	4,32	1,46	5,31	4,19	1,59	5,20	4,13	1,64	5,04	4,06	1,71	4,78	3,93	1,84
16,0	22	6,10	4,37	1,34	5,84	4,25	1,47	5,57	4,13	1,59	5,47	4,08	1,64	5,31	4,01	1,72	5,04	3,89	1,85
18,0	25	6,36	4,59	1,34	6,10	4,48	1,47	5,83	4,37	1,60	5,73	4,32	1,65	5,57	4,26	1,73	5,30	4,15	1,86
19,0	27	6,50	4,86	1,35	6,23	4,75	1,48	5,97	4,64	1,60	5,86	4,60	1,66	5,70	4,54	1,73	5,43	4,43	1,86
22,0	30	6,89	4,69	1,36	6,62	4,60	1,49	6,36	4,50	1,62	6,25	4,46	1,67	6,09	4,41	1,74	5,83	4,31	1,87
24,0	32	7,15	4,57	1,37	6,89	4,49	1,50	6,62	4,40	1,62	6,52	4,36	1,68	6,36	4,31	1,75	6,09	4,23	1,88

Heating 50 Hz 220 - 240 V

AFR	19,5
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB °C	TC	-15		-10		-5		0		6		10	
		PI	SHC	PI	SHC	PI	SHC	PI	SHC	PI	SHC	PI	SHC
15,0	3,49	1,74	4,19	1,83	4,90	1,92	5,60	2,01	7,45	2,12	8,10	2,19	
20,0	3,27	1,79	3,98	1,88	4,68	1,97	5,38	2,06	7,20	2,17	7,85	2,24	
22,0	3,19	1,81	3,89	1,90	4,59	1,99	5,30	2,08	7,10	2,19	7,75	2,26	
24,0	3,10	1,83	3,81	1,92	4,51	2,01	5,21	2,10	7,00	2,21	7,65	2,28	
25,0	3,06	1,84	3,76	1,93	4,47	2,02	5,17	2,11	6,95	2,22	7,60	2,29	
27,0	2,97	1,86	3,68	1,95	4,38	2,04	5,08	2,13	6,85	2,24	7,50	2,31	

Symbols
 AFR : Air flow rate [m³/min]
 BF : Bypass factor
 EWB : Entering wet-bulb temperature (°C WB)
 EDB : Entering dry-bulb temperature (°C DB)
 TC : Total capacity [kW]
 SHC : Sensible heat capacity [kW]
 PI : Power input [kW]

- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
 - The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
 - In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
 - The capacities are based on the following conditions:
 Corresponding refrigerant piping length: 5 m
 Level difference: 0m
 - The air flow rate and bypass factor are mentioned in the table.

3D110088B

FNA25A9 / RXM25N9

Cooling 50 Hz 220 - 240 V

AFR	8,7
BF	0,17

Indoor temperature		Outdoor temperature [°C DB]																	
EWB °C	EDB °C	20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	2,66	2,04	0,52	2,54	1,98	0,58	2,42	1,92	0,63	2,37	1,90	0,65	2,30	1,86	0,68	2,18	1,81	0,73
16,0	22	2,78	2,00	0,53	2,66	1,95	0,58	2,54	1,89	0,63	2,49	1,87	0,65	2,42	1,84	0,68	2,30	1,78	0,73
18,0	25	2,90	2,11	0,53	2,78	2,06	0,58	2,66	2,00	0,63	2,61	1,98	0,65	2,54	1,95	0,68	2,42	1,90	0,73
19,0	27	2,96	2,23	0,53	2,84	2,18	0,58	2,72	2,13	0,63	2,67	2,11	0,65	2,60	2,08	0,68	2,48	2,04	0,73
22,0	30	3,14	2,16	0,54	3,02	2,11	0,59	2,90	2,07	0,64	2,85	2,05	0,66	2,78	2,02	0,69	2,66	1,98	0,74
24,0	32	3,26	2,10	0,54	3,14	2,06	0,59	3,02	2,02	0,64	2,97	2,01	0,66	2,90	1,98	0,69	2,78	1,94	0,74

Heating 50 Hz 220 - 240 V

AFR	8,7
-----	-----

Indoor temperature		Outdoor temperature [°C WB]											
EDB °C	TC	-15		-10		-5		0		6		10	
		PI	SHC	PI	SHC	PI	SHC	PI	SHC	PI	SHC	PI	SHC
15,0	1,49	0,64	1,79	0,68	2,09	0,71	2,39	0,74	3,31	0,78	3,60	0,81	
20,0	1,40	0,66	1,70	0,69	2,00	0,73	2,30	0,76	3,20	0,80	3,49	0,83	
22,0	1,36	0,67	1,66	0,70	1,96	0,73	2,26	0,77	3,16	0,81	3,44	0,83	
24,0	1,32	0,68	1,62	0,71	1,92	0,74	2,22	0,77	3,11	0,81	3,40	0,84	
25,0	1,30	0,68	1,60	0,71	1,90	0,75	2,20	0,78	3,09	0,82	3,38	0,84	
27,0	1,27	0,69	1,57	0,72	1,87	0,75	2,17	0,79	3,05	0,83	3,33	0,85	

Symbols
 AFR : Air flow rate [m³/min]
 BF : Bypass factor
 EWB : Entering wet-bulb temperature (°C WB)
 EDB : Entering dry-bulb temperature (°C DB)
 TC : Total capacity [kW]
 SHC : Sensible heat capacity [kW]
 PI : Power input [kW]

- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
 - The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
 - In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
 - The capacities are based on the following conditions:
 Corresponding refrigerant piping length: 5 m
 Level difference: 0m
 - The air flow rate and bypass factor are mentioned in the table.

3D110089A

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

FNA35A9 / RXM35N9

Cooling

50 Hz 220 - 240 V

AFR	8,7
BF	0,17

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	2,96	2,19	0,75	2,96	2,19	0,85	2,96	2,19	0,96	2,96	2,19	1,01	2,96	2,19	1,08	2,85	2,13	1,17
16,0	22	3,64	2,42	0,85	3,48	2,34	0,93	3,32	2,26	1,01	3,26	2,23	1,04	3,17	2,18	1,09	3,01	2,11	1,17
18,0	25	3,80	2,51	0,85	3,64	2,43	0,93	3,48	2,36	1,02	3,42	2,33	1,05	3,32	2,29	1,10	3,16	2,22	1,18
19,0	27	3,87	2,63	0,86	3,72	2,55	0,94	3,56	2,48	1,02	3,49	2,46	1,05	3,40	2,42	1,10	3,24	2,35	1,18
22,0	30	4,11	2,52	0,86	3,95	2,46	0,94	3,79	2,40	1,03	3,73	2,38	1,06	3,63	2,34	1,11	3,48	2,28	1,19
24,0	32	4,27	2,45	0,87	4,11	2,39	0,95	3,95	2,34	1,03	3,89	2,32	1,06	3,79	2,28	1,11	3,63	2,23	1,19

Heating

50 Hz 220 - 240 V

AFR	8,7
-----	-----

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	15,0	1,86	0,92	2,23	0,97	2,61	1,02	2,98	1,07	4,14	1,12	4,50	1,16
20,0	20,0	1,75	0,95	2,12	1,00	2,50	1,05	2,87	1,09	4,00	1,15	4,36	1,19
22,0	22,0	1,70	0,96	2,07	1,01	2,45	1,06	2,82	1,10	3,94	1,16	4,31	1,20
24,0	24,0	1,65	0,97	2,03	1,02	2,40	1,07	2,78	1,11	3,89	1,17	4,25	1,21
25,0	25,0	1,63	0,98	2,01	1,02	2,38	1,07	2,76	1,12	3,86	1,18	4,22	1,21
27,0	27,0	1,59	0,99	1,96	1,03	2,33	1,08	2,71	1,13	3,81	1,19	4,02	1,21

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110090A

FNA50A9 / RXM50N9

Cooling

50 Hz 220 - 240 V

AFR	16,0
BF	0,12

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,12	3,94	1,13	4,89	3,83	1,24	4,66	3,71	1,35	4,56	3,67	1,40	4,42	3,60	1,46	4,19	3,49	1,57
16,0	22	5,35	3,87	1,14	5,12	3,77	1,25	4,89	3,66	1,36	4,79	3,62	1,40	4,65	3,56	1,47	4,42	3,45	1,58
18,0	25	5,58	4,08	1,15	5,35	3,98	1,26	5,12	3,88	1,37	5,02	3,84	1,41	4,88	3,78	1,48	4,65	3,69	1,59
19,0	27	5,70	4,32	1,15	5,47	4,22	1,26	5,23	4,13	1,37	5,14	4,09	1,41	5,00	4,04	1,48	4,77	3,94	1,59
22,0	30	6,04	4,17	1,16	5,81	4,09	1,27	5,58	4,00	1,38	5,49	3,97	1,42	5,35	3,92	1,49	5,11	3,84	1,60
24,0	32	6,27	4,07	1,17	6,04	3,99	1,28	5,81	3,92	1,39	5,72	3,89	1,43	5,58	3,84	1,50	5,34	3,77	1,60

Heating

50 Hz 220 - 240 V

AFR	16,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	15,0	2,70	1,40	3,24	1,47	3,78	1,54	4,33	1,61	6,00	1,70	6,52	1,75
20,0	20,0	2,53	1,44	3,07	1,51	3,62	1,58	4,16	1,65	5,80	1,74	6,32	1,79
22,0	22,0	2,46	1,45	3,01	1,52	3,55	1,59	4,10	1,67	5,72	1,75	6,24	1,81
24,0	24,0	2,40	1,47	2,94	1,54	3,49	1,61	4,03	1,68	5,64	1,77	6,16	1,83
25,0	25,0	2,36	1,48	2,91	1,55	3,45	1,62	4,00	1,69	5,60	1,78	6,12	1,83
27,0	27,0	2,30	1,49	2,84	1,56	3,39	1,63	3,93	1,71	5,52	1,79	6,04	1,85

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110091B

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

FNA60A9 / RXM60N9

Cooling 50 Hz 220 - 240 V

AFR	16,0
BF	0,12

Indoor temperature		Outdoor temperature [°C DB]																		
EWB	EDB	20			25			30			32			35			40			
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	
14,0	20	5,78	4,27	1,66	5,78	4,27	1,86	5,59	4,17	2,03	5,48	4,11	2,10	5,31	4,03	2,20	5,82	3,82	3,32	2,01
16,0	22	6,42	4,38	1,71	6,14	4,24	1,88	5,86	4,11	2,04	5,75	4,06	2,11	5,59	3,98	2,21	4,02	3,28	2,01	
18,0	25	6,70	4,57	1,72	6,42	4,44	1,89	6,14	4,32	2,05	6,03	4,27	2,12	5,86	4,20	2,22	4,22	3,51	2,01	
19,0	27	6,84	4,80	1,73	6,56	4,68	1,89	6,28	4,56	2,06	6,17	4,51	2,12	6,00	4,44	2,22	4,32	3,77	2,01	
22,0	30	7,25	4,62	1,74	6,97	4,52	1,91	6,69	4,41	2,07	6,58	4,37	2,14	6,41	4,31	2,24	4,62	3,67	2,01	
24,0	32	7,53	4,50	1,75	7,25	4,40	1,92	6,97	4,30	2,08	6,86	4,26	2,15	6,69	4,21	2,25	4,82	3,60	2,01	

Heating 50 Hz 220 - 240 V

AFR	16,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	20	3,39	1,81	4,08	1,90	4,76	2,00	5,44	2,09	7,24	2,20	7,87	2,27
20,0	20	3,18	1,86	3,87	1,95	4,55	2,05	5,23	2,14	7,00	2,25	7,63	2,32
22,0	20	3,10	1,88	3,78	1,97	4,47	2,07	5,15	2,16	6,90	2,27	7,54	2,35
24,0	20	3,02	1,90	3,70	1,99	4,38	2,09	5,07	2,18	6,81	2,29	7,44	2,37
25,0	20	2,97	1,91	3,66	2,00	4,34	2,10	5,03	2,19	6,76	2,30	7,39	2,38
27,0	20	2,89	1,93	3,57	2,03	4,26	2,12	4,94	2,21	6,66	2,32	7,29	2,40

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature [°C WB]
- EDB : Entering dry-bulb temperature [°C DB]
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110092B

FTXM20N / RXM20N9

Cooling 220-240V 50Hz

AFR	11,1
BF	0,16

1	2	3																	
		20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	2,05	1,76	0,34	1,96	1,72	0,37	1,86	1,68	0,40	1,83	1,66	0,42	1,77	1,64	0,44	1,68	1,59	0,47
16	22	2,14	1,76	0,34	2,05	1,69	0,37	1,95	1,65	0,41	1,92	1,64	0,42	1,86	1,62	0,44	1,77	1,58	0,47
18	25	2,23	1,85	0,34	2,14	1,81	0,38	2,05	1,78	0,41	2,01	1,76	0,42	1,95	1,74	0,44	1,86	1,70	0,47
19	27	2,28	1,98	0,34	2,19	1,95	0,38	2,09	1,91	0,41	2,06	1,90	0,42	2,00	1,88	0,44	1,91	1,84	0,47
22	30	2,42	1,92	0,35	2,32	1,89	0,38	2,23	1,86	0,41	2,19	1,85	0,42	2,14	1,83	0,44	2,05	1,80	0,47
24	32	2,51	1,88	0,35	2,42	1,86	0,38	2,32	1,83	0,41	2,29	1,82	0,43	2,23	1,80	0,44	2,14	1,77	0,48

Heating 220-240V 50Hz

AFR	10,4
-----	------

2	4											
	-15		-10		-5		0		6		10	
	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	1,19	0,32	1,43	0,34	1,67	0,36	2,25	0,46	2,59	0,49	2,81	0,51
20	1,12	0,33	1,36	0,35	1,60	0,37	2,16	0,47	2,50	0,50	2,73	0,52
22	1,09	0,34	1,33	0,36	1,57	0,37	2,13	0,48	2,47	0,50	2,69	0,52
24	1,06	0,34	1,30	0,36	1,54	0,38	2,09	0,48	2,43	0,51	2,66	0,53
25	1,04	0,34	1,28	0,36	1,52	0,38	2,07	0,49	2,41	0,51	2,64	0,53
27	1,01	0,35	1,25	0,37	1,49	0,38	2,04	0,49	2,38	0,52	2,61	0,54

Symbols

- TC : Total capacity [kW]
- PI : Power input [kW]
- SHC : Sensible heat capacity [kW]
- AFR : Air flow rate [m³/min]
- BF : Bypass factor

- 1 Indoor air temperature [°C WB]
- 2 Indoor air temperature [°C DB]
- 3 Outdoor air temperature [°C DB]
- 4 Outdoor air temperature [°C WB]

Notes

- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5.0 m
Level difference: 0m
- The bold cells indicate the standard conditions.
Rated operating frequency [Hz]

3D099850D

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

FTXM25N / RXM25N9

AFR	11,1
BF	0,21

Cooling 220-240V 50Hz

1	2	3																	
		20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	2,56	1,95	0,40	2,44	1,90	0,45	2,32	1,85	0,51	2,28	1,83	0,53	2,21	1,79	0,55	2,09	1,74	0,60
16	22	2,68	1,92	0,43	2,56	1,87	0,47	2,44	1,82	0,51	2,40	1,80	0,53	2,33	1,76	0,56	2,21	1,71	0,60
18	25	2,79	2,02	0,43	2,68	1,97	0,47	2,56	1,92	0,52	2,51	1,90	0,53	2,44	1,88	0,56	2,33	1,83	0,60
19	27	2,85	2,14	0,43	2,73	2,09	0,48	2,62	2,05	0,52	2,57	2,03	0,53	2,50	2,00	0,56	2,38	1,95	0,60
22	30	3,02	2,07	0,44	2,91	2,03	0,48	2,79	1,98	0,52	2,74	1,97	0,54	2,67	1,94	0,56	2,56	1,90	0,61
24	32	3,14	2,02	0,44	3,02	1,98	0,48	2,90	1,94	0,52	2,86	1,92	0,54	2,79	1,90	0,57	2,67	1,87	0,61

Heating 220-240V 50Hz

AFR	10,8
-----	------

2	4											
	-15		-10		-5		0		6		10	
	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	1,33	0,36	1,60	0,38	1,87	0,40	2,52	0,52	2,90	0,55	3,15	0,57
20	1,25	0,37	1,52	0,39	1,79	0,41	2,42	0,53	2,80	0,56	3,05	0,58
22	1,22	0,37	1,49	0,40	1,76	0,42	2,38	0,53	2,76	0,57	3,01	0,59
24	1,19	0,38	1,45	0,40	1,72	0,42	2,34	0,54	2,72	0,57	2,98	0,59
25	1,17	0,38	1,44	0,40	1,71	0,42	2,32	0,54	2,70	0,57	2,96	0,59
27	1,14	0,39	1,41	0,41	1,67	0,42	2,29	0,55	2,66	0,58	2,92	0,60

Symbols

TC: Total capacity [kW]

PI: Power input [kW]

SHC: Sensible heat capacity [kW]

AFR: Air flow rate [m³/min]

BF: Bypass factor

- Indoor air temperature [°C WB]
- Indoor air temperature [°C DB]
- Outdoor air temperature [°C DB]
- Outdoor air temperature [°C WB]

Notes

- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5.0 m
Level difference: 0m
- The bold cells indicate the standard conditions.
Rated operating frequency [Hz]

3D120715

FTXM35N / RXM35N9

AFR	12,3
BF	0,21

Cooling 220-240V 50Hz

1	2	3																	
		20			25			30			32			35			40		
		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14	20	3,48	2,66	0,59	3,32	2,60	0,67	3,16	2,52	0,73	3,11	2,49	0,75	3,01	2,45	0,79	2,85	2,38	0,85
16	22	3,64	2,63	0,62	3,48	2,57	0,68	3,32	2,49	0,73	3,27	2,46	0,76	3,17	2,42	0,79	3,01	2,35	0,86
18	25	3,80	2,77	0,62	3,64	2,70	0,68	3,48	2,64	0,74	3,42	2,61	0,76	3,32	2,58	0,80	3,17	2,51	0,86
19	27	3,88	2,93	0,62	3,72	2,88	0,69	3,56	2,81	0,74	3,50	2,78	0,76	3,40	2,74	0,80	3,25	2,68	0,86
22	30	4,11	2,84	0,63	3,96	2,78	0,69	3,79	2,72	0,74	3,73	2,70	0,77	3,63	2,67	0,81	3,48	2,61	0,87
24	32	4,27	2,77	0,63	4,11	2,71	0,70	3,96	2,66	0,75	3,89	2,64	0,77	3,79	2,61	0,81	3,63	2,57	0,87

Heating 220-240V 50Hz

AFR	10,8
-----	------

2	4											
	-15		-10		-5		0		6		10	
	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15	1,90	0,64	2,29	0,67	2,67	0,71	3,60	0,92	4,14	0,97	4,50	1,00
20	1,79	0,66	2,17	0,68	2,56	0,72	3,46	0,94	4,00	0,99	4,36	1,03
22	1,74	0,66	2,12	0,70	2,51	0,73	3,40	0,96	3,94	1,00	4,31	1,04
24	1,69	0,67	2,08	0,71	2,46	0,73	3,35	0,96	3,89	1,01	4,25	1,04
25	1,67	0,67	2,05	0,71	2,44	0,74	3,32	0,97	3,86	1,01	4,22	1,05
27	1,62	0,68	2,01	0,71	2,39	0,74	3,26	0,97	3,81	1,03	4,17	1,05

Symbols

TC: Total capacity [kW]

PI: Power input [kW]

SHC: Sensible heat capacity [kW]

AFR: Air flow rate [m³/min]

BF: Bypass factor

- Indoor air temperature [°C WB]
- Indoor air temperature [°C DB]
- Outdoor air temperature [°C DB]
- Outdoor air temperature [°C WB]

Notes

- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5.0 m
Level difference: 0m
- The bold cells indicate the standard conditions.
Rated operating frequency [Hz]

3D120716

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

4

FTXM42N / RXM42N9

Cooling 50 Hz 220 - 240 V

AFR	12,6
BF	0,21

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	3,89	2,92	0,73	3,89	2,92	0,82	3,75	2,85	0,89	3,83	2,89	0,92	3,72	2,83	0,96	3,52	2,74	1,03
16,0	22	4,31	2,99	0,75	4,13	2,90	0,82	3,94	2,81	0,90	4,03	2,85	0,92	3,91	2,79	0,96	3,71	2,70	1,04
18,0	25	4,50	3,12	0,76	4,31	3,04	0,83	4,13	2,96	0,90	4,22	3,00	0,92	4,10	2,95	0,97	3,91	2,87	1,04
19,0	27	4,59	3,29	0,76	4,41	3,21	0,83	4,22	3,13	0,90	4,32	3,17	0,93	4,20	3,12	0,97	4,00	3,04	1,04
22,0	30	4,87	3,17	0,77	4,68	3,10	0,84	4,50	3,03	0,91	4,61	3,07	0,93	4,49	3,03	0,98	4,29	2,96	1,05
24,0	32	5,06	3,09	0,77	4,87	3,02	0,84	4,68	2,96	0,91	4,80	3,00	0,94	4,68	2,96	0,98	4,49	2,89	1,05

Heating 50 Hz 220 - 240 V

AFR	13,0
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB		-15		-10		-5		0		6		10	
°C		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0		2,57	0,84	3,09	0,89	3,61	0,93	4,12	1,22	5,59	1,28	6,07	1,32
20,0		2,41	0,87	2,93	0,91	3,45	0,95	3,97	1,25	5,40	1,31	5,89	1,35
22,0		2,35	0,88	2,87	0,92	3,39	0,96	3,90	1,26	5,33	1,32	5,81	1,36
24,0		2,29	0,89	2,80	0,93	3,32	0,97	3,84	1,27	5,25	1,33	5,74	1,38
25,0		2,25	0,89	2,77	0,93	3,29	0,98	3,81	1,27	5,21	1,34	5,65	1,38
27,0		2,19	0,90	2,71	0,94	3,23	0,99	3,75	1,29	5,14	1,35	5,58	1,35

Symbols

AFR : Air flow rate [m³/min]
 BF : Bypass factor
 EWB : Entering wet-bulb temperature (°C WB)
 EDB : Entering dry-bulb temperature (°C DB)
 TC : Total capacity [kW]
 SHC : Sensible heat capacity [kW]
 PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
 Corresponding refrigerant piping length: 5 m
 Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D120633

FTXM50N / RXM50N9

Cooling 50 Hz 220 - 240 V

AFR	16,1
BF	0,13

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	4,11	3,04	1,07	3,88	2,93	1,14	3,65	2,83	1,21	3,55	2,78	1,28	3,41	2,72	1,34	3,18	2,62	1,44
16,0	22	5,26	3,46	1,08	5,03	3,35	1,15	4,80	3,25	1,22	4,70	3,20	1,29	4,56	3,14	1,35	4,33	3,04	1,44
18,0	25	5,58	3,66	1,08	5,35	3,55	1,15	5,12	3,45	1,22	5,02	3,40	1,29	4,88	3,34	1,36	4,65	3,24	1,45
19,0	27	5,70	3,83	1,09	5,47	3,72	1,16	5,23	3,62	1,23	5,14	3,58	1,30	5,00	3,52	1,36	4,77	3,42	1,45
22,0	30	6,04	3,68	1,09	5,81	3,59	1,16	5,58	3,50	1,23	5,49	3,46	1,30	5,35	3,40	1,37	5,11	3,32	1,46
24,0	32	6,27	3,57	1,09	6,04	3,49	1,16	5,81	3,40	1,23	5,72	3,37	1,30	5,58	3,32	1,38	5,34	3,24	1,47

Heating 50 Hz 220 - 240 V

AFR	17,1
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB		-15		-10		-5		0		6		10	
°C		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0		2,76	0,93	3,32	0,98	3,88	1,03	4,43	1,35	6,00	1,42	6,52	1,47
20,0		2,59	0,96	3,15	1,01	3,71	1,05	4,26	1,38	5,80	1,45	6,32	1,50
22,0		2,52	0,97	3,08	1,02	3,64	1,07	4,19	1,39	5,72	1,46	6,24	1,51
24,0		2,46	0,98	3,01	1,03	3,57	1,08	4,12	1,40	5,64	1,48	6,16	1,52
25,0		2,42	0,99	2,98	1,03	3,54	1,08	4,09	1,41	5,60	1,48	6,12	1,53
27,0		2,35	1,00	2,91	1,04	3,47	1,09	4,02	1,42	5,52	1,50	6,04	1,54

Symbols

AFR : Air flow rate [m³/min]
 BF : Bypass factor
 EWB : Entering wet-bulb temperature (°C WB)
 EDB : Entering dry-bulb temperature (°C DB)
 TC : Total capacity [kW]
 SHC : Sensible heat capacity [kW]
 PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
 Corresponding refrigerant piping length: 5 m
 Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D120632

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

FTXM60N / RXM60N9

Cooling 50 Hz 220 - 240 V

AFR	17,1
BF	0,17

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	5,10	3,76	0,19	4,82	3,63	0,31	4,55	3,51	0,80	4,38	3,45	1,66	4,26	3,38	1,75	4,09	3,26	1,88
16,0	22	6,31	4,18	0,20	6,04	4,05	0,33	5,76	3,93	0,81	5,64	3,87	1,67	5,47	3,80	1,76	5,30	3,68	1,88
18,0	25	6,70	4,39	0,20	6,42	4,26	0,34	6,14	4,14	0,82	6,02	4,08	1,67	5,86	4,00	1,77	5,58	3,88	1,89
19,0	27	6,84	4,59	0,22	6,56	4,46	0,34	6,28	4,34	0,82	6,17	4,29	1,69	6,00	4,22	1,77	5,72	4,10	1,89
22,0	30	7,25	4,41	0,22	6,97	4,30	0,34	6,70	4,20	0,83	6,59	4,15	1,70	6,42	4,08	1,78	6,13	3,98	1,90
24,0	32	7,52	4,28	0,22	7,25	4,18	0,34	6,97	4,08	0,83	6,86	4,04	1,70	6,70	3,98	1,79	6,41	3,88	1,92

Heating 50 Hz 220 - 240 V

AFR	17,7
-----	------

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	15	3,33	1,24	4,01	1,31	4,68	1,38	6,29	1,81	7,24	1,90	7,87	1,97
20,0	20	3,13	1,29	3,80	1,35	4,48	1,41	6,05	1,85	7,00	1,94	7,63	2,01
22,0	22	3,04	1,30	3,72	1,37	4,39	1,43	5,95	1,86	6,90	1,95	7,53	2,02
24,0	24	2,97	1,31	3,63	1,38	4,31	1,45	5,85	1,87	6,81	1,98	7,43	2,03
25,0	25	2,92	1,33	3,60	1,38	4,27	1,45	5,80	1,89	6,76	1,98	7,39	2,05
27,0	27	2,84	1,34	3,51	1,39	4,19	1,46	5,71	1,90	6,66	2,01	7,29	2,06

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D117546A

FVXM25F / RXM25N9

Cooling 50 Hz 220 - 240 V

AFR	8,2
BF	0,1

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	2,56	2,00	0,46	2,44	1,95	0,50	2,33	1,89	0,55	2,28	1,87	0,56	2,21	1,84	0,59	2,10	1,78	0,64
16,0	22	2,68	1,97	0,46	2,56	1,92	0,51	2,44	1,87	0,55	2,40	1,84	0,57	2,33	1,81	0,59	2,21	1,76	0,64
18,0	25	2,79	2,08	0,46	2,68	2,03	0,51	2,56	1,98	0,55	2,51	1,96	0,57	2,44	1,93	0,60	2,33	1,89	0,64
19,0	27	2,85	2,21	0,47	2,73	2,16	0,51	2,62	2,11	0,55	2,57	2,09	0,57	2,50	2,07	0,60	2,38	2,02	0,64
22,0	30	3,02	2,13	0,47	2,91	2,09	0,51	2,79	2,05	0,56	2,74	2,03	0,58	2,67	2,01	0,60	2,56	1,97	0,65
24,0	32	3,14	2,08	0,47	3,02	2,04	0,52	2,90	2,01	0,56	2,86	1,99	0,58	2,79	1,97	0,60	2,67	1,93	0,65

Heating 50 Hz 220 - 240 V

AFR	8,8
-----	-----

Indoor temperature		Outdoor temperature [°C WB]											
EDB	°C	-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	15	1,58	0,62	1,90	0,65	2,22	0,68	2,54	0,71	3,52	0,75	3,82	0,78
20,0	20	1,48	0,64	1,80	0,67	2,12	0,70	2,44	0,73	3,40	0,77	3,71	0,79
22,0	22	1,44	0,64	1,76	0,67	2,08	0,71	2,40	0,74	3,35	0,78	3,66	0,80
24,0	24	1,41	0,65	1,72	0,68	2,04	0,71	2,36	0,75	3,31	0,78	3,61	0,81
25,0	25	1,39	0,65	1,70	0,69	2,02	0,72	2,34	0,75	3,28	0,79	3,59	0,81
27,0	27	1,35	0,66	1,67	0,69	1,98	0,72	2,30	0,76	3,24	0,79	3,54	0,82

Symbols

- AFR : Air flow rate [m³/min]
- BF : Bypass factor
- EWB : Entering wet-bulb temperature (°C WB)
- EDB : Entering dry-bulb temperature (°C DB)
- TC : Total capacity [kW]
- SHC : Sensible heat capacity [kW]
- PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
Corresponding refrigerant piping length: 5 m
Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110093A

4 Capacity tables

4 - 1 Cooling/Heating Capacity Tables

4

FVXM35F / RXM35N9

Cooling 50 Hz 220 - 240 V

AFR	8,5
BF	0,11

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	3,11	2,29	0,75	3,11	2,29	0,86	3,11	2,29	0,96	3,11	2,29	1,01	3,10	2,29	1,08	2,93	2,21	1,16
16,0	22	3,75	2,50	0,84	3,58	2,42	0,92	3,42	2,34	1,00	3,36	2,31	1,03	3,26	2,26	1,08	3,10	2,18	1,16
18,0	25	3,91	2,60	0,85	3,75	2,52	0,93	3,58	2,45	1,01	3,52	2,42	1,04	3,42	2,37	1,09	3,26	2,30	1,17
19,0	27	3,99	2,72	0,85	3,83	2,65	0,93	3,66	2,57	1,01	3,60	2,55	1,04	3,50	2,50	1,09	3,34	2,43	1,17
22,0	30	4,23	2,61	0,86	4,07	2,55	0,94	3,90	2,49	1,02	3,84	2,46	1,05	3,74	2,43	1,10	3,58	2,36	1,18
24,0	32	4,39	2,54	0,86	4,23	2,48	0,94	4,07	2,42	1,02	4,00	2,40	1,05	3,90	2,37	1,10	3,74	2,31	1,18

Heating 50 Hz 220 - 240 V

AFR	9,4
-----	-----

Symbols

Indoor temperature		Outdoor temperature [°C WB]											
EDB		-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	20,0	2,09	0,96	2,51	1,01	2,94	1,06	3,36	1,10	4,66	1,16	5,06	1,20
20,0	22,0	1,96	0,98	2,39	1,03	2,81	1,08	3,23	1,13	4,50	1,19	4,91	1,23
22,0	24,0	1,91	1,00	2,33	1,04	2,76	1,09	3,18	1,14	4,44	1,20	4,84	1,24
24,0	25,0	1,86	1,01	2,28	1,06	2,70	1,10	3,13	1,15	4,38	1,21	4,78	1,25
25,0	27,0	1,83	1,01	2,26	1,06	2,68	1,11	3,10	1,16	4,34	1,22	4,75	1,26
27,0		1,78	1,02	2,20	1,07	2,63	1,12	3,05	1,17	4,28	1,23	4,69	1,26

AFR : Air flow rate [m³/min]
 BF : Bypass factor
 EWB : Entering wet-bulb temperature (°C WB)
 EDB : Entering dry-bulb temperature (°C DB)
 TC : Total capacity [kW]
 SHC : Sensible heat capacity [kW]
 PI : Power input [kW]

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
 Corresponding refrigerant piping length: 5 m
 Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110094A

FVXM50F / RXM50N9

Cooling 50 Hz 220 - 240 V

AFR	10,1
BF	0,13

Indoor temperature		Outdoor temperature [°C DB]																	
EWB	EDB	20			25			30			32			35			40		
°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14,0	20	3,82	2,82	0,98	3,82	2,82	1,12	3,82	2,82	1,27	3,82	2,82	1,33	3,82	2,82	1,42	3,82	2,82	1,57
16,0	22	4,86	3,20	1,12	4,86	3,20	1,27	4,86	3,20	1,42	4,79	3,16	1,47	4,65	3,09	1,54	4,42	2,98	1,65
18,0	25	5,58	3,56	1,20	5,35	3,45	1,32	5,12	3,34	1,43	5,02	3,29	1,48	4,88	3,23	1,54	4,65	3,12	1,66
19,0	27	5,70	3,71	1,20	5,47	3,60	1,32	5,23	3,49	1,43	5,14	3,45	1,48	5,00	3,39	1,55	4,77	3,28	1,66
22,0	30	6,04	3,56	1,21	5,81	3,46	1,33	5,58	3,37	1,44	5,49	3,33	1,49	5,35	3,27	1,56	5,11	3,18	1,67
24,0	32	6,27	3,45	1,22	6,04	3,36	1,34	5,81	3,27	1,45	5,72	3,24	1,50	5,58	3,19	1,57	5,34	3,10	1,68

Heating 50 Hz 220 - 240 V

AFR	11,8
-----	------

Symbols

Indoor temperature		Outdoor temperature [°C WB]											
EDB		-15		-10		-5		0		6		10	
°C	°C	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
15,0	20,0	2,70	1,29	3,24	1,35	3,78	1,42	4,33	1,48	6,00	1,56	6,52	1,61
20,0	22,0	2,53	1,32	3,07	1,39	3,62	1,45	4,16	1,52	5,80	1,60	6,32	1,65
22,0	24,0	2,46	1,34	3,01	1,40	3,55	1,47	4,10	1,53	5,72	1,61	6,24	1,66
24,0	25,0	2,40	1,35	2,94	1,42	3,49	1,48	4,03	1,55	5,64	1,63	6,16	1,68
25,0	27,0	2,36	1,36	2,91	1,42	3,45	1,49	4,00	1,55	5,57	1,63	6,09	1,69
27,0		2,30	1,37	2,84	1,44	3,39	1,50	3,93	1,57	5,43	1,65	5,93	1,70

AFR : Air flow rate [m³/min]
 BF : Bypass factor
 EWB : Entering wet-bulb temperature (°C WB)
 EDB : Entering dry-bulb temperature (°C DB)
 TC : Total capacity [kW]
 SHC : Sensible heat capacity [kW]
 PI : Power input [kW]

Notes


- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- On the figure the □ mark shows the rated capacity and rated coefficient of the power input.
- The total capacity, power input and sensible heat capacity must be calculated by interpolation, using the figures in the table (figures not in the table may not be used in the calculation).
- In case the sensible heat capacity is not mentioned in the table, please calculate it using an approximation between two values in direct proportion.
- The capacities are based on the following conditions:
 Corresponding refrigerant piping length: 5 m
 Level difference: 0m
- The air flow rate and bypass factor are mentioned in the table.

3D110095B

5 Dimensional drawings


5 - 1 Dimensional Drawings

RXM20-35N9

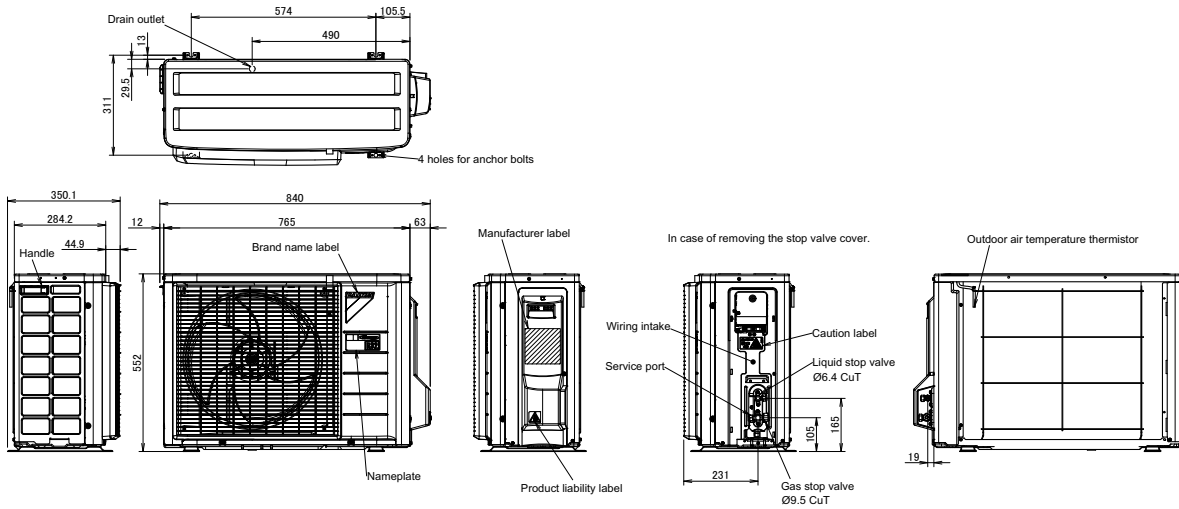


Minimum space for air passage

Wall height on air outlet side < 1200 mm

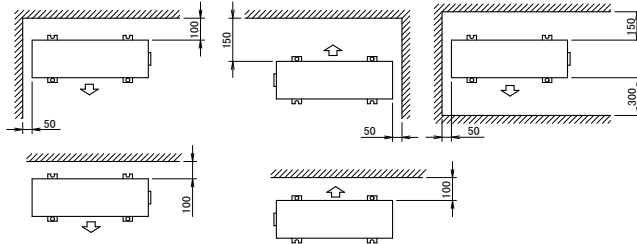


3D119881

RXM42-60N9

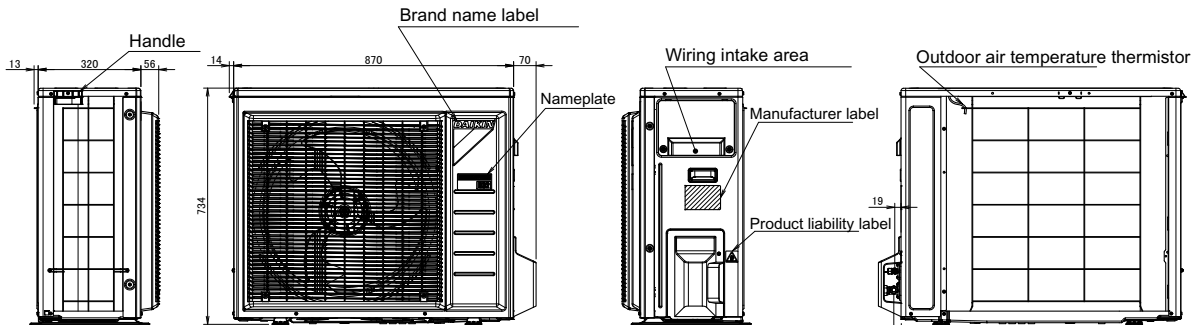


4 holes for anchor bolts
M8 or M10

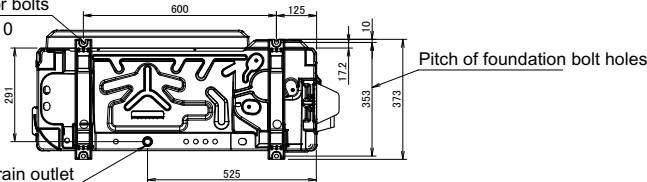


Drain outlet
Connection hose (inside diameter: 15.9mm)

Minimum space for air passage
Wall height on air outlet side < 1200 mm

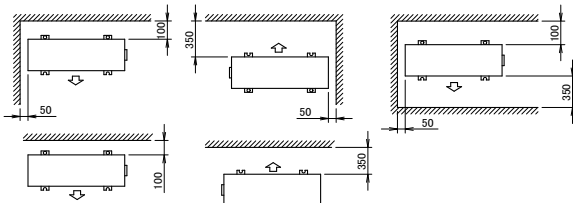

In case of removing the stop valve cover.

Terminal strip with earth terminal

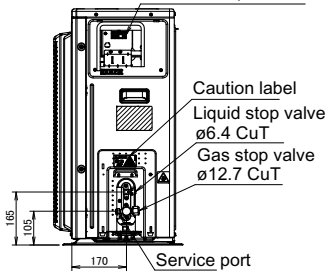


3D114108

6 Centre of gravity

6 - 1 Centre of Gravity


6

RXM20-35N9

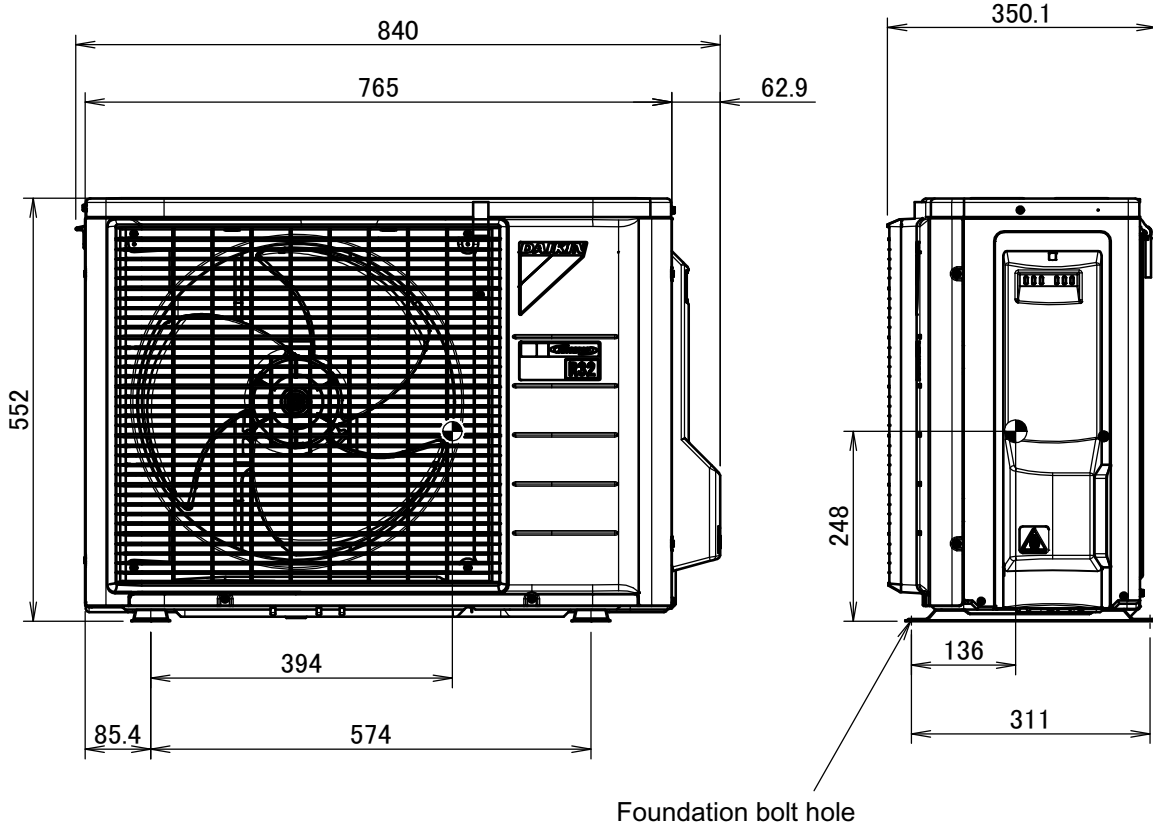

4D119880

RXM42-60N9

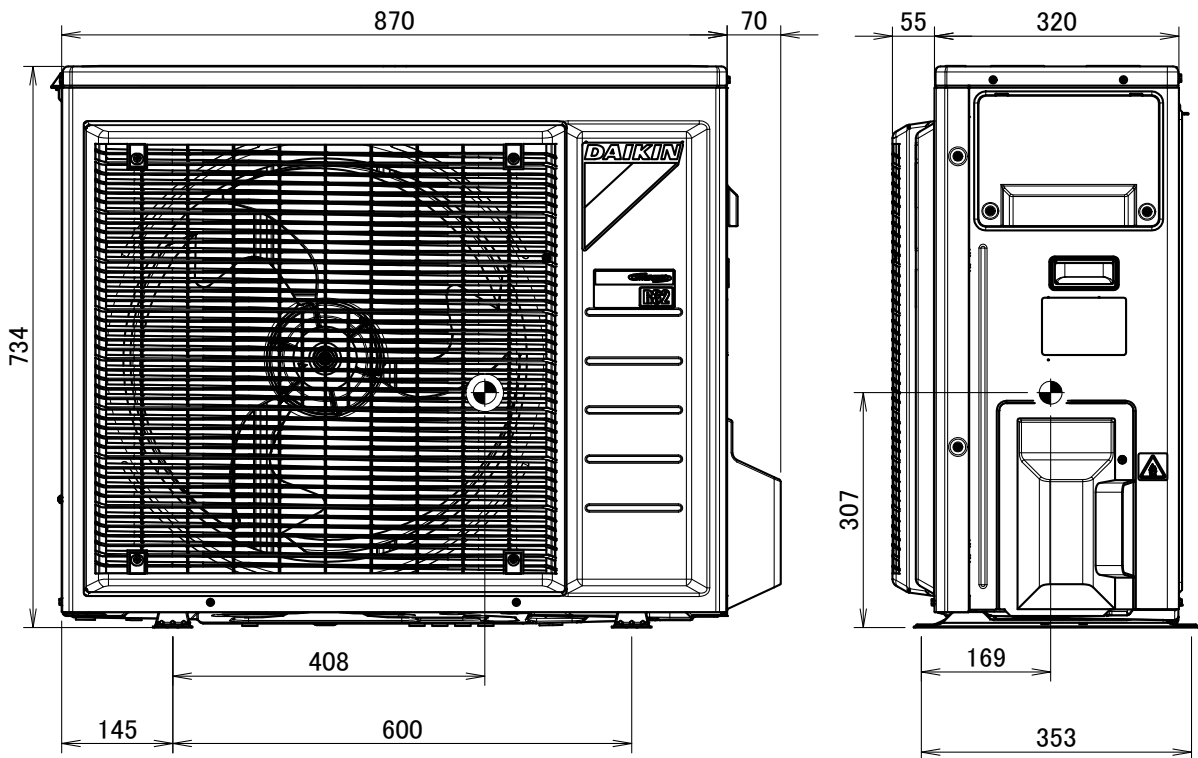


4D117299

7 Piping diagrams

7 - 1 Piping Diagrams


RXM20-35N9

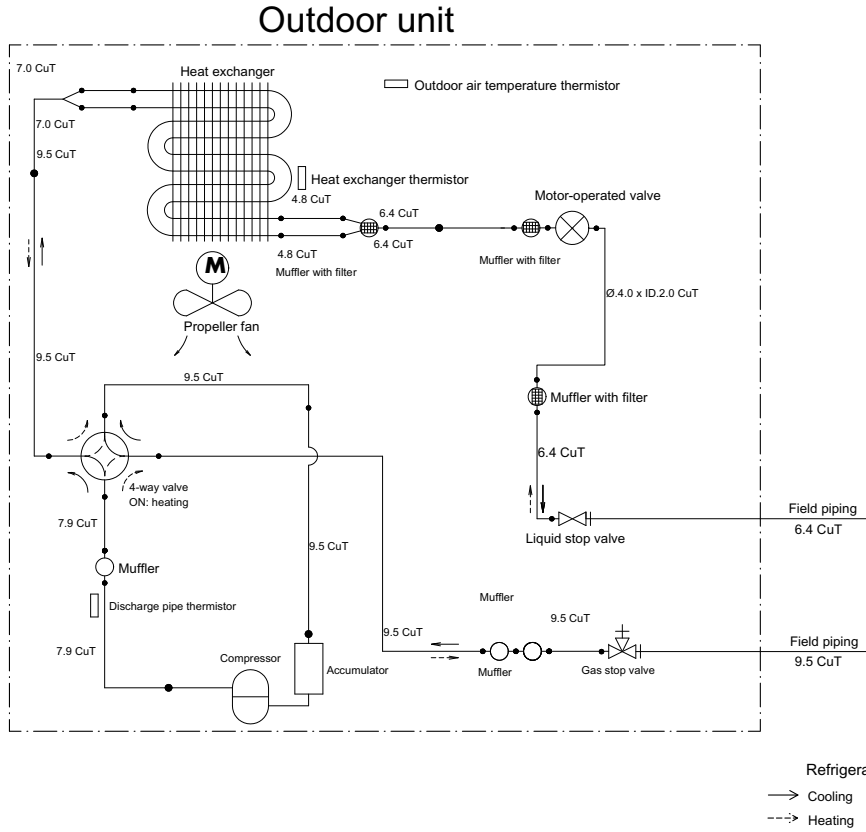

3D091995B

RXM42-60N9

Refrigerant flow

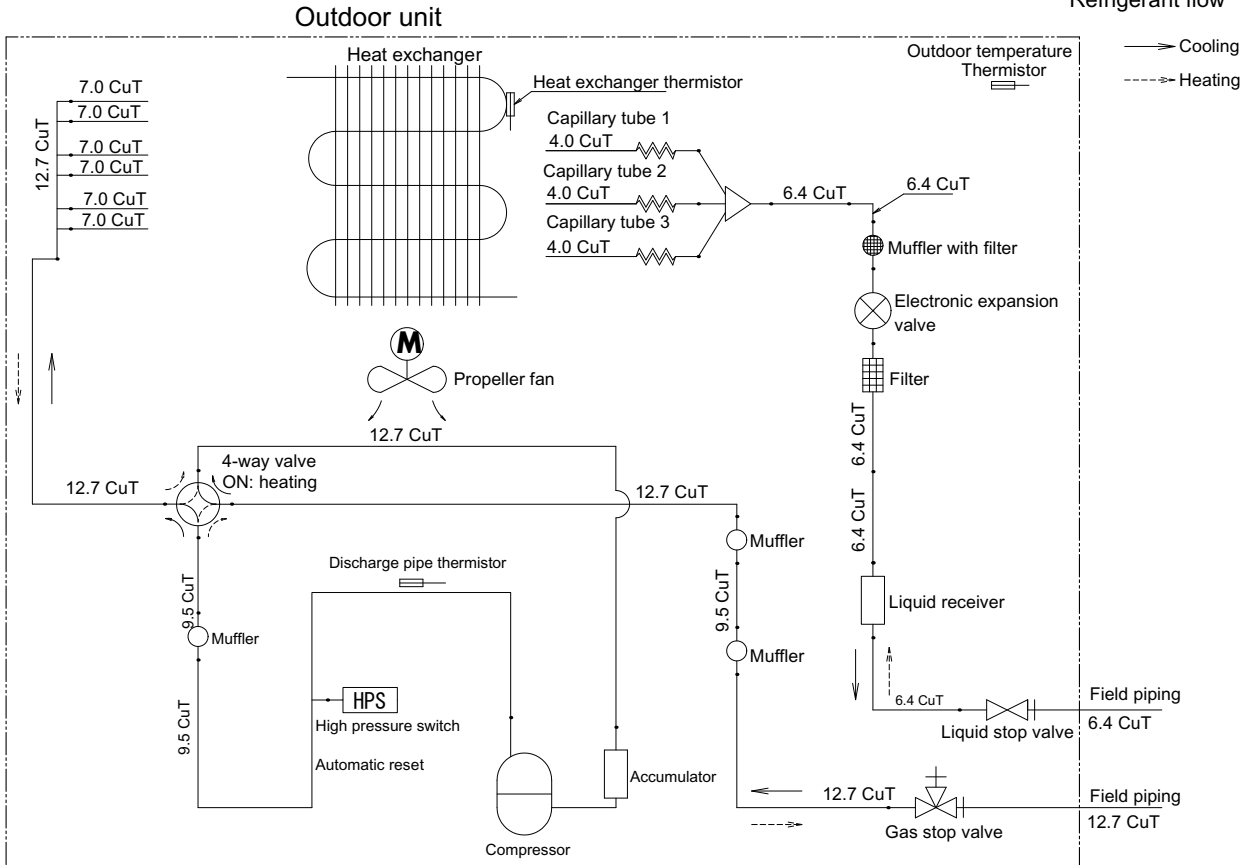


3D116829

8 Wiring diagrams

8 - 1 Wiring Diagrams - Single Phase

8

RXM20-35N9

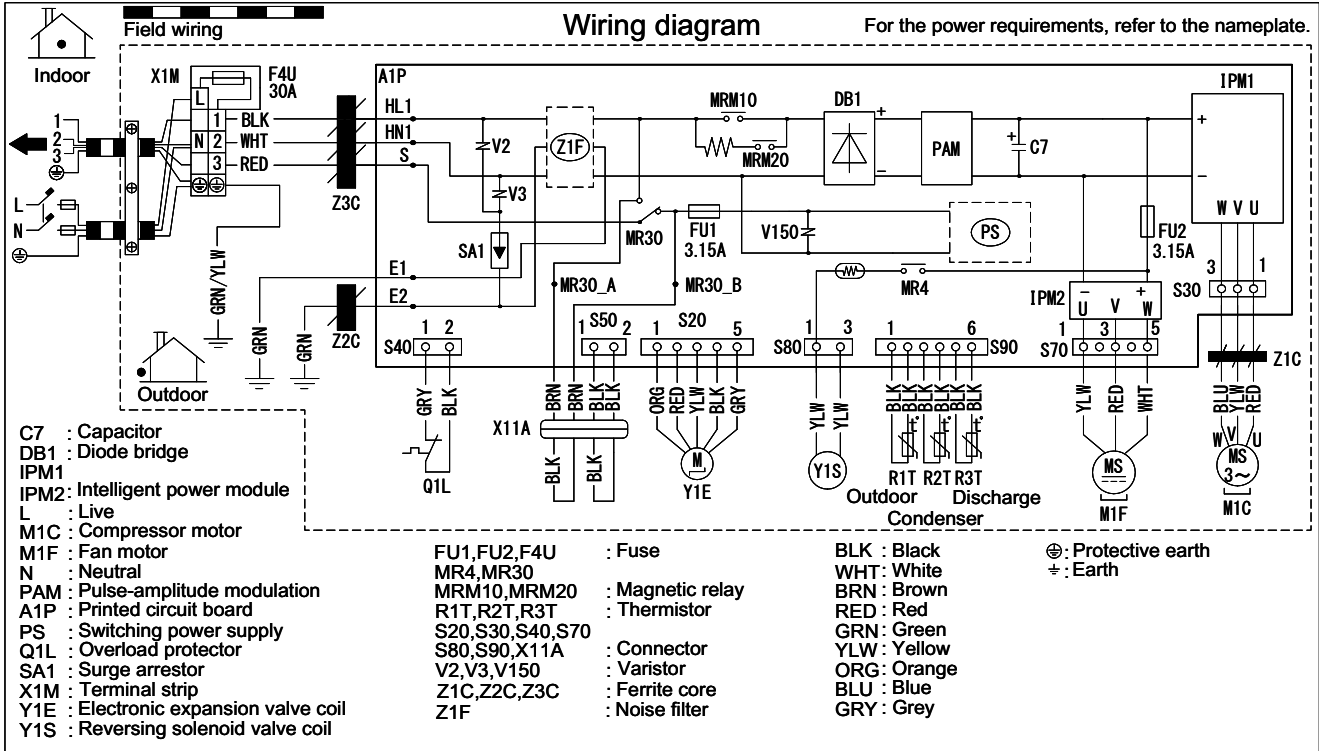


Notes

Size: 140 x 80

Refer to purchasing specification AS303002, unless otherwise specified.

4D120154


RXM42N9

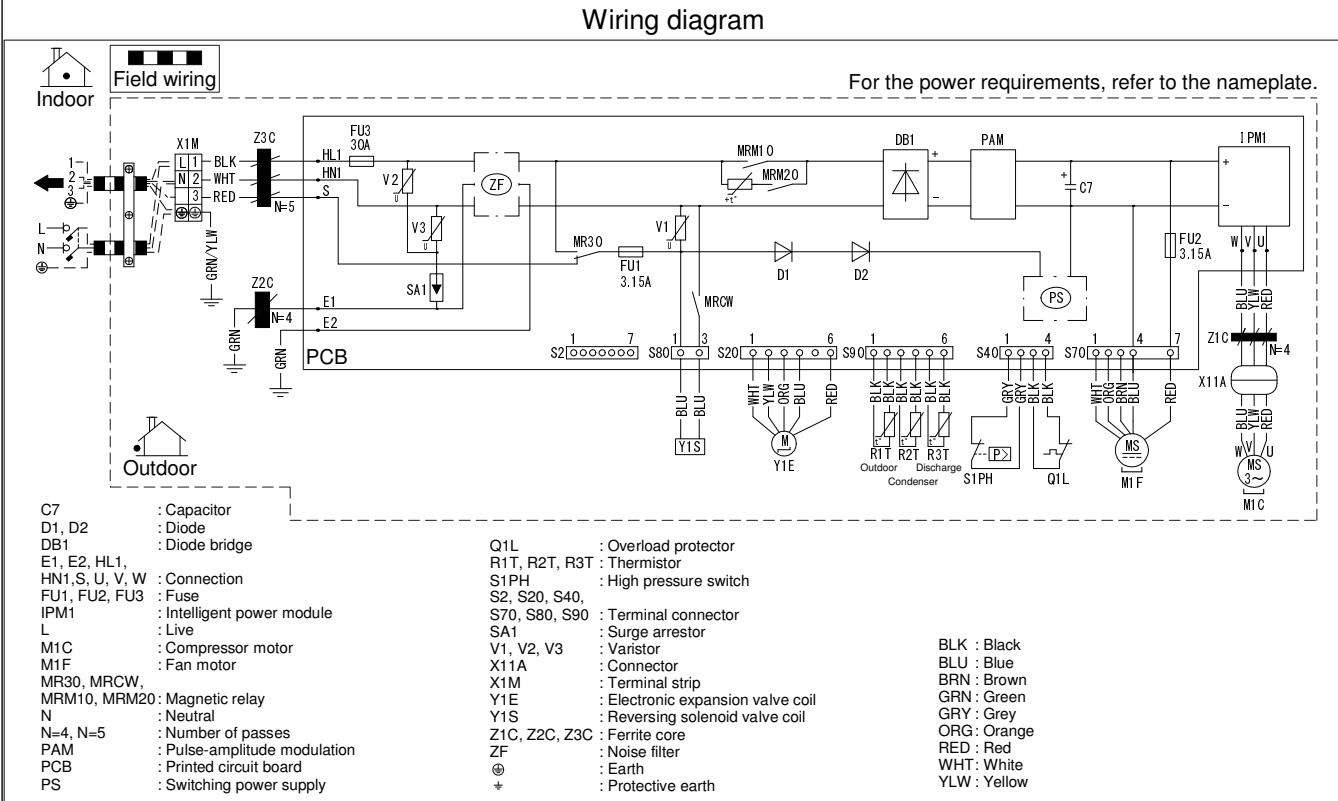

3D114452A

8 Wiring diagrams

8 - 1 Wiring Diagrams - Single Phase


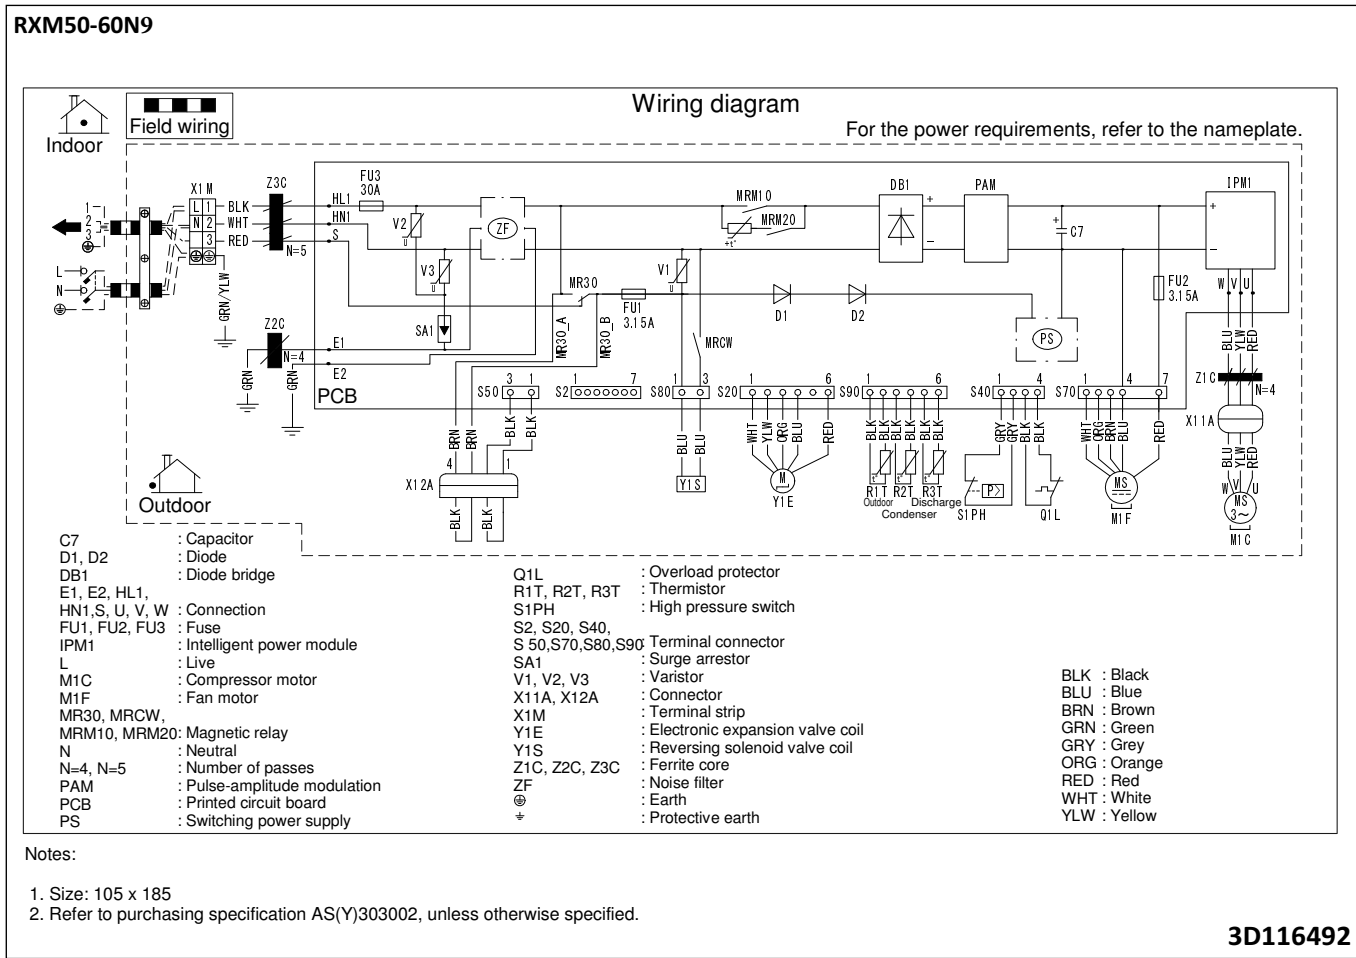


9 Sound data

9 - 1 Sound Pressure Spectrum

9

RXM20N9

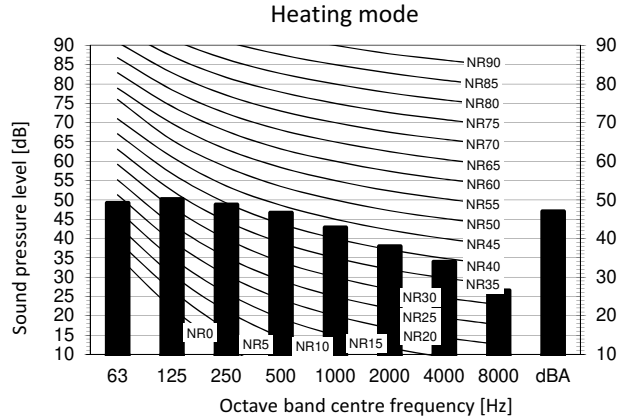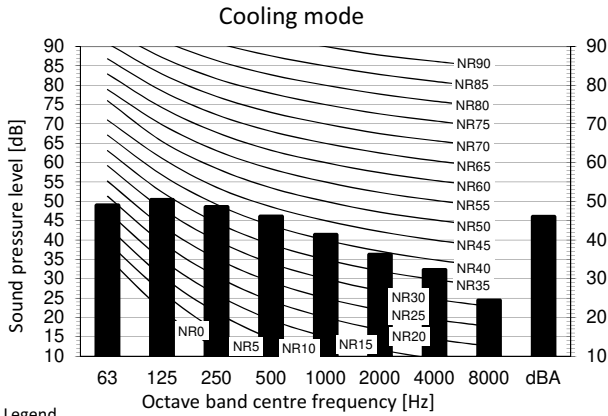


Legend

dBA = A-weighted sound pressure level (A scale according to IEC).

- A Scale
- B Fan speed: High

Location of microphone



Cooling		Total dB
A	B	
dBA		46



Heating		Total dB
A	B	
dBA		47

Notes

- 1 Background noise already taken into account.
- 2 Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard
- 3 Operating noise varies depending on operation and ambient conditions.
- 4 The operation noise measuring method is in accordance with JISC9612.
- 5 Measuring location: anechoic chamber

3D110121A

RXM25N9

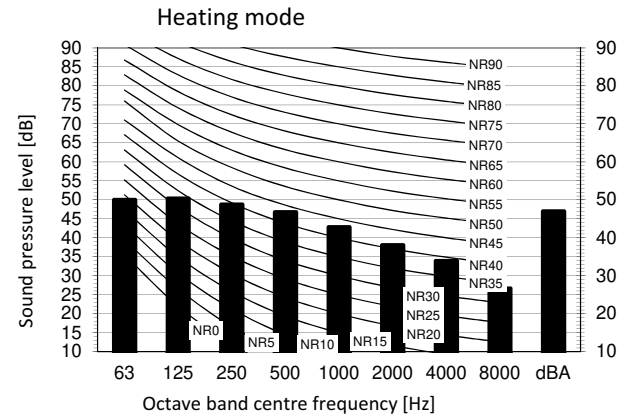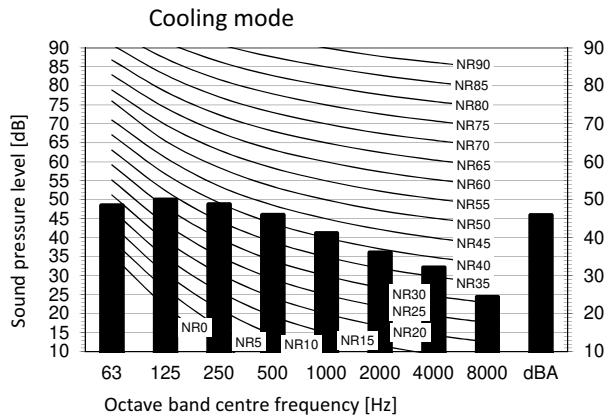


Legend

dBA = A-weighted sound pressure level (A scale according to IEC).

- A Scale
- B Fan speed: High

Location of microphone



Cooling		Total dB
A	B	
dBA		46

Heating		Total dB
A	B	
dBA		47

Notes


- 1 Background noise already taken into account.
- 2 Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard
- 3 Operating noise varies depending on operation and ambient conditions.
- 4 The operation noise measuring method is in accordance with JISC9612.
- 5 Measuring location: anechoic chamber

3D110122A

9 Sound data

9 - 1 Sound Pressure Spectrum

RXM35N9

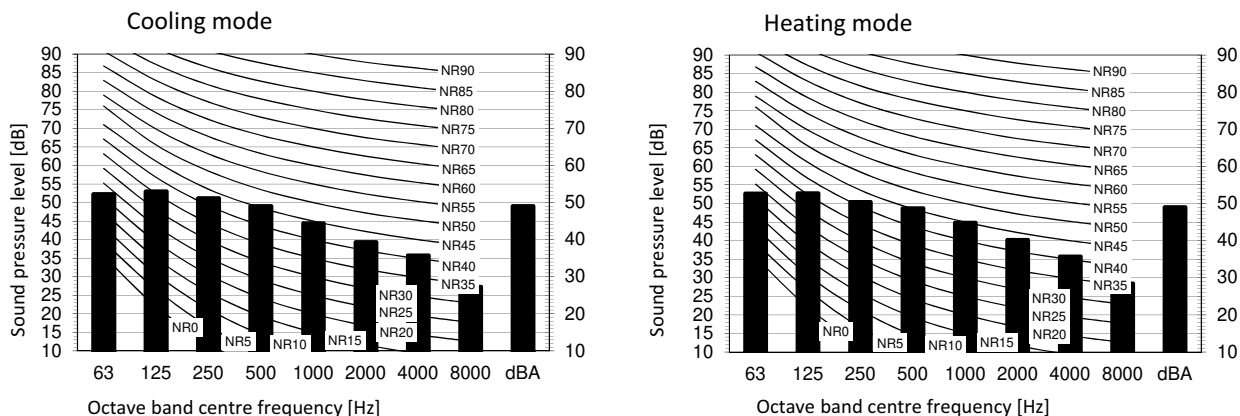


Legend

dBA = A-weighted sound pressure level (A scale according to IEC).

- A Scale
- B Fan speed: High

Location of microphone



Notes


- 1 Background noise already taken into account.
- 2 Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard
- 3 Operating noise varies depending on operation and ambient conditions.
- 4 The operation noise measuring method is in accordance with JISC9612.
- 5 Measuring location: anechoic chamber

Cooling		Total dB
A	B	
dBA		49

Heating		Total dB
A	B	
dBA		49

3D110123A

RXM42N9

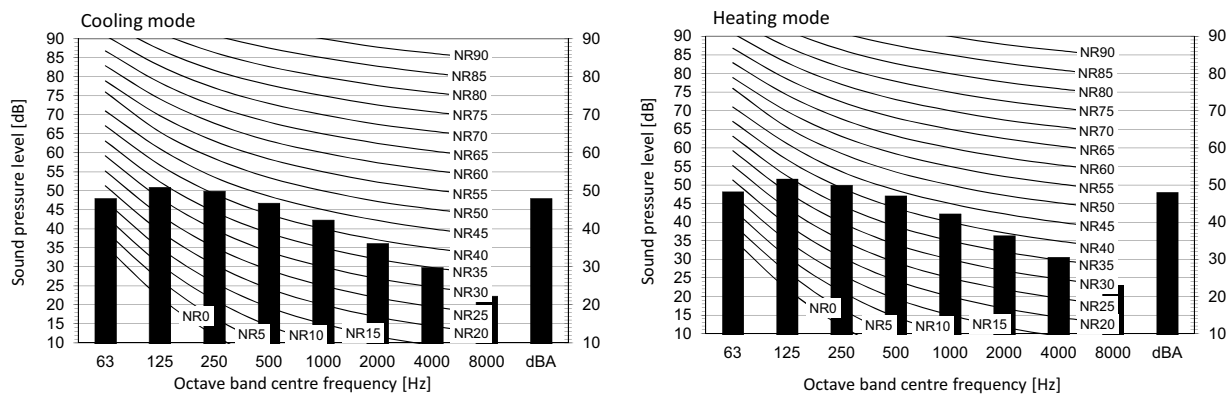


Legend

dBA = A-weighted sound pressure level (A scale according to IEC).

- A Scale
- B Fan speed: High

Location of microphone



Cooling		Total dB
A	B	
dBA		48,0

Heating		Total dB
A	B	
dBA		48,0

Notes

- 1 . Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard
- 2 . Background noise already taken into account.
- 3 . Operating noise varies depending on operation and ambient conditions.
- 4 . The operation noise measuring method is in accordance with JISC9612.
- 5 . Measuring location: anechoic chamber



3D117529

9 Sound data

9 - 1 Sound Pressure Spectrum

9

RXM50N9

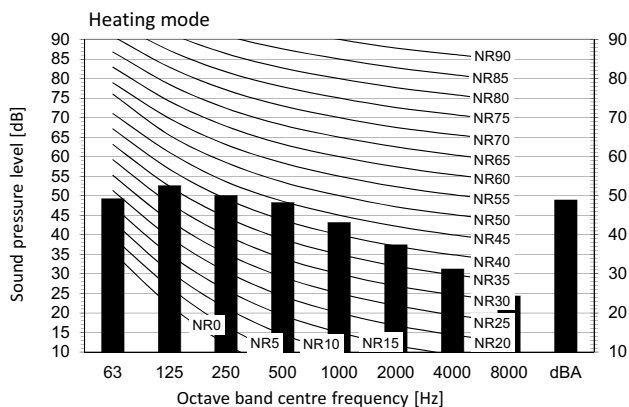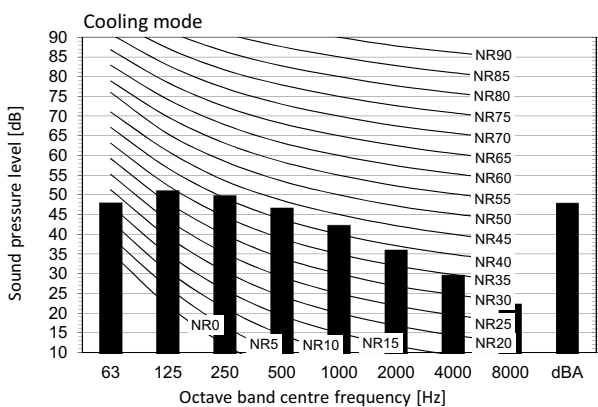

Legend

dBA = A-weighted sound pressure level (A scale according to IEC).


A Scale

B Fan speed: High

Cooling		Total dBA
A	B	
dBA		48,0

Heating		Total dBA
A	B	
dBA		49,0

Location of microphone





Notes

1. Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard
2. Background noise already taken into account.
3. Operating noise varies depending on operation and ambient conditions.
4. The operation noise measuring method is in accordance with JISC9612.
5. Measuring location: anechoic chamber

3D117528

RXM60N9

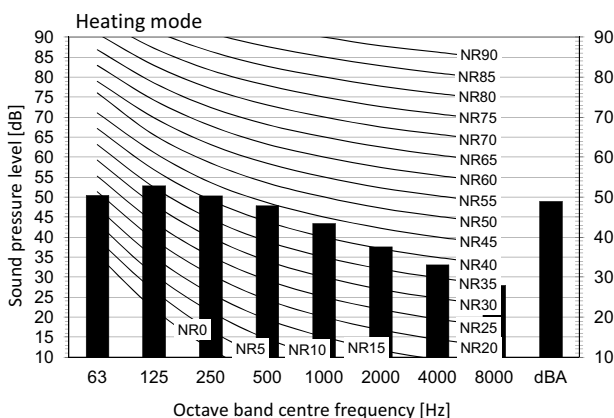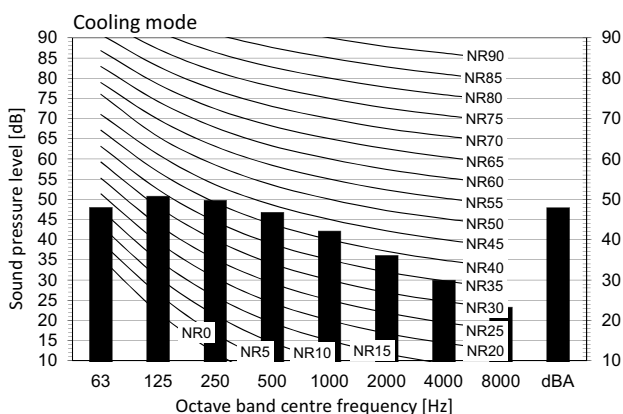

Legend

dBA = A-weighted sound pressure level (A scale according to IEC).


A Scale

B Fan speed: High

Cooling		Total dBA
A	B	
dBA		48,0

Heating		Total dBA
A	B	
dBA		49,0

Location of microphone



Notes



1. Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard
2. Background noise already taken into account.
3. Operating noise varies depending on operation and ambient conditions.
4. The operation noise measuring method is in accordance with JISC9612.
5. Measuring location: anechoic chamber

3D117530

10 Operation range

10 - 1 Operation Range



RXM-N9

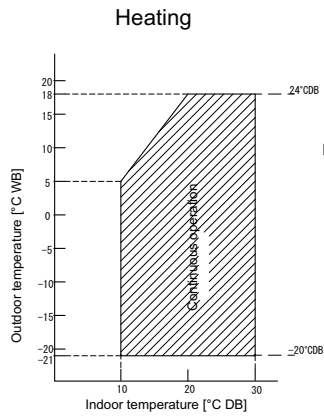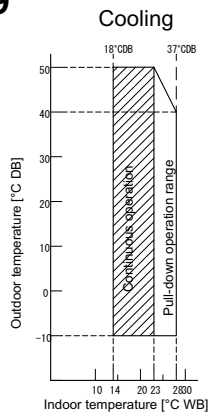

Notes

- The graph is based on the following conditions.
 Corresponding refrigerant piping length: 5 m
 Level difference: 0m
 Air flow rate High

Only possible in combination with CTXM*N2V1B, ATXM*N2V1B, FTXM*N2V1B

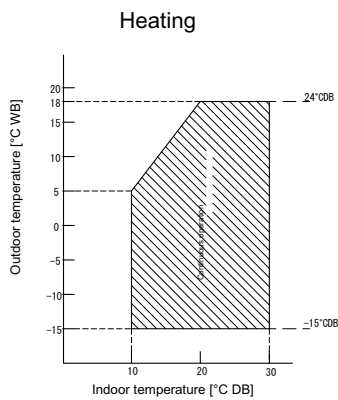
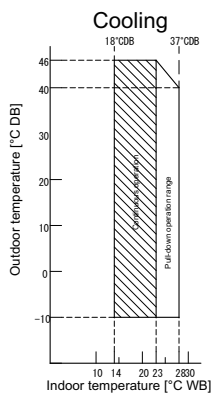


Only possible in combination with CTXM*M2V1B, ATXM*M2V1B, FTXM*M2V1B, FVXM*FV1B, FCAG*AVEB, FFA*A2VEB9, FBA*A2VEB9, FHA*AVEB9, FDXM*F3V1B9, FNA*A2VEB9

3D119882B



Daikin Europe N.V. Naamloze Vennootschap - Zandvoordestraat 300, B-8400 Oostende - Belgium - www.daikin.eu - BE 0412 120 336 - RPR Oostende



EEDEN19 03/19



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.