



NOTES


- DO NOT SCALE FROM THIS DRAWING.
- CONTRACTOR SHALL MONITOR THE EXISTING LOADS ON THE BUILDING AND ADVISE ON PHASE BALANCING, BEFORE ANY NEW WORKS ARE CARRIED OUT.
- THE ELECTRICAL CONTRACTOR SHALL INSTRUCT UKPN TO ISOLATE THE MAIN SUPPLY FUSES TO ALLOW THE NEW MECHANICAL BOARD TO BE CONNECTED.
- ONCE RECONNECTION TO THE LV NETWORK HAS BEEN CARRIED OUT, THE CONTRACTOR SHALL ENSURE THAT SAFETY SEALS ARE PROVIDED AS APPROPRIATE.
- THE CONTRACTOR SHALL MAKE ALL NECESSARY APPLICATIONS FOR THE NEW UTILITY METER AND ENSURE THIS IS CONNECTED BEFORE POWER IS RESTORED.
- THE ELECTRICAL CONTRACTOR SHALL REFER TO THE ELECTRICAL SCOPE OF WORKS DOCUMENT FOR FULL DETAILS OF THE PROPOSED DESIGN.

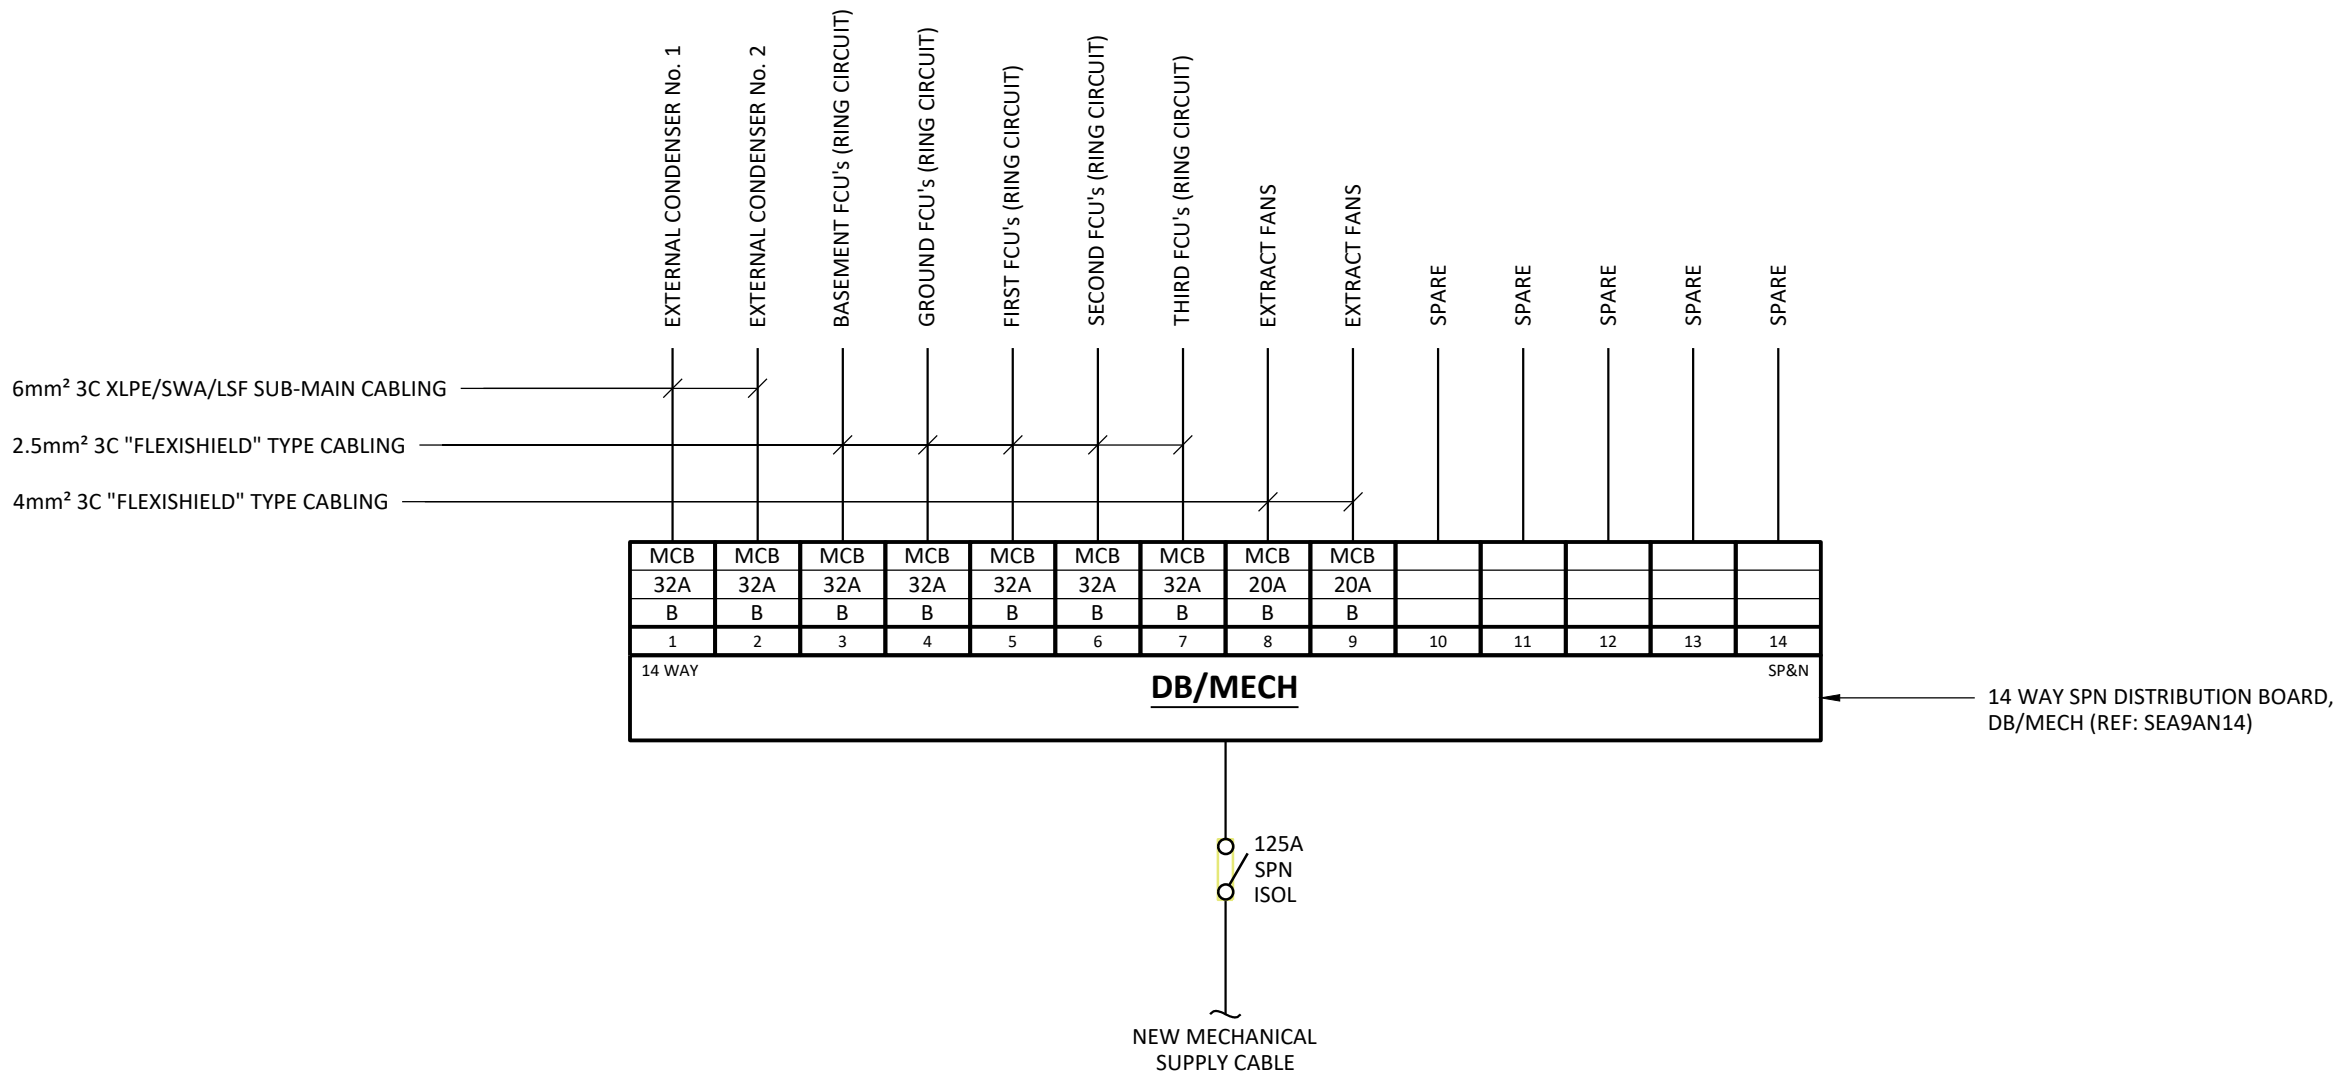

EXISTING SCHEMATIC

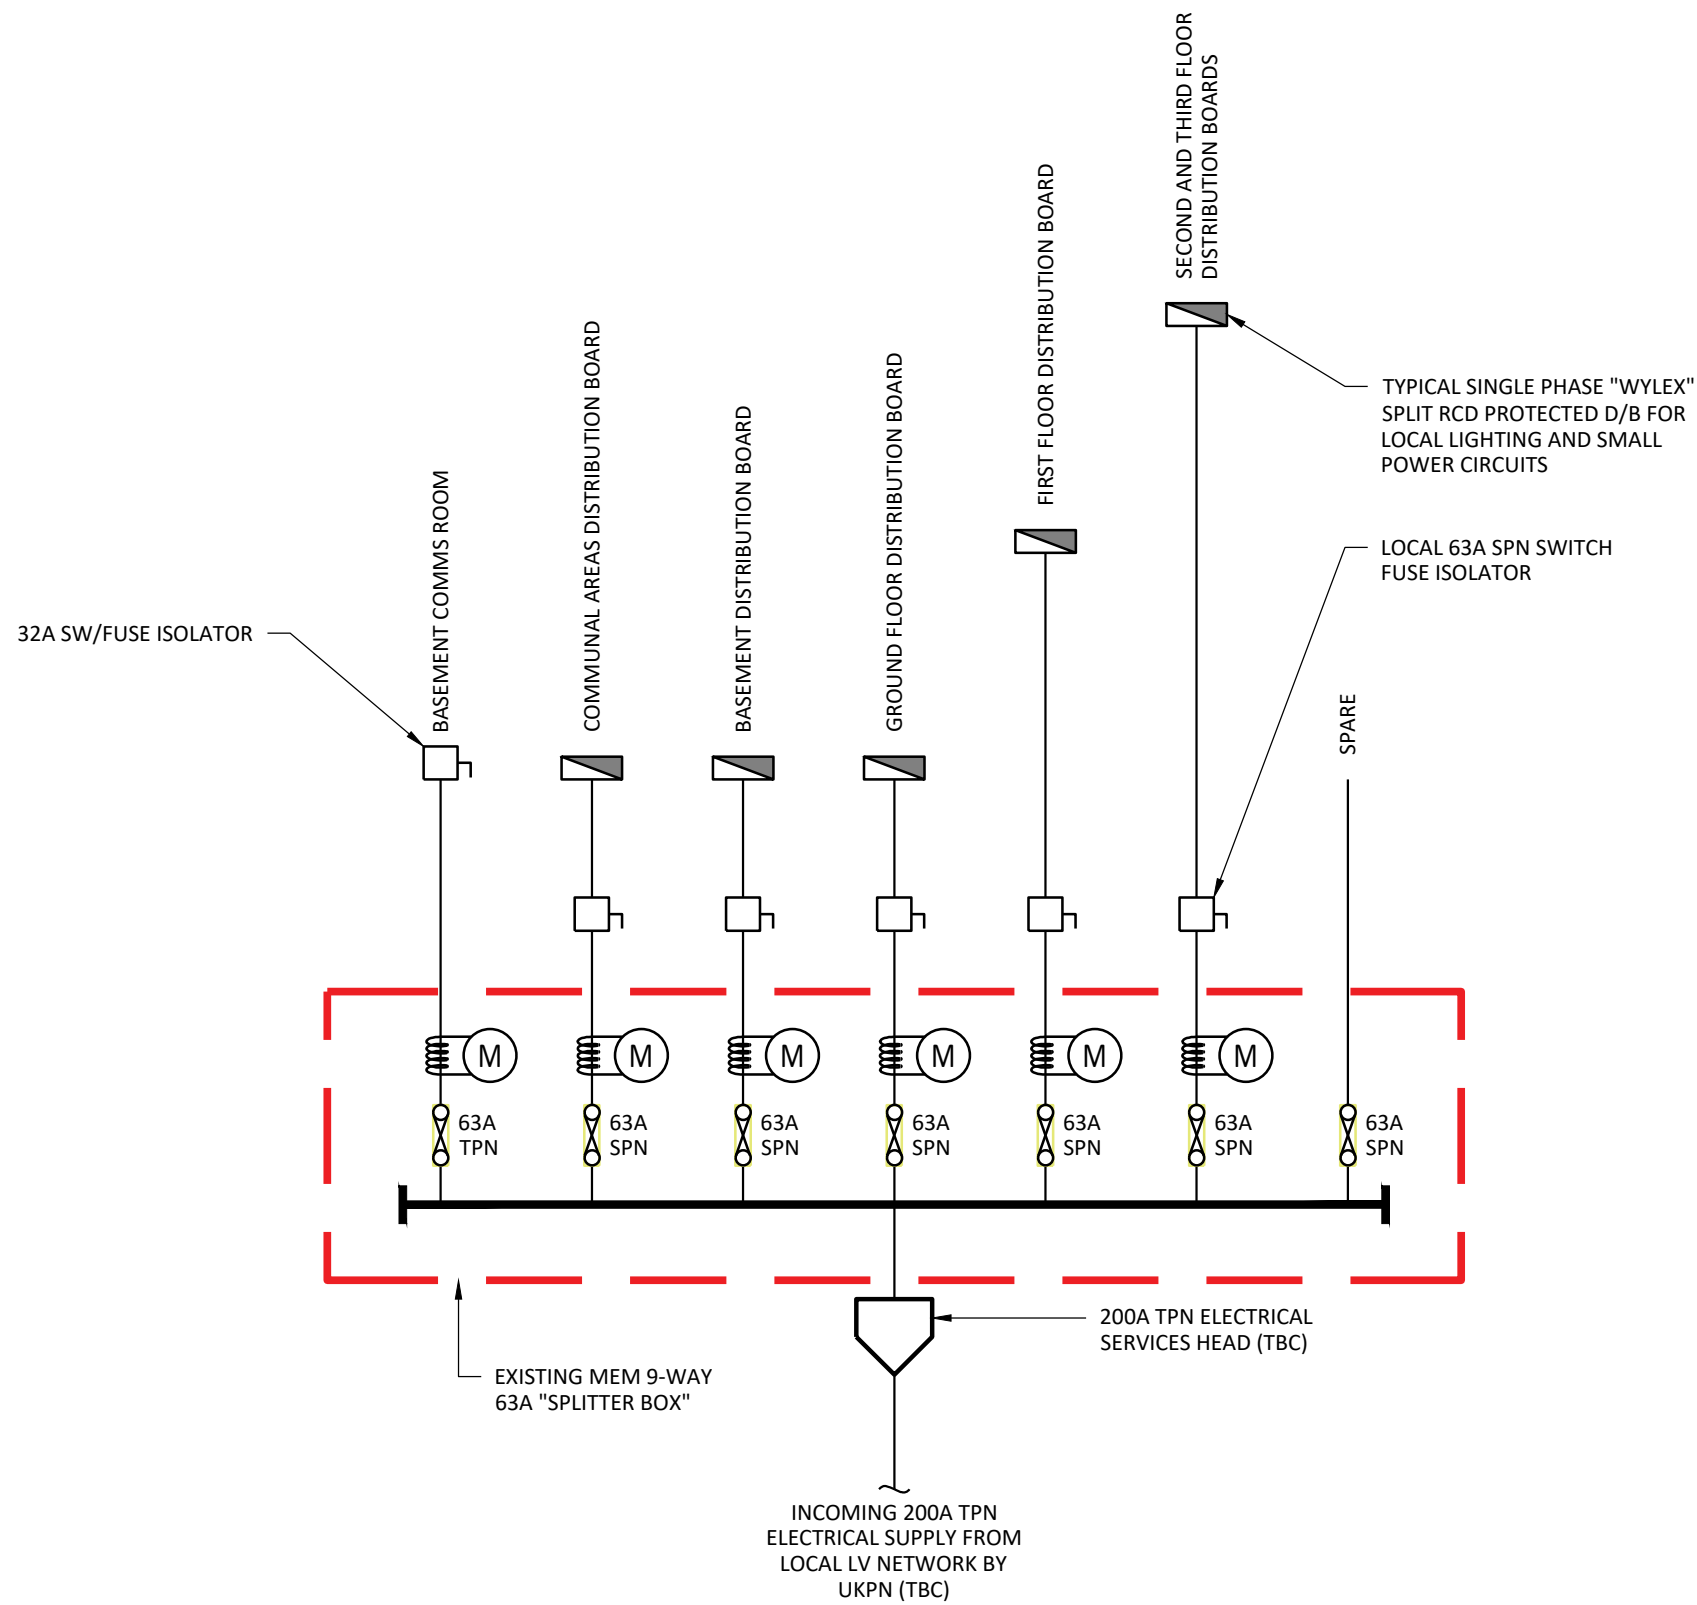

PROPOSED SCHEMATIC

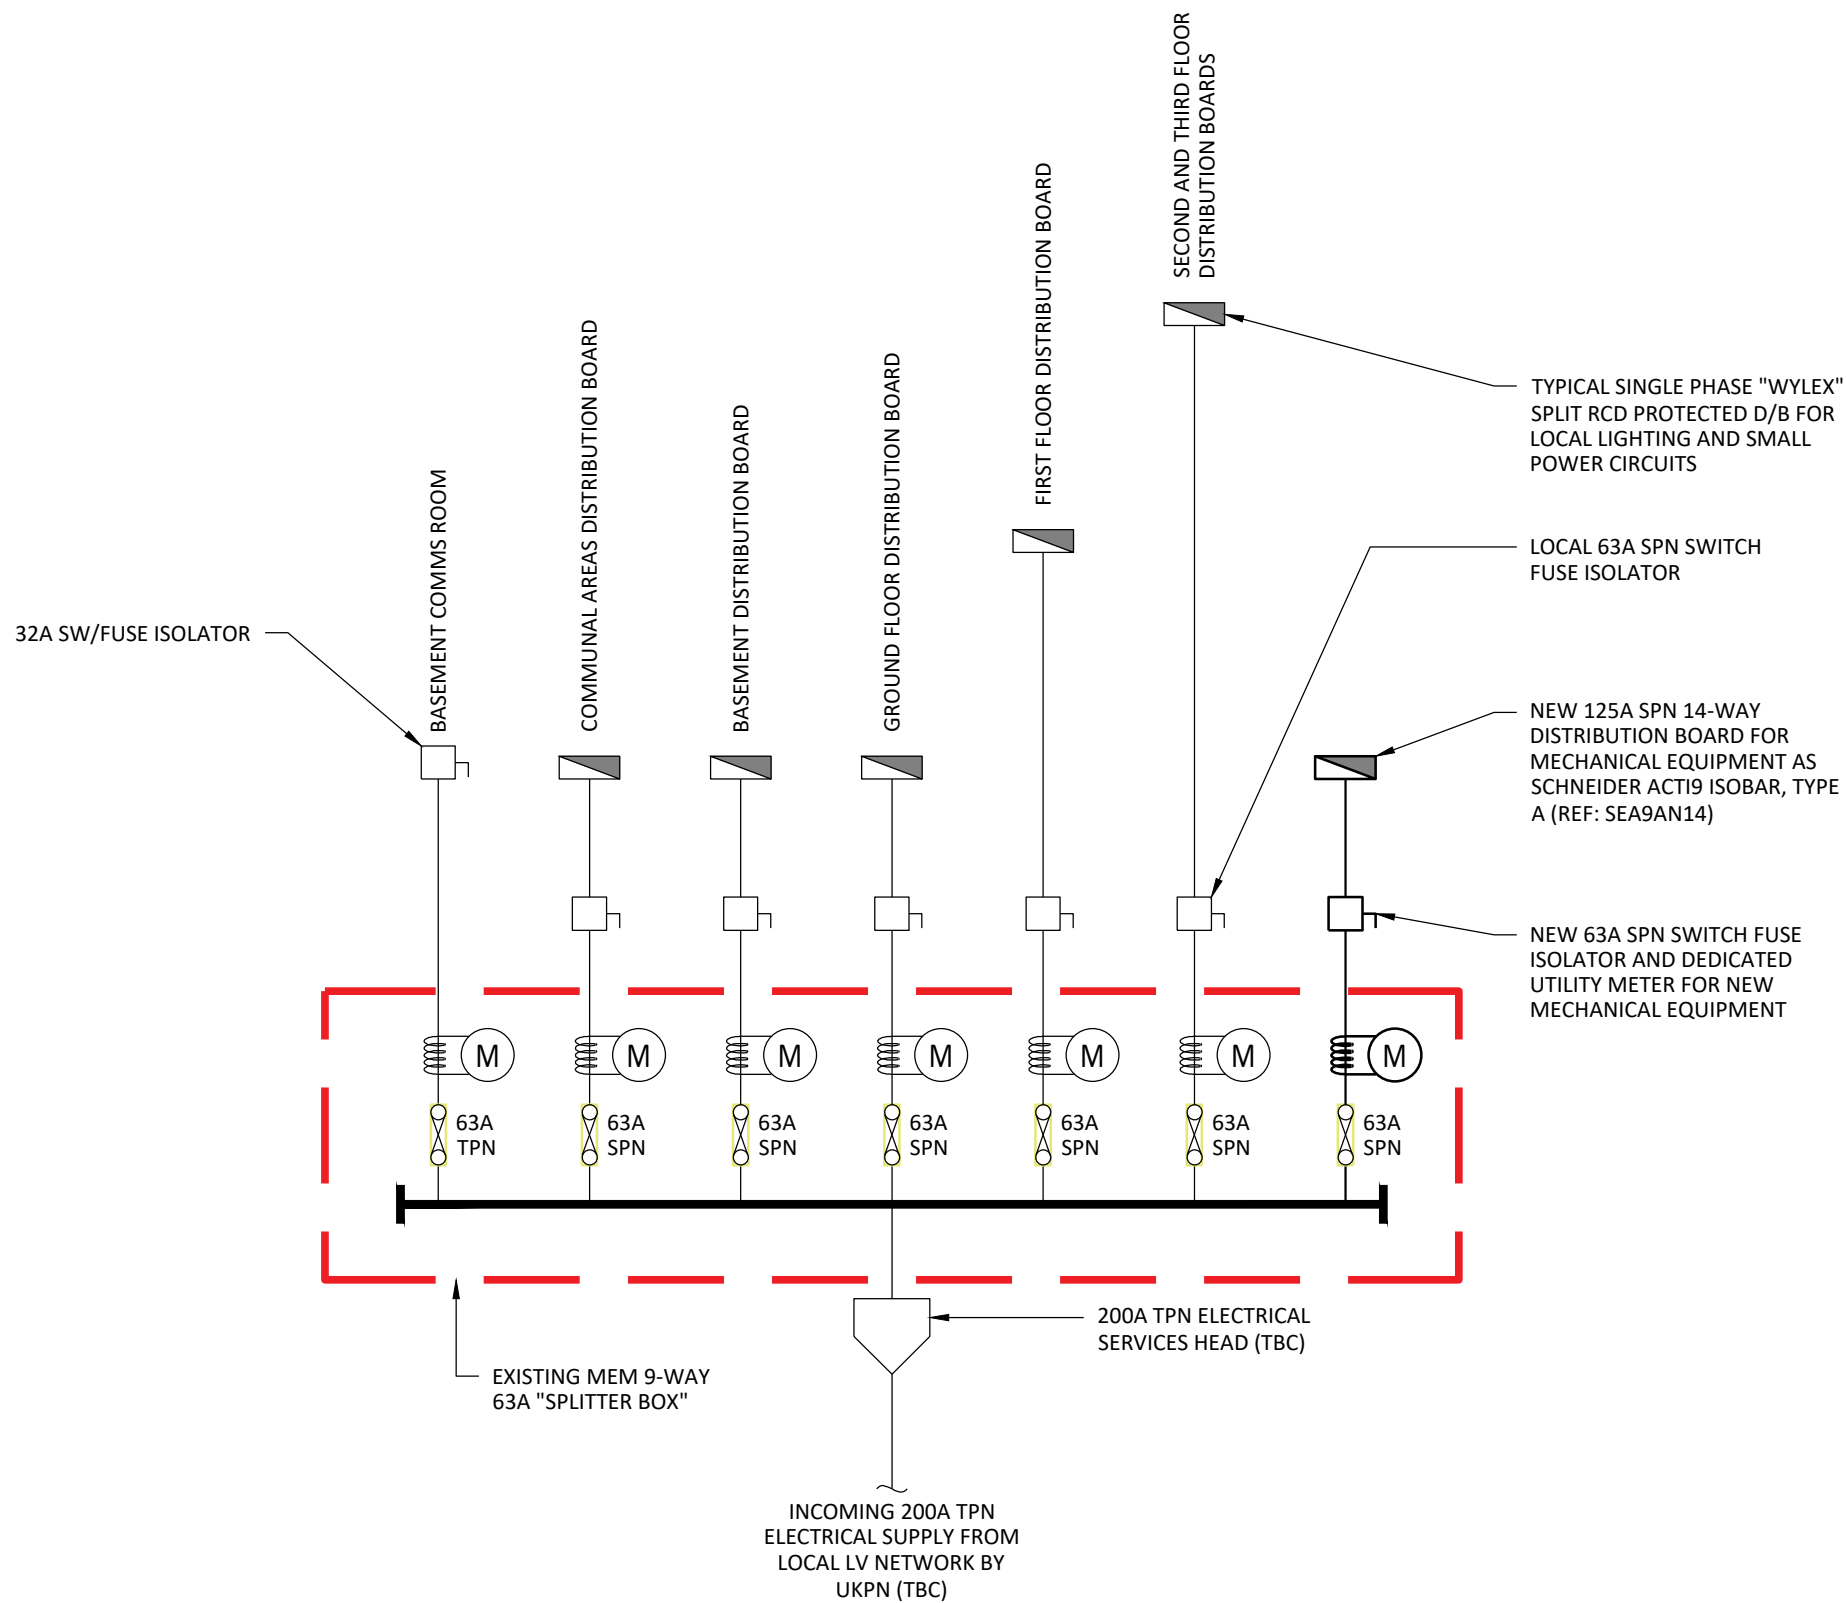

P1			
REV	DESCRIPTION	DATE	CHKD
PRELIMINARY ISSUE			
 Vintage Yard, 59-63 Bermondsey Street London SE1 3XF, Tel: 020 7336 0808			
CLIENT			
PROJECT			
27 FITZROY SQUARE LONDON W1T 6ES			
TITLE			
ELECTRICAL SCHEMATIC			
SCALE	PAGE SIZE	STATUS	DATE
NTS @ A1	A1		NOV 2020
JOB No.	DRAWN	ENGINEER	CHECKED
DRAWING No.			REVISION
3935/E101			----