

Report VA3753.210708.NIA

10 Charlotte Place, London

Noise Impact Assessment

09 July 2021

**Fan Rescue Limited
Unit 129, Ability House
121 Brooker Road
Waltham Cross
EN9 1JH**

01962 461016
0203 8650332
mail@ventaacoustics.com

registered company no. 10139494

Contents

1. Introduction.....	1
2. Design Criterion and Assessment Methodology	1
2.1 Consultation with the Local Authority.....	1
2.2 BS8233:2014	2
3. Site Description.....	2
4. Environmental Noise Survey	3
4.1 Survey Procedure & Equipment	3
4.2 Results	3
4.3 Plant Noise Emission Limits	4
5. Predicted Noise Impact	4
5.1 Proposed plant.....	4
5.2 Recommended Mitigation Measures	4
5.3 Predicted noise levels.....	5
5.4 Comparison to NR35 Curve	5
5.5 Structureborne Noise	6
5.6 Comparison to BS8233:2014 Criteria.....	6
6. Conclusion	6

Attachments

VA3753/SP1	Indicative Site Plan
VA3753/TH1-TH3	Environmental Noise Time Histories
Appendix A	Acoustic Terminology
Appendix B	Acoustic Calculations

1. Introduction

It is proposed to install a new kitchen supply and extract system to service the restaurant at 10 Charlotte Place, London.

Venta Acoustics has been commissioned by Fan Rescue Limited to undertake an assessment of the potential noise impact of these proposals in support of an application for planning permission.

An environmental noise survey has been undertaken to determine the background noise levels at the most affected noise sensitive receptors. These levels are used to undertake an assessment of the likely impact with reference to the planning requirements of Camden Council.

2. Design Criterion and Assessment Methodology

2.1 Consultation with the Local Authority

Camden Council's Local Plan (adopted June 2017), Appendix 3, provides the following guidance regarding noise from Industrial and Commercial Noise Sources

A relevant standard or guidance document should be referenced when determining values for LOAEL and SOAEL for non-anonymous noise. Where appropriate and within the scope of the document it is expected that British Standard 4142:2014 'Methods for rating and assessing industrial and commercial sound' (BS 4142) will be used. For such cases a 'Rating Level' of 10 dB below background (15dB if tonal components are present) should be considered as the design criterion).

Existing Noise sensitive receiver	Assessment Location	Design Period	LOAEL (Green)	LOAEL to SOAEL (Amber)	SOAL (Red)
Dwellings**	Garden used for main amenity (free field) and Outside living or dining or bedroom window (façade)	Day	'Rating level' 10dB* below background	'Rating level' between 9dB below and 5dB above background	'Rating level' greater than 5dB above background
Dwellings**	Outside bedroom window (façade)	Night	'Rating level' 10dB* below background and no events exceeding 57dB _{L_{Amax}}	'Rating level' between 9dB below and 5dB above background or noise events between 57dB and 88dB _{L_{Amax}}	'Rating level' greater than 5dB above background and/or events exceeding 88dB _{L_{Amax}}

**10dB should be increased to 15dB if the noise contains audible tonal elements. (day and night). However, if it can be demonstrated that there is no significant difference in the character of the residual background noise and the specific noise from the proposed development then this reduction may not be required.*

In addition, a frequency analysis (to include, the use of Noise Rating (NR) curves or other criteria curves) for the assessment of tonal or low frequency noise may be required.

***levels given are for dwellings, however, levels are use specific and different levels will apply dependent on the use of the premises.*

The periods in Table C correspond to 0700 hours to 2300 hours for the day and 2300 hours to 0700 hours for the night. The Council will take into account the likely times of occupation for types of development and will be amended according to the times of operation of the establishment under consideration.

There are certain smaller pieces of equipment on commercial premises, such as extract ventilation, air conditioning units and condensers, where achievement of the rating levels (ordinarily determined by a BS:4142 assessment) may not afford the necessary protection. In these cases, the Council will generally also require a NR curve specification of NR35 or below, dependant on the room (based upon measured or predicted $L_{eq,5mins}$ noise levels in octave bands) 1 metre from the façade of affected premises, where the noise sensitive premise is located in a quiet background area.

2.2 BS8233:2014

BS8233 *Guidance on sound insulation and noise reduction for buildings* provides guidance as to suitable internal noise levels for different areas within residential buildings.

The relevant section of the standard is shown below in Table 2.1.

Activity	Location	07:00 to 23:00	23:00 to 07:00
Resting	Living Room	35 dB L_{Aeq} , 16 hour	-
Dining	Dining Room	40 dB L_{Aeq} , 16 hour	-
Sleeping (daytime resting)	Bedroom	35 dB L_{Aeq} , 16 hour	30 dB L_{Aeq} , 8 hour

Table 2.1 - Excerpt from BS8233: 2014

[dB ref. 20µPa]

3. Site Description

As illustrated on attached site plan VA3753/SP1, the site building is located a row of shops and restaurants with apartments above.

The most affected noise sensitive receivers are expected to be the apartments above 10 Charlotte Place.

Existing building services plant was noted on several of the neighbouring rooftops.

4. Environmental Noise Survey

4.1 Survey Procedure & Equipment

In order to establish the existing background noise levels at the site, a noise survey was carried out between Tuesday 6th and Friday 9th July 2021 at first floor level at the location shown in site plan VA3753/SP1. This location was chosen to be representative of the background noise level at the most affected noise sensitive receivers.

Continuous 5-minute samples of the L_{Aeq} , L_{Amax} , L_{A10} and L_{A90} sound pressure levels were undertaken at the measurement location.

The weather during the survey period was generally dry with light winds. The background noise data is not considered to have been compromised by these conditions.

Measurements were made generally in accordance with ISO 1996 2:2017 *Acoustics - Description, measurement and assessment of environmental noise – Part 2: Determination of sound pressure levels*.

The following equipment was used in the course of the survey:

Manufacturer	Model Type	Serial No	Calibration	
			Certificate No.	Date
NTi Class 1 Integrating SLM	XL2	A2A-12202-E0	UCRT21/1102	21/1/21
Larson Davis calibrator	CAL200	13049	UCRT21/1385	22/3/21

Table 4.1 – Equipment used for the tests

The calibration of the sound level meter was verified before and after use with no significant calibration drift observed.

4.2 Results

The measured sound levels are shown as time-history plots on the attached charts VA3753/TH1-3.

The background noise level is determined by road traffic noise in the area, with nearby plant controlling the noise level for some periods of the day.

The typical background noise levels measured were:

Monitoring Period	Minimum $L_{A90,5min}$
07:00 – 23:00 hours	48 dB
23:00 – 07:00 hours	48 dB

Table 4.2 – Typical background noise levels

[dB ref. 20 μ Pa]

4.3 Plant Noise Emission Limits

On the basis of the measured noise levels and the planning requirements of the Local Authority, and considering that it is not expected that tonal noise will be generated by the proposed plant units, the following plant specific sound levels should not be exceeded at the most affected noise sensitive receivers:

Monitoring Period	Design Criterion (L _{Aeq})
07:00 – 23:00 hours	38 dB
23:00 – 07:00 hours	38 dB

Table 4.3 – Specific sound pressure levels not to be exceeded at most affected noise sensitive receivers

5. Predicted Noise Impact

5.1 Proposed plant

The following plant is proposed for installation with the extract fan motor located externally, with the extract duct running up the rear of the building and terminating above eaves level. The supply fan will be located internally and the supply grille will be at first floor roof level at the approximate locations indicated on site plan VA3753/SP1.

Plant Item	Quantity	Proposed Model	Notes
Extract Fan	1	Helios GBW EC 450	
Supply Fan	1	Woods ESPADA 150	

Table 5.1 – Indicative plant selections assumed for this assessment.

Consulting the manufacturer's datasheets, the following noise emissions levels are attributed to the proposed plant items. The Woods catalogue provides a single value figure at 3m which has been converted into a sound power based on typical fans and reported below.

Plant Item	Octave Band Centre Frequency (Hz)								dB(A)
	Sound Power Level, L _w (dB)								
	63	125	250	500	1k	2k	4k	8k	
Helios GBW EC 450 - Exhaust	84	76	79	77	75	73	64	61	80
Helios GBW EC 450 - Breakout	72	64	65	51	47	45	41	32	58
Woods ESPADA 150	66	50	43	43	43	40	45	41	50

Table 5.2 – Advised plant noise data used for the assessment.

5.2 Recommended Mitigation Measures

The atmospheric side duct work of the fans will need to be fitted with attenuators providing the following minimum insertion losses.

Attenuation Component	Octave Band Centre Frequency (Hz) Silencer Insertion Loss (dB)							
	63	125	250	500	1k	2k	4k	8k
Extract – Attenuator 1	8	16	24	32	30	32	32	32
Extract – Attenuator 2	8	16	24	32	30	32	32	32
Supply - Attenuator	5	8	19	33	39	39	25	17

Table 5.3 – Minimum silencer insertion losses

Should the above insertion loss be achieved using multiple silencers, these should be separated from each other by a distance of minimum $3-4 \times D$, where D is the largest internal dimension of the duct work (e.g. D is 0.5m, so a minimum of 1.5-2m apart). Attenuators should be fitted as close to the fan as possible, and attached to the ductwork using flexible connections.

For the extract attenuator, it is recommended that a Melinex lined silencer is used to prevent grease impregnation into the acoustic media which may degrade the performance realised over time.

In addition to the above, the extract fan motor should be contained within an enclosure providing the minimum sound reduction values shown in Table 5.4

Attenuation Component	Octave Band Centre Frequency (Hz) Sound Reduction Performance (dB)							
	63	125	250	500	1k	2k	4k	8k
Extract Fan Enclosure	3	6	10	13	17	22	33	38

Table 5.4 – Minimum enclosure losses

Please note that the above recommendations relate to acoustic issues only. It is recommended that professional advice confirming the suitability of these measures be sought from others with regards to issues such as airflow, structural stability and visual impact.

5.3 Predicted noise levels

The cumulative noise level at the most affected noise sensitive receivers, at first floor and on the top floor above 10 Charlotte Place, has been calculated on the basis of the above information and assuming the recommended mitigation measures, with reference to the guidelines set out in BS4142:2014.

A summary of the calculations are shown in Appendix B.

Description	Sound Pressure Level
Plant noise criterion	38 dB(A)
L_p 1m from receiver – Top Floor	26 dB(A)
L_p 1m from receiver – First Floor	33 dB(A)

Table 5.5 – Predicted noise and level and design criteria at noise sensitive location

5.4 Comparison to NR35 Curve

As can be seen from the following comparison in Table 5.6, the predicted noise levels at 1m from the most affected receiver are comfortably below the NR35 curve.

Frequency (Hz)	63	125	250	500	1k	2k	4k	8k
NR35	63	52	45	39	35	35	30	28
L _p 1m from receiver – Top Floor	49	38	30	13	5	-2	-7	-4
L _p 1m from receiver – First Floor	57	41	35	18	10	3	8	12

Table 5.6 – Comparison of predicted noise levels against the NR35 criterion

5.5 Structureborne Noise

All plant and ductwork should be fitted with anti-vibration mounts in accordance with the manufacturer guidelines.

The extract fan will have a dominant case frequency of 50-60Hz. To mitigate this and remove the tonal content, the fan motor should be mounted on rubber or neoprene mounts with a minimum deflection of 5mm, which would provide 95% isolation efficiency, considerably more than the recommended minimum of 90% isolation.

The fan should be attached to the ductwork on either side using flexible coupling to minimise vibration transfer to the ductwork. Ductwork should be attached to the building using isolated fixings, with either a rubber or neoprene isolator with a minimum deflection of 1mm, which would provide 90% isolation, considerably more than would be required considering the reduced energy transmitted to the ductwork.

The above measures are to control structureborne noise and re-radiated noise to other areas of the building to considerably below current internal noise levels and hence would be considered acceptable.

5.6 Comparison to BS8233:2014 Criteria

BS8233 assumes a loss of approximately 15dB for a partially open window. The external noise level shown in Table 5.5 would result in internal noise levels that achieve the guidelines shown in Table 2.1.

6. Conclusion


A baseline noise survey has been undertaken by Venta Acoustics to establish the background noise climate in the locality of 10 Charlotte Place, London in support of a planning application for the proposed introduction of new building services plant.

This has enabled noise emission limits to be set at the most affected noise sensitive receiver such that the proposed installation meets the requirements of Camden Council .

The cumulative noise emission levels from the proposed plant have been assessed to be compliant with the plant noise emission limits, with necessary mitigation measures specified.

The proposed scheme is not expected to have a significant adverse noise impact and the relevant plant noise requirements have been shown to be met.


Jamie Duncan MIOA

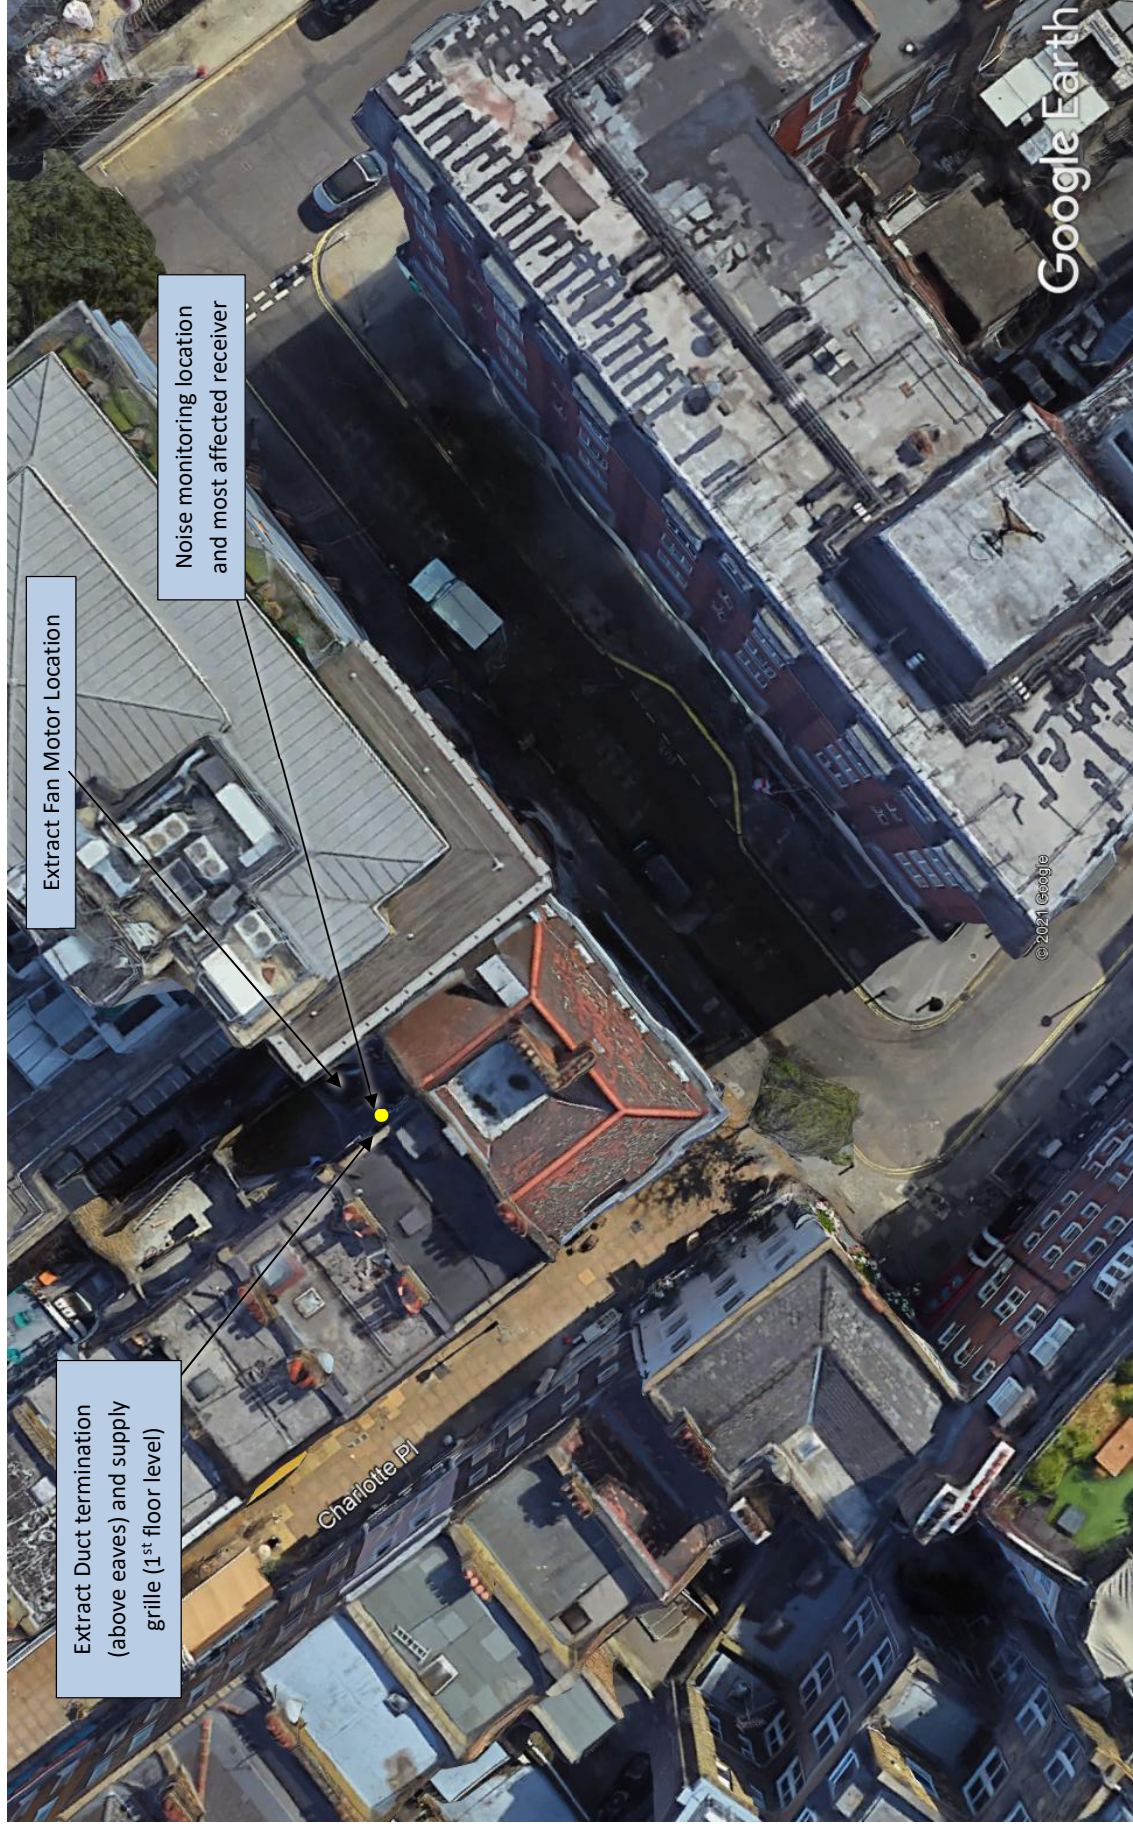

10 Charlotte Place, London
Environmental Noise Time History: 1




Figure VA3753/TH1

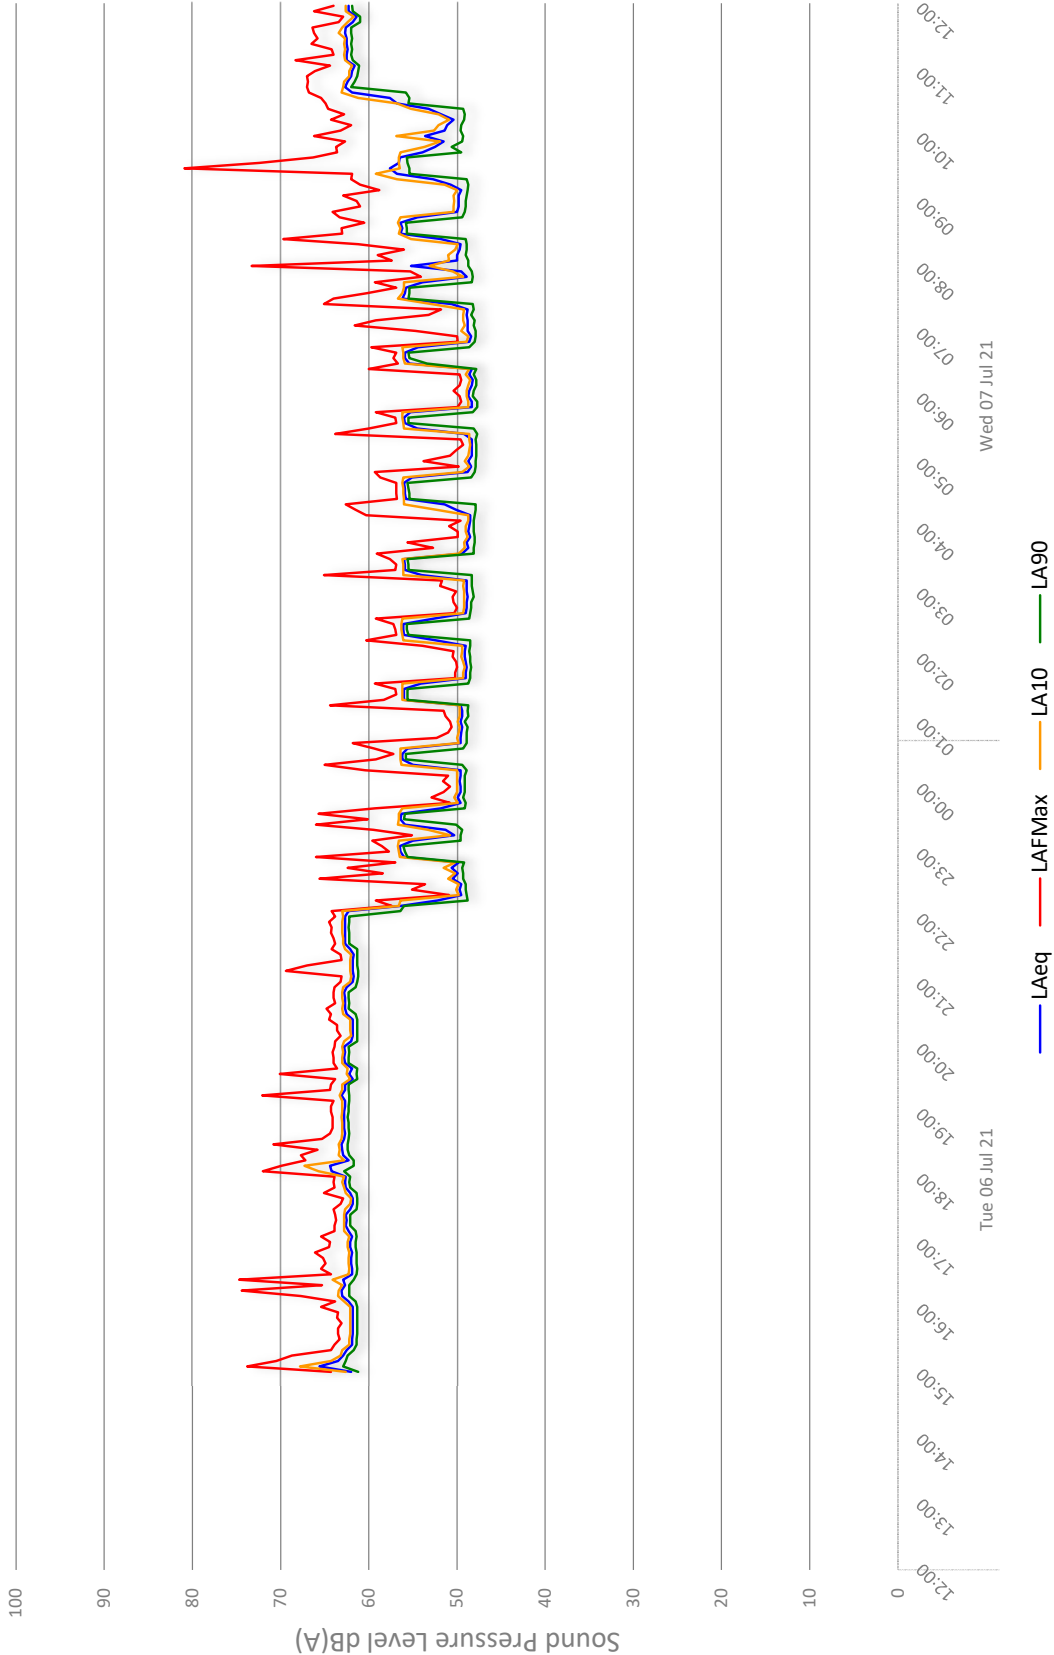

10 Charlotte Place, London
Environmental Noise Time History: 2




Figure VA3753/TH2

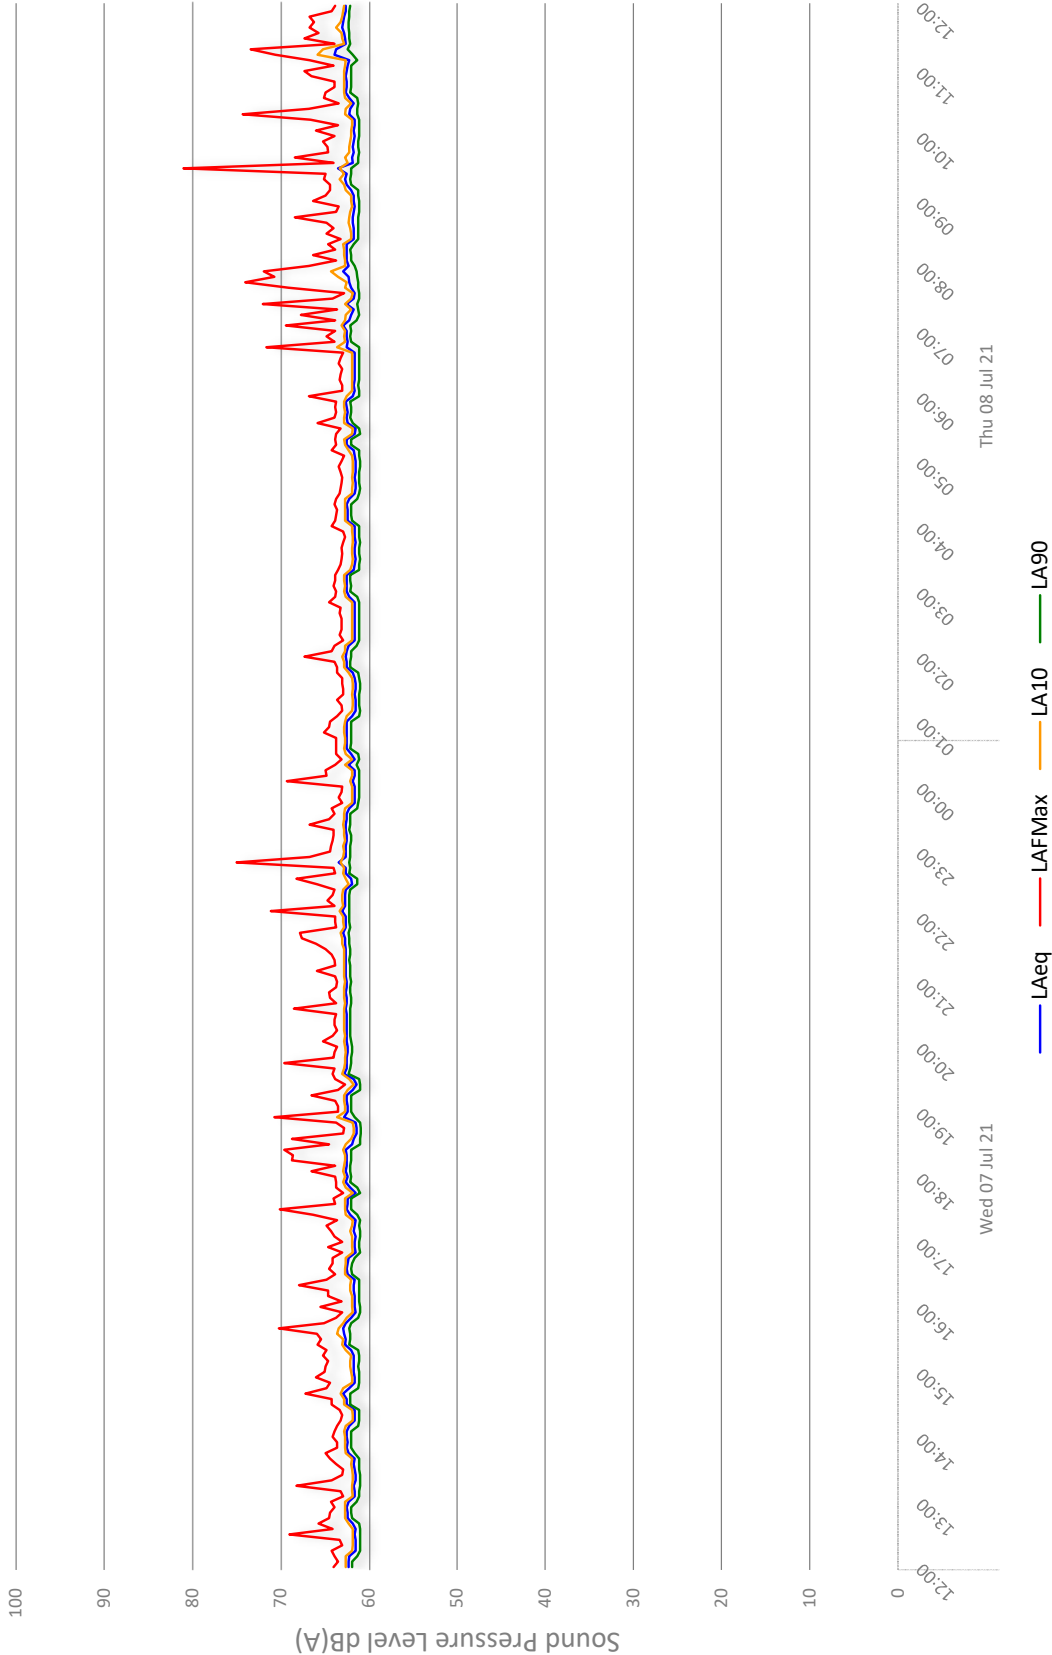

10 Charlotte Place, London
Environmental Noise Time History: 3



Figure VA3753/TH3

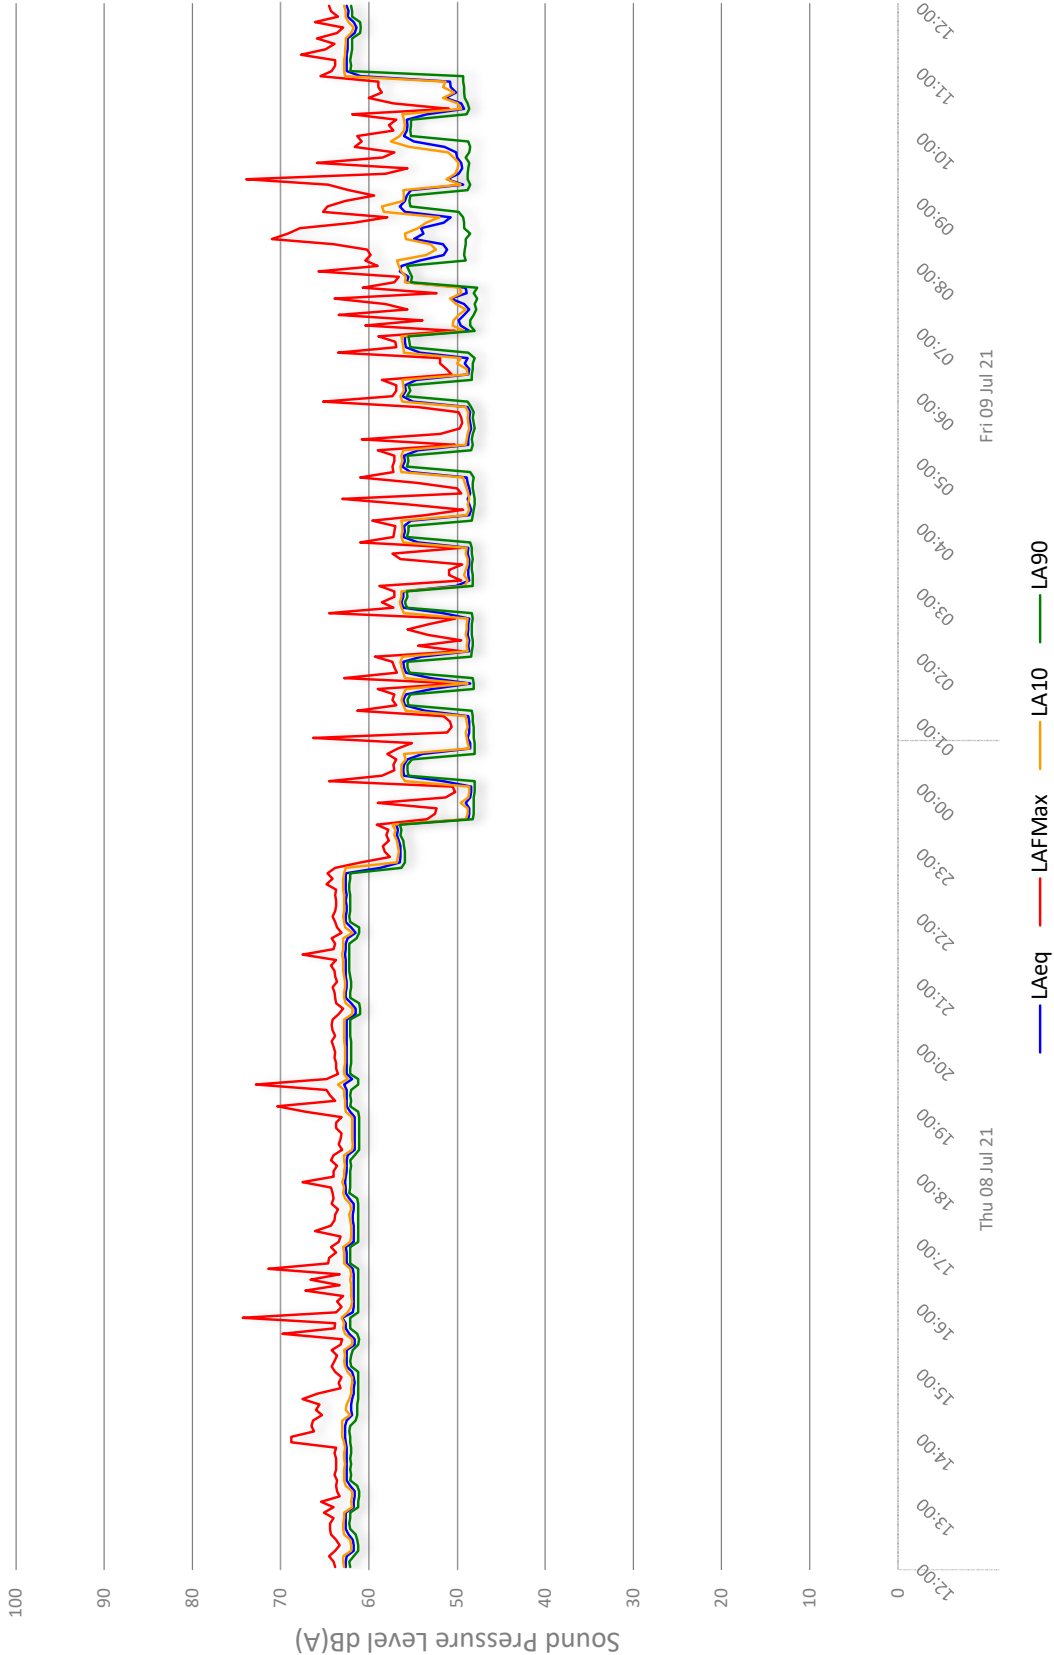

10 Charlotte Place, London
Environmental Noise Time History: 4



Figure VA3753/TH4



APPENDIX A

Acoustic Terminology & Human Response to Broadband Sound

1.1 Acoustic Terminology

The human impact of sounds is dependent upon many complex interrelated factors such as 'loudness', its frequency (or pitch) and variation in level. In order to have some objective measure of the annoyance, scales have been derived to allow for these subjective factors.

Sound	Vibrations propagating through a medium (air, water, etc.) that are detectable by the auditory system.
Noise	Sound that is unwanted by or disturbing to the perceiver.
Frequency	The rate per second of vibration constituting a wave, measured in Hertz (Hz), where 1Hz = 1 vibration cycle per second. The human hearing can generally detect sound having frequencies in the range 20Hz to 20kHz. Frequency corresponds to the perception of 'pitch', with low frequencies producing low 'notes' and higher frequencies producing high 'notes'.
dB(A):	Human hearing is more susceptible to mid-frequency sounds than those at high and low frequencies. To take account of this in measurements and predictions, the 'A' weighting scale is used so that the level of sound corresponds roughly to the level as it is typically discerned by humans. The measured or calculated 'A' weighted sound level is designated as dB(A) or L_A . A notional steady sound level which, over a stated period of time, would contain the same amount of acoustical energy as the actual, fluctuating sound measured over that period (e.g. 8 hour, 1 hour, etc).
L_{eq} :	The concept of L_{eq} (equivalent continuous sound level) has primarily been used in assessing noise from industry, although its use is becoming more widespread in defining many other types of sounds, such as from amplified music and environmental sources such as aircraft and construction. Because L_{eq} is effectively a summation of a number of events, it does not in itself limit the magnitude of any individual event, and this is frequently used in conjunction with an absolute sound limit.
L_{10} & L_{90} :	Statistical L_n indices are used to describe the level and the degree of fluctuation of non-steady sound. The term refers to the level exceeded for n% of the time. Hence, L_{10} is the level exceeded for 10% of the time and as such can be regarded as a typical maximum level. Similarly, L_{90} is the typical minimum level and is often used to describe background noise. It is common practice to use the L_{10} index to describe noise from traffic as, being a high average, it takes into account the increased annoyance that results from the non-steady nature of traffic flow.
R	<i>Sound Reduction Index</i> . Effectively the <i>Level Difference</i> of a building element when measured in an accredited laboratory test suite in accordance with the procedures laid down in BS EN ISO 10140-2:2010 and corrected for its size and the reverberant characteristics of the receive room.

1.2 Octave Band Frequencies

In order to determine the way in which the energy of sound is distributed across the frequency range, the International Standards Organisation has agreed on "preferred" bands of frequency for sound measurement and analysis. The widest and most commonly used band for frequency measurement and analysis is the Octave Band. In these bands, the upper frequency limit is twice the lower frequency limit, with the band being described by its "centre frequency" which is the average (geometric mean) of the upper and lower limits, e.g. 250 Hz octave band extends from 176 Hz to 353 Hz. The most commonly used octave bands are:

Octave Band Centre Frequency Hz	63	125	250	500	1000	2000	4000	8000
---------------------------------	----	-----	-----	-----	------	------	------	------

1.3 Human Perception of Broadband Noise

APPENDIX A

Acoustic Terminology & Human Response to Broadband Sound

Because of the logarithmic nature of the decibel scale, it should be borne in mind that sound levels in dB(A) do not have a simple linear relationship. For example, 100dB(A) sound level is not twice as loud as 50dB(A). It has been found experimentally that changes in the average level of fluctuating sound, such as from traffic, need to be of the order of 3dB before becoming definitely perceptible to the human ear. Data from other experiments have indicated that a change in sound level of 10dB is perceived by the average listener as a doubling or halving of loudness. Using this information, a guide to the subjective interpretation of changes in environmental sound level can be given.

Change in Sound Level dB	Subjective Impression	Human Response
0 to 2	Imperceptible change in loudness	Marginal
3 to 5	Perceptible change in loudness	Noticeable
6 to 10	Up to a doubling or halving of loudness	Significant
11 to 15	More than a doubling or halving of loudness	Substantial
16 to 20	Up to a quadrupling or quartering of loudness	Substantial
21 or more	More than a quadrupling or quartering of loudness	Very Substantial

APPENDIX B

VA3753 - 10 Charlotte Place, London

Noise Impact Assessment - Top Floor

Extract Fan		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Helios GBW EC 450 - Exhaust	Lw	84	76	79	77	75	73	64	61	80
Acoustica R02 3-1500 - Melinex Faced		-8	-16	-24	-32	-30	-32	-32	-32	
Acoustica R02 3-1500 - Melinex Faced		-8	-16	-24	-32	-30	-32	-32	-32	
Distance Loss	To 3m	-10	-10	-10	-10	-10	-10	-10	-10	
Spherical radiation		-11	-11	-11	-11	-11	-11	-11	-11	
Directivity (Hor:0,Vert:140)		-1	-2	-3	-7	-9	-8	-8	-8	
Level at receiver		47	22	7	-14	-15	-20	-29	-31	21

Extract Fan		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Helios GBW EC 450 - Breakout	Lw	72	64	65	51	47	45	41	32	58
Enclosure loss		-3	-6	-10	-13	-17	-22	-33	-38	
Distance Loss	To 7m	-17	-17	-17	-17	-17	-17	-17	-17	
Hemispherical radiation		-8	-8	-8	-8	-8	-8	-8	-11	
Level at receiver		44	33	30	13	5	-2	-17	-34	24

Supply Fan		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Woods ESPADA 150	Lw	66	50	43	43	43	40	45	41	50
Acoustica R02-6-1500		-5	-8	-19	-33	-39	-39	-25	-17	
Distance Loss	To 6m	-16	-16	-16	-16	-16	-16	-16	-16	
Quarter spherical radiation		-5	-5	-5	-5	-5	-5	-5	-5	
Directivity (Hor:0,Vert:90)		0	0	0	0	-4	-7	-7	-7	
Level at receiver		40	21	3	-11	-21	-27	-8	-4	15

Cumulative noise level at receiver 26 dB(A)

Noise Impact Assessment - First Floor

Extract Fan		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Helios GBW EC 450 - Exhaust	Lw	84	76	79	77	75	73	64	61	80
Acoustica R02 3-1500 - Melinex Faced		-8	-16	-24	-32	-30	-32	-32	-32	
Acoustica R02 3-1500 - Melinex Faced		-8	-16	-24	-32	-30	-32	-32	-32	
Distance Loss	To 8m	-18	-18	-18	-18	-18	-18	-18	-18	
Spherical radiation		-11	-11	-11	-11	-11	-11	-11	-11	
Directivity (Hor:0,Vert:140)		-1	-2	-3	-7	-9	-8	-8	-8	
Level at receiver		38	13	-1	-23	-23	-28	-37	-40	12

Extract Fan		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Helios GBW EC 450 - Breakout	Lw	72	64	65	51	47	45	41	32	58
Enclosure loss		-3	-6	-10	-13	-17	-22	-33	-38	
Distance Loss	To 4m	-12	-12	-12	-12	-12	-12	-12	-12	
Hemispherical radiation		-8	-8	-8	-8	-8	-8	-8	-11	
Level at receiver		49	38	35	18	10	3	-12	-29	29

Supply Fan		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Woods ESPADA 150	Lw	66	50	43	43	43	40	45	41	50
Acoustica R02-6-1500		-5	-8	-19	-33	-39	-39	-25	-17	
Distance Loss	To 1m	0	0	0	0	0	0	0	0	
Quarter spherical radiation		-5	-5	-5	-5	-5	-5	-5	-5	
Directivity (Hor:0,Vert:90)		0	0	0	0	-4	-7	-7	-7	
Level at receiver		56	37	19	5	-5	-11	8	12	30

Cumulative noise level at receiver 33 dB(A)