


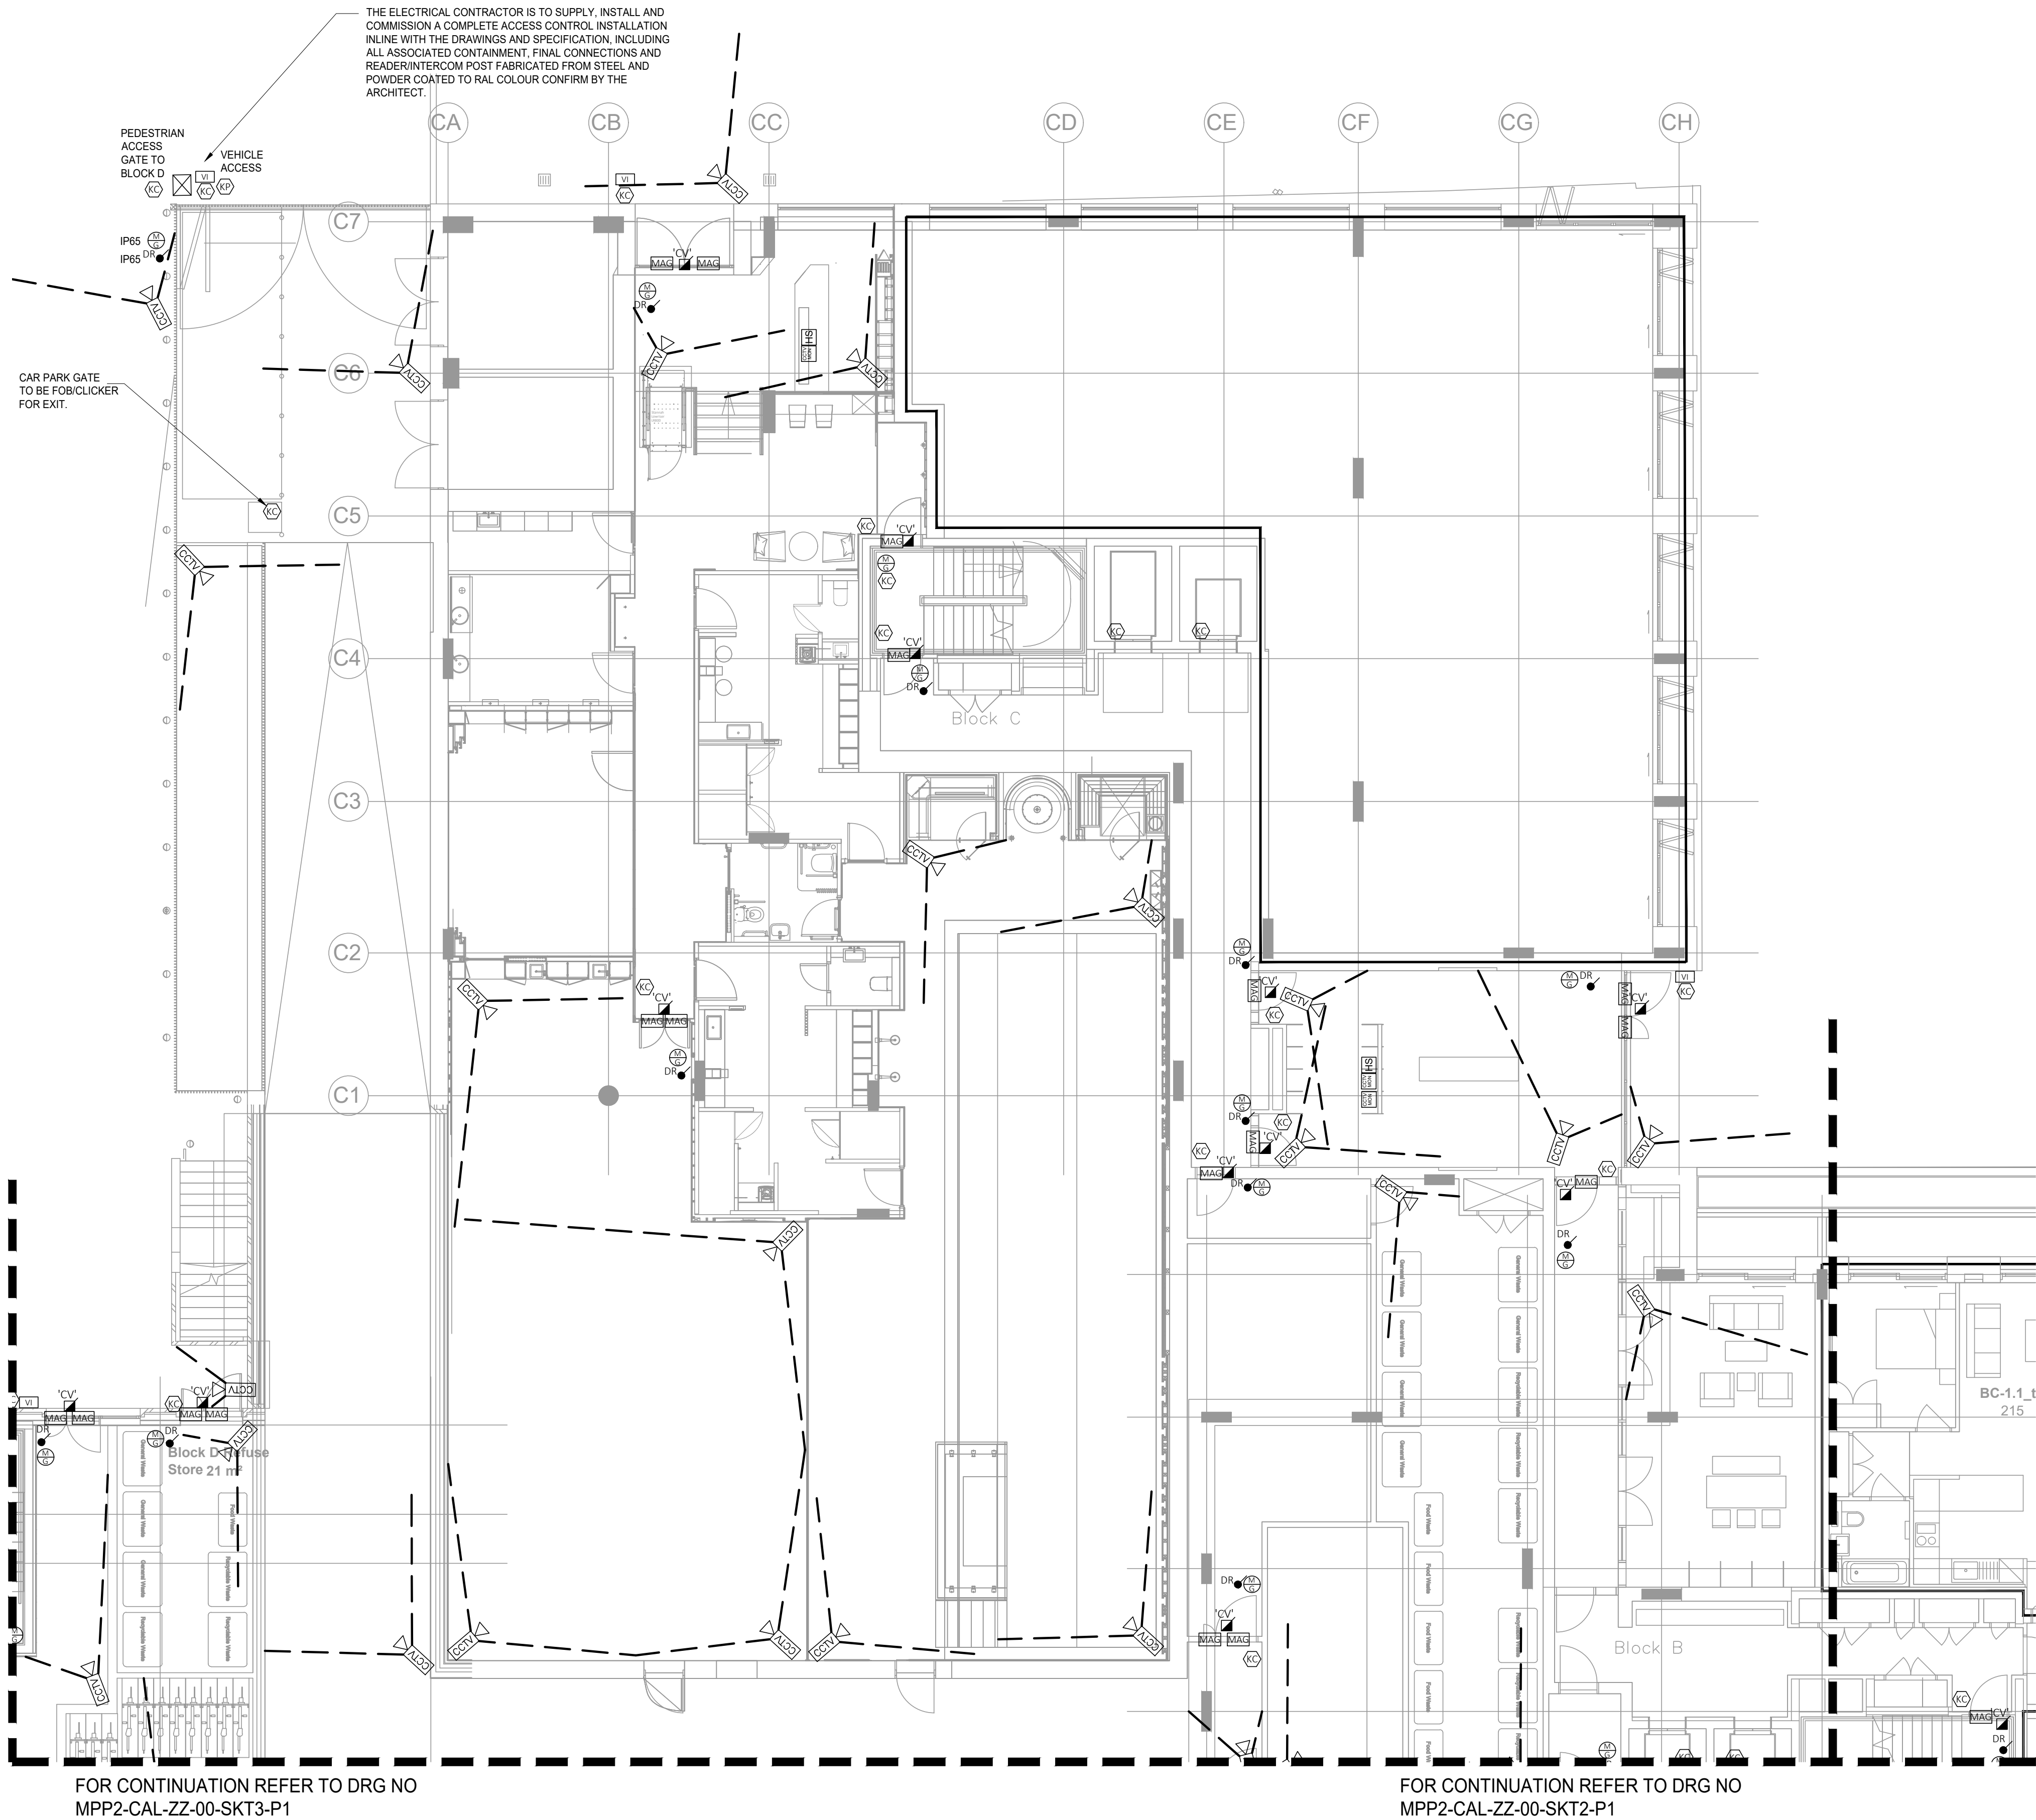

CALDWELL SECURITY	
 MAG	ELECTROMAGNETIC PLATE LOCK FITTED ON LEAF OF DOOR AND FRAME AT HIGH LEVEL.
 PSU	DOOR ACCESS UNIT POWER SUPPLY AND CONTROLS INSTALLED IN CEILING VOID
 DR	'PUSH BUTTON TO OPEN' MANUAL EGRESS DOOR RELEASE SWITCH. FOR NORMAL USE.
 V	FAIL SAFE OPEN DEVICE. WALL MOUNTED GREEN BREAK GLASS TYPE FOR USE IN SCENARIOS WHERE FIRE ALARM INTERFACE FAILS OR DOOR CONTROL EQUIPMENT FAILS.
 V	FOB SWIPE TYPE WALL/PANEL MOUNTED FOB READER LINKED TO LOCAL DOOR ACCESS CONTROLS.
 DE	DOOR ENTRY PANEL
 VI	VIDEO INTERCOM
 CCTV	CCTV CAMERA

P2 MAR.21	INDUCTION LOOP REMOVAL	CS	LW
P1 FEB.21	ISSUED FOR REVIEW/APPROVAL	CS	LW
REV DATE	DESCRIPTION	DR	CK

Caldwell

ARCHITECT
RYDER ARCHITECTS

JOB
MOUNT PLEASANT
PHASE 2
4023

DRAWING
SECURITY ACCESS AND CCTV PROPOSAL
BLOCK 00
BLOCK B

DRAWING NO./REVISION
MPP2 - CAL - ZZ - 00 - M2 - SKT1 - P2


SCALE/PRINTED AT 1:100@A1	DATE FEB'21	DRAWN CS	CHECKED LW
------------------------------	----------------	-------------	---------------

UNIT 6 FORESTGROVE BUSINESS PARK TEL: 02890699720 FAX: 02890641625
NEWTOWNBRED A BELFAST BT8 6AW E-MAIL: admin@caldwellconsulting.net

INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.

CALDWELL SECURITY	
 MAG	ELECTROMAGNETIC PLATE LOCK FITTED ON LEAF OF DOOR AND FRAME AT HIGH LEVEL.
 CV	DOOR ACCESS UNIT POWER SUPPLY AND CONTROLS INSTALLED IN CEILING VOID
 DR	'PUSH BUTTON TO OPEN' MANUAL EGRESS DOOR RELEASE SWITCH. FOR NORMAL USE.
 K	FAIL SAFE OPEN DEVICE. WALL MOUNTED GREEN BREAK GLASS TYPE FOR USE IN SCENARIOS WHERE FIRE ALARM INTERFACE FAILS OR DOOR CONTROL EQUIPMENT FAILS.
 VC	FOB-SWIPE TYPE WALL/PANEL MOUNTED FOB READER LINKED TO LOCAL DOOR ACCESS CONTROLS.
 DE	DOOR ENTRY PANEL
 VI	VIDEO INTERCOM
 CCTV	CCTV CAMERA

FOR CONTINUATION REFER TO DRG NO MPP2-CAL-ZZ-00-SKT1-P1

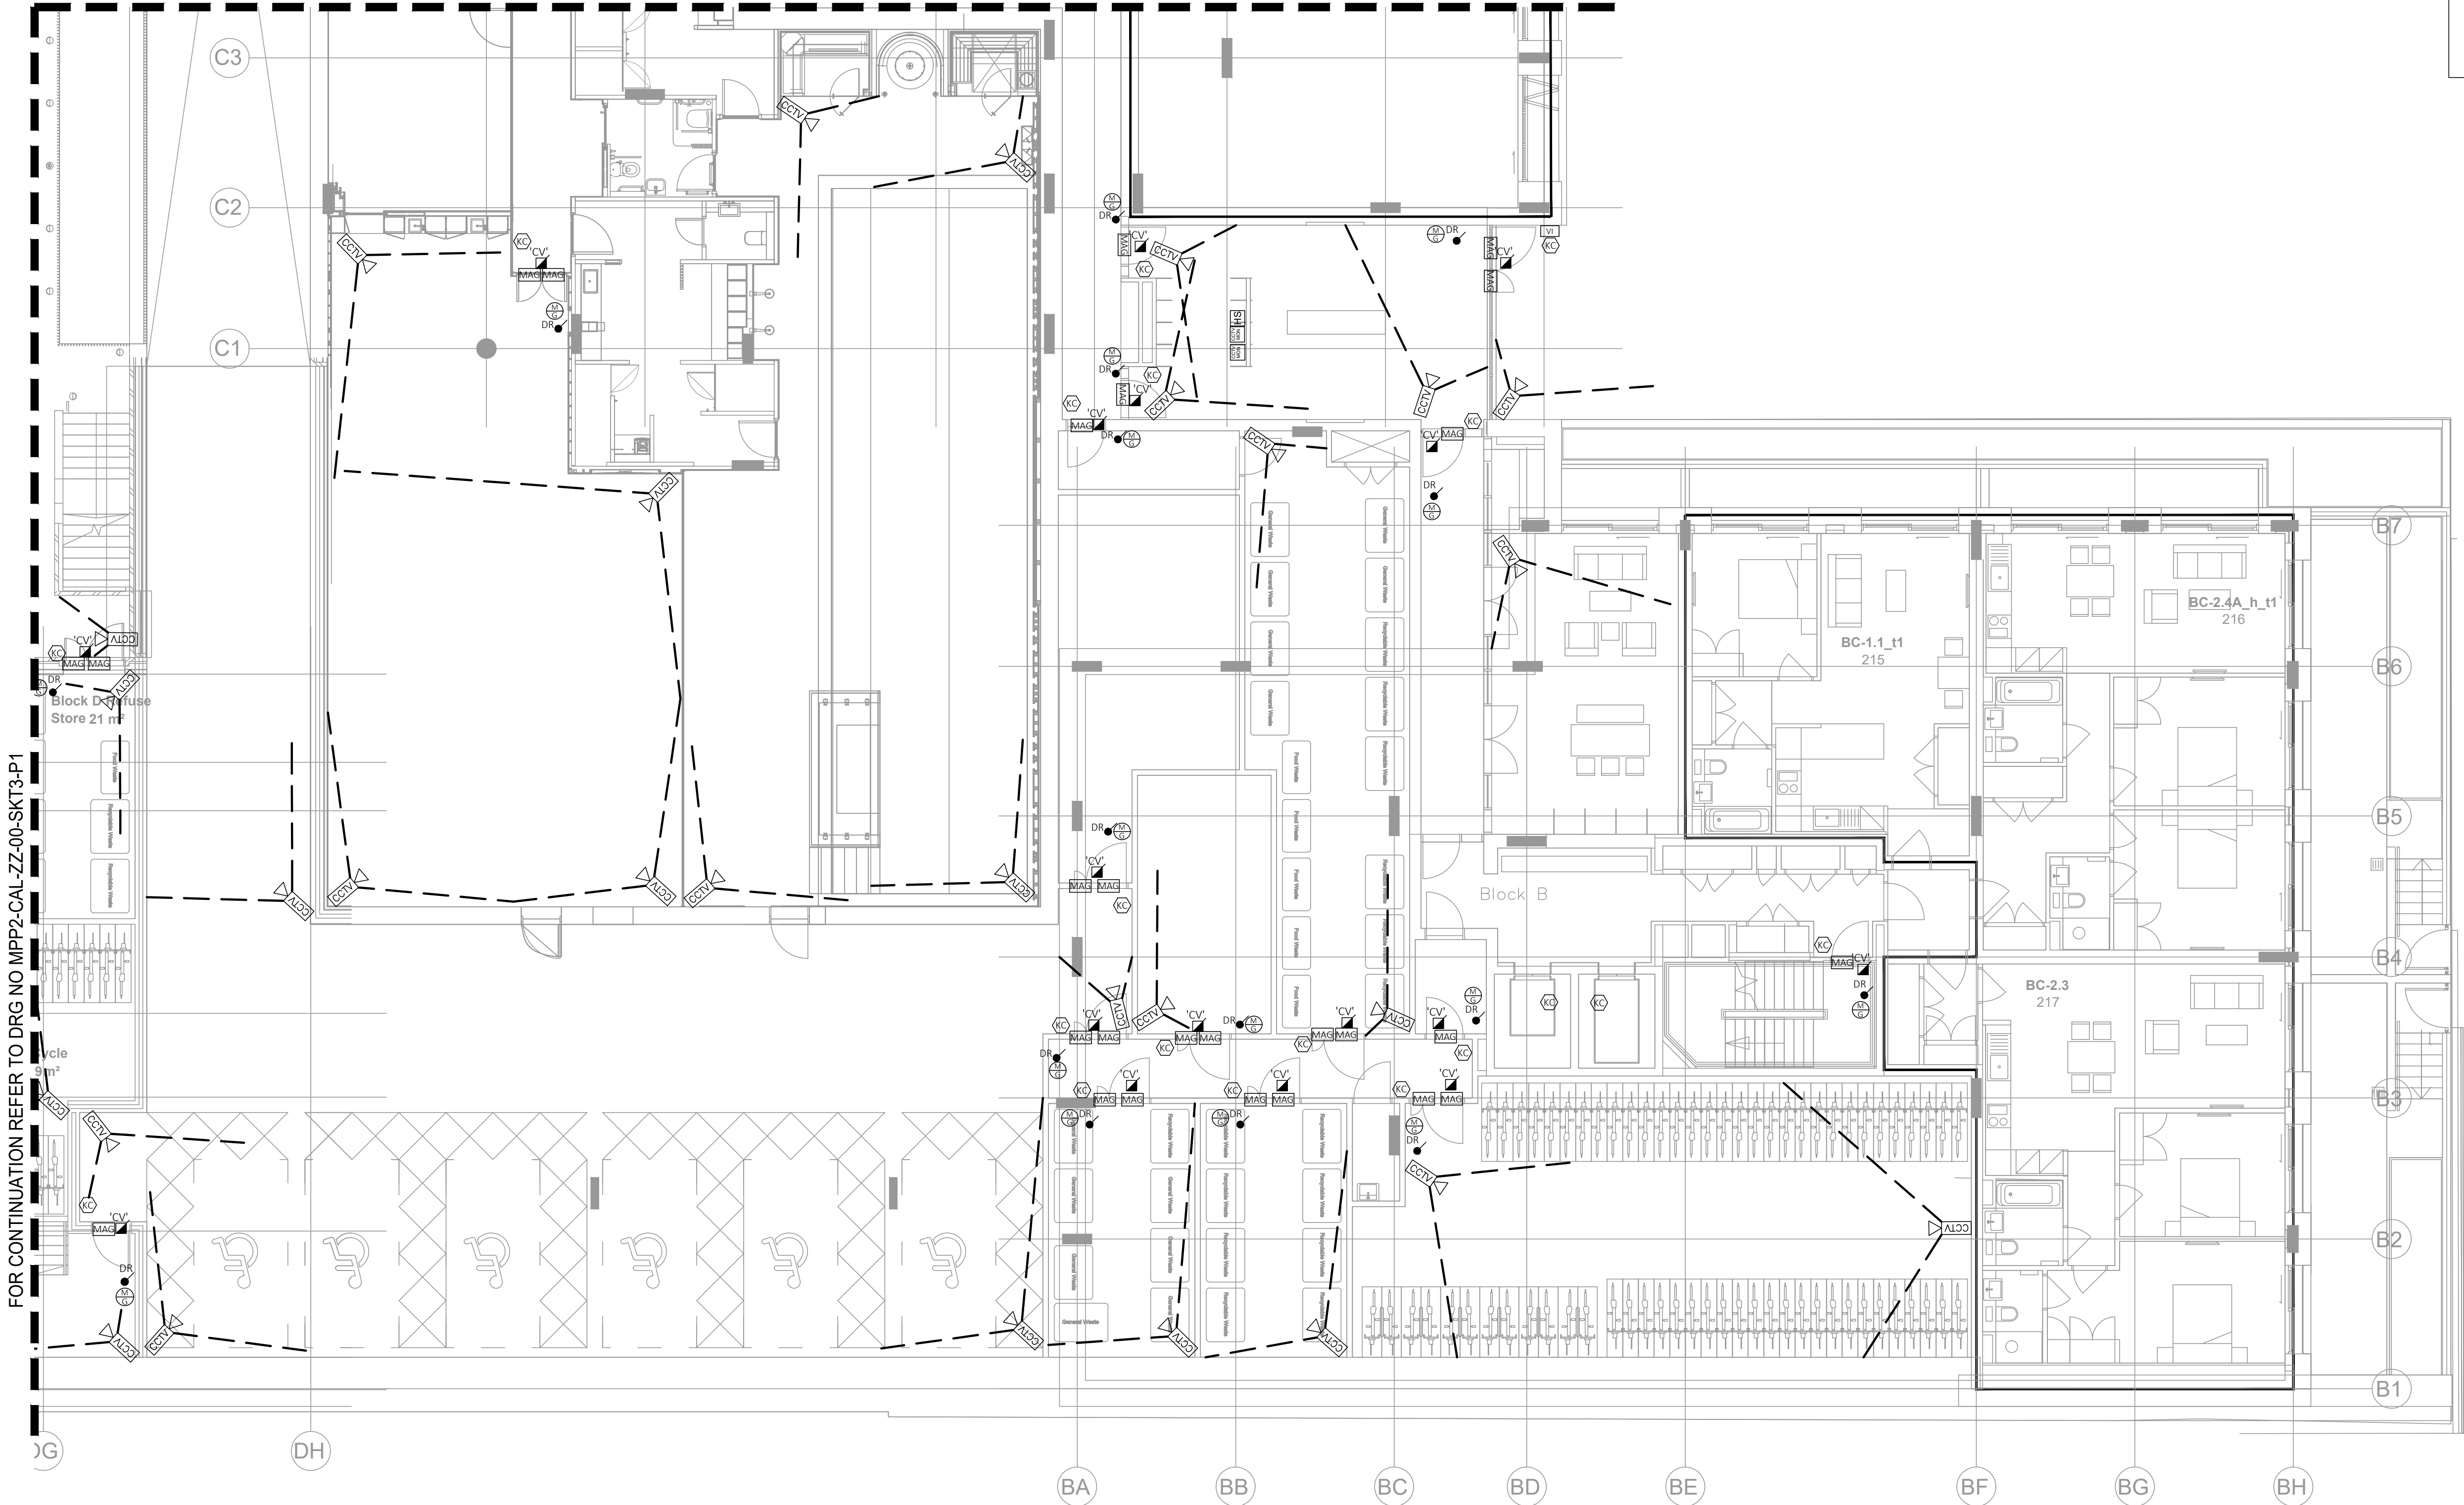

FOR CONTINUATION REFER TO DRG NO MPP2-CAL-ZZ-00-SKT3-P1

INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.

P2 MAR.21	INDUCTION LOOP REMOVAL	CS	LW
P1 FEB.21	ISSUED FOR REVIEW/APPROVAL	CS	LW
REV DATE	DESCRIPTION	DR	CK

Caldwell

ARCHITECT
RYDER ARCHITECTS


JOB
MOUNT PLEASANT
PHASE 2
4023

DRAWING
SECURITY ACCESS AND CCTV PROPOSAL
LEVEL 00
BLOCK C


DRAWING NO./REVISION
MPP2 - CAL - ZZ - 00 - SKT2 - P2

SCALE/PRINTED AT 1:100@A1	DATE DEC'20	DRAWN CS	CHECKED LW
------------------------------	----------------	-------------	---------------

UNIT 6 FORESTGROVE BUSINESS PARK TEL: 02890699720 FAX: 02890641625
NEWTOWNREDA BELFAST BT8 6AW E-MAIL: admin@caldwellconsulting.net

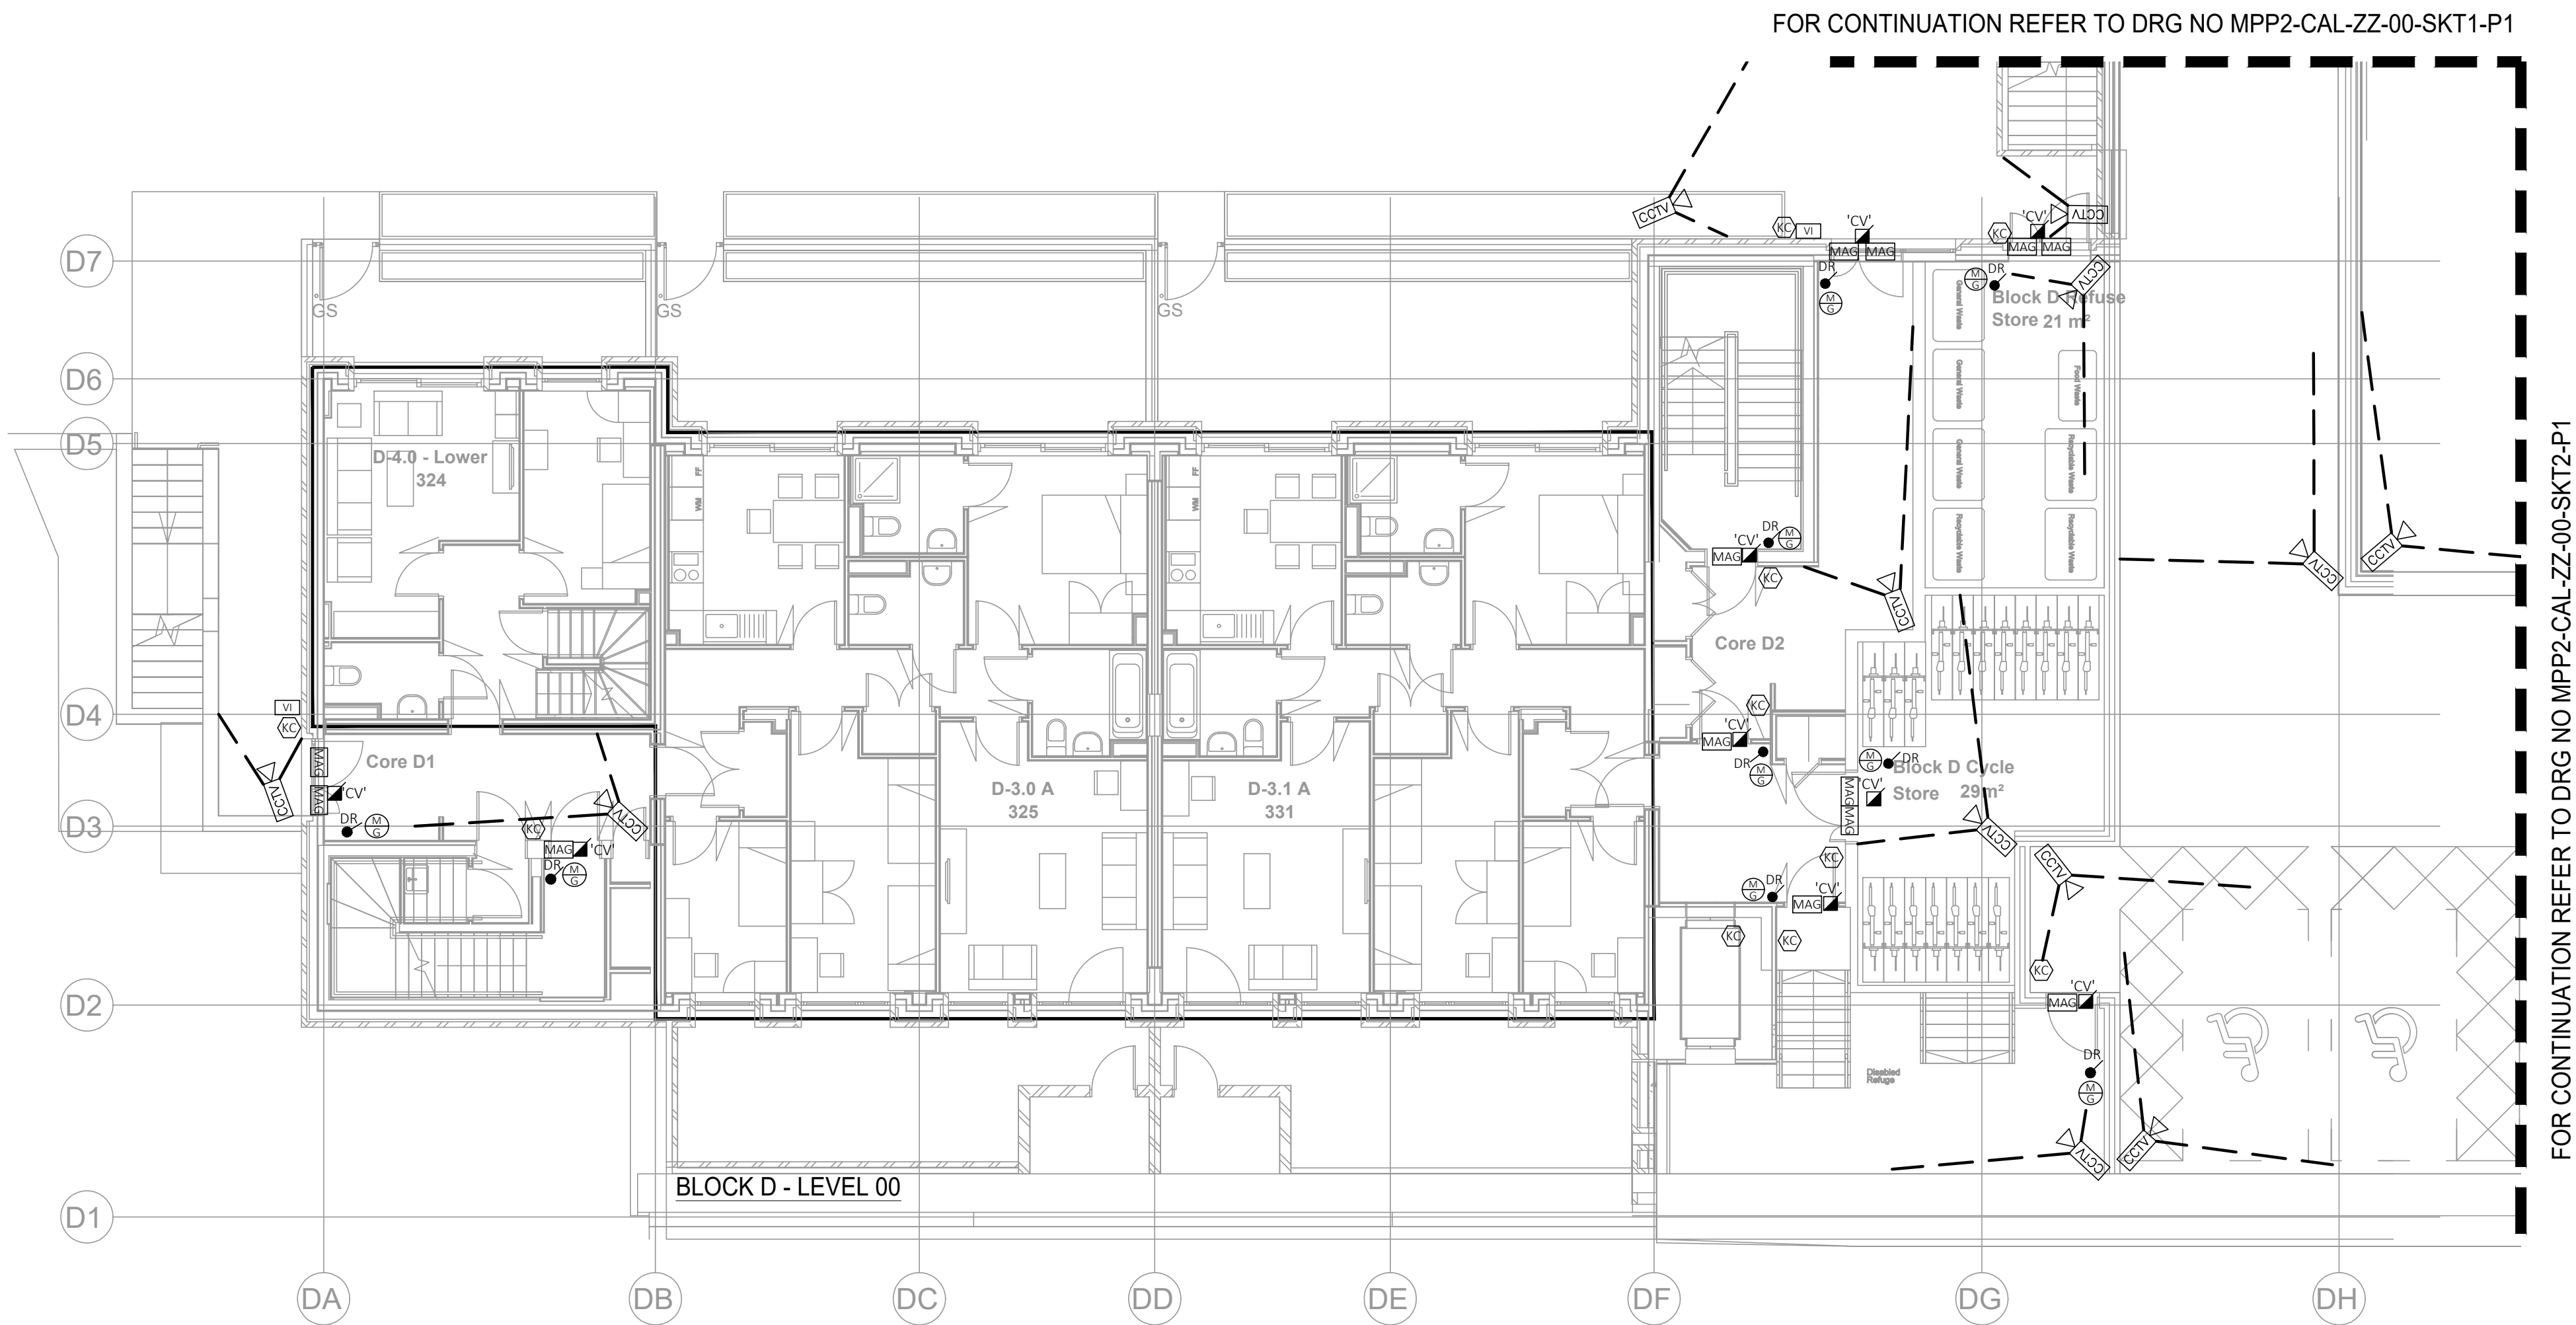

CALDWELL SECURITY	
	ELECTROMAGNETIC PLATE LOCK FITTED ON LEAF OF DOOR AND FRAME AT HIGH LEVEL.
	DOOR ACCESS UNIT POWER SUPPLY AND CONTROLS INSTALLED IN CEILING VOID
	'PUSH BUTTON TO OPEN' MANUAL EGRESS DOOR RELEASE SWITCH. FOR NORMAL USE.
	FAIL SAFE OPEN DEVICE. WALL MOUNTED GREEN BREAK GLASS TYPE FOR USE IN SCENARIOS WHERE FIRE ALARM INTERFACE FAILS OR DOOR CONTROL EQUIPMENT FAILS.
	FOB-SWIPE TYPE WALL/PANEL MOUNTED FOB READER LINKED TO LOCAL DOOR ACCESS CONTROLS.
	DOOR ENTRY PANEL
	VIDEO INTERCOM
	CCTV CAMERA

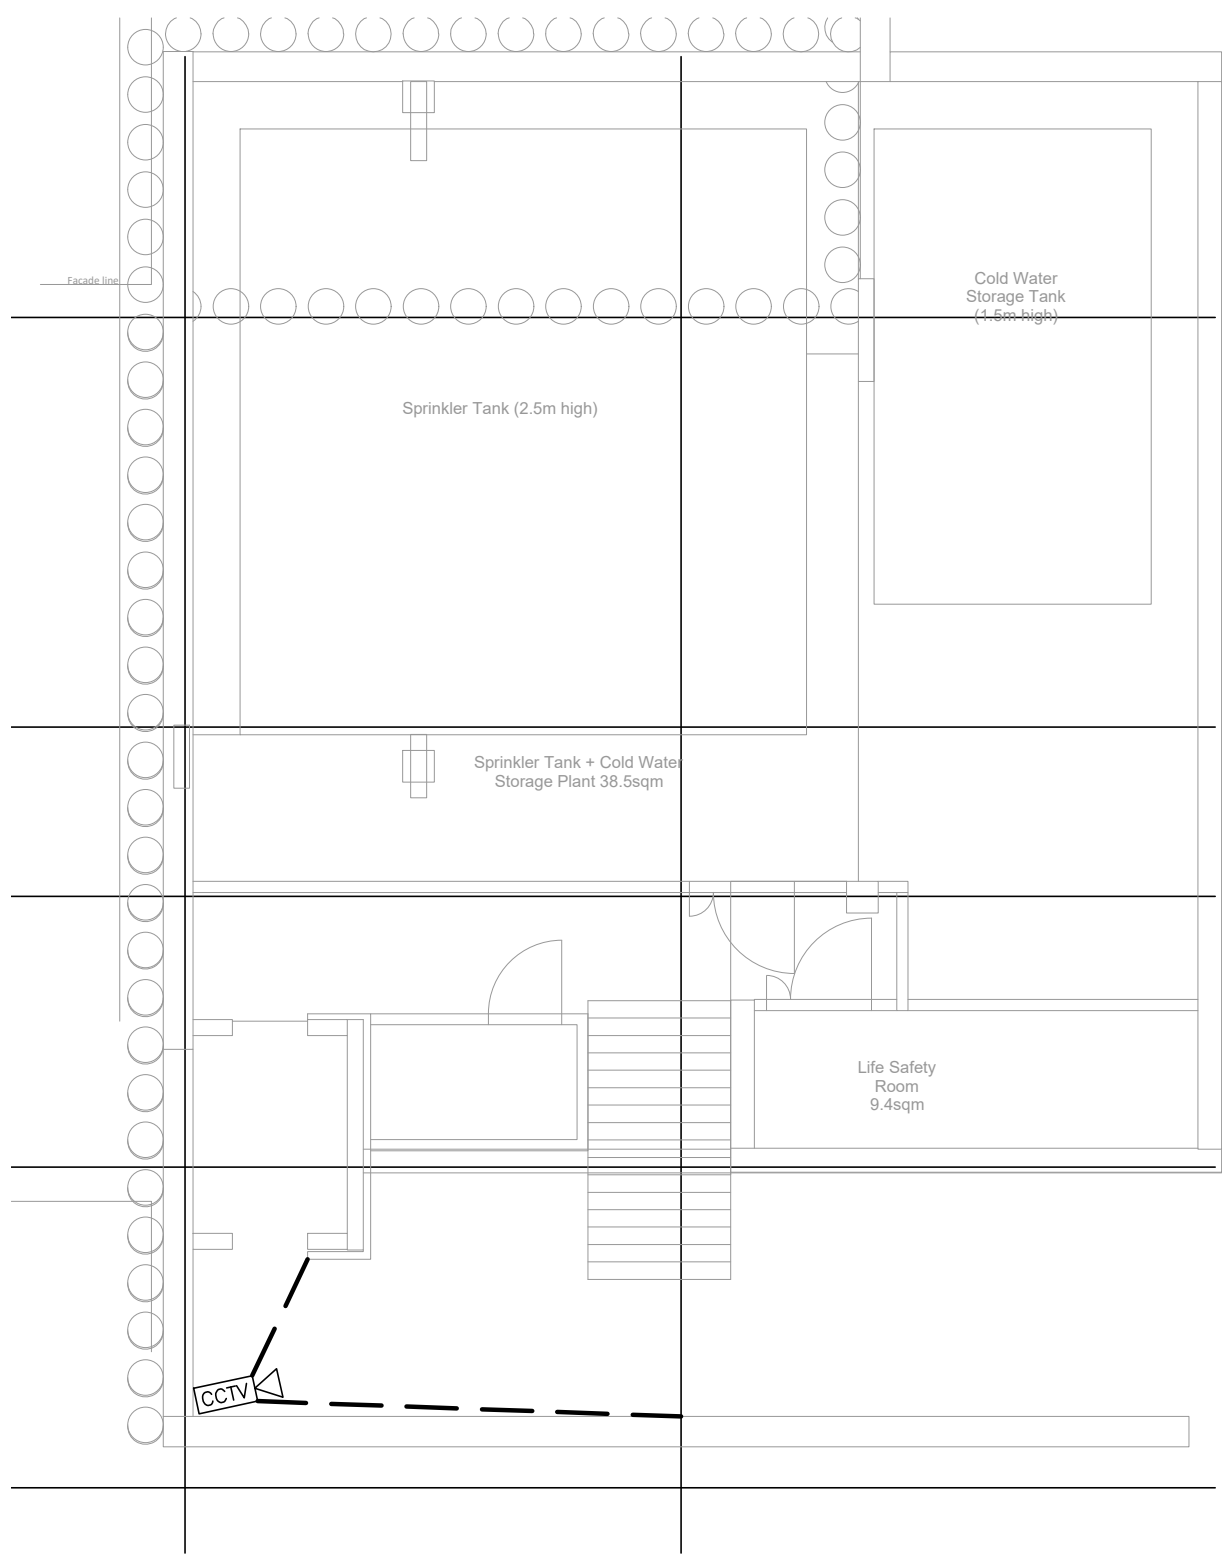

P2	MAR.21	INDUCTION LOOP REMOVAL	CS	LW
P1	FEB.21	ISSUED FOR REVIEW/APPROVAL	CS	LW
REV	DATE	DESCRIPTION	DR	CK

Caldwell

ARCHITECT
RYDER ARCHITECTS

JOB
MOUNT PLEASANT
PHASE 2
4023


DRAWING
SECURITY ACCESS AND CCTV PROPOSAL
LEVEL 00 AND LEVEL -01
BLOCK D

DRAWING NO./REVISION
MPP2 - CAL - ZZ - 00 - SKT3 - P2


SCALE/PRINTED AT 1:100@A1	DATE DEC'20	DRAWN CS	CHECKED LW
------------------------------	----------------	-------------	---------------

UNIT 6 FORESTROVE BUSINESS PARK TEL: 02890699720 FAX: 02890641625
NEWTOWNBRED A BELFAST BT8 6AW E-MAIL: admin@caldwellconsulting.net

INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.

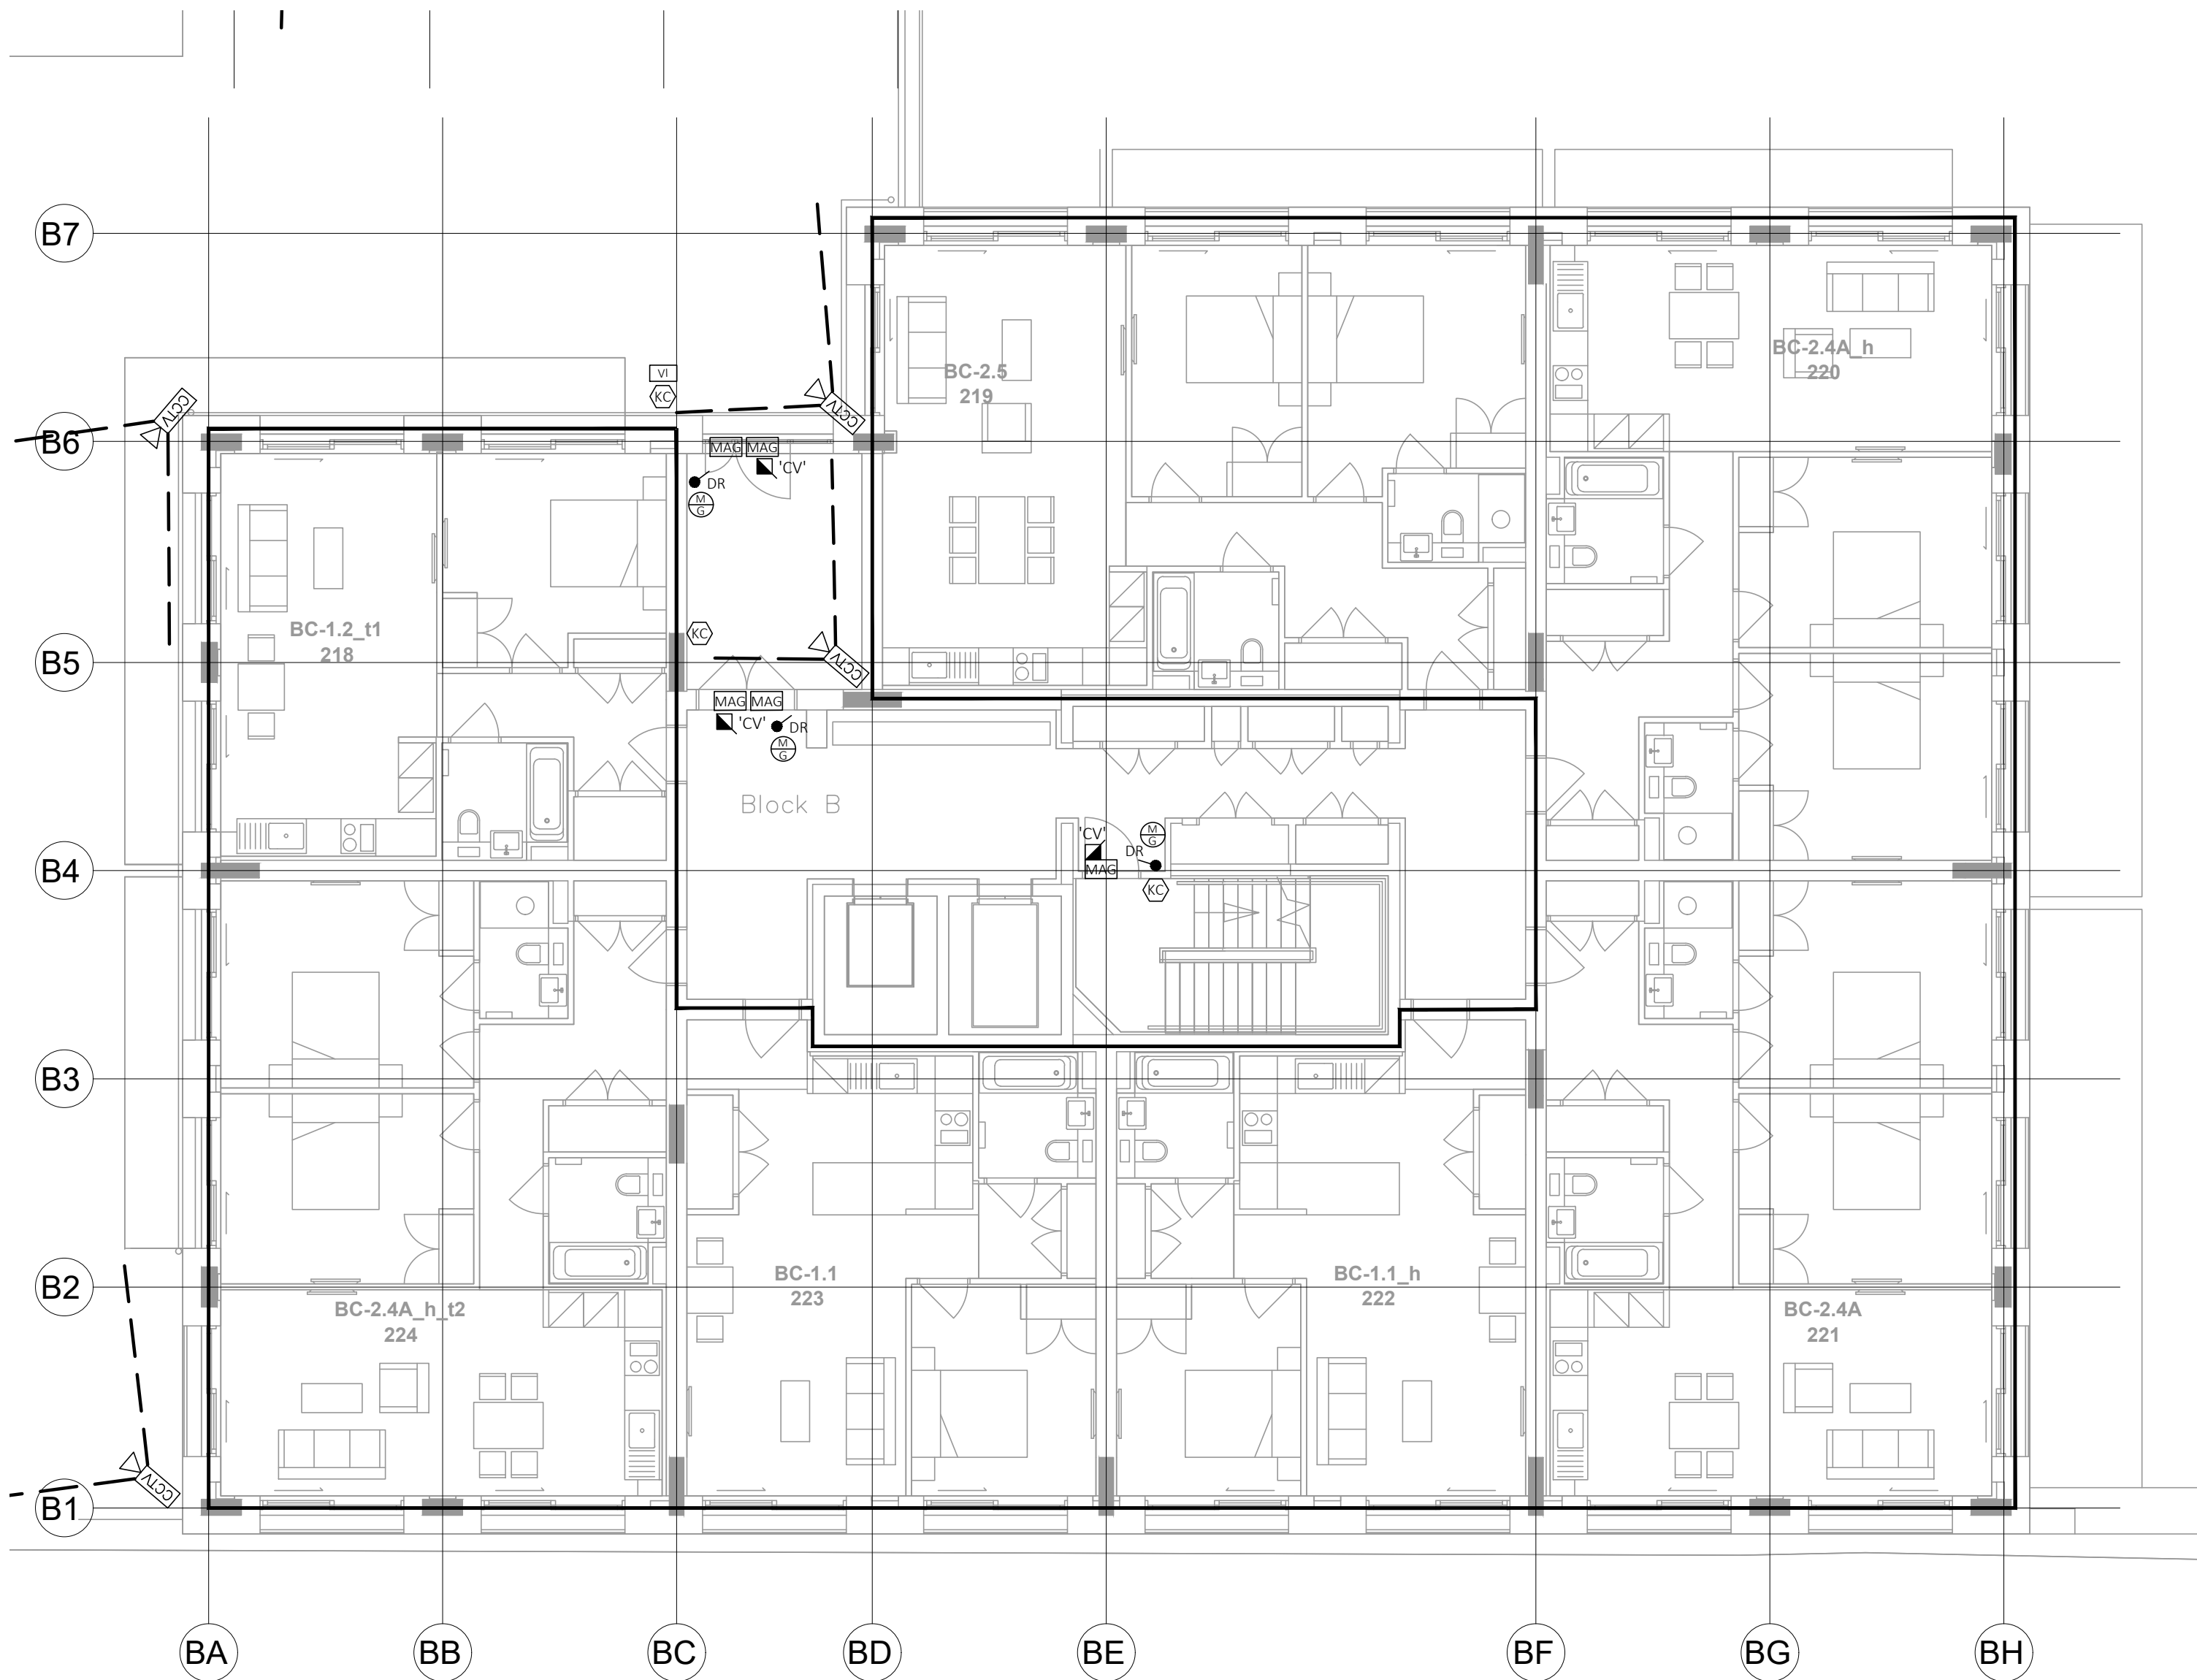

BLOCK B - LEVEL 01

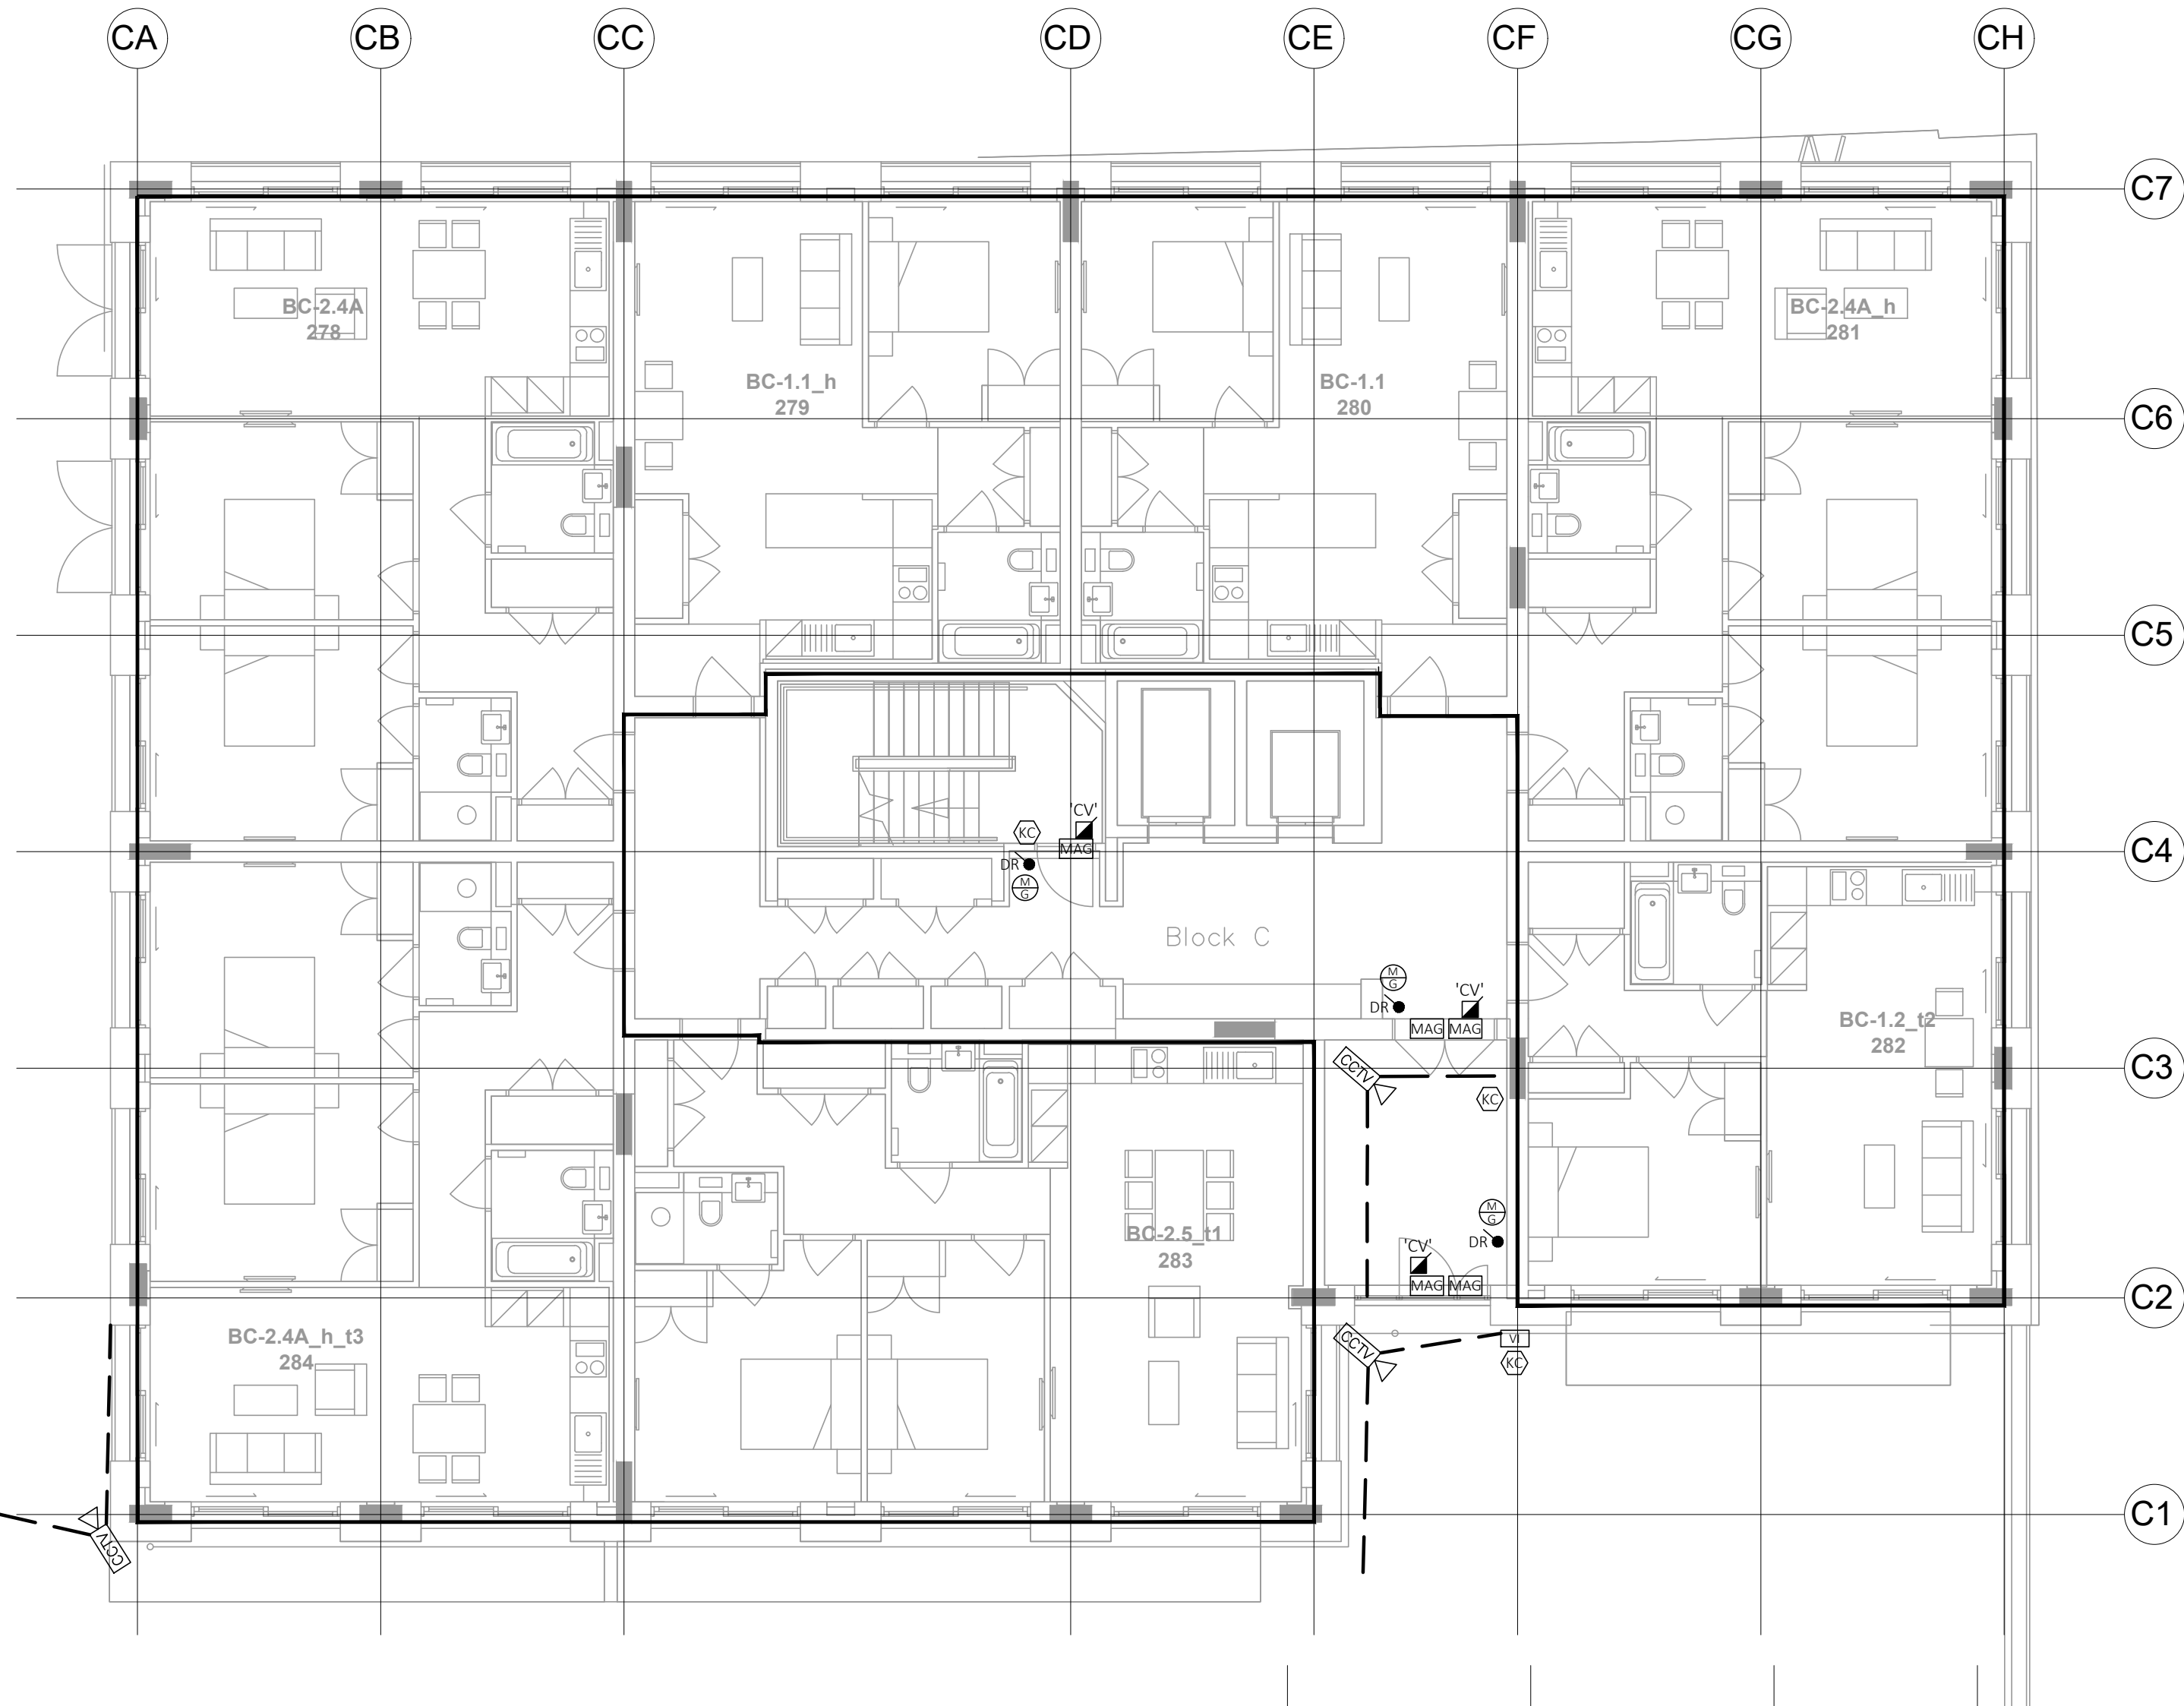

BLOCK C - LEVEL 01



BLOCK D - LEVEL 01

Caldwell Security	
 MAG	ELECTROMAGNETIC PLATE LOCK FITTED ON LEAF OF DOOR AND FRAME AT HIGH LEVEL.
 CV	DOOR ACCESS UNIT POWER SUPPLY AND CONTROLS INSTALLED IN CEILING VOID
 PSU	'PUSH BUTTON TO OPEN' MANUAL EGRESS DOOR RELEASE SWITCH. FOR NORMAL USE.
 DR	FAIL SAFE OPEN DEVICE. WALL MOUNTED GREEN BREAK GLASS TYPE FOR USE IN SCENARIOS WHERE FIRE ALARM INTERFACE FAILS OR DOOR CONTROL EQUIPMENT FAILS.
 M/G	FOB-SWIPE TYPE WALL/PANEL MOUNTED FOB READER LINKED TO LOCAL DOOR ACCESS CONTROLS.
 KC	DOOR ENTRY PANEL
 DE	VIDEO INTERCOM
 VI	CCTV CAMERA
 CCTV	

P2 MAR.21	INDUCTION LOOP REMOVAL	CS	LW
P1 FEB.21	ISSUED FOR REVIEW/APPROVAL	CS	LW
REV DATE	DESCRIPTION	DR	CK

Caldwell

ARCHITECT
RYDER ARCHITECTS


JOB
MOUNT PLEASANT
PHASE 2
4023

DRAWING
SECURITY ACCESS AND CCTV PROPOSAL
LEVEL 01
BLOCK B, C & D


DRAWING NO./REVISION
MPP2 - CAL - ZZ - 01 - SK14 - P2

SCALE/PRINTED AT 1:100@A1	DATE DEC'20	DRAWN CS	CHECKED LW
UNIT 6 FORESTROVE BUSINESS PARK NEWTOWNREDA BELFAST BT8 6AW TEL: 02890699720 FAX: 02890641625 E-MAIL: admin@caldwellconsulting.net			

INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.

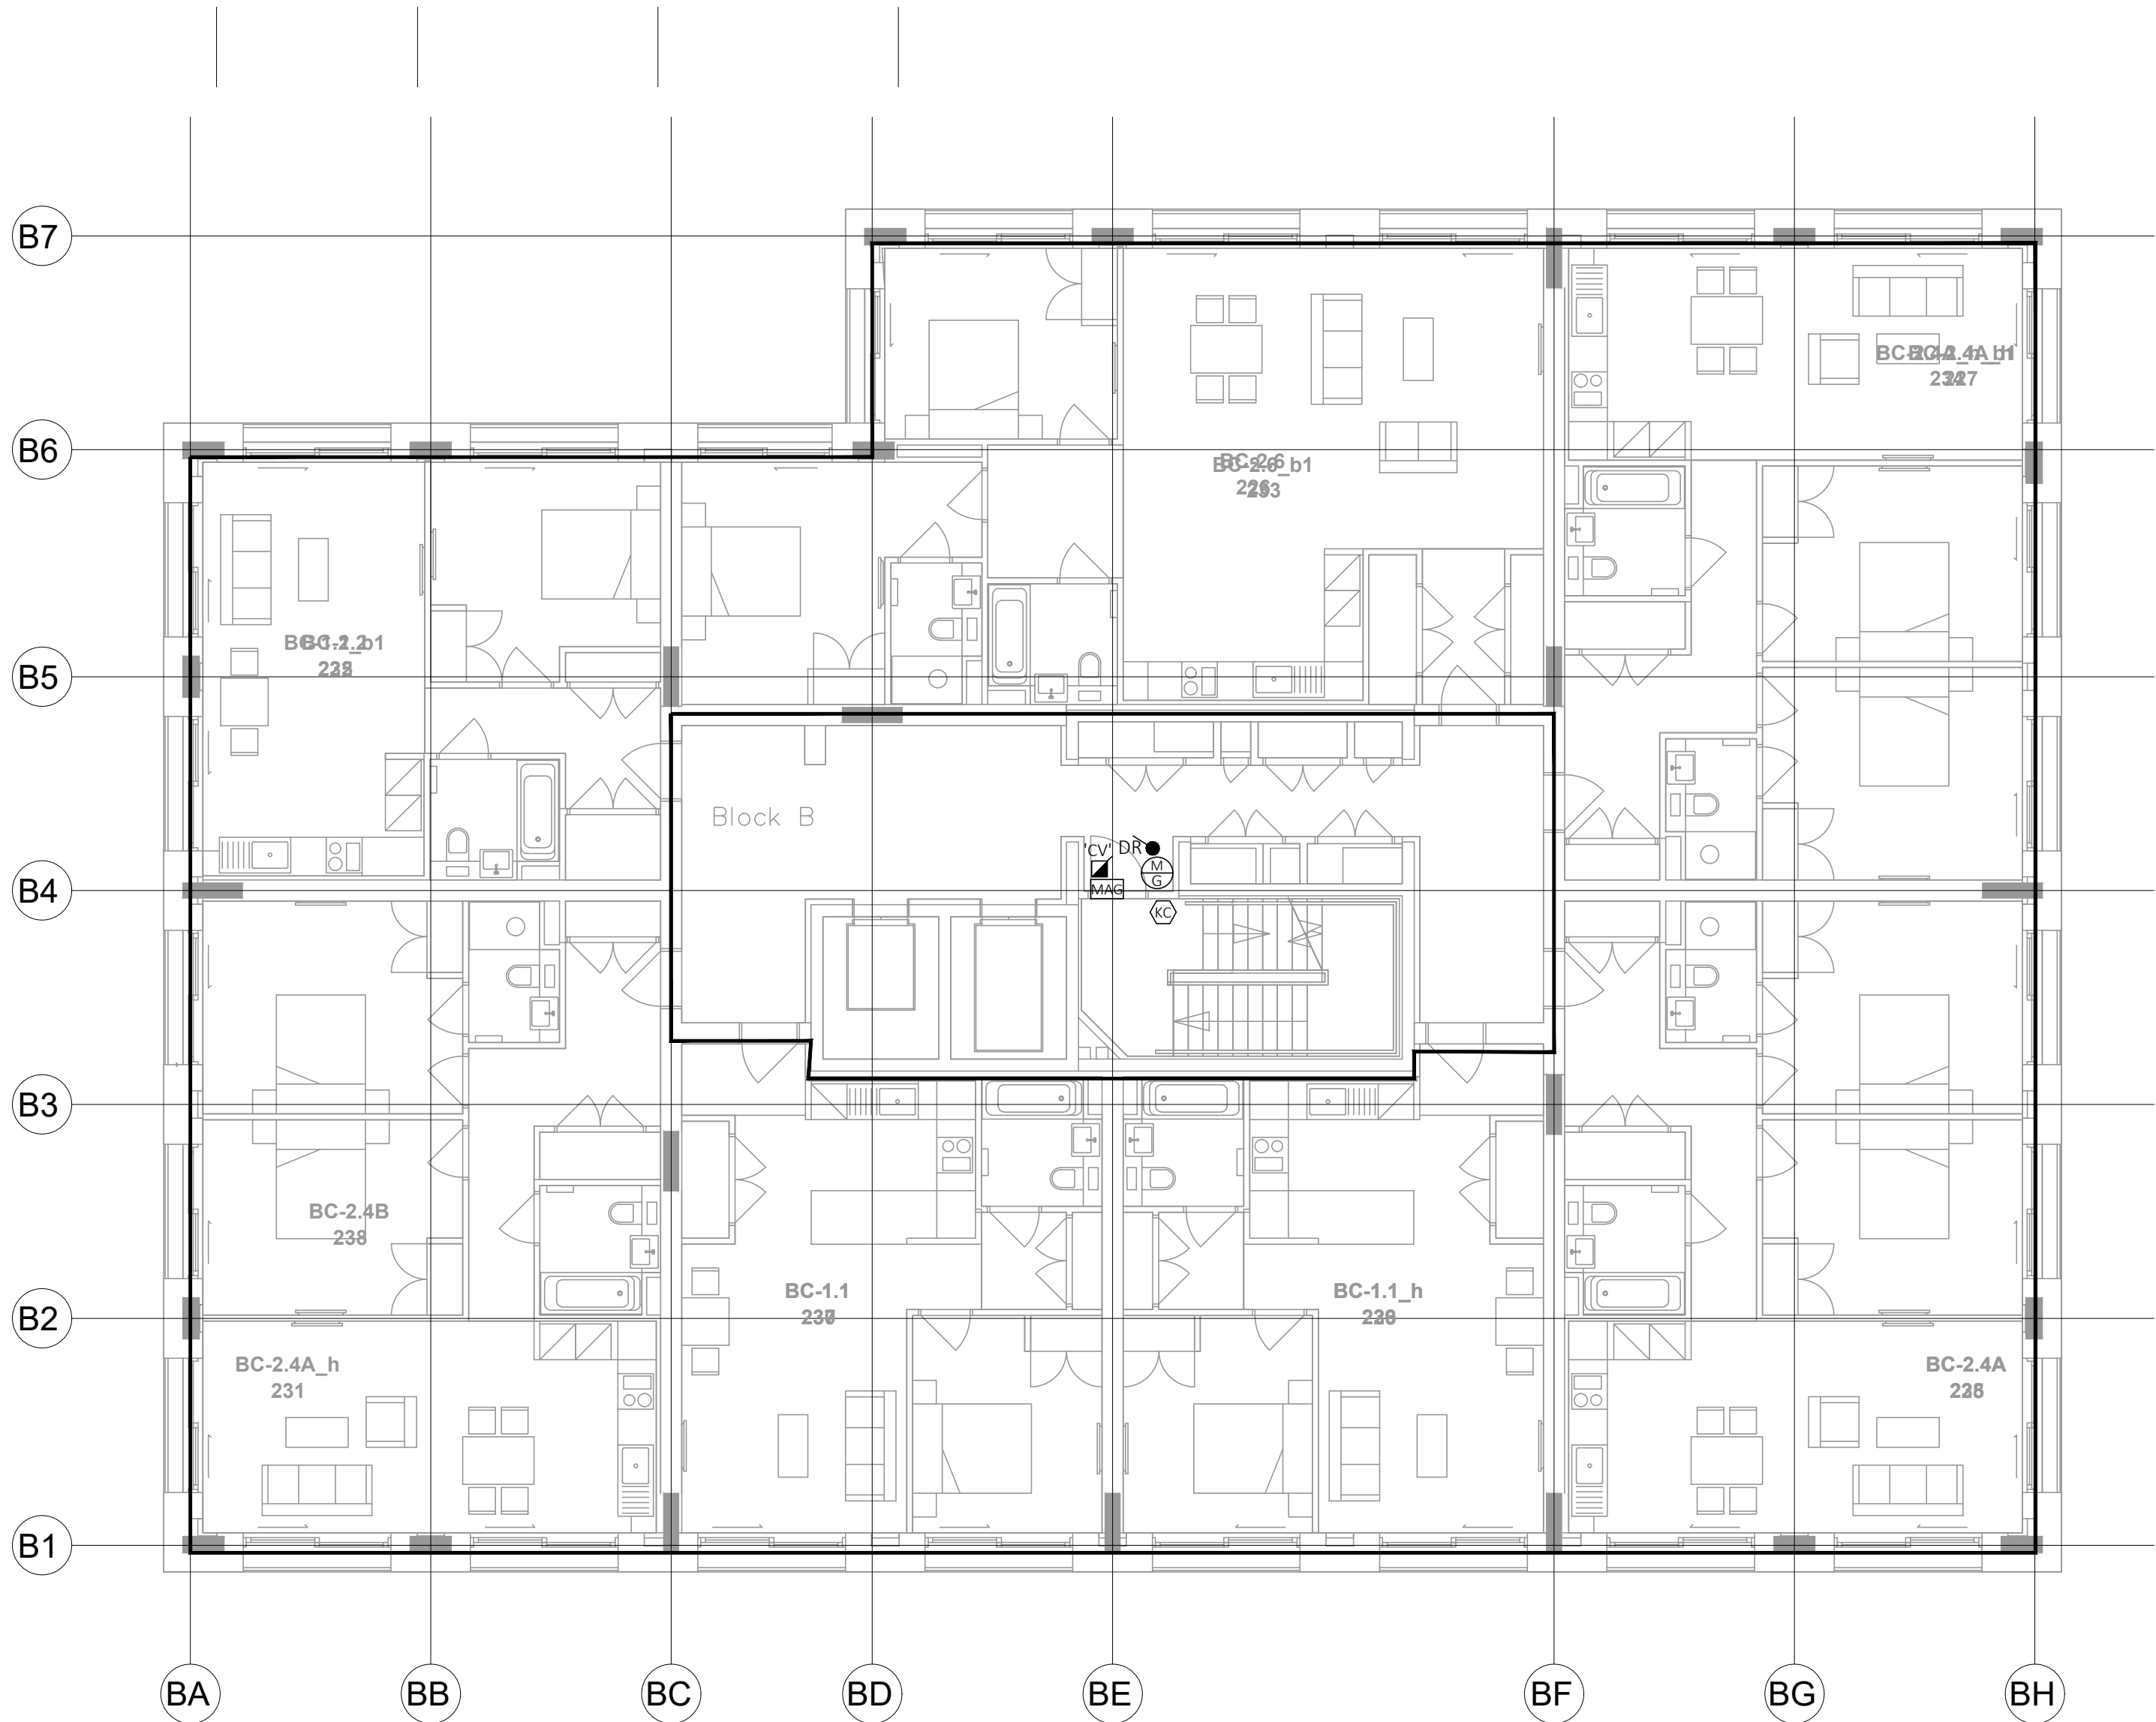

BLOCK B - LEVEL 02

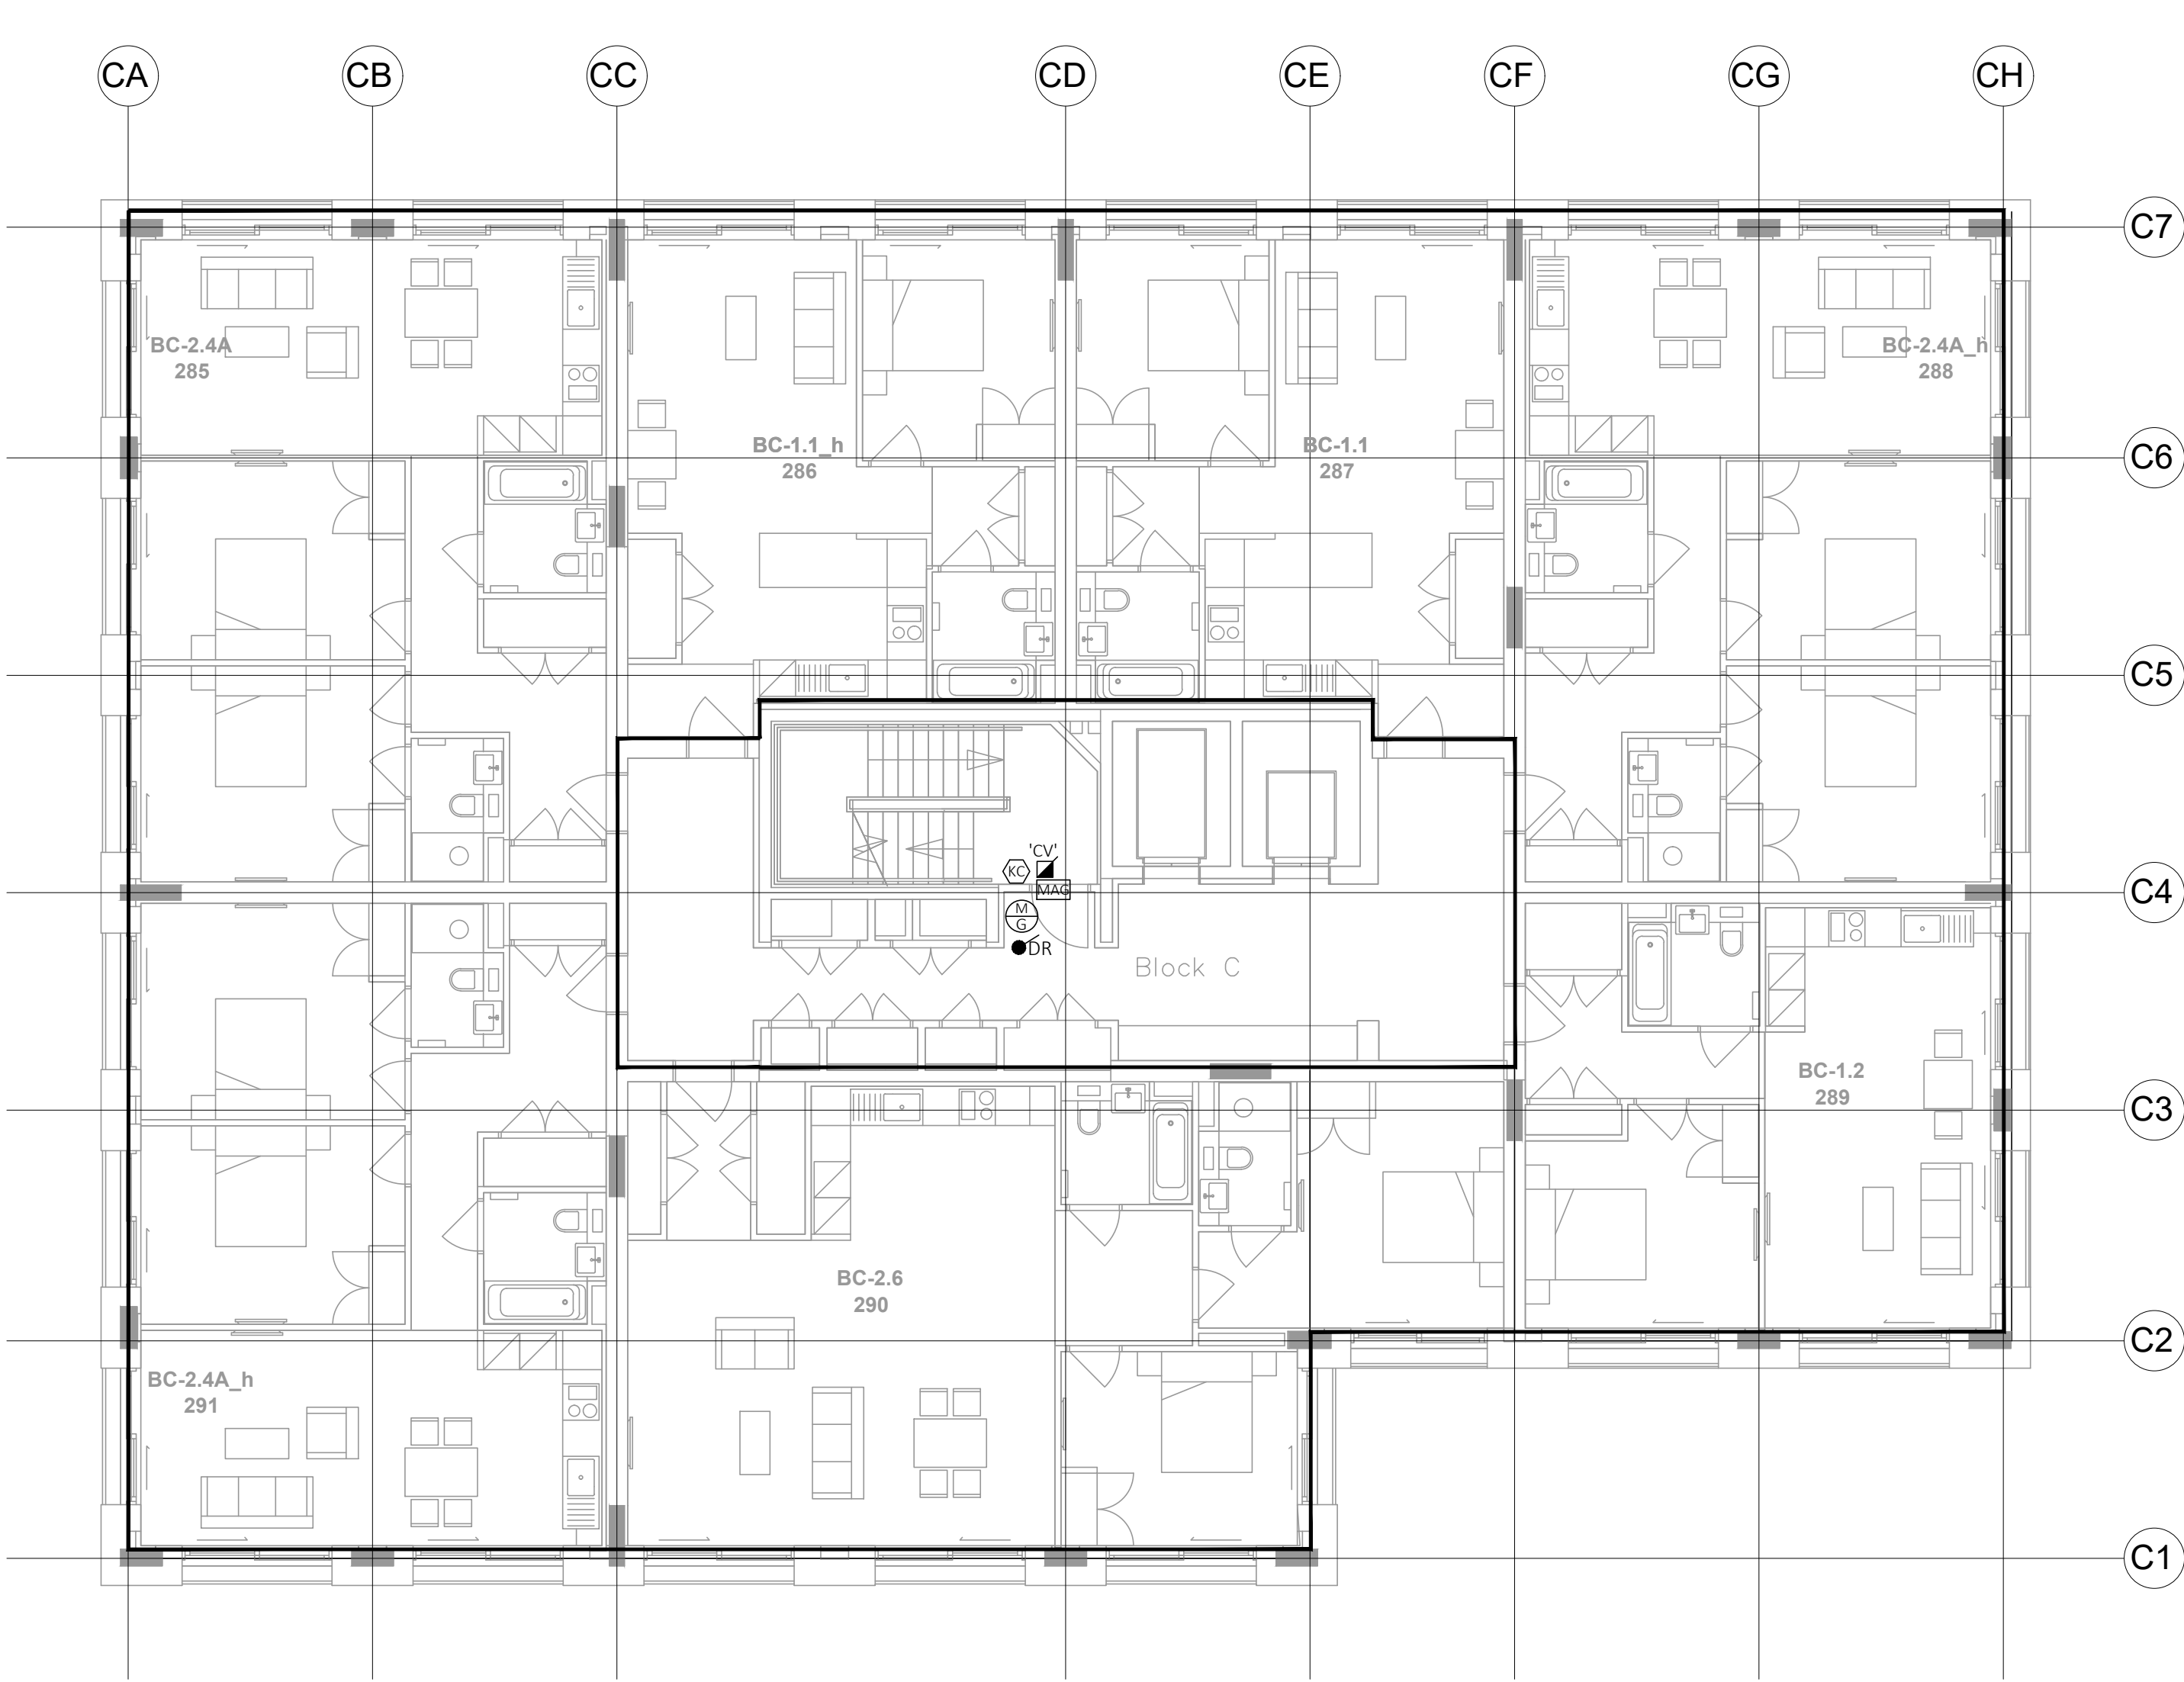

BLOCK C - LEVEL 02



BLOCK D - LEVEL 02

CALDWELL SECURITY	
	ELECTROMAGNETIC PLATE LOCK FITTED ON LEAF OF DOOR AND FRAME AT HIGH LEVEL.
	
	DOOR ACCESS UNIT POWER SUPPLY AND CONTROLS INSTALLED IN CEILING VOID
	'PUSH BUTTON TO OPEN' MANUAL EGRESS DOOR RELEASE SWITCH, FOR NORMAL USE.
	FAIL SAFE OPEN DEVICE, WALL MOUNTED GREEN BREAK GLASS TYPE FOR USE IN SCENARIOS WHERE FIRE ALARM INTERFACE FAILS OR DOOR CONTROL EQUIPMENT FAILS.
	FOB-SWIPE TYPE WALL/PANEL MOUNTED FOB READER LINKED TO LOCAL DOOR ACCESS CONTROLS.
	DOOR ENTRY PANEL
	VIDEO INTERCOM
	CCTV CAMERA

P2 MAR.21	INDUCTION LOOP REMOVAL	CS	LW
P1 FEB.21	ISSUED FOR REVIEW/APPROVAL	CS	LW
REV DATE	DESCRIPTION	DR	CK

Caldwell

ARCHITECT
RYDER ARCHITECTS

JOB
MOUNT PLEASANT
PHASE 2
4023

DRAWING
SECURITY ACCESS AND CCTV PROPOSAL
LEVEL 02
BLOCK B, C & D


DRAWING NO./REVISION
MPP2 - CAL - ZZ - 02 - SK15 - P2

SCALE/PRINTED AT 1:100@A1	DATE DEC'20	DRAWN CS	CHECKED LW
UNIT 6 FORESTROVE BUSINESS PARK NEWTOWNREDA BELFAST BT8 6AW		TEL: 02890699720 FAX: 02890641625 E-MAIL: admin@caldwellconsulting.net	

INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.



BLOCK B - LEVEL 03

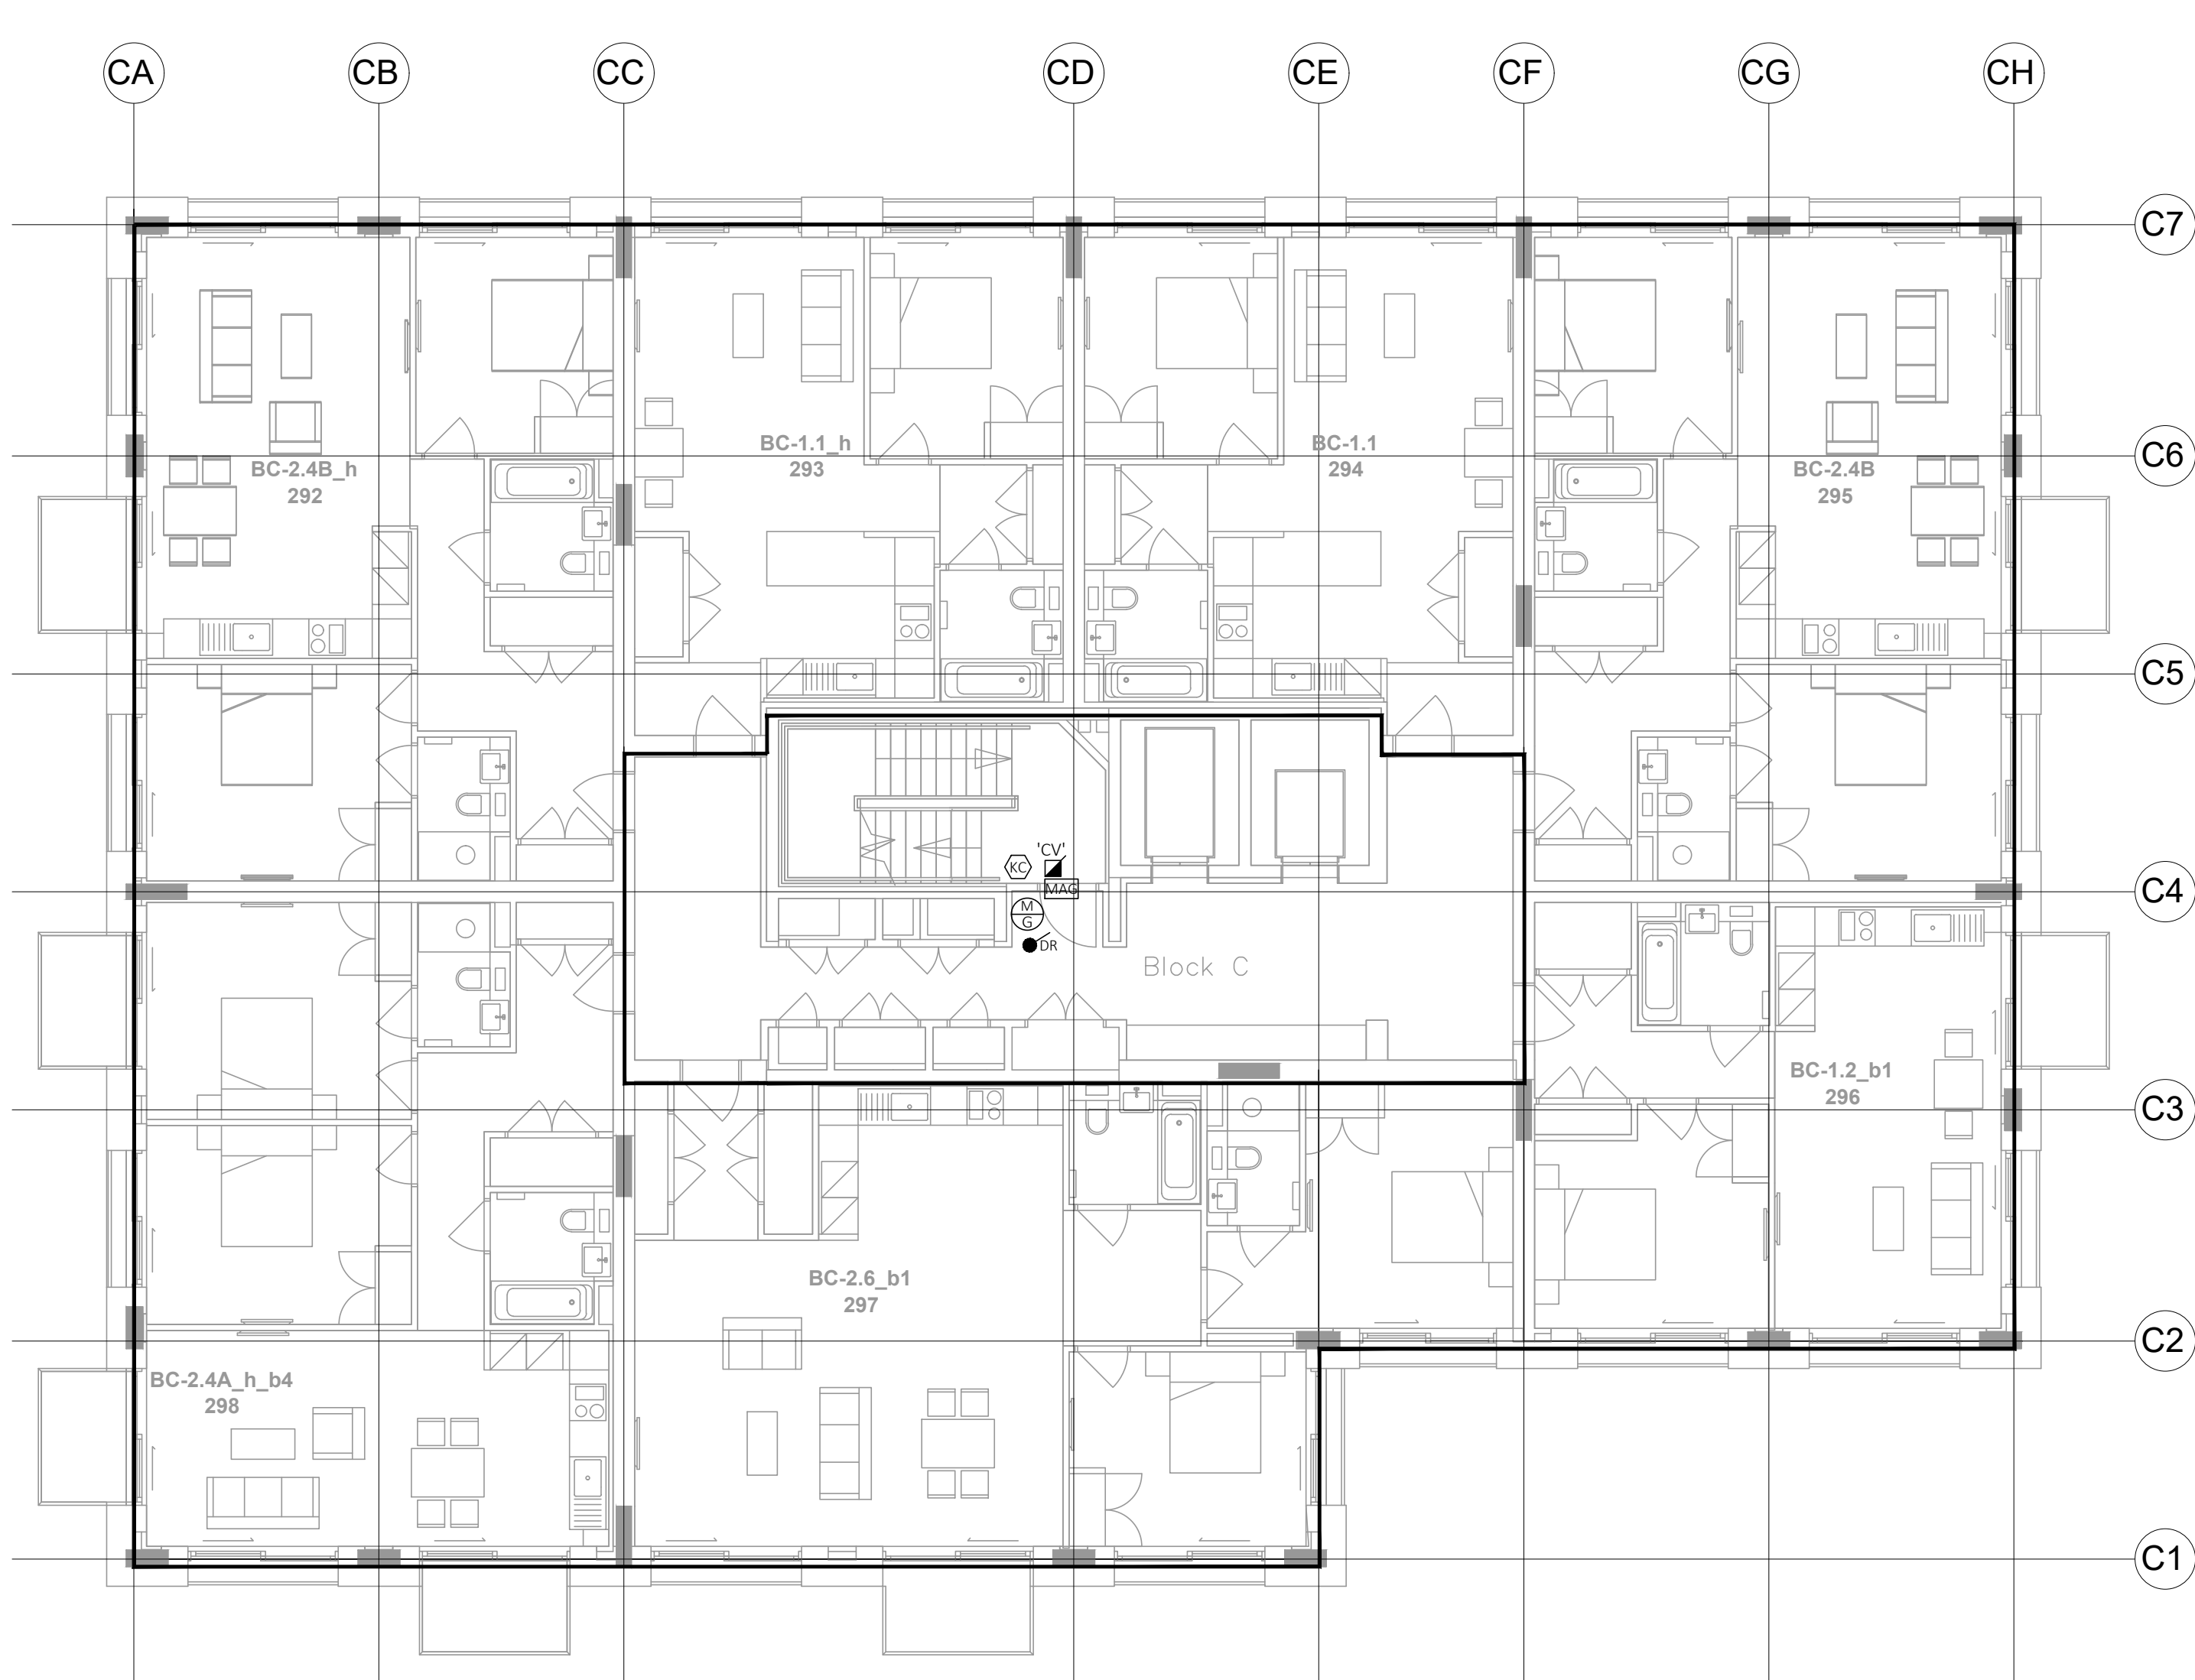

BLOCK C - LEVEL 03



BLOCK D - LEVEL 03

CALDWELL SECURITY	
 MAG	ELECTROMAGNETIC PLATE LOCK FITTED ON LEAF OF DOOR AND FRAME AT HIGH LEVEL.
 CV	DOOR ACCESS UNIT POWER SUPPLY AND CONTROLS INSTALLED IN CEILING VOID
 DR	'PUSH BUTTON TO OPEN' MANUAL EGRESS DOOR RELEASE SWITCH, FOR NORMAL USE.
 M	FAIL SAFE OPEN DEVICE, WALL MOUNTED GREEN BREAK GLASS TYPE FOR USE IN SCENARIOS WHERE FIRE ALARM INTERFACE FAILS OR DOOR CONTROL EQUIPMENT FAILS.
 KC	FOB-SWIPE TYPE WALL/PANEL MOUNTED FOB READER LINKED TO LOCAL DOOR ACCESS CONTROLS.
 DE	DOOR ENTRY PANEL
 VI	VIDEO INTERCOM
 CCTV	CCTV CAMERA

P2 MAR.21	INDUCTION LOOP REMOVAL	CS	LW
P1 FEB.21	ISSUED FOR REVIEW/APPROVAL	CS	LW
REV. DATE	DESCRIPTION	DR	CK

Caldwell

ARCHITECT
RYDER ARCHITECTS


JOB
MOUNT PLEASANT
PHASE 2
4023

DRAWING
SECURITY ACCESS AND CCTV PROPOSAL
LEVEL 03
BLOCK B, C & D


DRAWING NO./REVISION
MPP2 - CAL - ZZ - 03 - SK16 - P2

SCALE/PRINTED AT 1:100@A1	DATE OCT'20	DRAWN CS	CHECKED LW
UNIT 6 FOREST GROVE BUSINESS PARK NEWTOWNREDA BELFAST BT8 6AW		TEL: 02890699720 FAX: 02890641625 E-MAIL: admin@caldwellconsulting.net	


INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.

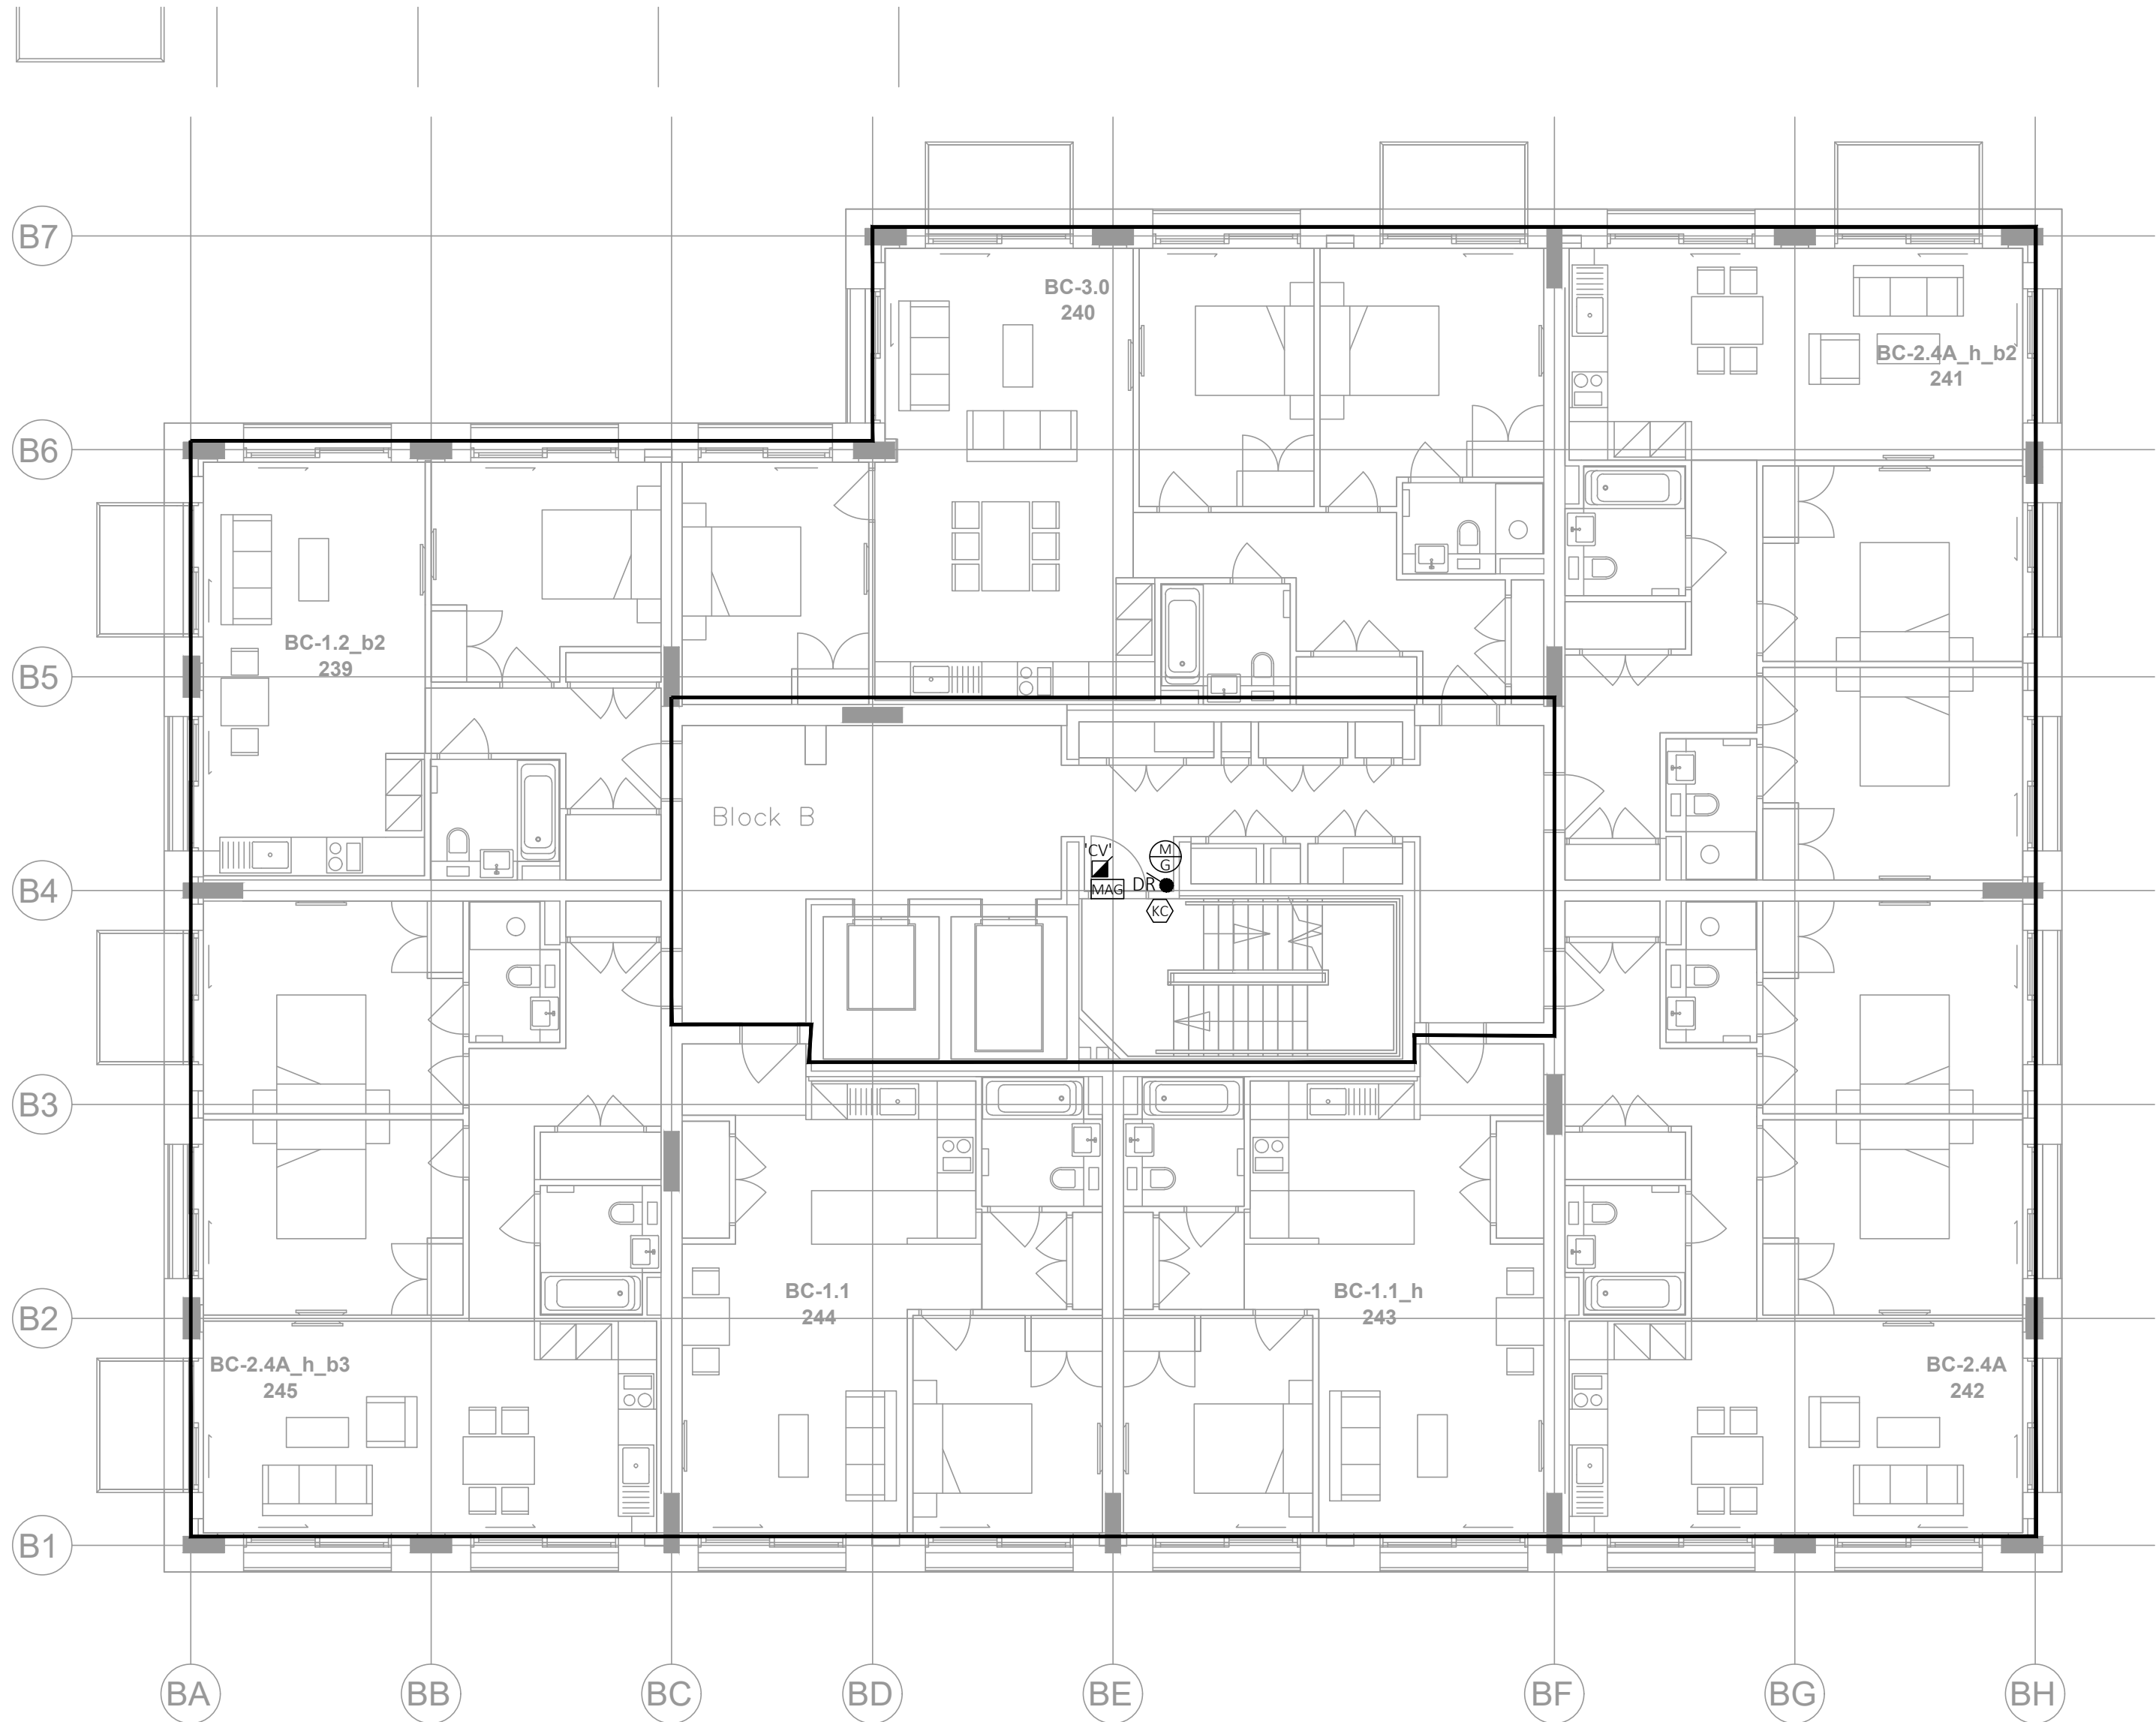

BLOCK B - LEVEL 04

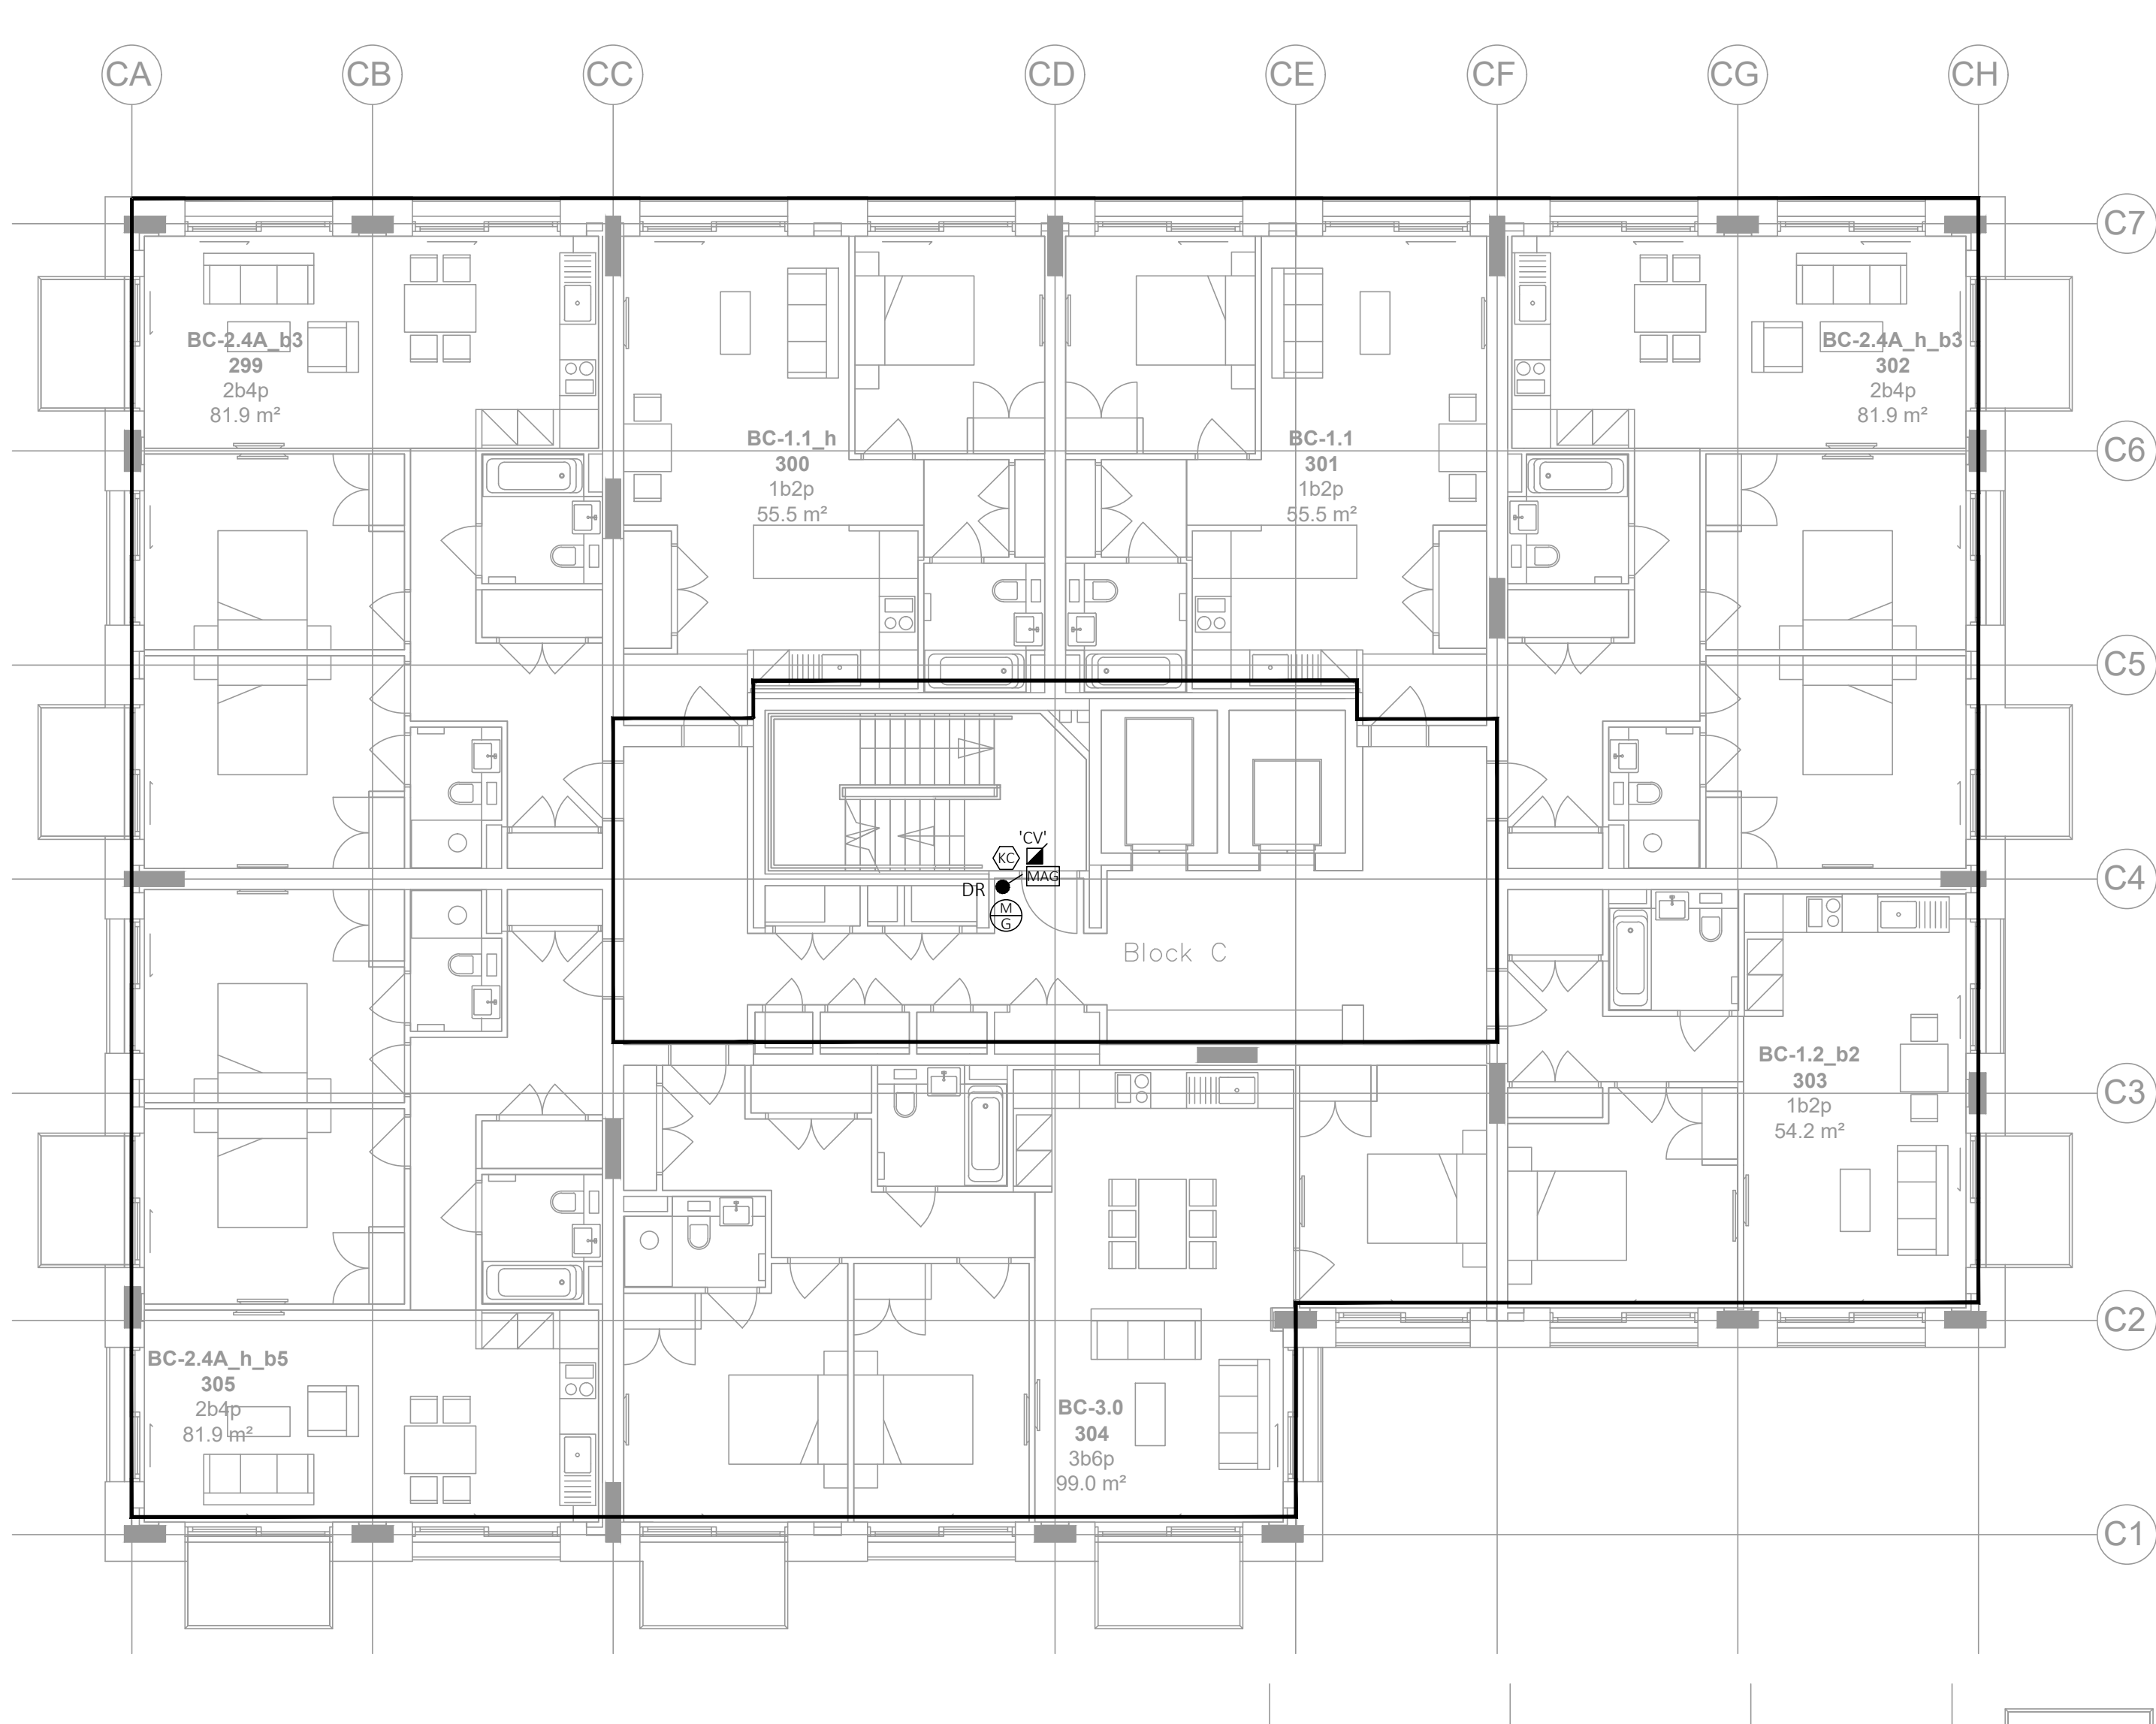

BLOCK C - LEVEL 04

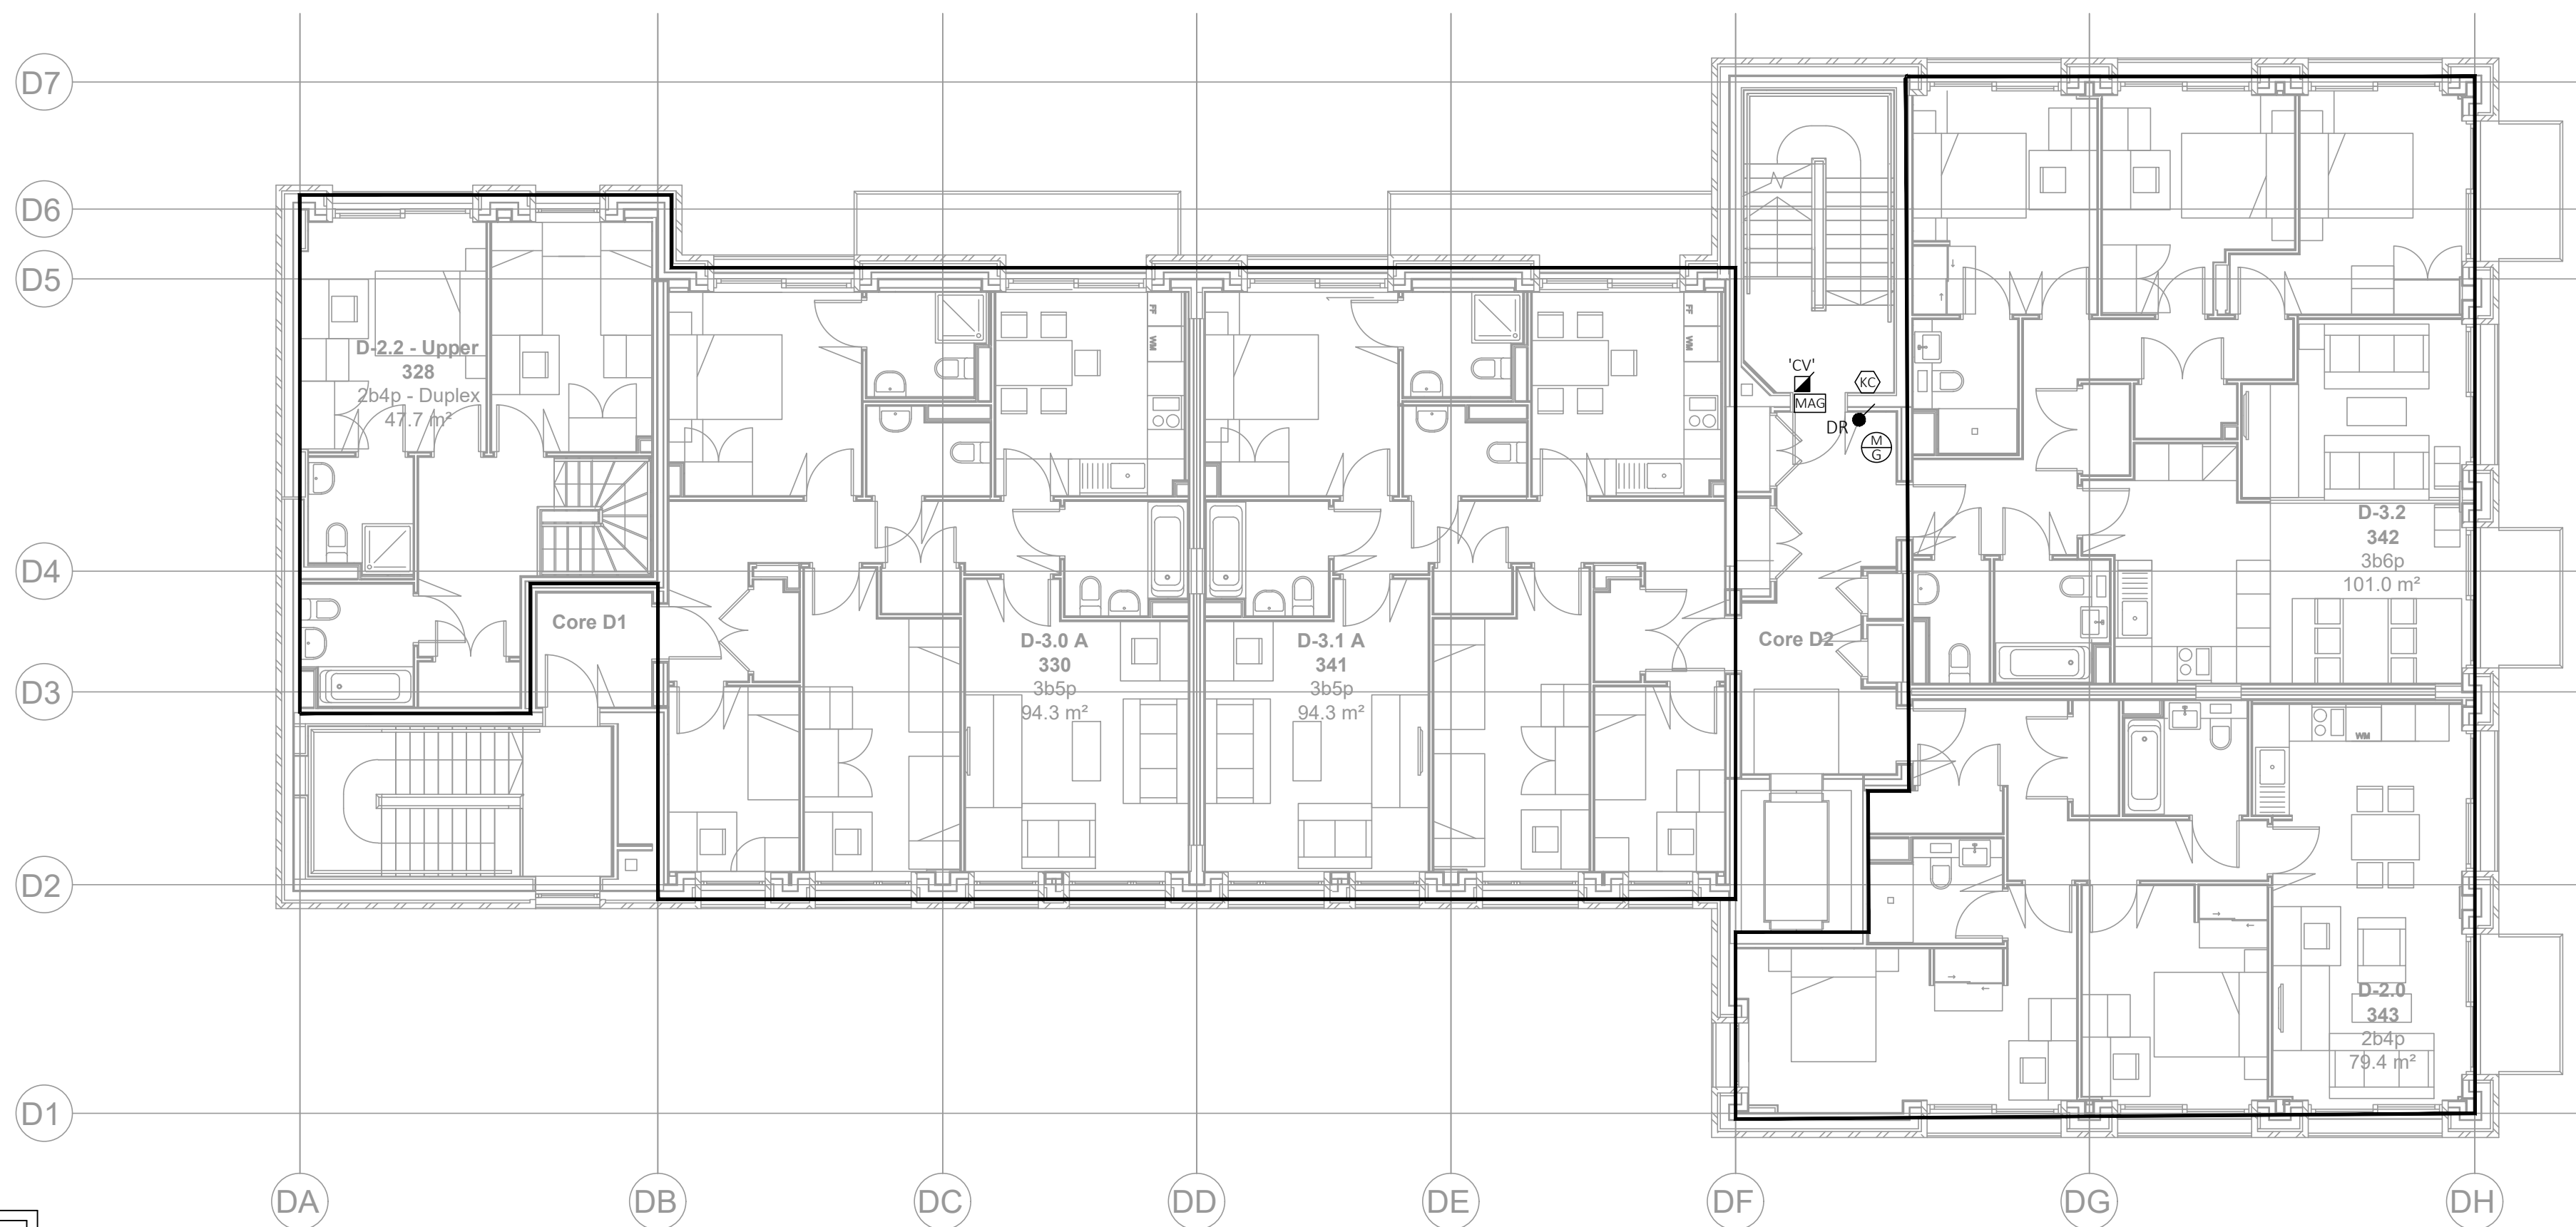

BLOCK D - LEVEL 04

CALDWELL SECURITY	
	ELECTROMAGNETIC PLATE LOCK FITTED ON LEAF OF DOOR AND FRAME AT HIGH LEVEL.
	DOOR ACCESS UNIT POWER SUPPLY AND CONTROLS INSTALLED IN CEILING VOID
	'PUSH BUTTON TO OPEN' MANUAL EGRESS DOOR RELEASE SWITCH. FOR NORMAL USE.
	FAIL SAFE OPEN DEVICE. WALL MOUNTED GREEN BREAK GLASS TYPE FOR USE IN SCENARIOS WHERE FIRE ALARM INTERFACE FAILS OR DOOR CONTROL EQUIPMENT FAILS.
	FOB-SWIPE TYPE WALL/PANEL MOUNTED FOB READER LINKED TO LOCAL DOOR ACCESS CONTROLS.
	DOOR ENTRY PANEL
	VIDEO INTERCOM
	CCTV CAMERA

P2	MAR.21	INDUCTION LOOP REMOVAL	CS	LW
P1	FEB.21	ISSUED FOR REVIEW/APPROVAL	CS	LW
REV	DATE	DESCRIPTION	DR	CK

Caldwell

ARCHITECT
RYDER ARCHITECTS

JOB
MOUNT PLEASANT
PHASE 2
4023

DRAWING
SECURITY ACCESS AND CCTV PROPOSAL
LEVEL 04
BLOCK B, C & D


DRAWING NO./REVISION
MPP2 - CAL - ZZ - 04 - SK17 - P2

SCALE/PRINTED AT 1:100@A1	DATE OCT'20	DRAWN CS	CHECKED LW
UNIT 6 FORESTROVE BUSINESS PARK NEWTOWNBREA BELFAST BT8 6AW		TEL : 02890699720 FAX:02890641625 E.MAIL : admin@caldwellconsulting.net	


INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.



BLOCK B - LEVEL 05

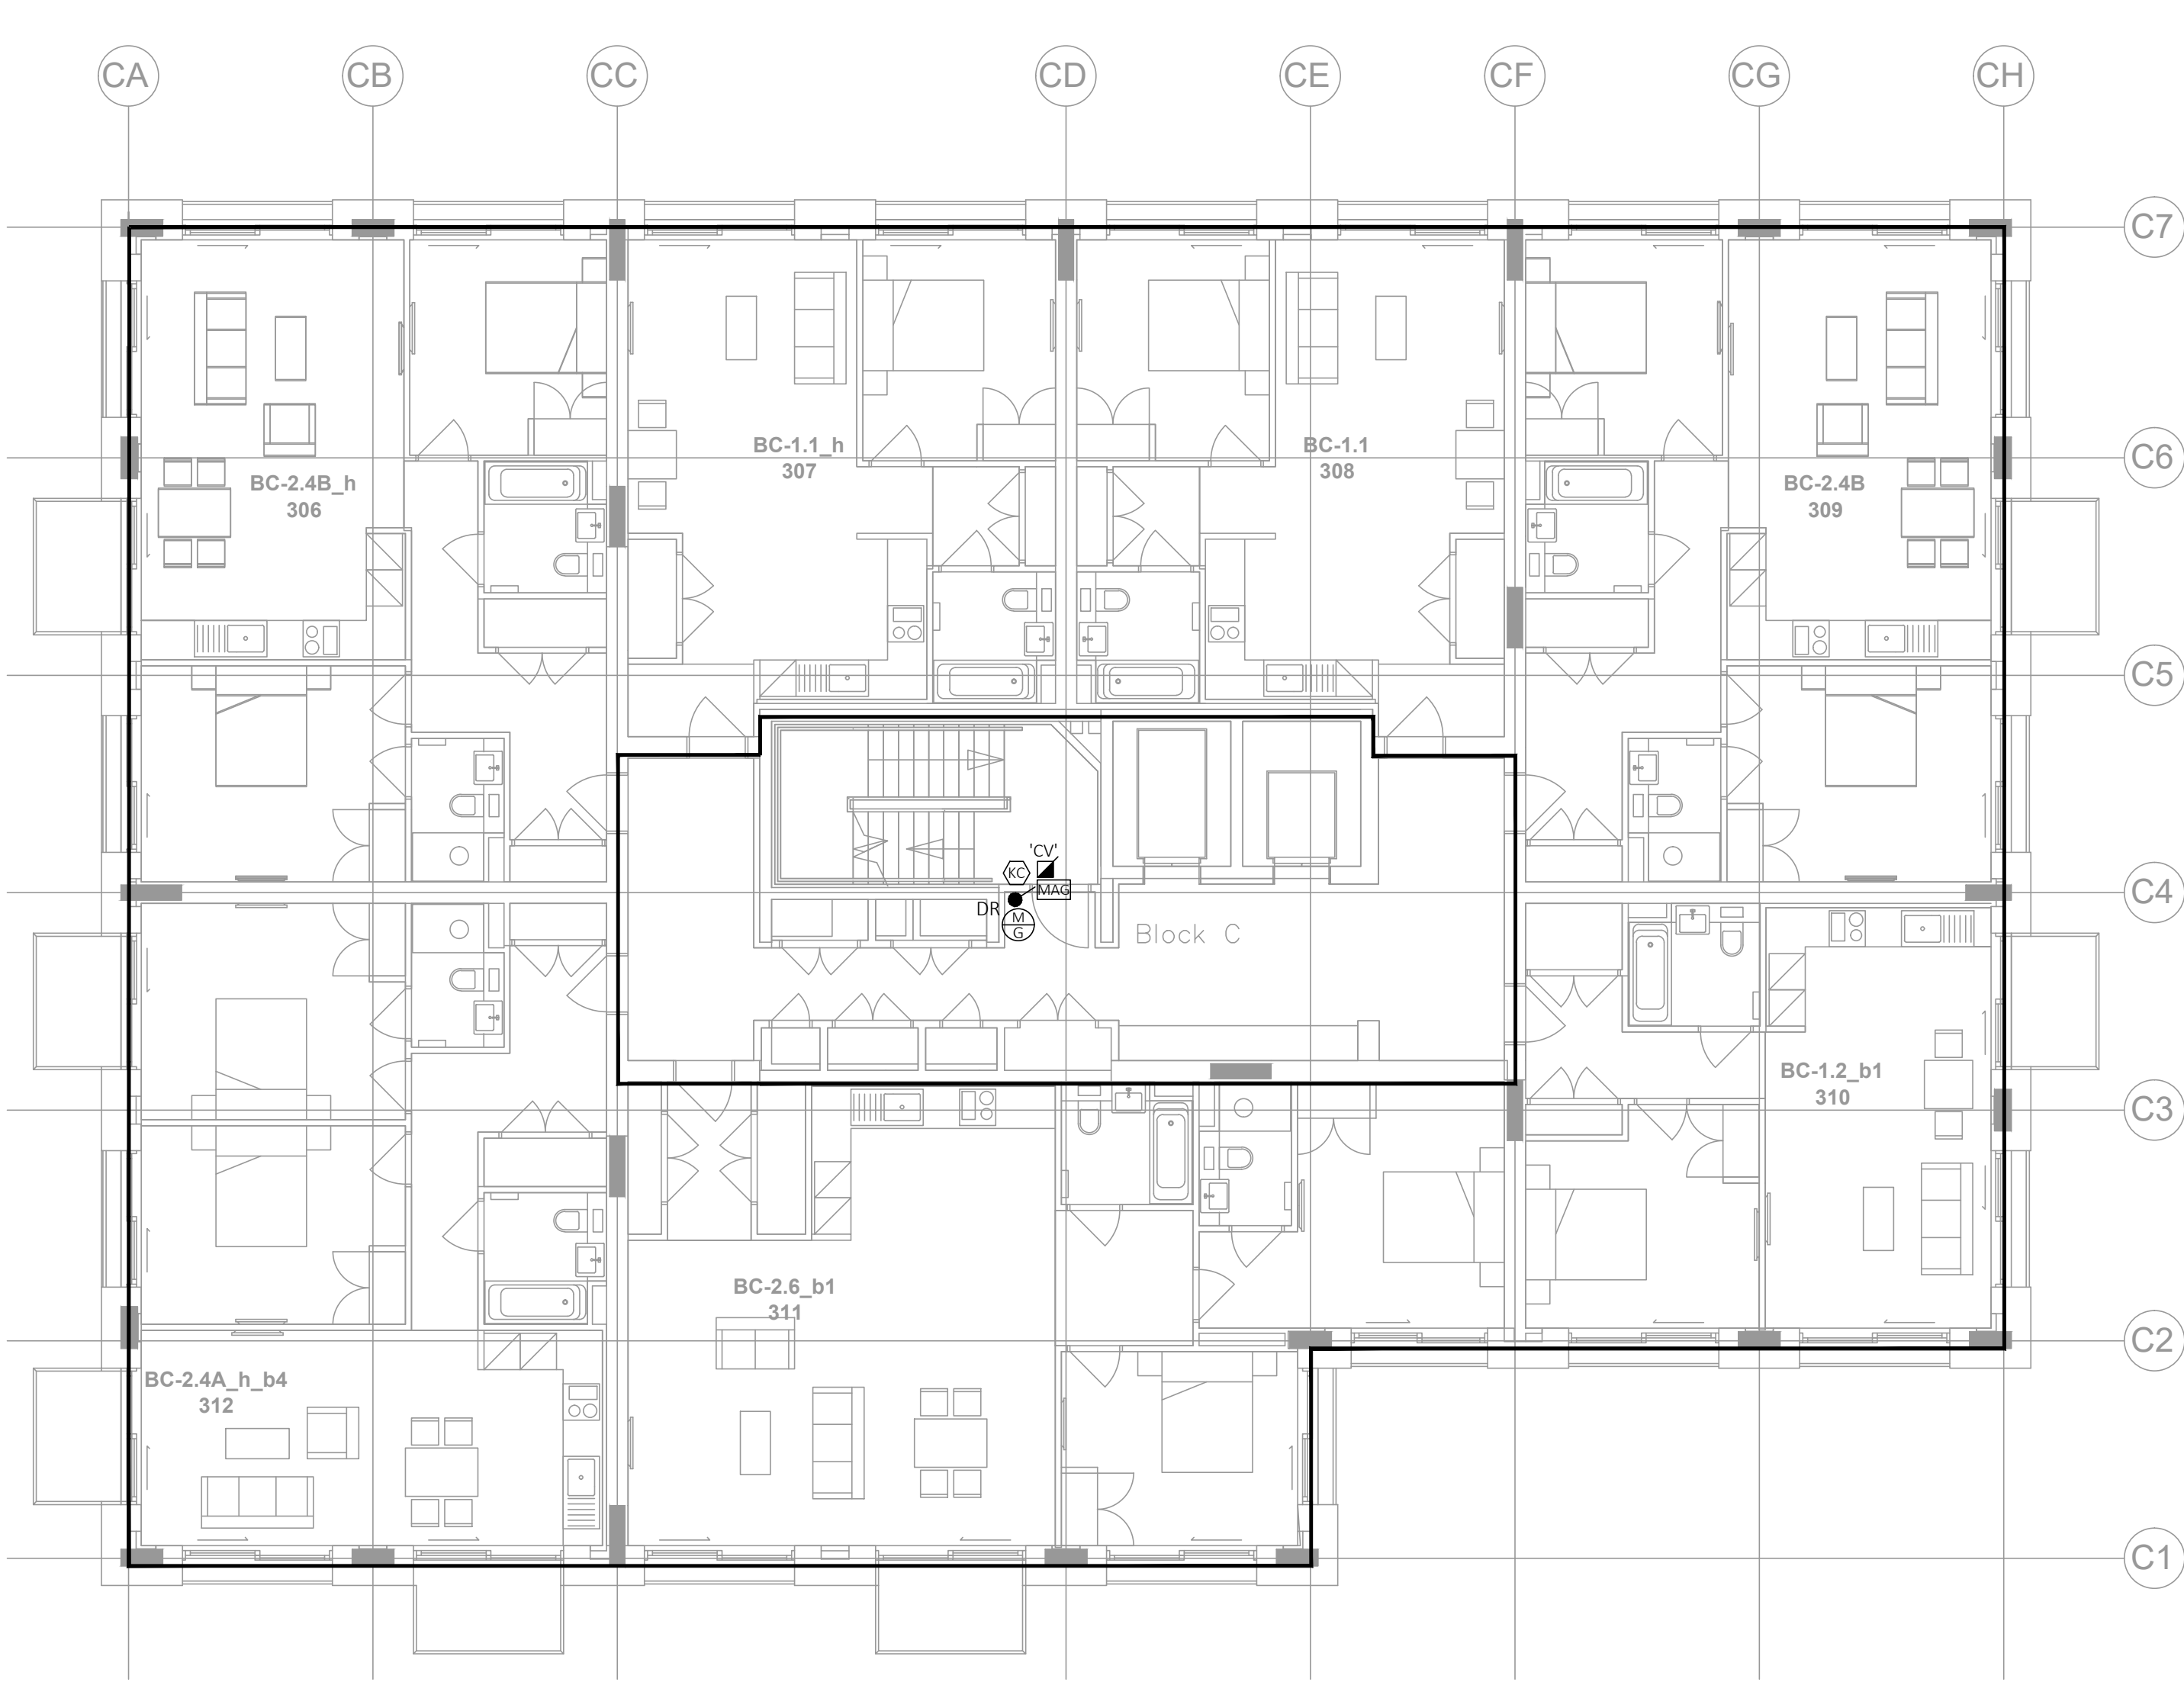

BLOCK C - LEVEL 05

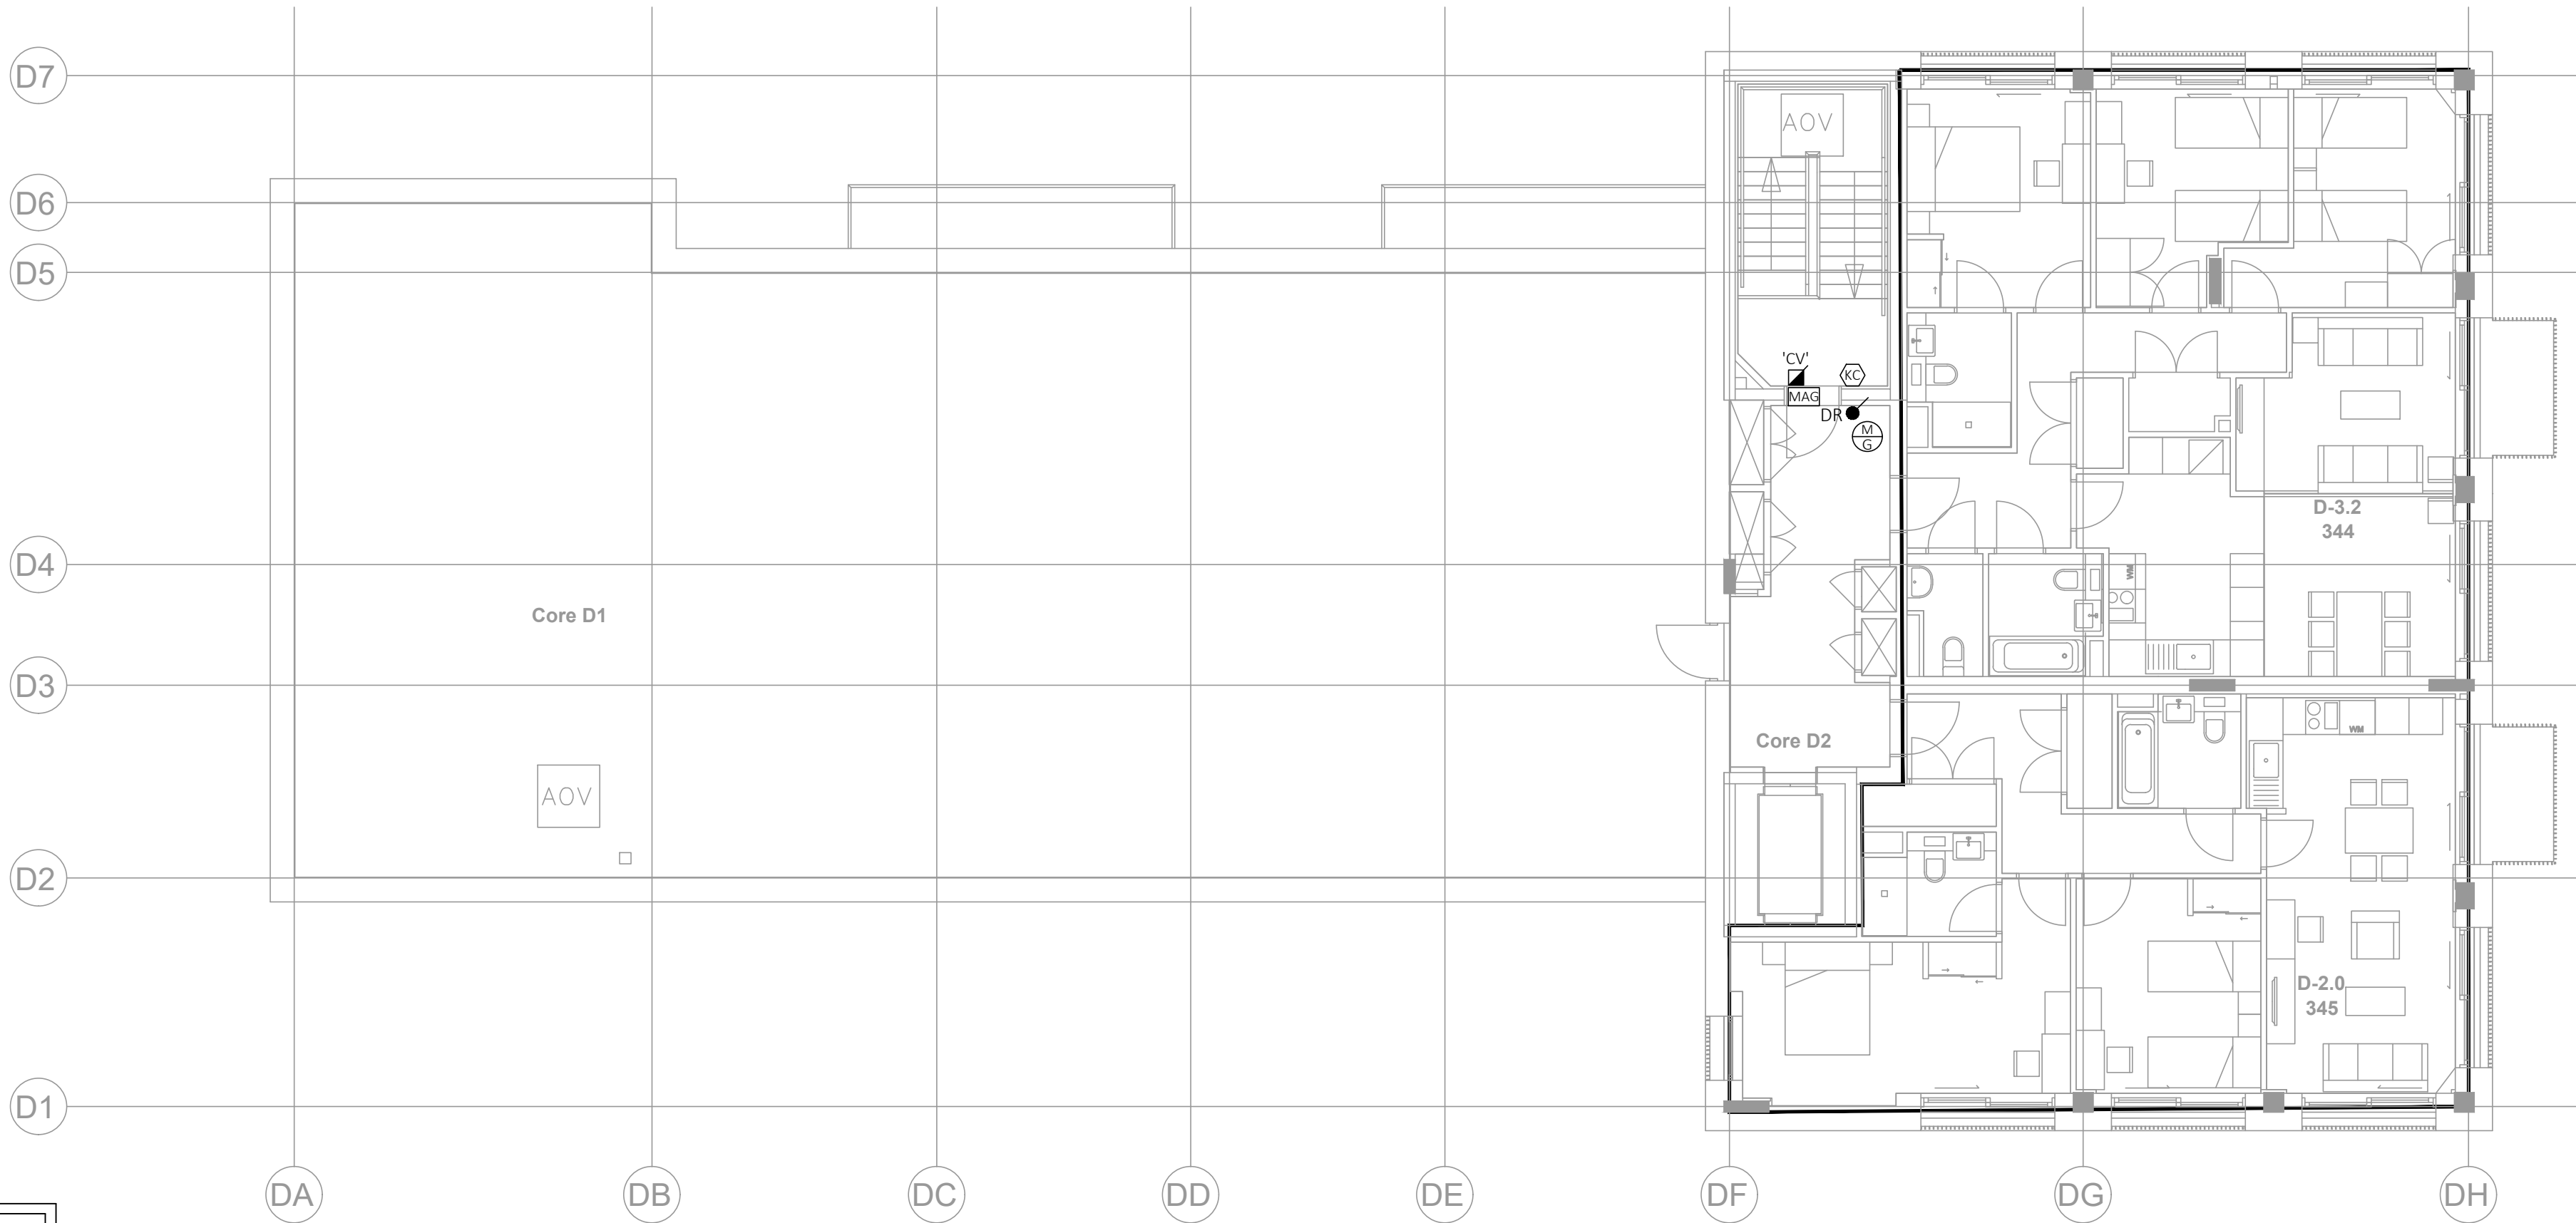

BLOCK D - LEVEL 05

CALDWELL SECURITY	
	ELECTROMAGNETIC PLATE LOCK FITTED ON LEAF OF DOOR AND FRAME AT HIGH LEVEL.
	DOOR ACCESS UNIT POWER SUPPLY AND CONTROLS INSTALLED IN CEILING VOID
	'PUSH BUTTON TO OPEN' MANUAL EGRESS DOOR RELEASE SWITCH. FOR NORMAL USE.
	FAIL SAFE OPEN DEVICE. WALL MOUNTED GREEN BREAK GLASS TYPE FOR USE IN SCENARIOS WHERE FIRE ALARM INTERFACE FAILS OR DOOR CONTROL EQUIPMENT FAILS.
	FOB-SWIPE TYPE WALL/PANEL MOUNTED FOB READER LINKED TO LOCAL DOOR ACCESS CONTROLS.
	DOOR ENTRY PANEL
	VIDEO INTERCOM
	CCTV CAMERA

P2 MAR.21	INDUCTION LOOP REMOVAL	CS	LW
P1 FEB.21	ISSUED FOR REVIEW/APPROVAL	CS	LW
REV DATE	DESCRIPTION	DR	CK

Caldwell

ARCHITECT
RYDER ARCHITECTS

JOB
MOUNT PLEASANT
PHASE 2
4023

DRAWING
SECURITY ACCESS AND CCTV PROPOSAL
LEVEL 05
BLOCK B, C & D


DRAWING NO./REVISION
MPP2 - CAL - ZZ - 05 - SK18 - P2

SCALE/PRINTED AT 1:100@A1	DATE DEC'20	DRAWN CS	CHECKED LW
UNIT 6 FORESTROVE BUSINESS PARK NEWTOWNBREDABELFAST BT8 6AW		TEL: 02890699720 FAX: 02890641625 E-MAIL: admin@caldwellconsulting.net	


INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.



BLOCK B - LEVEL 06

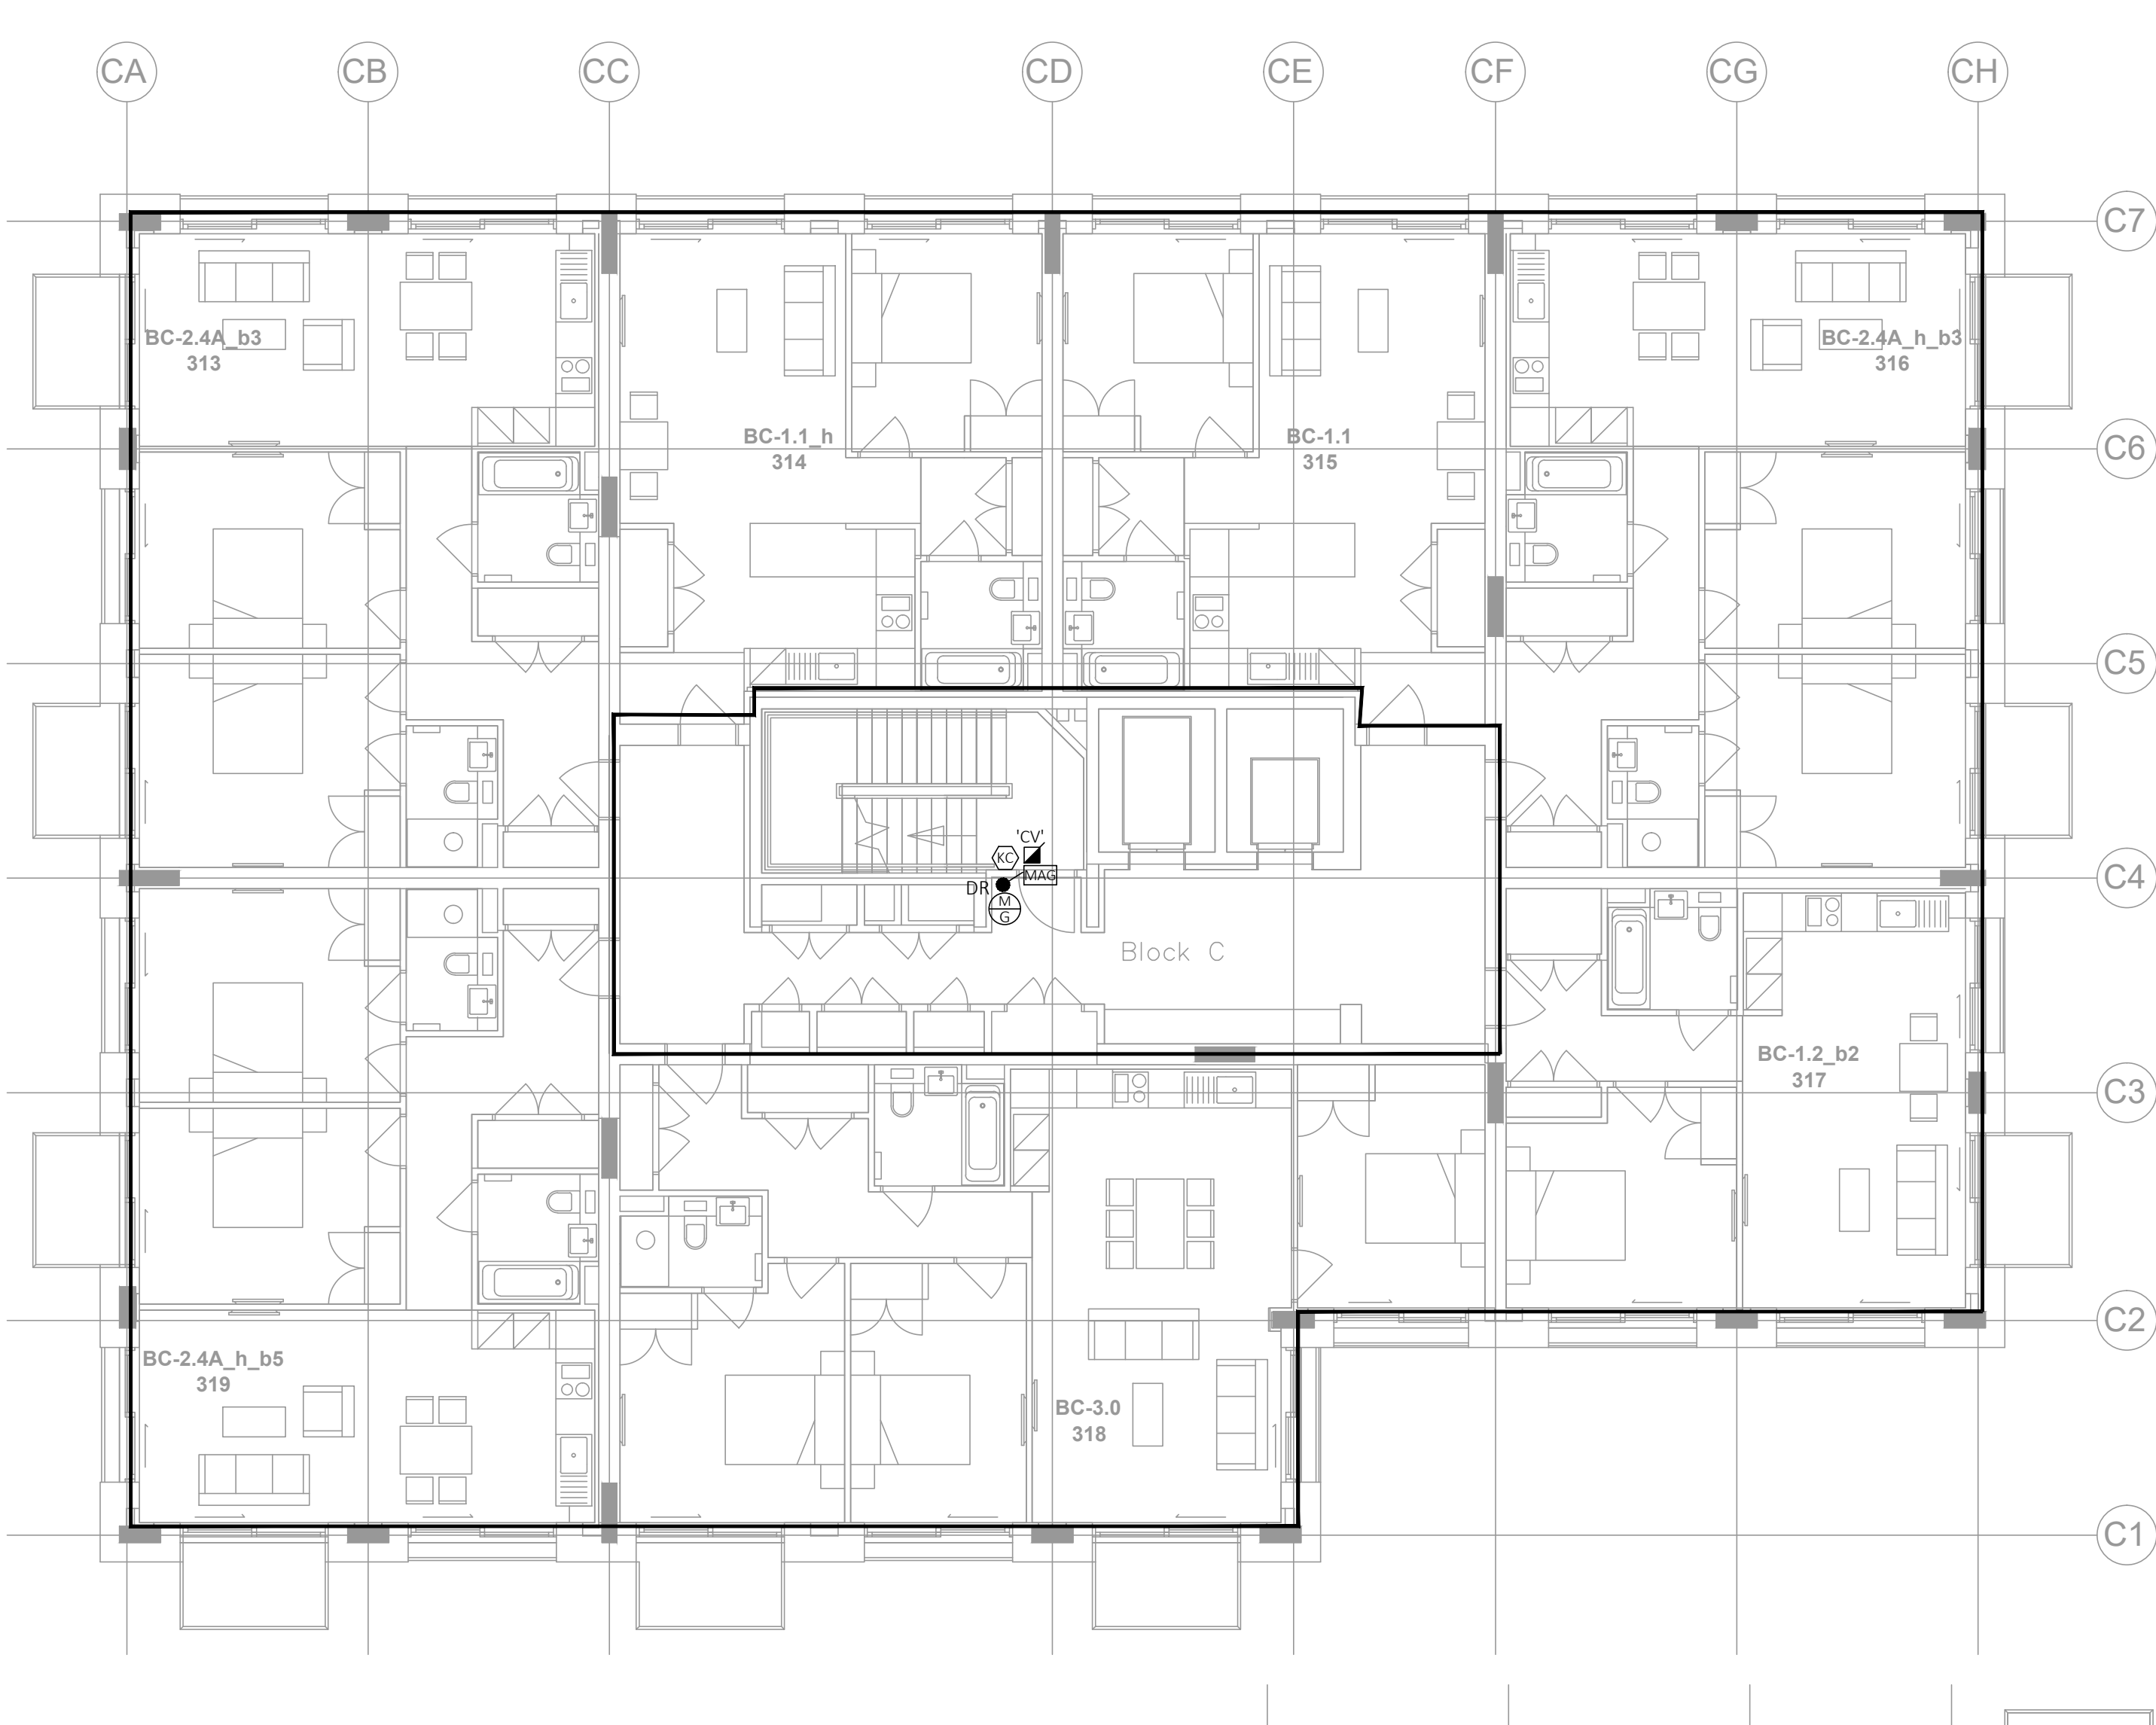

BLOCK C - LEVEL 06

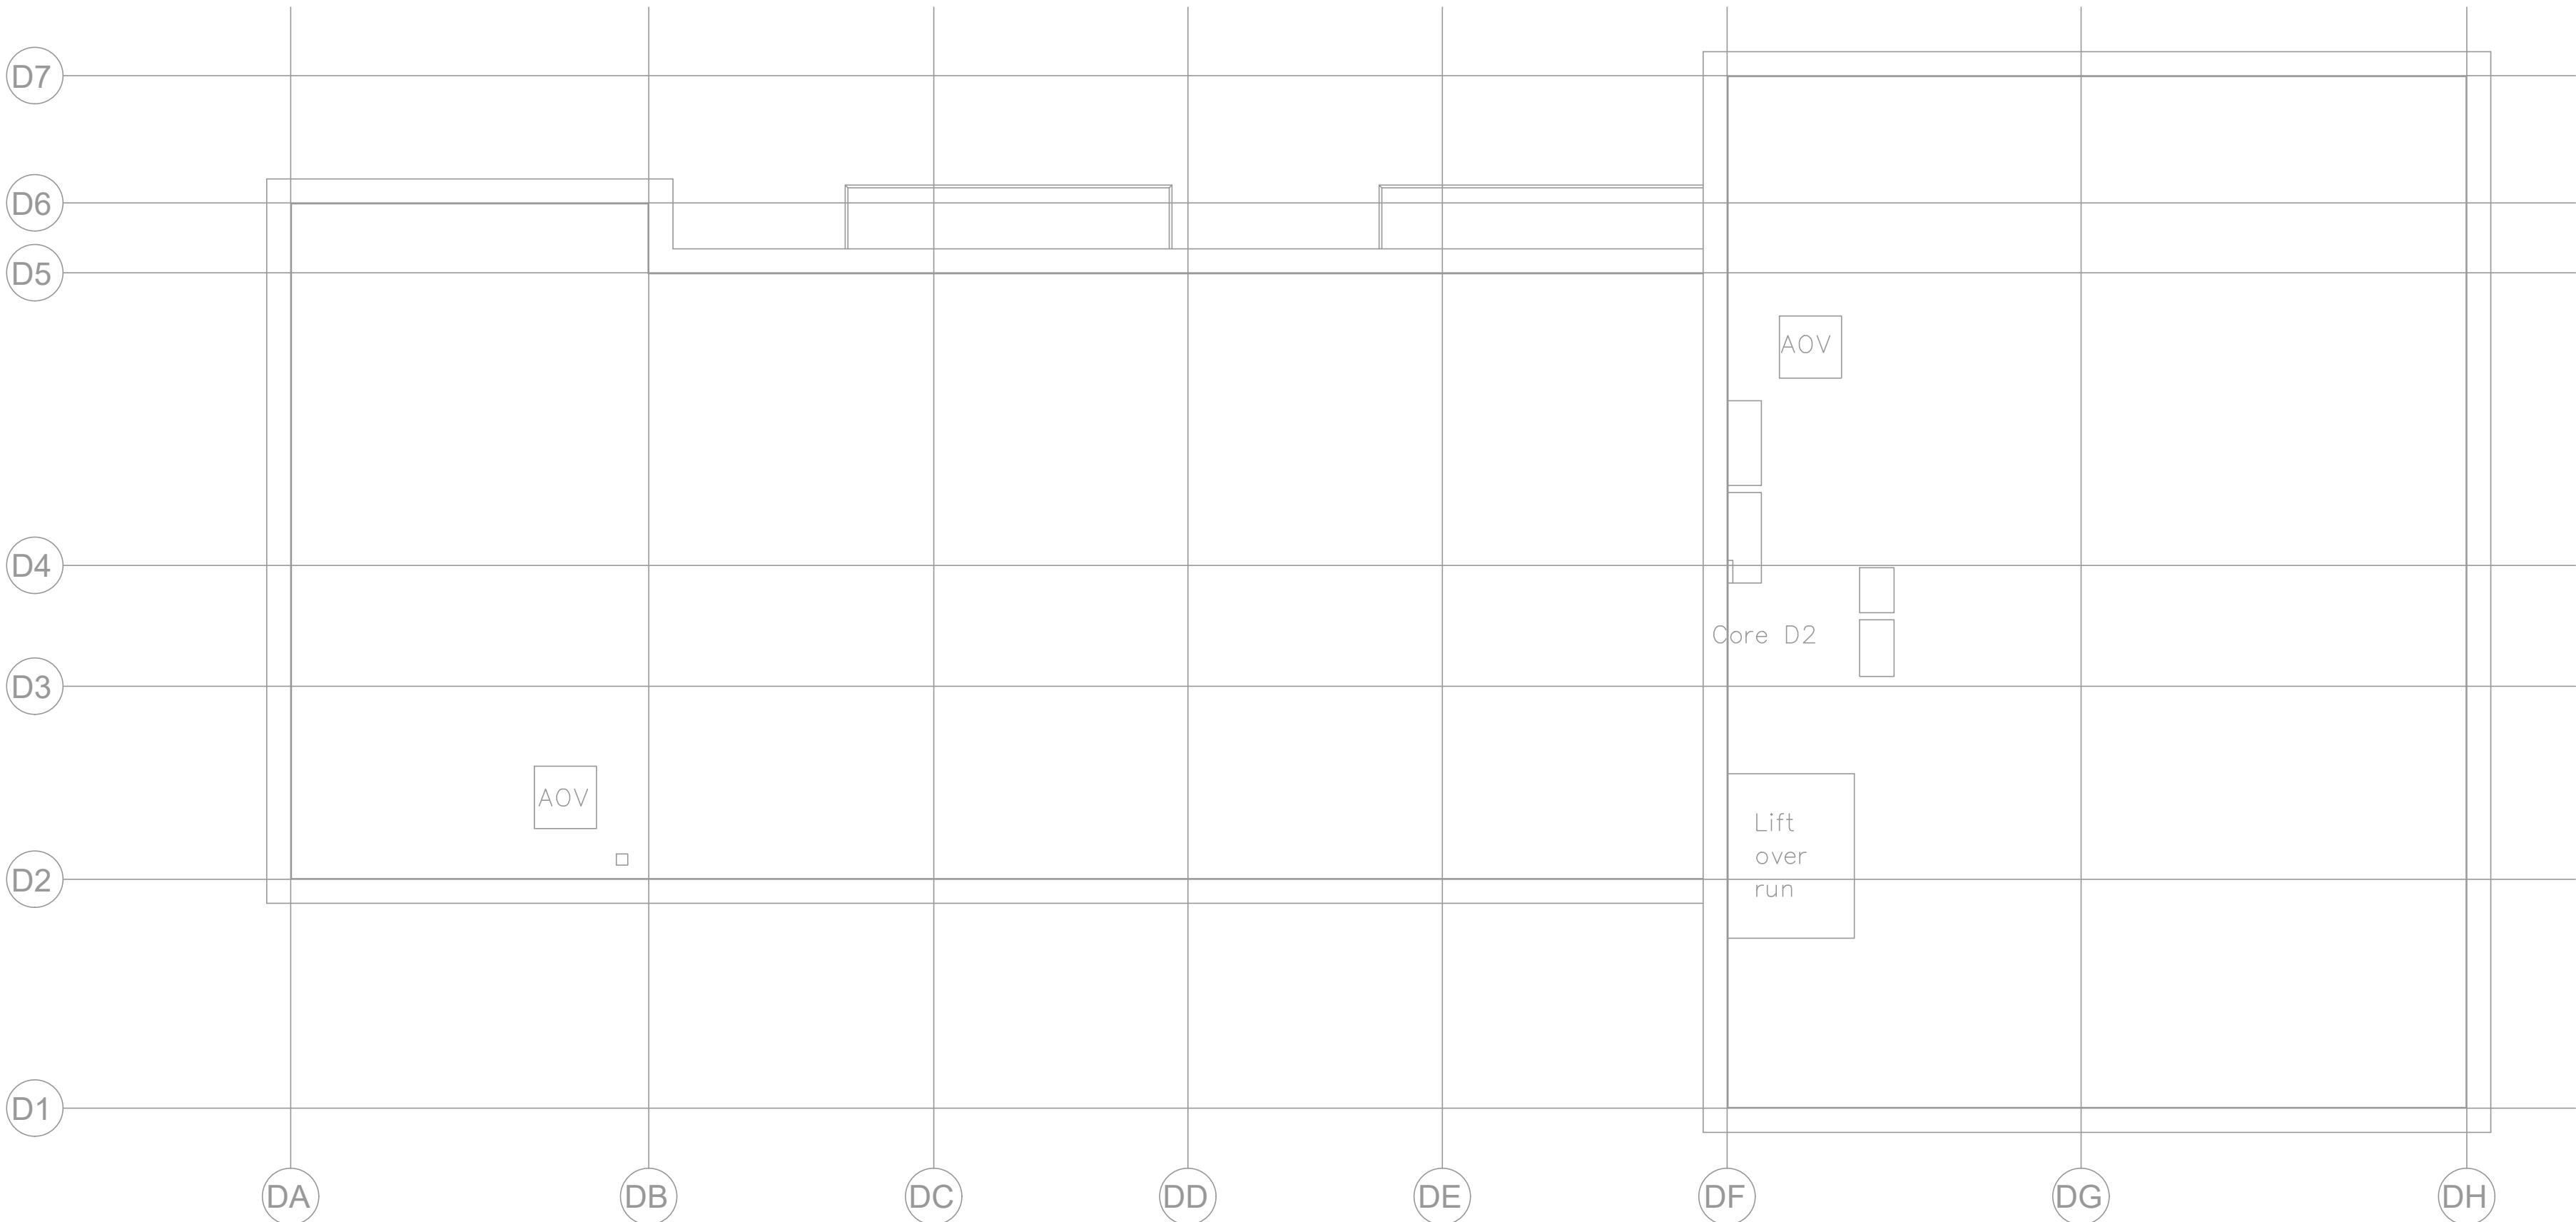

BLOCK D - ROOF LEVEL

CALDWELL SECURITY	
 MAG	ELECTROMAGNETIC PLATE LOCK FITTED ON LEAF OF DOOR AND FRAME AT HIGH LEVEL.
 PSU	DOOR ACCESS UNIT POWER SUPPLY AND CONTROLS INSTALLED IN CEILING VOID
 DR	'PUSH BUTTON TO OPEN' MANUAL EGRESS DOOR RELEASE SWITCH, FOR NORMAL USE.
 M/G	FAILSAFE OPEN DEVICE, WALL MOUNTED GREEN BREAK GLASS TYPE FOR USE IN SCENARIOS WHERE FIRE ALARM INTERFACE FAILS OR DOOR CONTROL EQUIPMENT FAILS.
 VC	FOB-SWIPE TYPE WALL/PANEL MOUNTED FOB READER LINKED TO LOCAL DOOR ACCESS CONTROLS.
 DE	DOOR ENTRY PANEL
 VI	VIDEO INTERCOM
 CCTV	CCTV CAMERA

P2	MAR.21	INDUCTION LOOP REMOVAL	CS	LW
P1	FEB.21	ISSUED FOR REVIEW/APPROVAL	CS	LW
REV	DATE	DESCRIPTION	DR	CK

Caldwell

ARCHITECT
RYDER ARCHITECTS

JOB
MOUNT PLEASANT
PHASE 2
4023

DRAWING
SECURITY ACCESS AND CCTV PROPOSAL
LEVEL 06
BLOCK B, C & D


DRAWING NO./REVISION
MPP2 - CAL - ZZ - 06 - SKT9 - P2

SCALE/PRINTED AT	DATE	DRAWN	CHECKED
1:100@A1	DEC'20	CS	LW
UNIT 6 FORESTROVE BUSINESS PARK TEL: 02890699720 FAX: 02890641625 NEWTOWNBREDABELFAST BT8 6AW E.MAIL: admin@caldwellconsulting.net			

INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.



BLOCK B - LEVEL 07

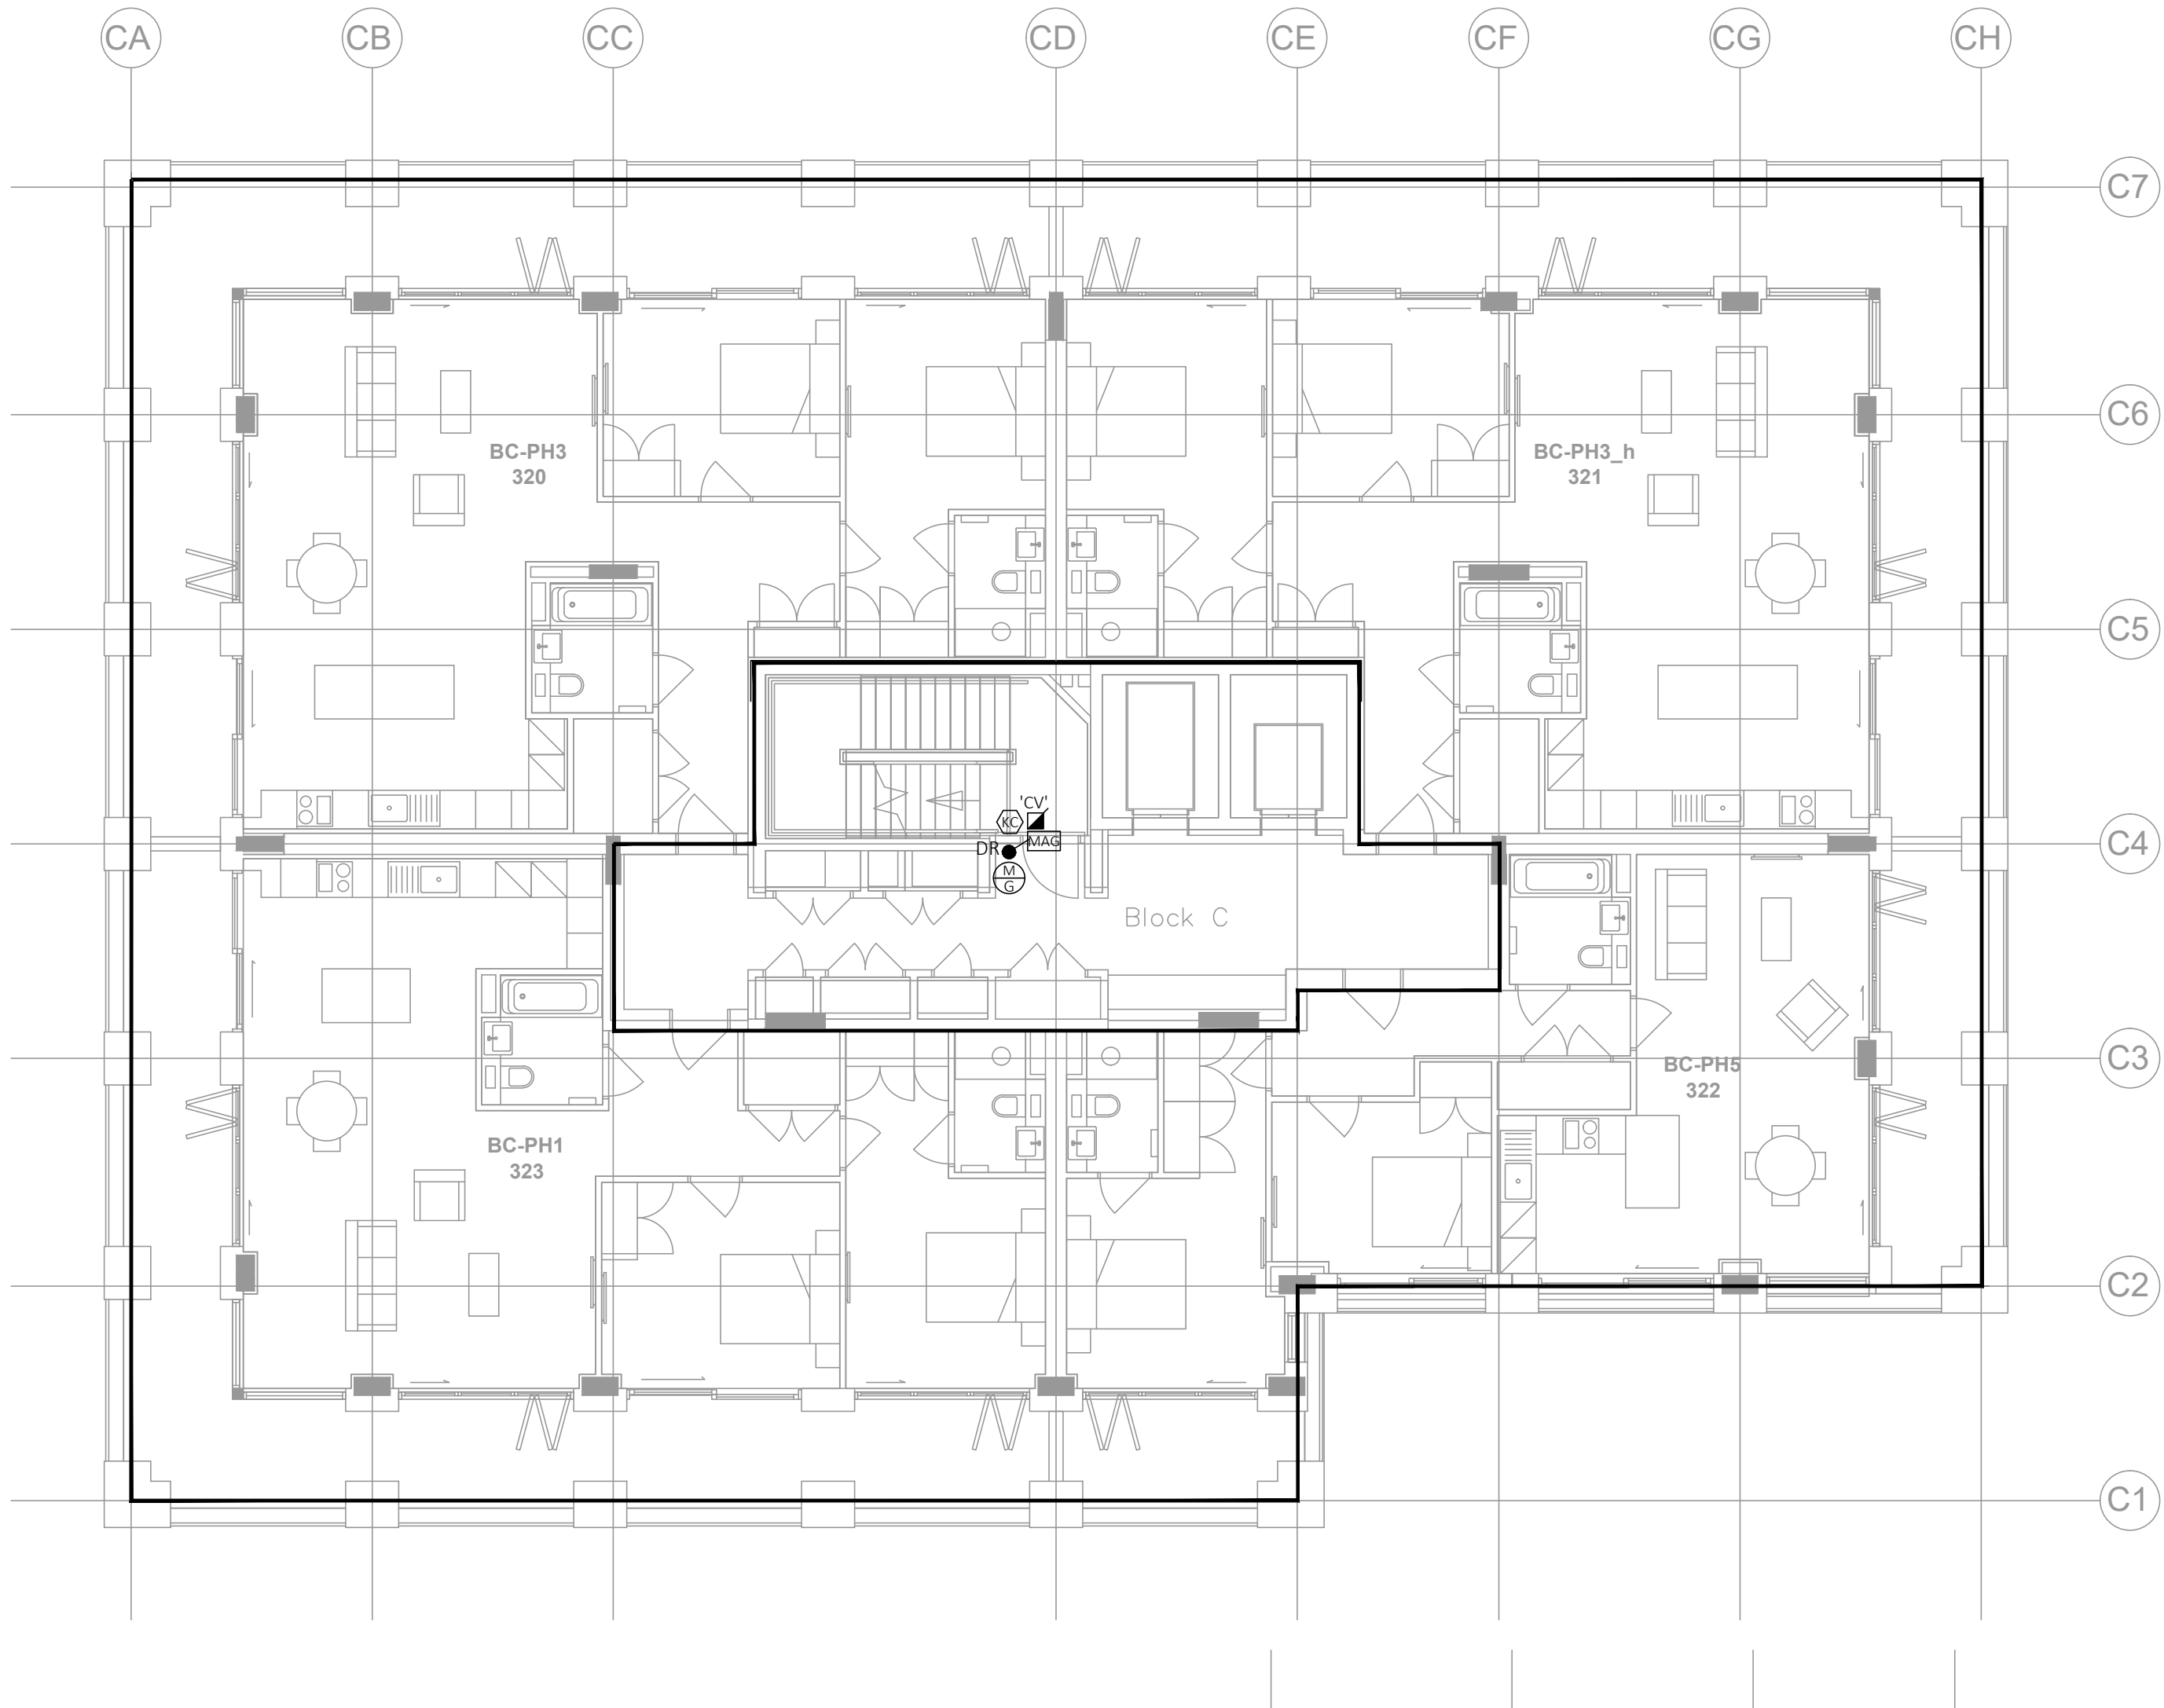

BLOCK C - LEVEL 07

CALDWELL SECURITY	
	ELECTROMAGNETIC PLATE LOCK FITTED ON LEAF OF DOOR AND FRAME AT HIGH LEVEL.
	DOOR ACCESS UNIT POWER SUPPLY AND CONTROLS INSTALLED IN CEILING VOID
	'PUSH BUTTON TO OPEN' MANUAL EGRESS DOOR RELEASE SWITCH. FOR NORMAL USE.
	FAIL SAFE OPEN DEVICE. WALL MOUNTED GREEN BREAK GLASS TYPE FOR USE IN SCENARIOS WHERE FIRE ALARM INTERFACE FAILS OR DOOR CONTROL EQUIPMENT FAILS.
	FOB-SWIPE TYPE WALL/PANEL MOUNTED FOB READER LINKED TO LOCAL DOOR ACCESS CONTROLS.
	DOOR ENTRY PANEL
	VIDEO INTERCOM
	CCTV CAMERA

P2	MAR.21	INDUCTION LOOP REMOVAL	CS	LW
P1	FEB.21	ISSUED FOR REVIEW/APPROVAL	CS	LW
REV	DATE	DESCRIPTION	DR	CK

Caldwell

ARCHITECT
RYDER ARCHITECTS


JOB
MOUNT PLEASANT
PHASE 2
4023

DRAWING
SECURITY ACCESS AND CCTV PROPOSAL
LEVEL 07
BLOCK B, C & D

DRAWING NO./REVISION
MPP2 - CAL - ZZ - 07 - SKT10 - P2

SCALE/PRINTED AT 1:100@A1	DATE OCT'20	DRAWN CS	CHECKED LW
UNIT 6 FORESTGROVE BUSINESS PARK NEWTOWNBREA BELFAST BT8 6AW		TEL: 02890699720 FAX: 02890641625 E.MAIL: admin@caldwellconsulting.net	

INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.

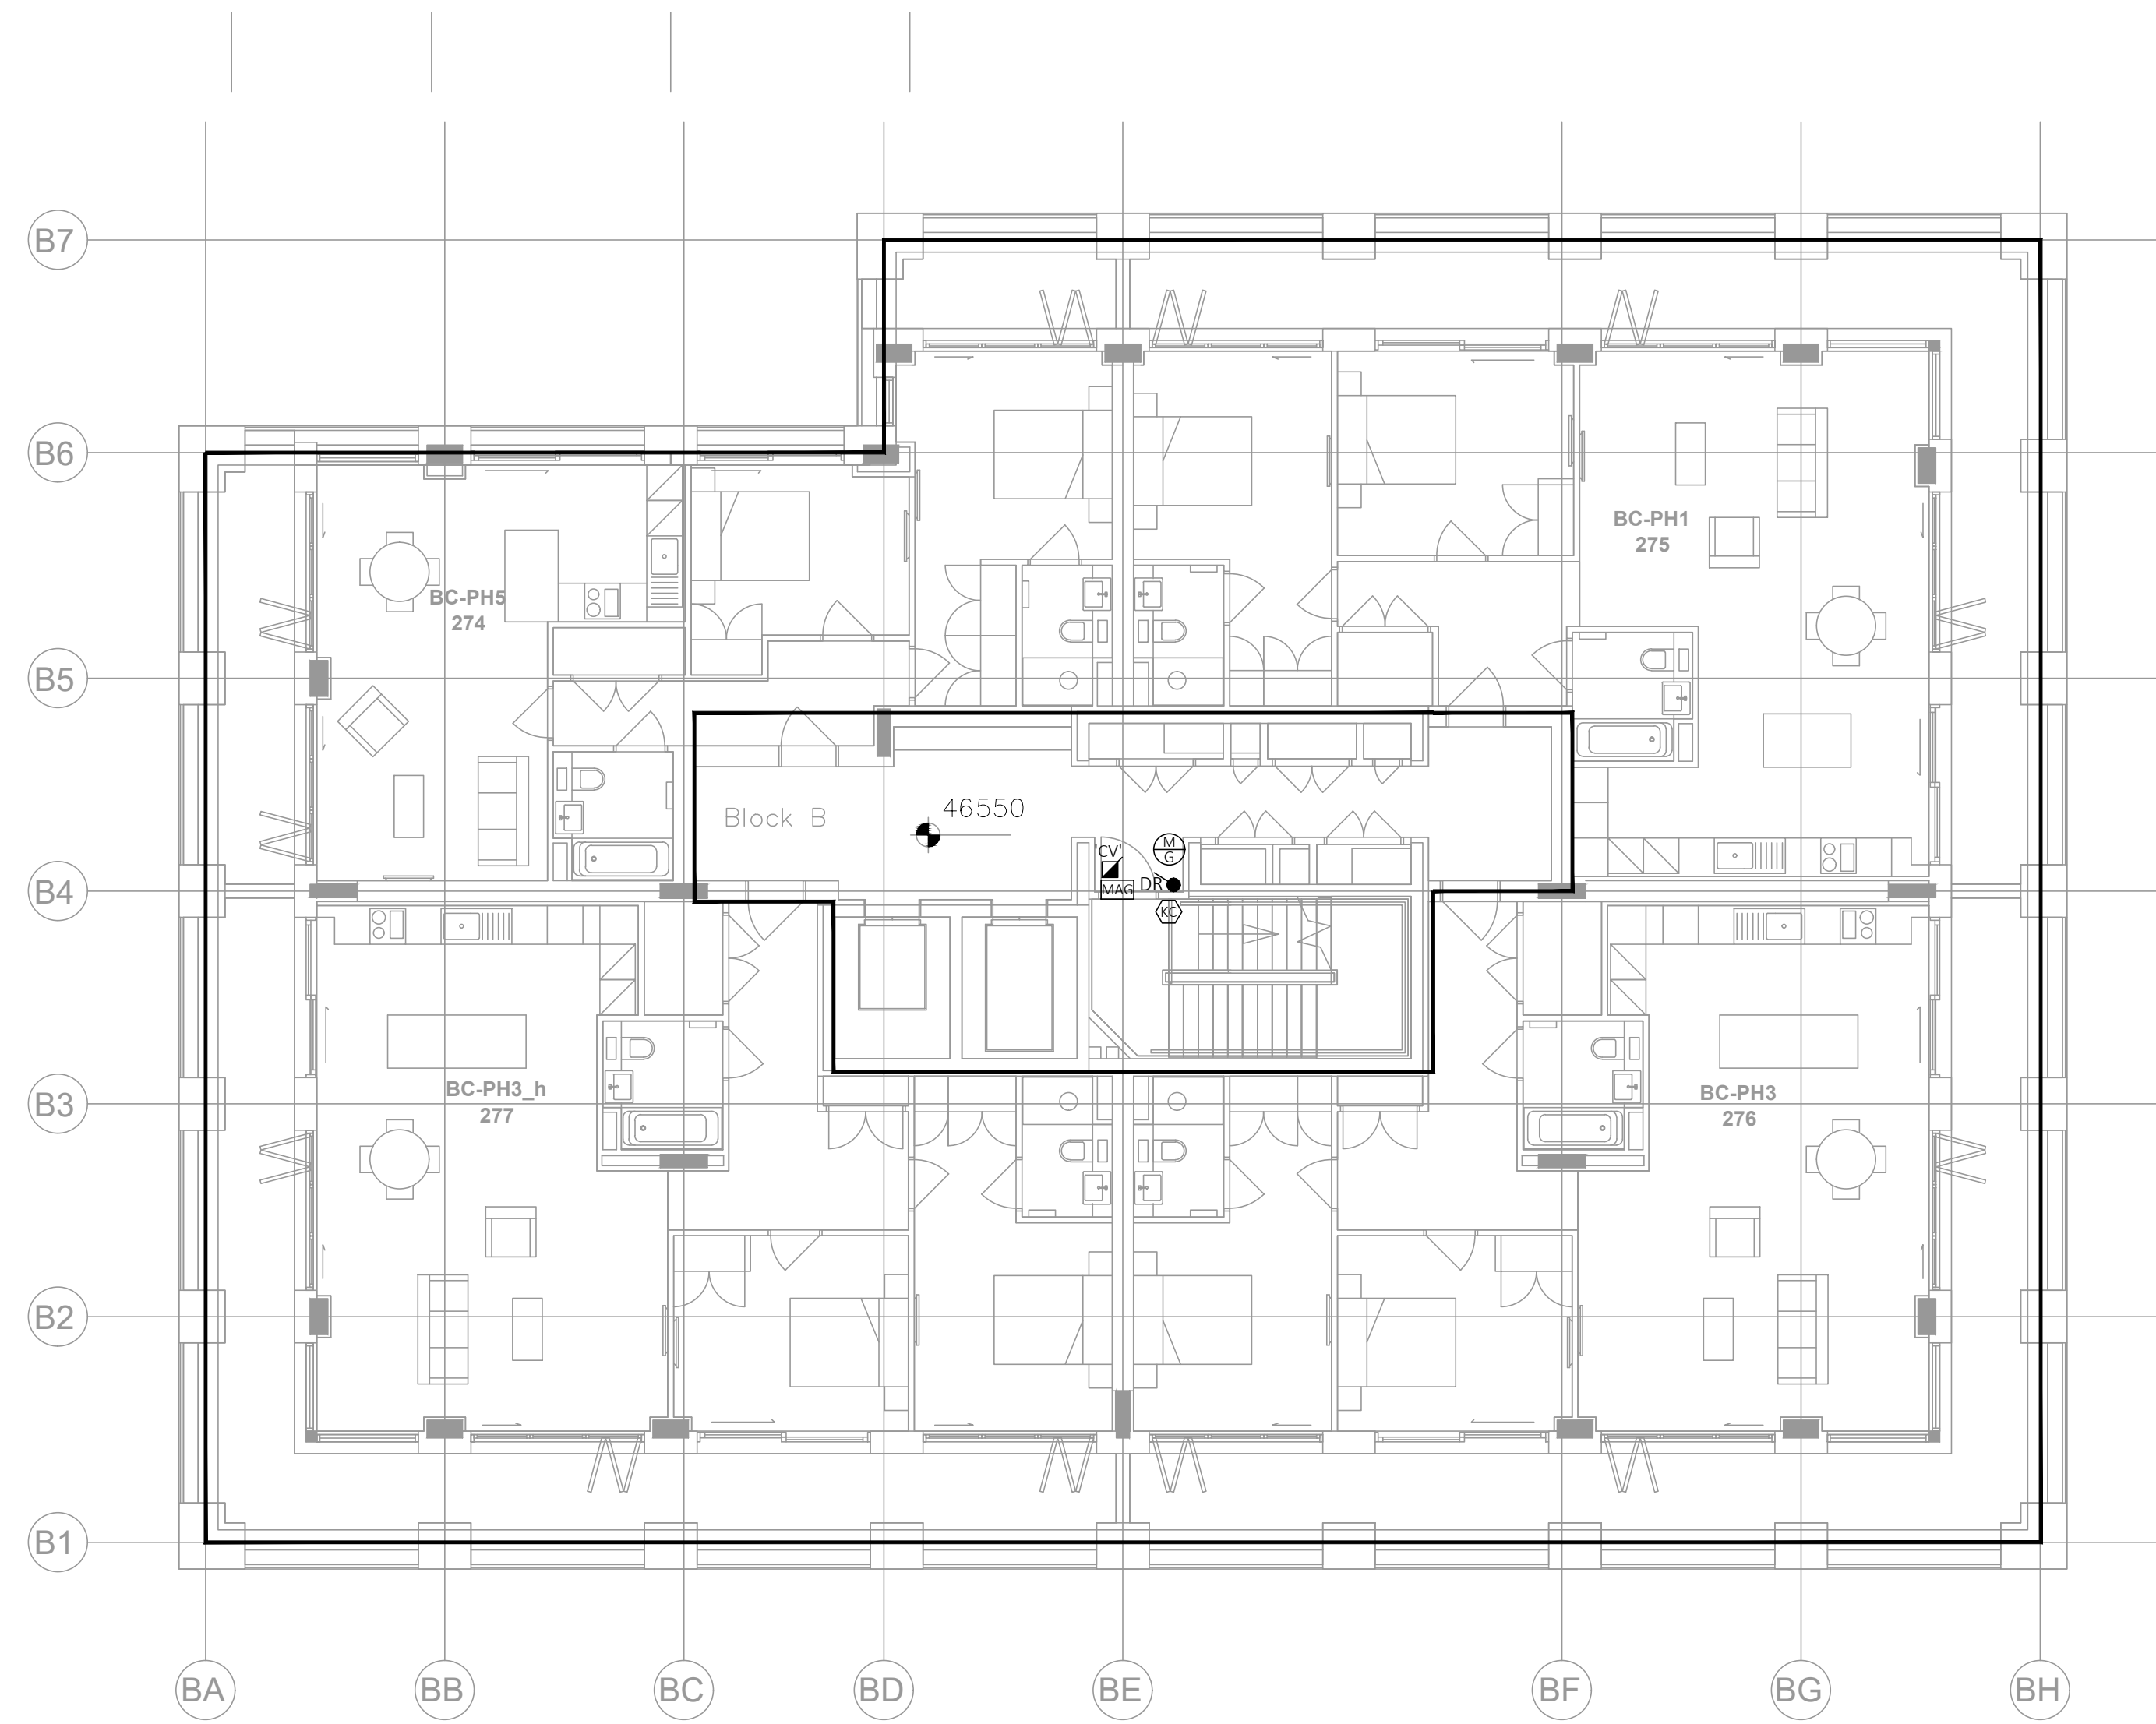

BLOCK B - LEVEL 09

CALDWELL SECURITY	
	ELECTROMAGNETIC PLATE LOCK FITTED ON LEAF OF DOOR AND FRAME AT HIGH LEVEL.
	DOOR ACCESS UNIT POWER SUPPLY AND CONTROLS INSTALLED IN CEILING VOID
	'PUSH BUTTON TO OPEN' MANUAL EGRESS DOOR RELEASE SWITCH. FOR NORMAL USE.
	FAIL SAFE OPEN DEVICE. WALL MOUNTED GREEN BREAK GLASS TYPE FOR USE IN SCENARIOS WHERE FIRE ALARM INTERFACE FAILS OR DOOR CONTROL EQUIPMENT FAILS.
	FOB-SWIPE TYPE WALL/PANEL MOUNTED FOB READER LINKED TO LOCAL DOOR ACCESS CONTROLS.
	DOOR ENTRY PANEL
	VIDEO INTERCOM
	CCTV CAMERA

P2	MAR.21	INDUCTION LOOP REMOVAL	CS	LW
P1	FEB.21	ISSUED FOR REVIEW/APPROVAL	CS	LW
REV	DATE	DESCRIPTION	DR	CK

Caldwell

ARCHITECT
RYDER ARCHITECTS


JOB
MOUNT PLEASANT
PHASE 2
4023

DRAWING
SECURITY ACCESS AND CCTV PROPOSAL
LEVEL 09
BLOCK B

DRAWING NO./REVISION
MPP2 - CAL - ZZ - 09 - SKT12 - P2

SCALE/PRINTED AT 1:100@A1	DATE OCT'20	DRAWN CS	CHECKED LW
UNIT 6 FORESTGROVE BUSINESS PARK NEWTOWNBRED A BELFAST BT8 6AW		TEL: 02890699720 FAX: 02890641625 E.MAIL: admin@caldwellconsulting.net	

INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.

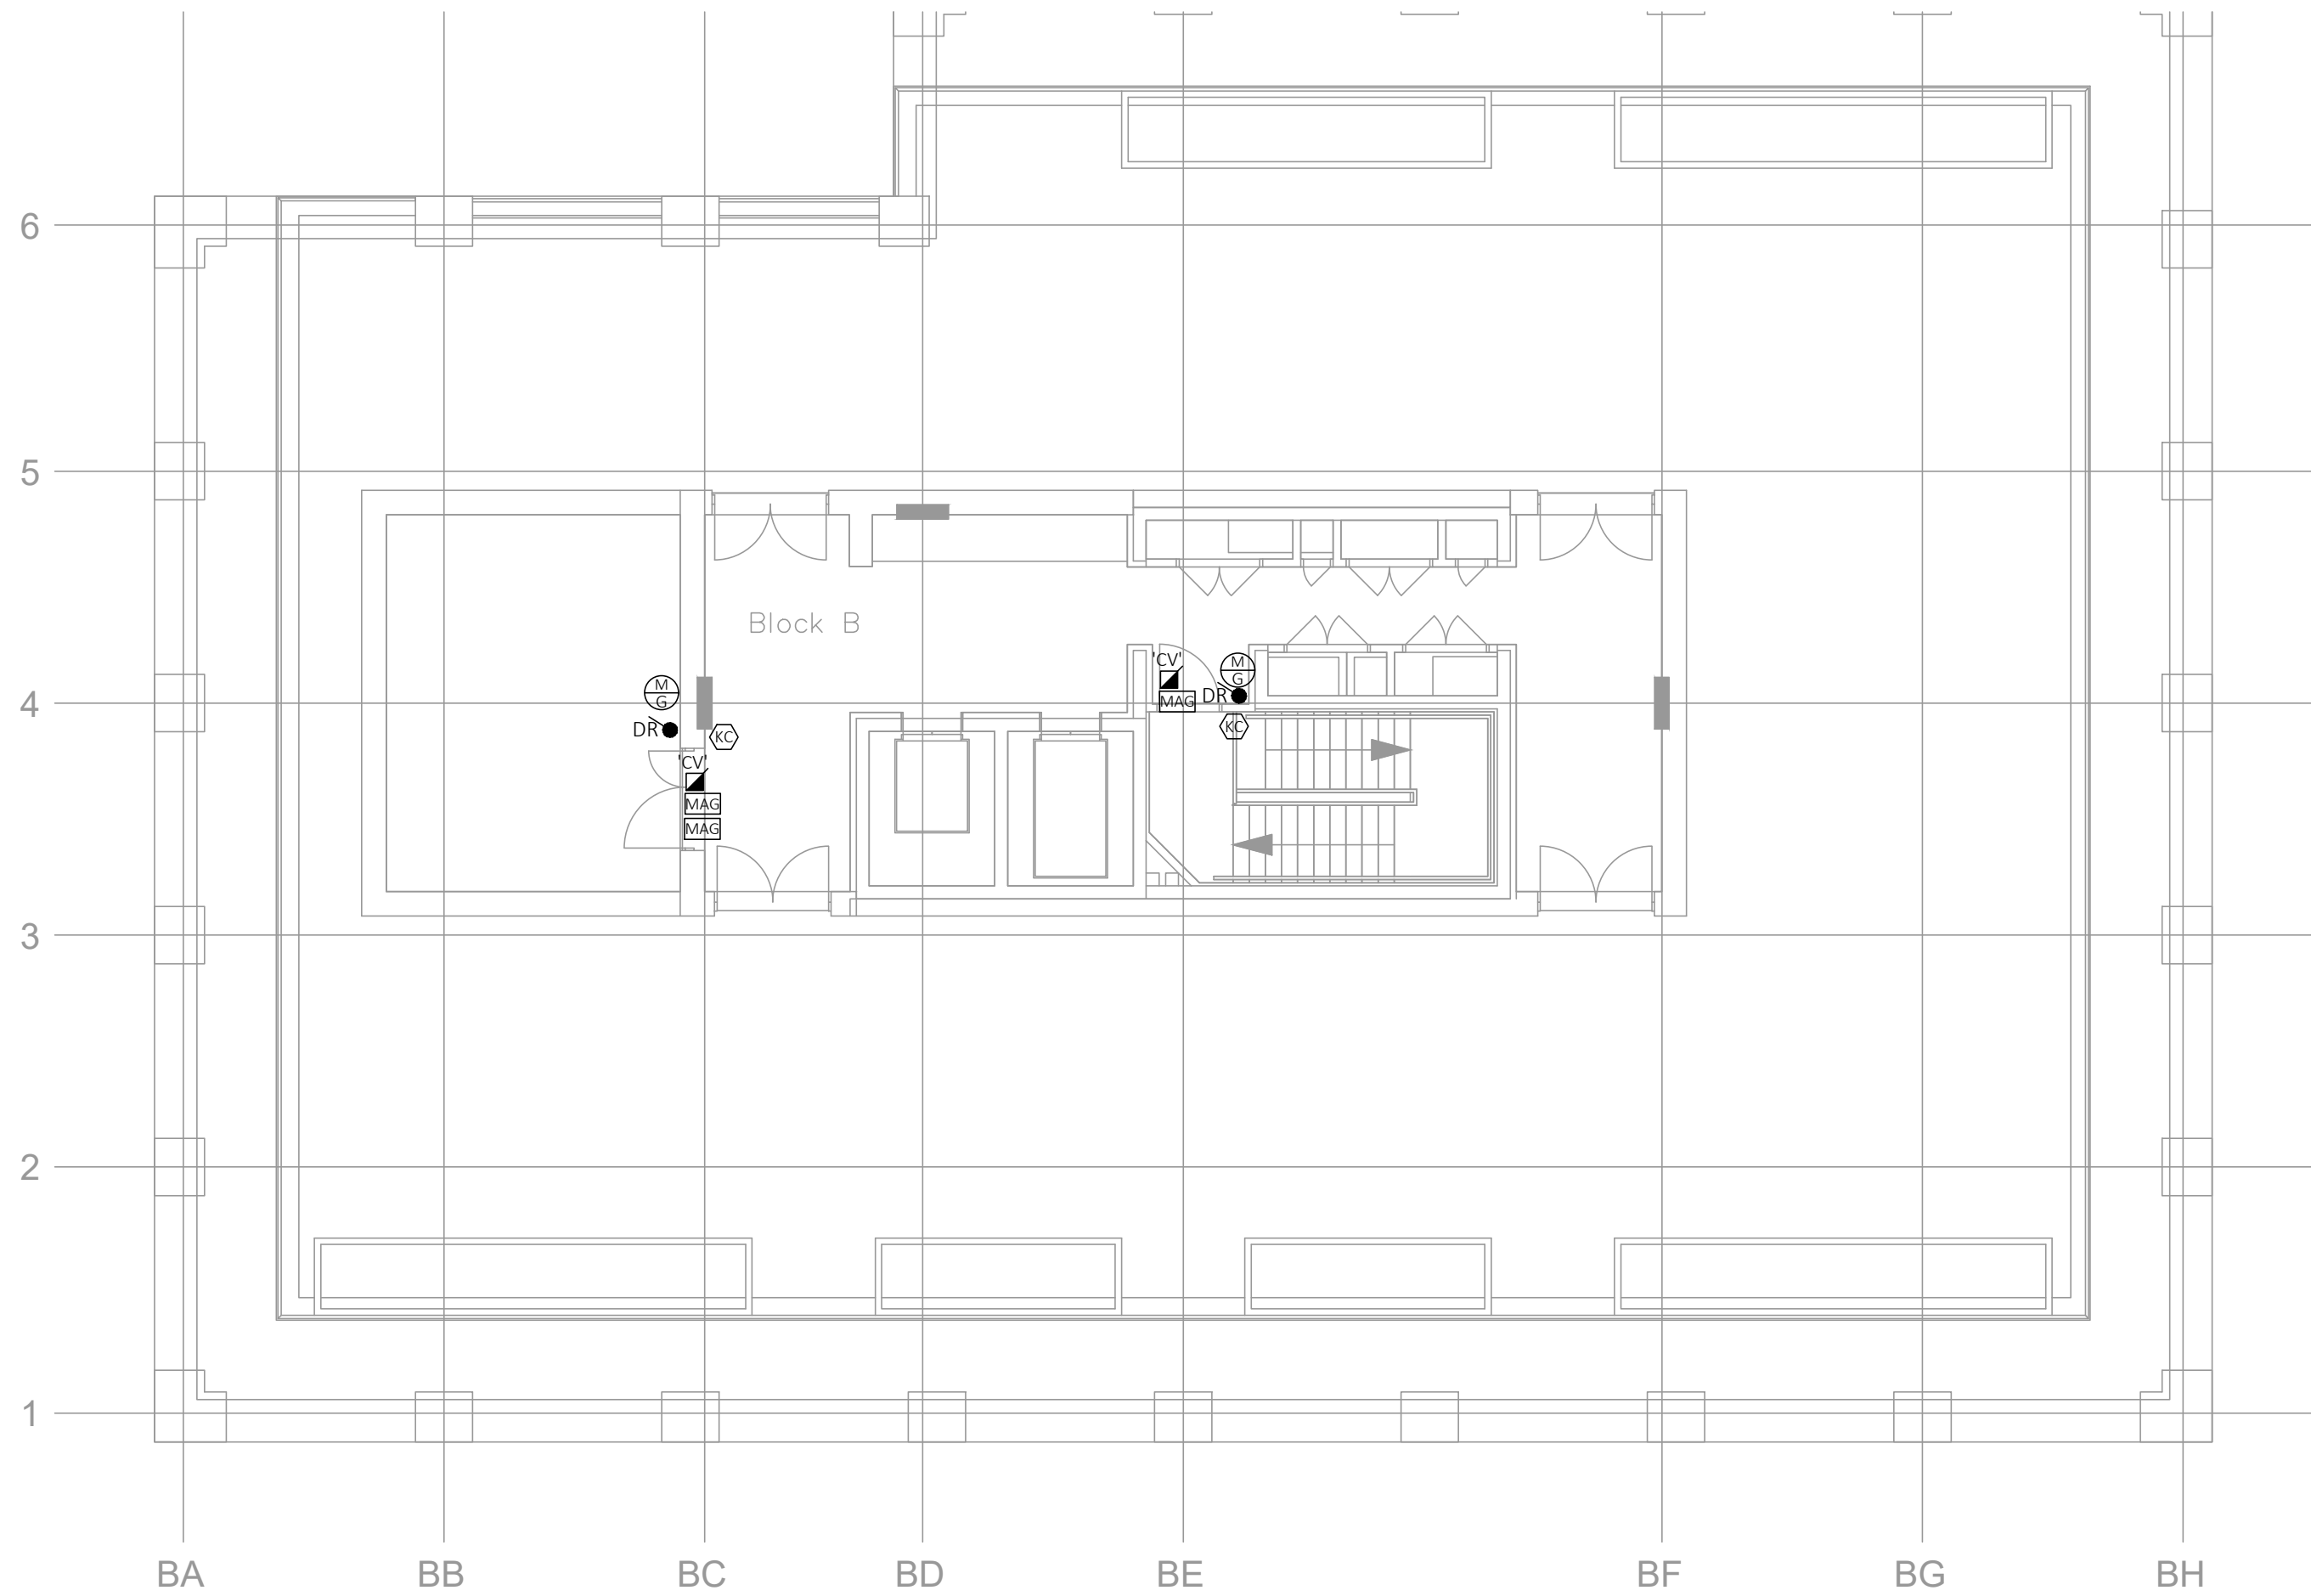

BLOCK B - LEVEL 10

CALDWELL SECURITY	
	ELECTROMAGNETIC PLATE LOCK FITTED ON LEAF OF DOOR AND FRAME AT HIGH LEVEL.
	DOOR ACCESS UNIT POWER SUPPLY AND CONTROLS INSTALLED IN CEILING VOID
	'PUSH BUTTON TO OPEN' MANUAL EGRESS DOOR RELEASE SWITCH. FOR NORMAL USE.
	FAIL SAFE OPEN DEVICE. WALL MOUNTED GREEN BREAK GLASS TYPE FOR USE IN SCENARIOS WHERE FIRE ALARM INTERFACE FAILS OR DOOR CONTROL EQUIPMENT FAILS.
	FOB-SWIPE TYPE WALL/PANEL MOUNTED FOB READER LINKED TO LOCAL DOOR ACCESS CONTROLS.
	DOOR ENTRY PANEL
	VIDEO INTERCOM
	CCTV CAMERA

P2	MAR.21	INDUCTION LOOP REMOVAL	CS	LW
P1	FEB.21	ISSUED FOR REVIEW/APPROVAL	CS	LW
REV	DATE	DESCRIPTION	DR	CK

Caldwell

ARCHITECT
RYDER ARCHITECTS

JOB
MOUNT PLEASANT
PHASE 2
4023

DRAWING
SECURITY ACCESS AND CCTV PROPOSAL
LEVEL 10
BLOCK B

DRAWING NO./REVISION
MPP2 - CAL - ZZ - 10 - SKT13 - P2

SCALE/PRINTED AT 1:100@A1	DATE OCT'20	DRAWN CS	CHECKED LW
UNIT 6 FORESTGROVE BUSINESS PARK NEWTOWNBRED A BELFAST BT8 6AW		TEL: 02890699720 FAX: 02890641625 E.MAIL: admin@caldwellconsulting.net	

INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.