


CALDWELL SECURITY	
 MAG	ELECTROMAGNETIC PLATE LOCK FITTED ON LEAF OF DOOR AND FRAME AT HIGH LEVEL.
 CV	DOOR ACCESS UNIT POWER SUPPLY AND CONTROLS INSTALLED IN CEILING VOID
 PSU	
 DR	'PUSH BUTTON TO OPEN' MANUAL EGRESS DOOR RELEASE SWITCH. FOR NORMAL USE.
 K	FAIL SAFE OPEN DEVICE. WALL MOUNTED GREEN BREAK GLASS TYPE FOR USE IN SCENARIOS WHERE FIRE ALARM INTERFACE FAILS OR DOOR CONTROL EQUIPMENT FAILS.
 VC	FOB-SWIPE TYPE WALL/PANEL MOUNTED FOB READER LINKED TO LOCAL DOOR ACCESS CONTROLS.
 DE	DOOR ENTRY PANEL
 IPES	
 VI	VIDEO INTERCOM
 CCTV	CCTV CAMERA

FOR CONTINUATION REFER TO DRG NO MPP2-CAL-ZZ-00-SKT1-P1

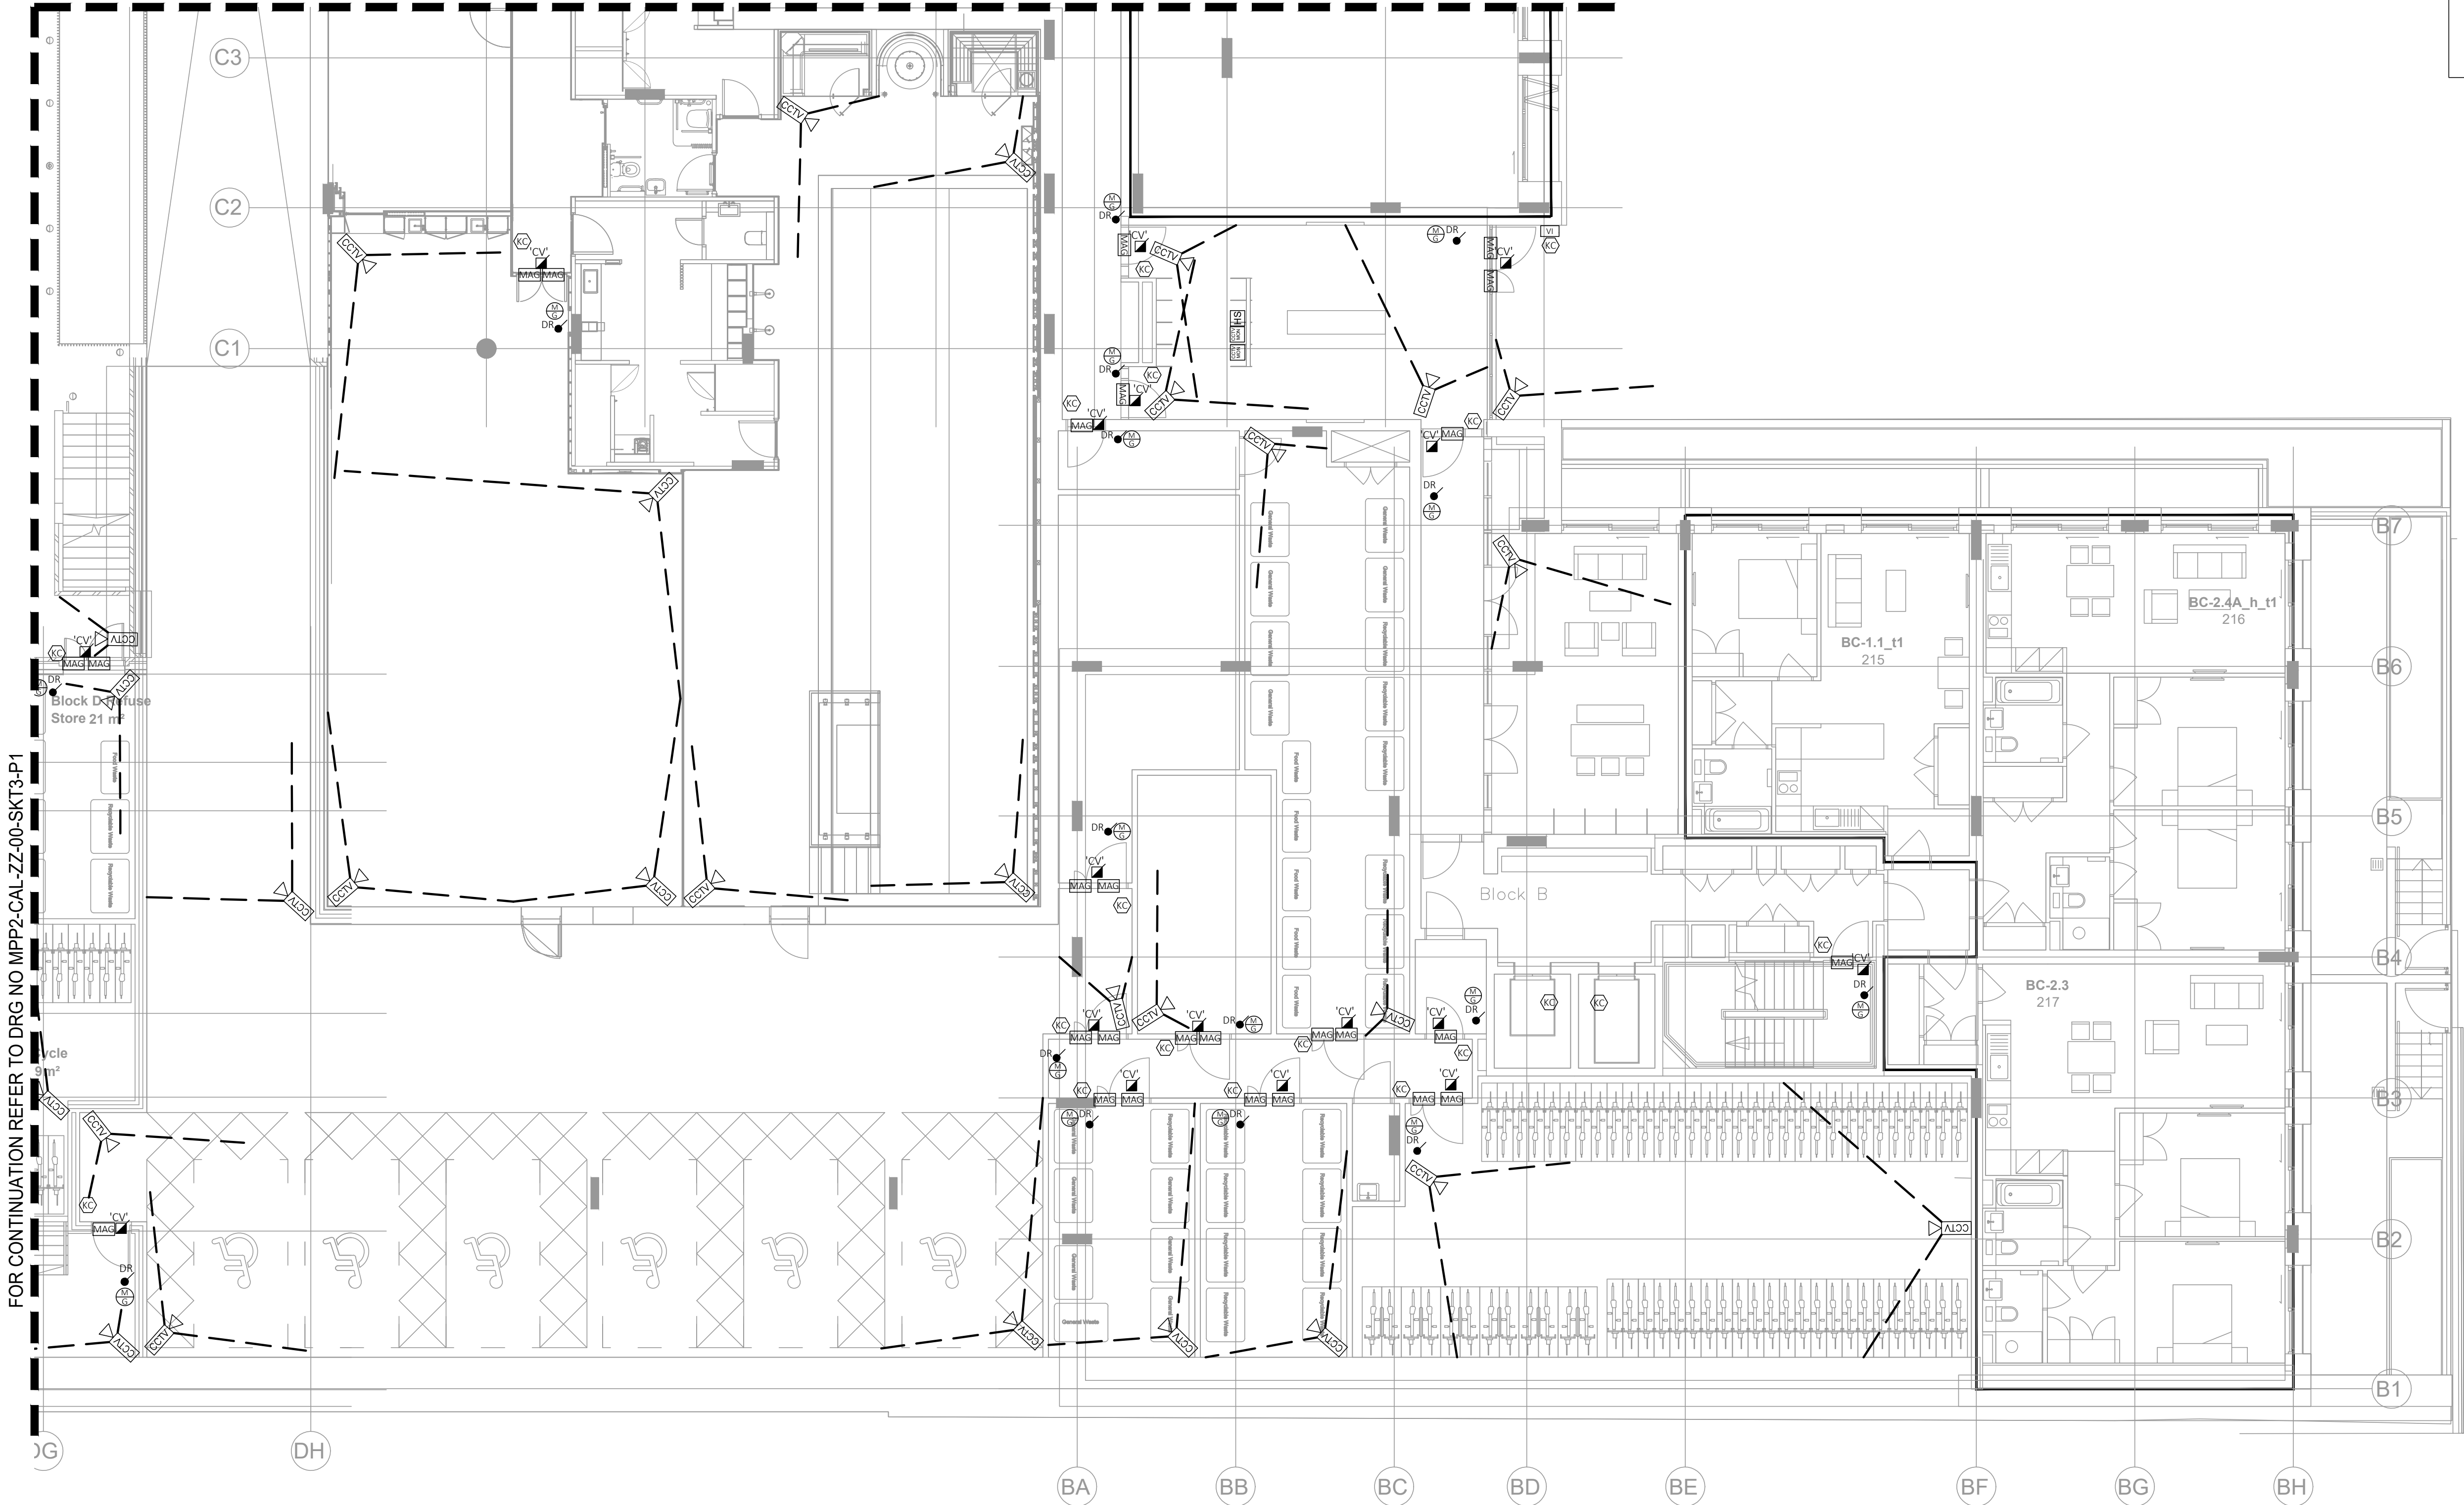

FOR CONTINUATION REFER TO DRG NO MPP2-CAL-ZZ-00-SKT3-P1

INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.

P2 MAR.21	INDUCTION LOOP REMOVAL	CS	LW
P1 FEB.21	ISSUED FOR REVIEW/APPROVAL	CS	LW
REV DATE	DESCRIPTION	DR	CK

Caldwell

ARCHITECT
RYDER ARCHITECTS

JOB
MOUNT PLEASANT
PHASE 2
4023

DRAWING
SECURITY ACCESS AND CCTV PROPOSAL
LEVEL 00
BLOCK C

DRAWING NO./REVISION
MPP2 - CAL - ZZ - 00 - SKT2 - P2

SCALE/PRINTED AT 1:100@A1	DATE DEC'20	DRAWN CS	CHECKED LW
------------------------------	----------------	-------------	---------------

UNIT 6 FORESTGROVE BUSINESS PARK TEL: 02890699720 FAX: 02890641625
NEWTOWNREDA BELFAST BT8 6AW E-MAIL: admin@caldwellconsulting.net