



NOTES:

1. THIS DRAWING IS BASED ON RECORD DRAWINGS. THE CONTRACTOR SHALL VERIFY THE INSTALLED EQUIPMENT AND LOCATIONS NOTED ON THE DRAWING BEFORE THE COMMENCEMENT OF THE STRIPOUT WORKS.
2. THIS DRAWING IS TO BE READ CONJUNCTION WITH THE SCOPE OF WORKS, SPECIFICATIONS AND ASSOCIATED DRAWINGS AS PREPARED BY YES ENGINEERING.
3. THE CONTRACTOR SHALL TEST THE INTEGRITY OF ALL ISOLATION VALVES TO BE USED TO ISOLATE ANY SERVICES BEING STRIPPED OUT PRIOR TO ANY STRIPOUT WORKS BEING COMMENCED.
4. CHW PIPEWORK MARKED FOR STRIPOUT SHALL BE STRIPPED BACK AND TERMINATED SO AS TO ALLOW FUTURE RECONNECTION WHILST NOT CREATING ANY DEADLEGS AND CAPPED OFF SO AS TO PREVENT LEAKAGE.
5. THE CONTRACTOR SHALL INSPECT ALL ITEMS TO BE RETAINED AND DETERMINE THEIR SUITABILITY FOR REUSE, THIS SHALL INCLUDE BUT IS NOT LIMITED TO: STEELWORK SUPPORTS, PIPEWORK, VALVES AND ACTUATORS.
6. AS LIMITED RECORD INFORMATION EXISTED FOR THE DOMESTIC COLD WATER FEEDS TO THE ADIABATIC COIL SPRAYS, THE CONTRACTOR SHALL SURVEY THE WATER AND ANY WASTE SERVICES INSTALLED AND SHALL SAFELY STRIP THESE BACK TO THE RISERS AND TERMINATE THESE SO AS NOT TO CREATE ANY DEADLEGS.
7. THE CHILLERS NOTED FOR REMOVAL SHALL BE SAFELY DECOMMISSIONED AND THE REFRIGERANT GASES TO BE RECOVERED AND DISPOSED OF IN ACCORDANCE WITH RELEVANT (F-GAS) REGULATIONS. PROOF OF PROPER RECOVERY AND DISPOSALS SHALL BE PROVIDED.
8. REFER TO ELECTRICAL DRAWINGS AND SPECIFICATIONS FOR DETAILS OF ELECTRICAL STRIPOUT SCOPE.

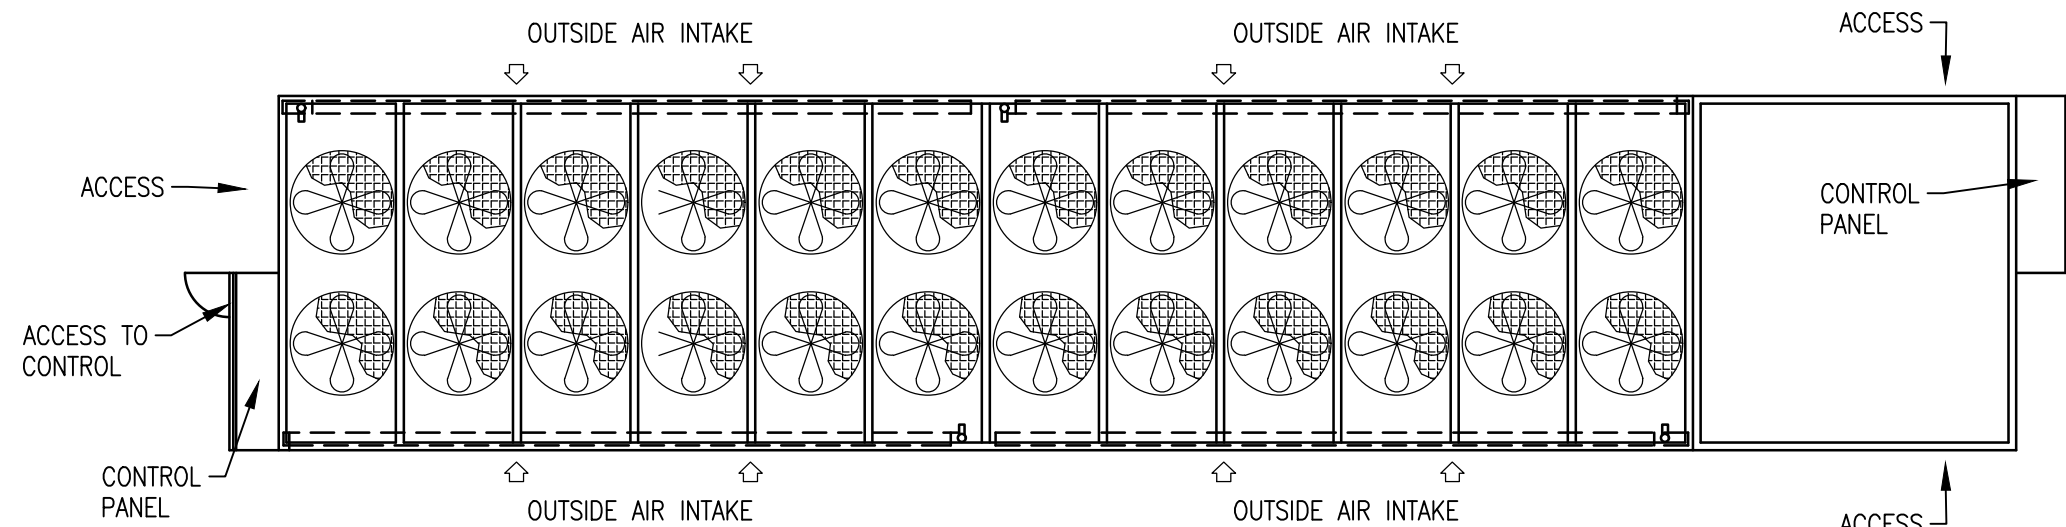

CHILLER DETAILS
SCALE 1:100

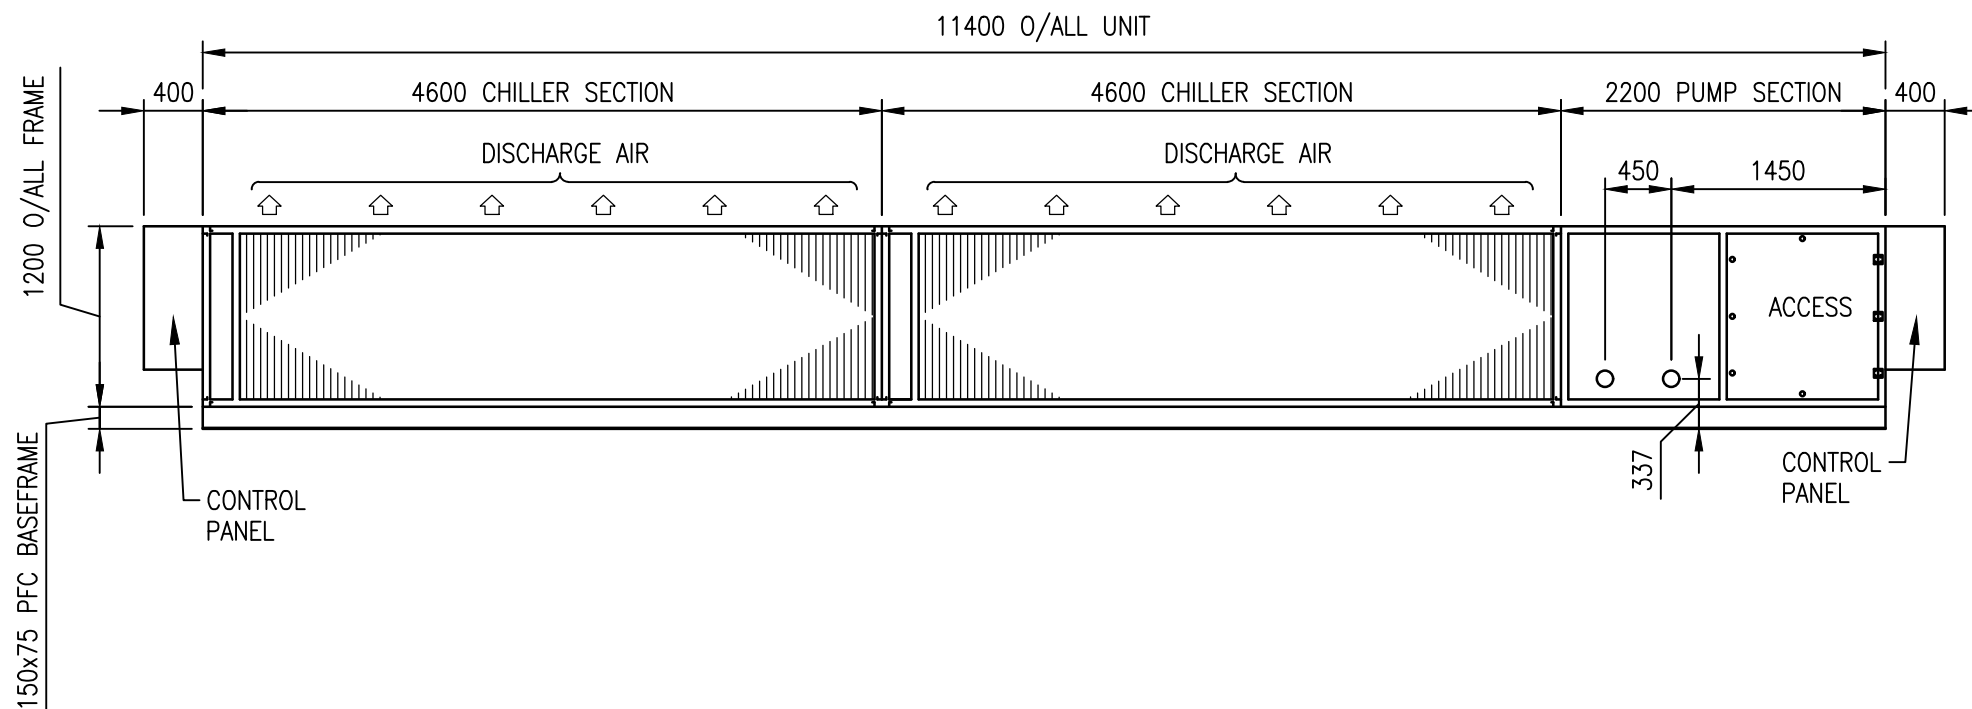

DO NOT SCALE

FOR TENDER			
No.	Revision	By	Chk
0		HR	PW
			02.07.21

Date:	02.07.21	Project Eng:	AP
Scale @ A1:	1:50	Drawn By:	HR
Scale @ A3:	1:100	Checked By:	PW



Client: EVERGREEN MARINE CORP

Project: CHILLER REPLACEMENT

Title: ROOF MECHANICAL STRIP OUT

FOR TENDER NOT FOR CONSTRUCTION	
Discipline	MECHANICAL
Drawing No.	2106801-M-R042
Rev.	0

IF IN DOUBT ASK.