

GENERAL NOTES

LEGEND

- C
2
C
C
FAP
VRV
CP
EPH
Q
HOB
UHF
WC
UV
IMM
- 3
FB1
FB2
FB3
VP
VEP
F
F
IP67
MCP
EB
FB
DW
??A
FAP
5A
NFI
BT/M
PB
- CLEANERS SOCKET OUTLET
TWIN SWITCHED SOCKET OUTLET
SWITCHED FUSED CONNECTION UNIT
UNSWITCHED FUSED CONNECTION UNIT
FAP - FIRE ALARM PANEL
VRV - VRV UNIT
CP - CONDENSE PUMP
EPH - ELECTRIC PANEL HEATER
Q - QUOOKER
HOB - HOB
UHF - UNDERFLOOR HEATING
WC - WATER CONDITIONER
UV - UV FILTER
IMM - IMMERSION
- 3 COMPARTMENT FLOOR OUTLET BOX
- 2 x TSSO
- 1 x QUAD RJ45
- 3 COMPARTMENT FLOOR OUTLET BOX
- 1 x TSSO
- 1 x QUAD RJ45 & 1 x BLANK FOR AV
- CIRCULAR FLOORBOX WITH 5A SOCKET OUTLET
VIDEO ENTRY PHONE HANDSET
VIDEO ENTRY PHONE
FOB SENSOR
DUAL RJ45 OUTLET (4 DENOTES QUAD)
- IP67 RATED SOCKET OUTLET
FIRE ALARM MCP
DOUBLE POLE PUSH TO EXIT/GREEN BREAK GLASS
POWER TRACK 2400mm LONG
SINGLE SOCKET FOR FRIDGE
SINGLE SOCKET FOR DISHWASHER
ISOLATOR (SWITCH DISCONNECTOR)
RATING AND PHASE IDENTIFICATION
FIRE ALARM CONTROL PANEL
5 AMP LIGHTING SWITCH SOCKET
SINGLE RJ45 OUTLET FROM ROUTER
GRID PLATE
DISTRIBUTION BOARD
BT TELEPHONE LINE
PANIC ALARM BUTTON

STAGE 4

A	APR.21	REVISED TO SUIT UPDATED BACKGROUNDS
0	JUN.19	STAGE 4 ISSUE
Rev	Date	Description

TPS.

Taylor Project Services LLP

No.1 Cornhill
London EC3V 3ND
Tel 020 7743 6602
www.taylorprojectservices.com

Client:



Project

30 PERCY STREET
LONDON

Drawing Title

ROOF
LOW LEVEL ELECTRICAL
SERVICES LAYOUT

Scale 1:50@A1

Date 17.01.18

Drawn T.S.

Checked M.G.


Drawing Status

STAGE 4


Revision 0 A

Drawing No.

TPS/30PS/R/E/LL

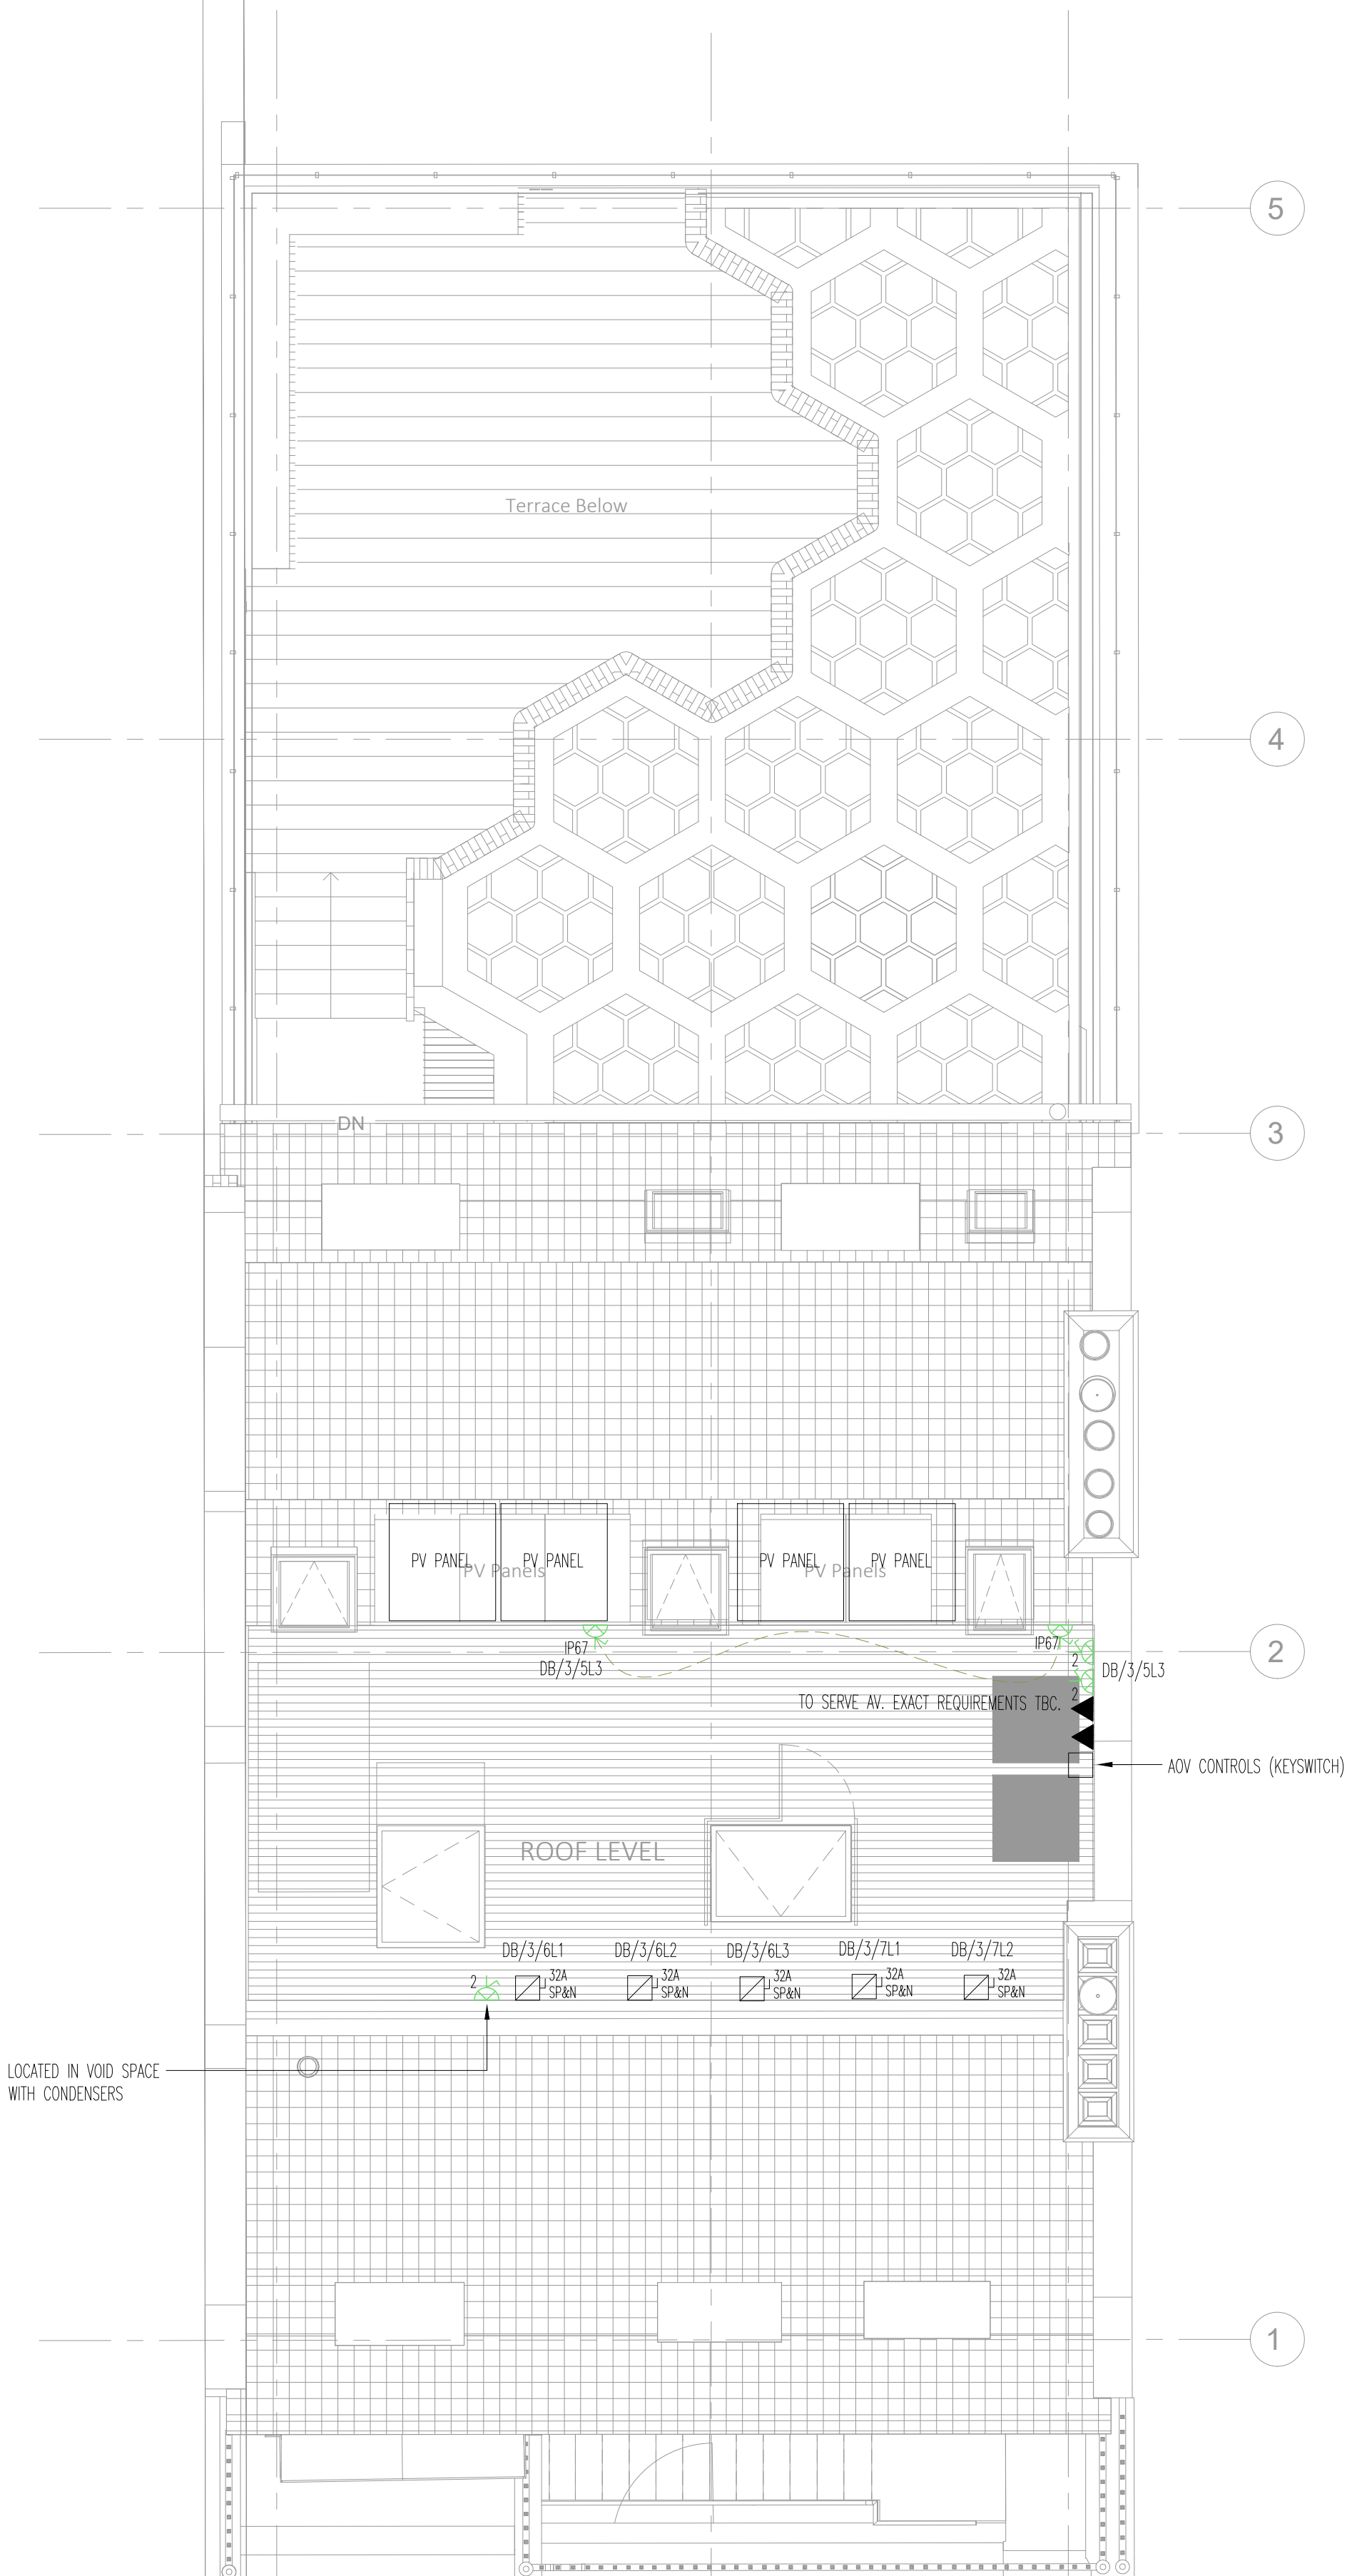

NO SERVICES SHALL BE RUN ON SURFACE/EXPOSED AND
MINI TRUNKING SHALL NOT BE INSTALLED IN ANY ROOM.
ALL SERVICES RUNS TO BE REVIEWED ON SITE FOLLOWING
STRIP OUT AND OPENING UP.
NEW SERVICE ROUTES TO BE INSTALLED WITHIN EXISTING
BUILDERS WORK & UTILISED WHEREVER POSSIBLE.



Scale Bar 1: 50 @ A1