


THIS DRAWING MUST NOT BE REPRODUCED WITHOUT PRIOR CONSENT.
DO NOT SCALE FROM THIS DRAWING.
THIS DRAWING IS COPYRIGHT ©

GENERAL NOTES


- REFER TO GRILLE SCHEDULE FOR DETAILS. FCU'S IN JOINERY TO BE COMPLETE WITH A GRILLE ON TOP OF JOINERY.
- DAIKIN THERMOSTAT TO BE MADOKA MATT BLACK.

LEGEND


- SUPPLY DUCT
- EXTRACT DUCT
- CROSS-TALK ATTENUATOR
- CTA
- EXTRACT GRILLE
- VOLUME CONTROL DAMPER
- WALL MOUNTED/FLOOR STANDING FAN COIL UNIT
- ELECTRIC UNDERFLOOR HEATING ZONE
- THERMOSTAT
- UNDER FLOOR THERMOSTAT
- ELECTRIC WALL MOUNTED PANEL HEATER
- NON-VISION TRANSFER GRILLE AT H/L
- GAS METER VENTILATION - 100mm X 50mm SLOT AT HIGH LEVEL
- HIGH LEVEL ABOVE CEILING VOID
- HIGH LEVEL BELOW CEILING
- LOW LEVEL ABOVE GROUND
- LOW LEVEL BELOW FLOOR

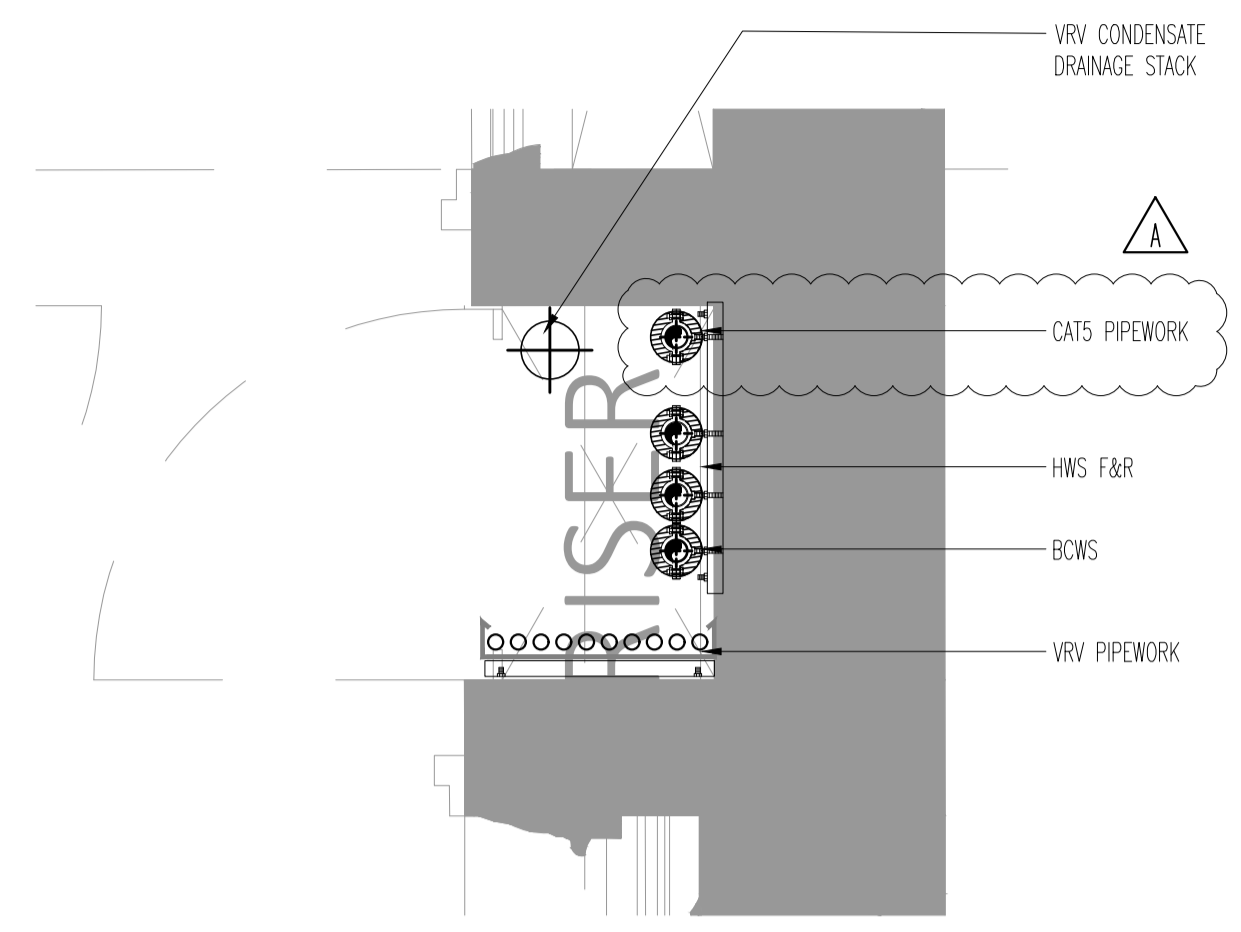


MECHANICAL SERVICES RISER
(SCALE 1:10@A1)

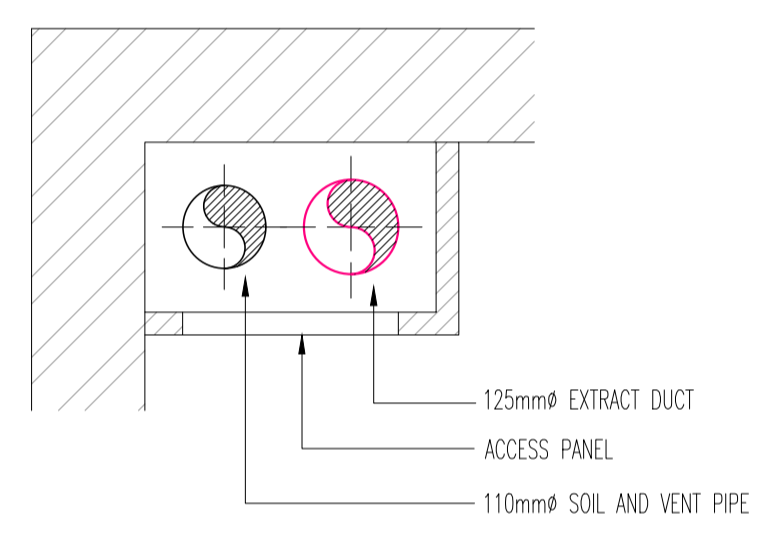

DETAIL A
(SCALE 1:10@A1)

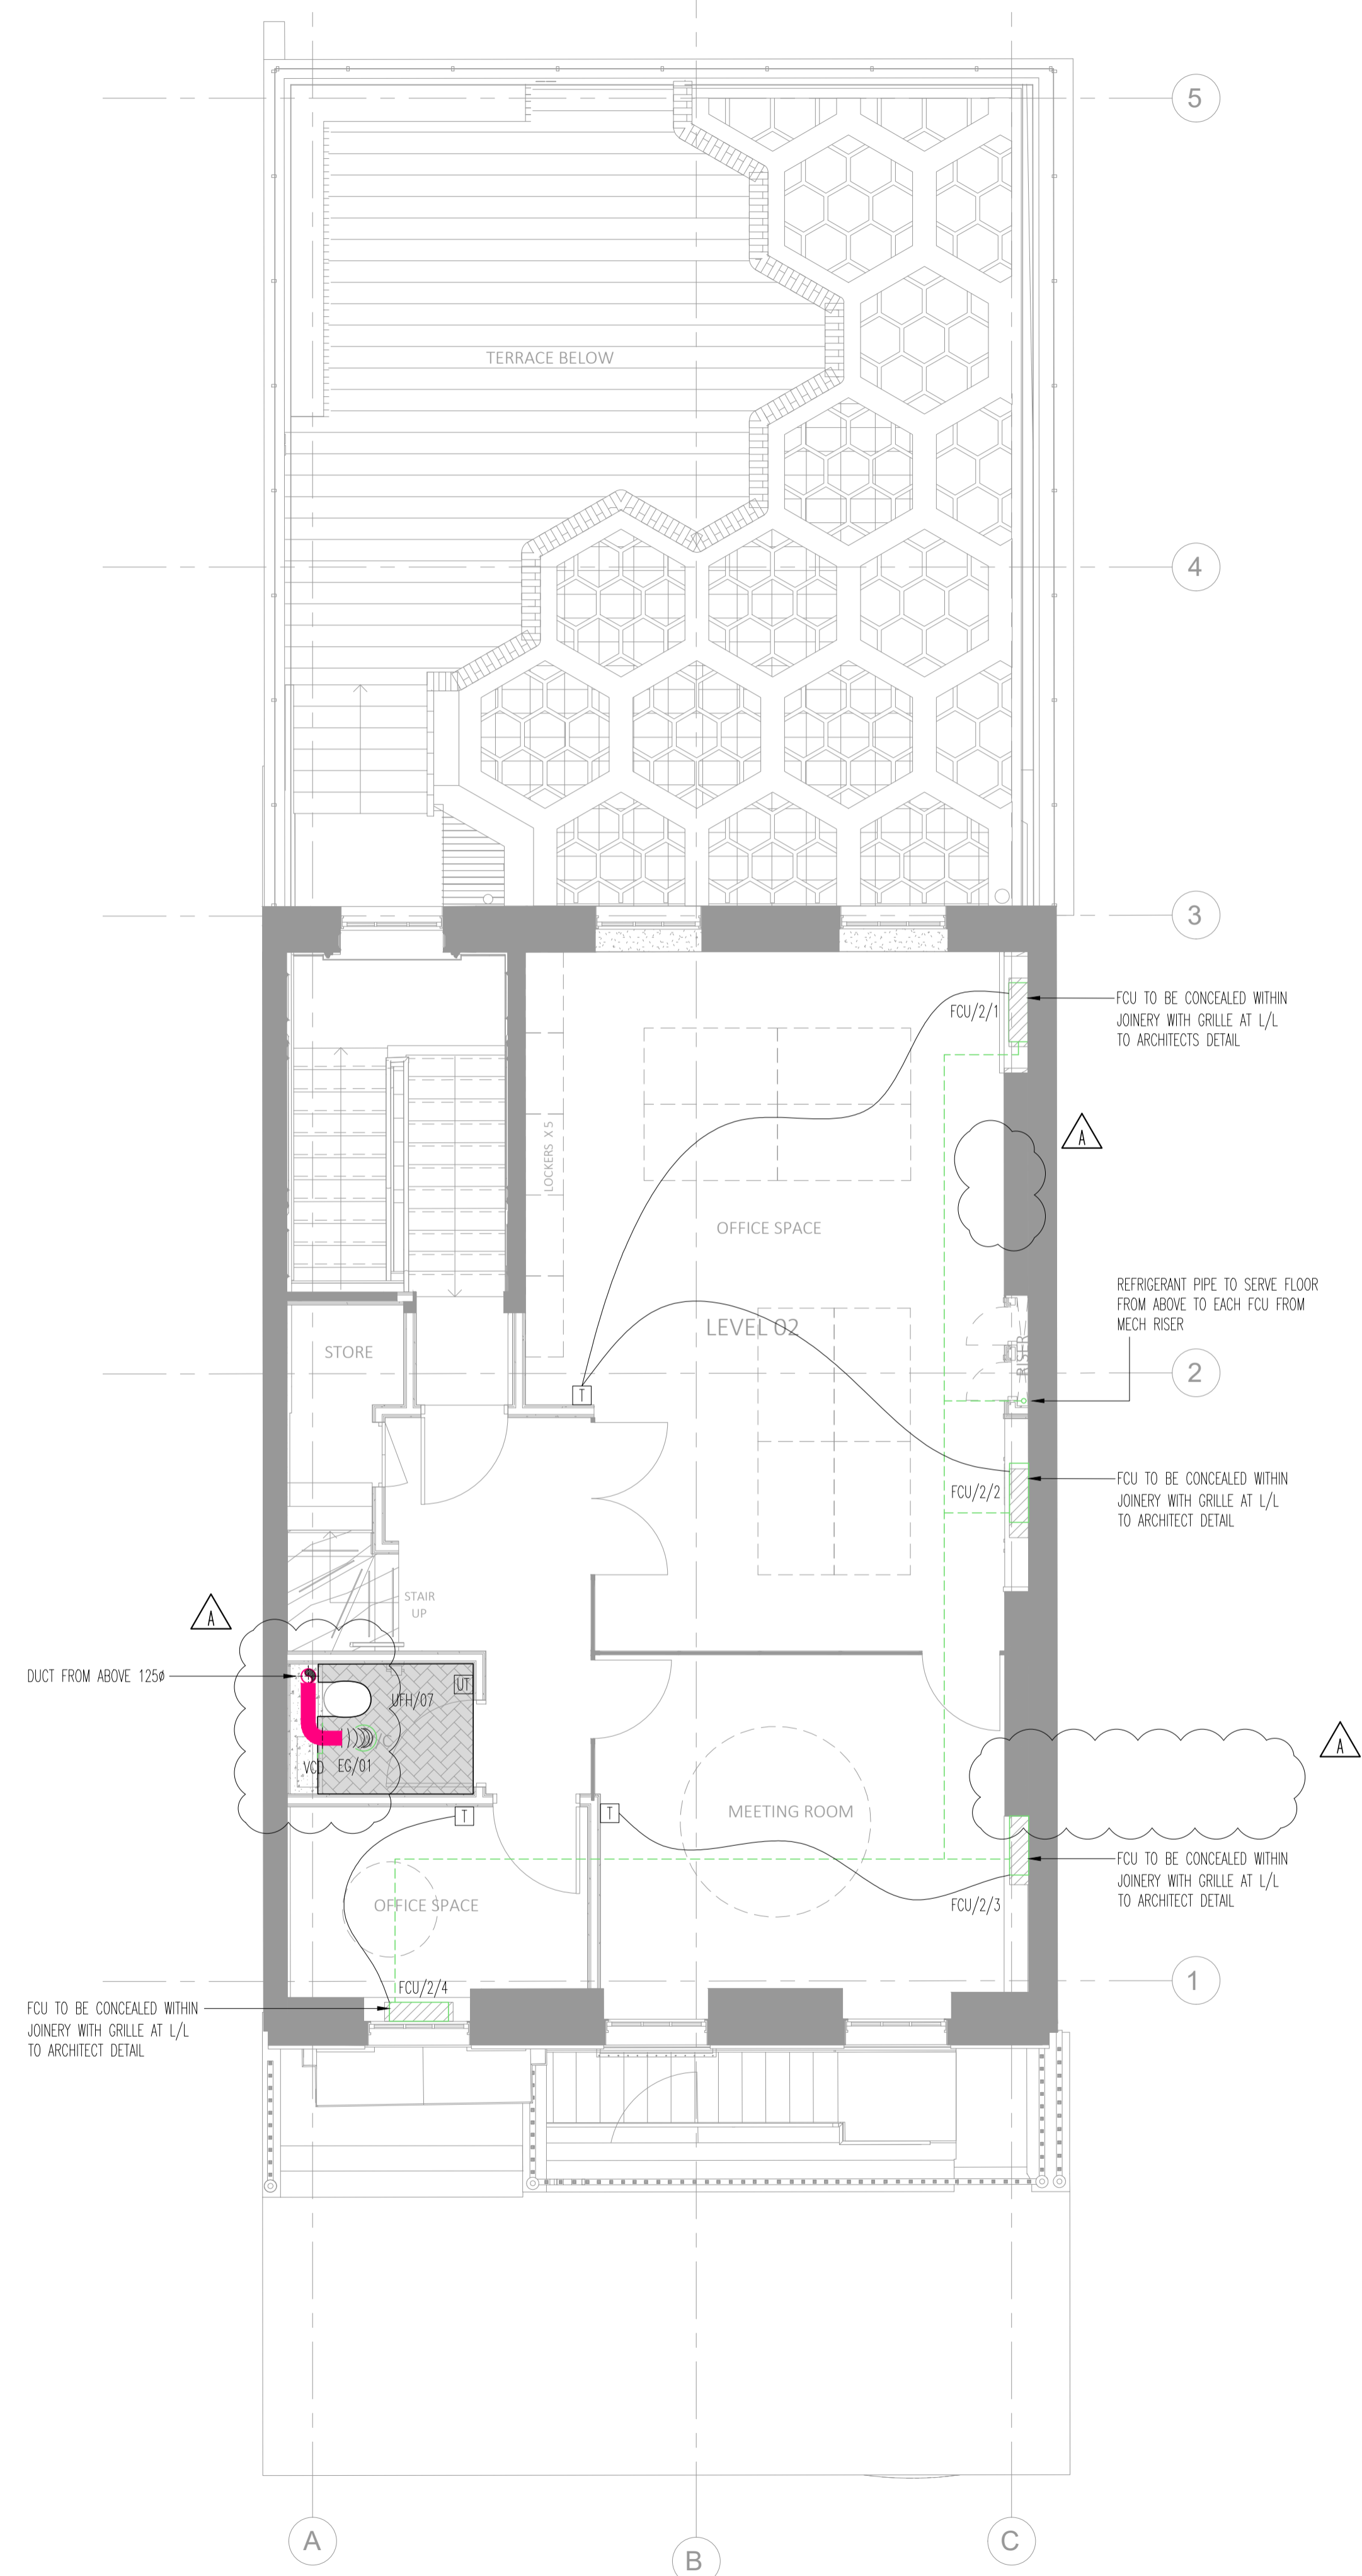

NO SERVICES SHALL BE RUN ON SURFACE/EXPOSED AND MINI TRUNKING SHALL NOT BE INSTALLED IN ANY ROOM.
ALL SERVICES RUNS TO BE REVIEWED ON SITE FOLLOWING STRIP OUT AND OPENING UP.
NEW SERVICE ROUTES TO BE INSTALLED WITHIN EXISTING BUILDERS WORK & UTILISED WHEREVER POSSIBLE.

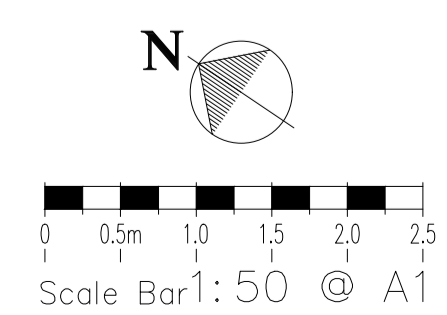

STAGE 4

Rev	Date	Description
A	APR.21	REVISED TO SUIT UPDATED BACKGROUNDS
0	JUN.19	STAGE 4 ISSUE

TPS.
Taylor Project Services LLP
No.1 Cornhill
London, EC3V 3ND
Tel 020 7743 6602
www.taylorprojectservices.com



Client
30 PERCY STREET LONDON

Drawing Title
SECOND FLOOR MECHANICAL SERVICES LAYOUT

Scale	1:50@A1	Date	21.01.19
Drawn	C.A.D.	Checked	C.M.
Drawing Status	STAGE 4		
Revision	0	A	
Drawing No.	TPS/30PS/2/M		