


Ground Floor Plan
as Existing

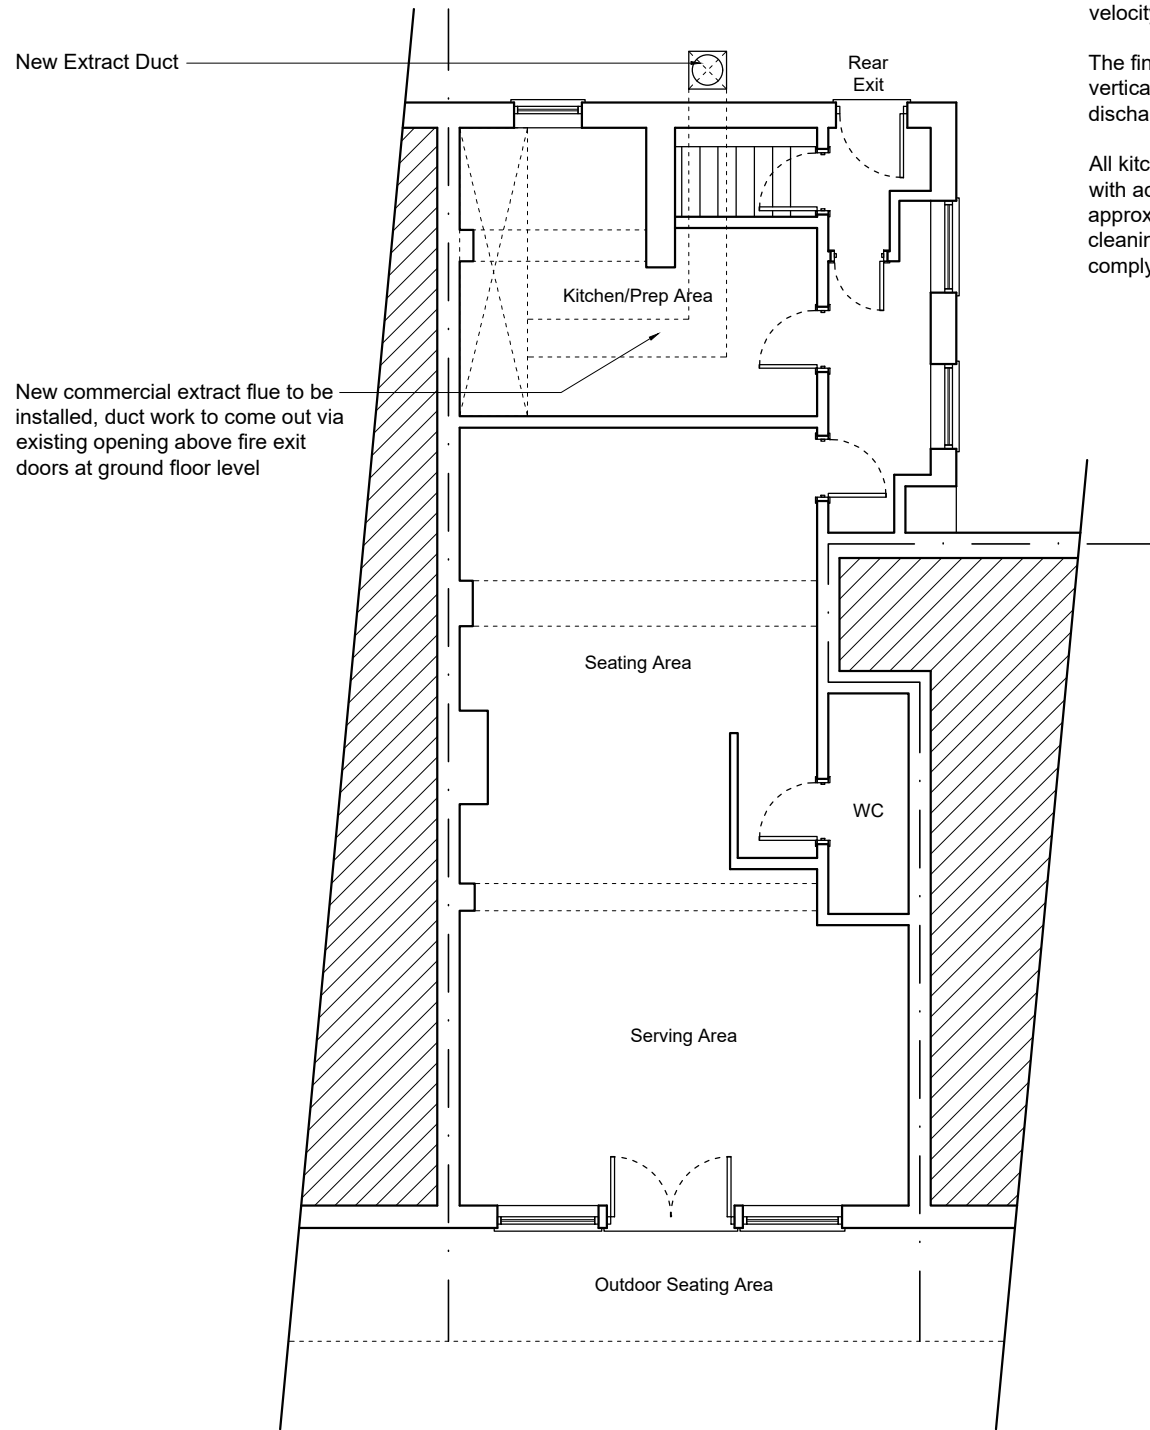

Ground Floor Plan
as Proposed

Stack height to be a minimum of 1m above roof eaves, to ensure adequate dilution of odours to take place before the plume interacts with a receptor.

Extractor to have a minimum discharge velocity of at least 8m/s

The final discharge point needs to be vertically upwards and unhindered. The discharge point is directed to the rear.

All kitchen extract ducting must be fitted with access panels/hatches at approximately 3 metre intervals to enable cleaning and maintenance and must also comply with the safe access standards.

PPLX
Architects

58 Pine Grove
Brookmans Park
Herts
AL9 7BW

t: 07886 526 081
f: 01707 642 026
e: papalexandrakos@hotmail.com


Site:
181 York Way
London
N7 9LN

Client:
Greek Coffee Ltd

Title:
Ground Floor Plans
as Existing and Proposed

Drawn: NP | Drg. No. 307_01

Date: Sept. 2021 | Rev. #



Scale: 1:100 | Drg. Size: A3

Key:

Existing Walls/Floors
Boundary

| Rev. | Date | Note |
|------|------|------|
| | | |