


Section B-B

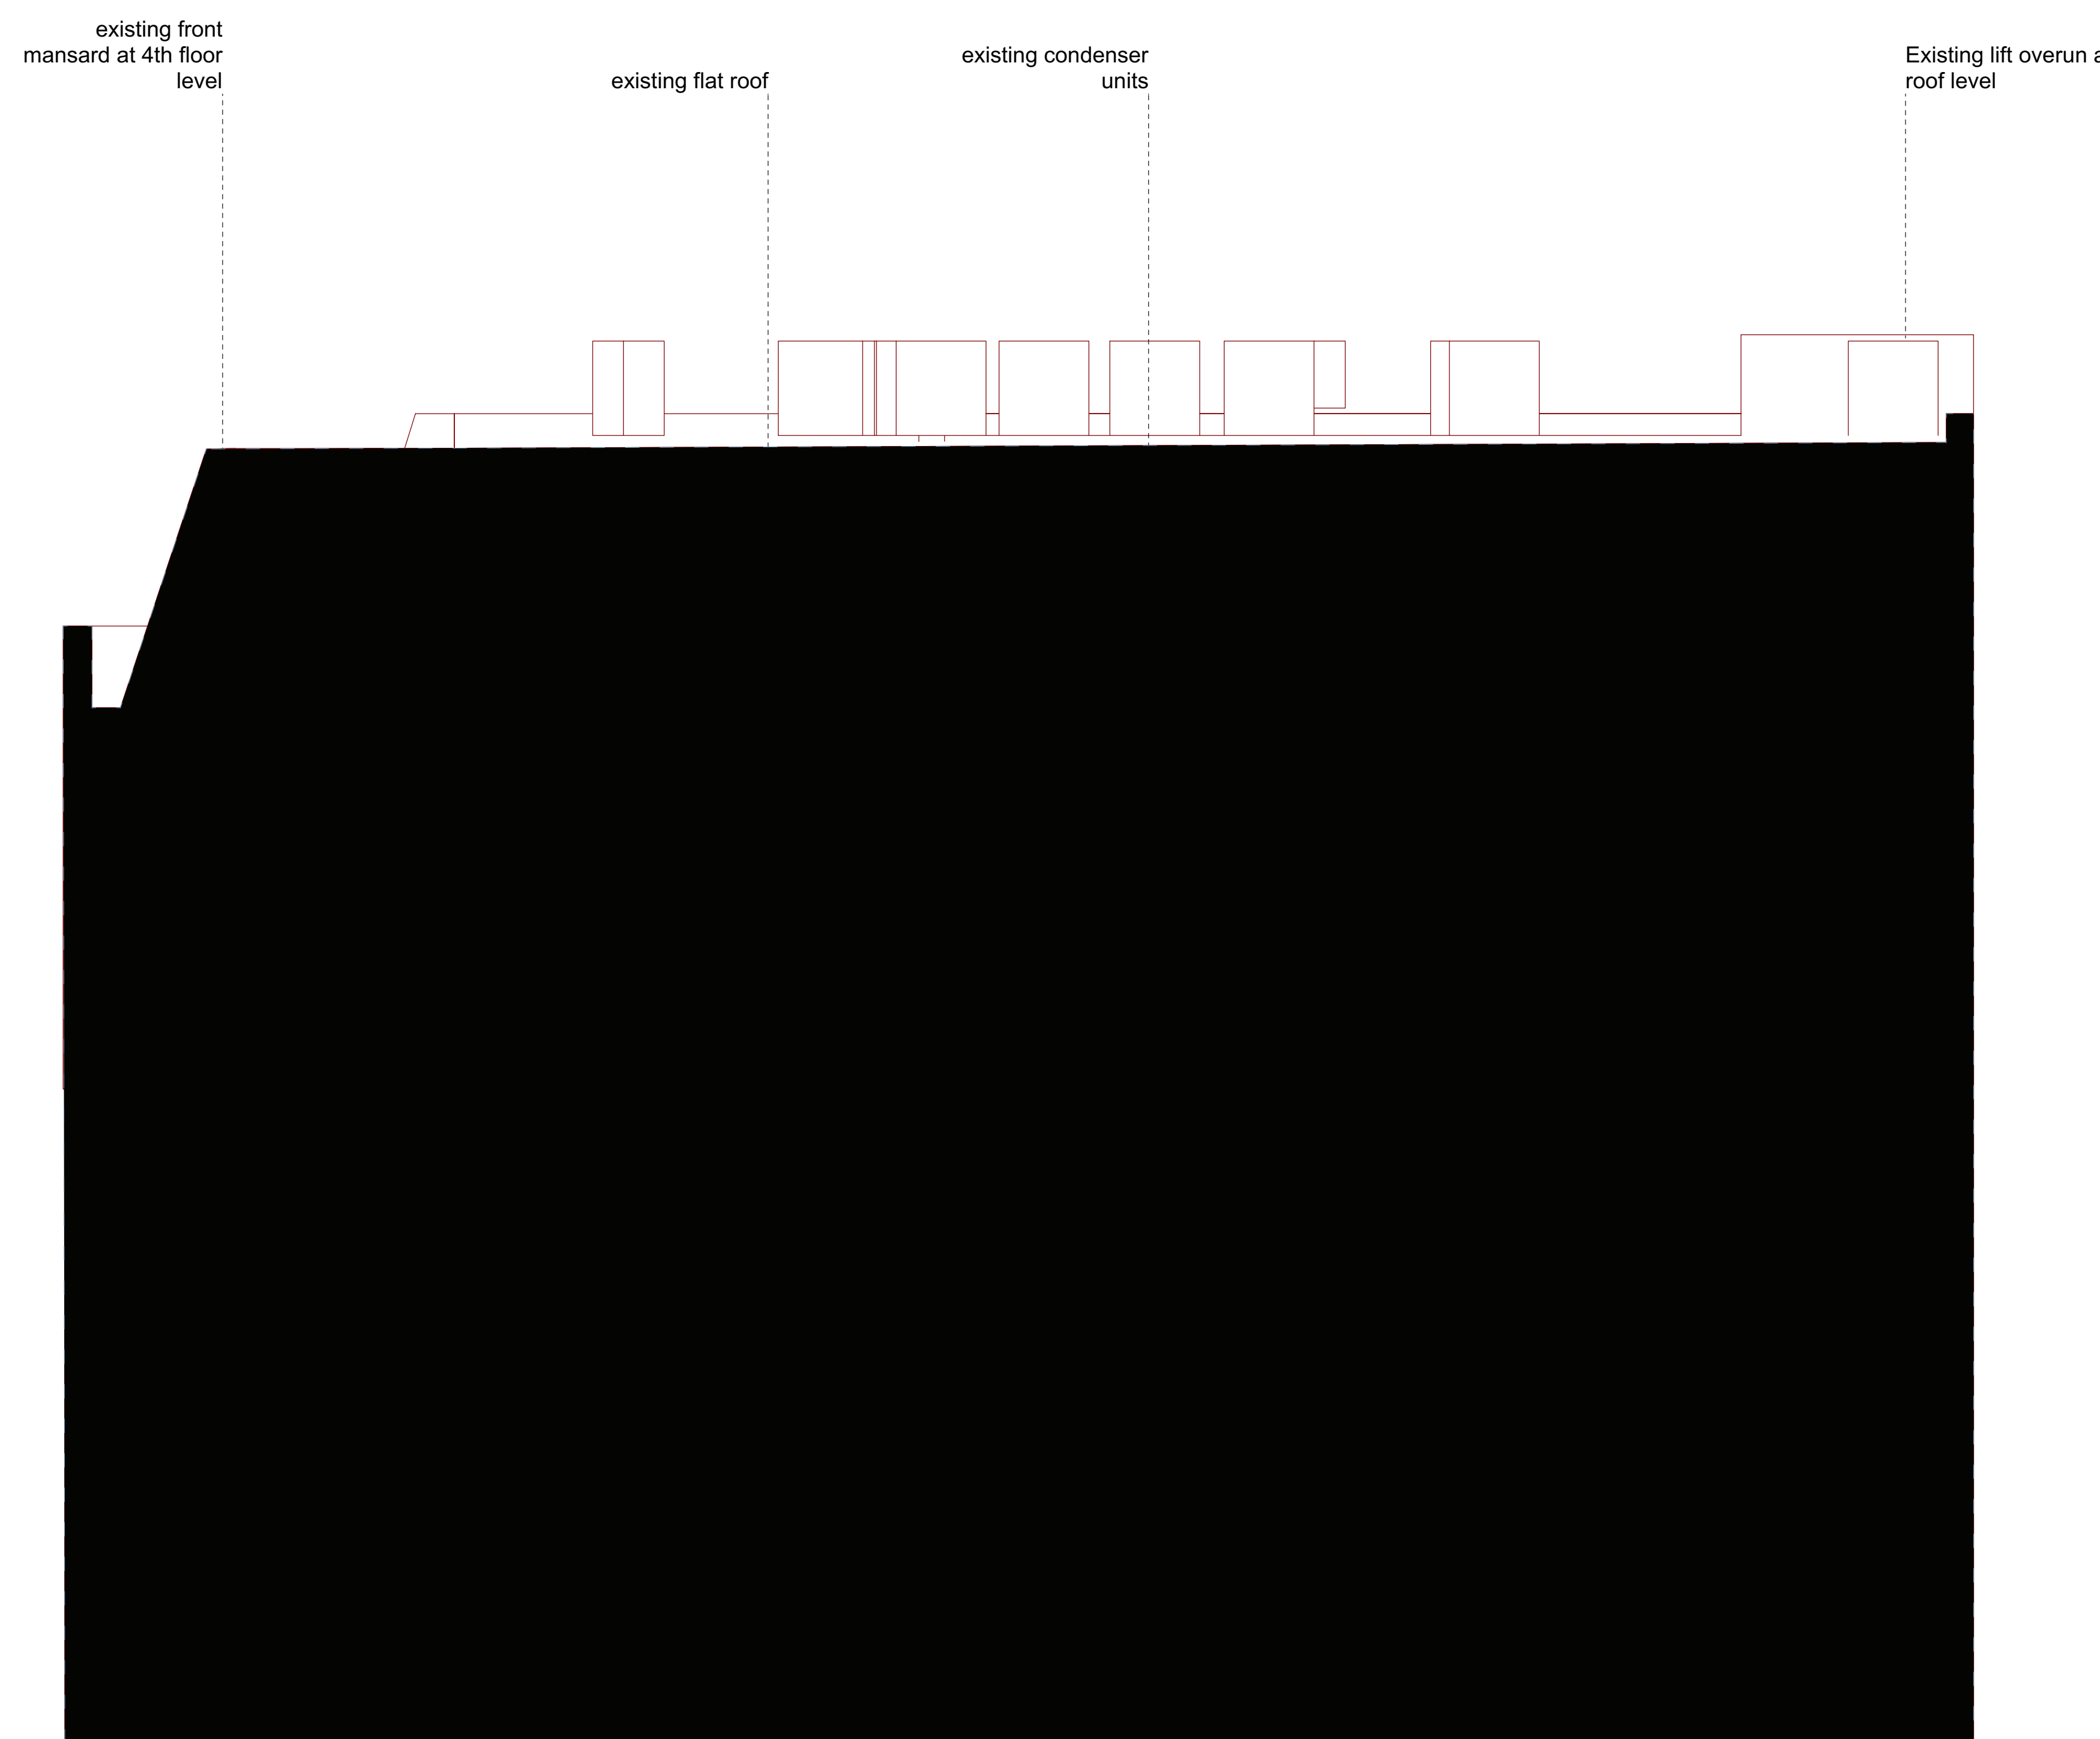

Section A-A

Schedule of Existing AC Units and Sound Output

6 no.	Fujitsu	Sound Power Level	70dBa
1 no.	LG	Sound Max	65dBa
1 no.	Daikin	Sound Power Level	63dBa
5 no.	Mitsubishi	Sound Pressure Level	51dBa
5 no.	Details not known		
total 18 no. units			



issue:	date:	recipients:
rev: B	date: 26/10/21	notes: Updated prior to planning app

project	128-134 Cleveland Street	SECOND FLOOR
drawing	Sections As Existing	28 POLAND STREET
scale & size	1:50@A1	LONDON W1F 8QP
date	14.06.21	020 7734 0538
drawn by	AM	info@baynesandmitchell.co.uk
checked by	AM	www.baynesandmitchell.co.uk
464 03 B	Status	extg

BAYNESANDMITCHELLARCHITECTS

Baynes and Mitchell Architects Ltd. Company Registration Number 6884991 (England & Wales)