




C:\Users\michaelhowarth\Documents\C-14299-HYD-XX-02-DR-M3-ME-0002_Michaelhowarth\CDSP.rvt

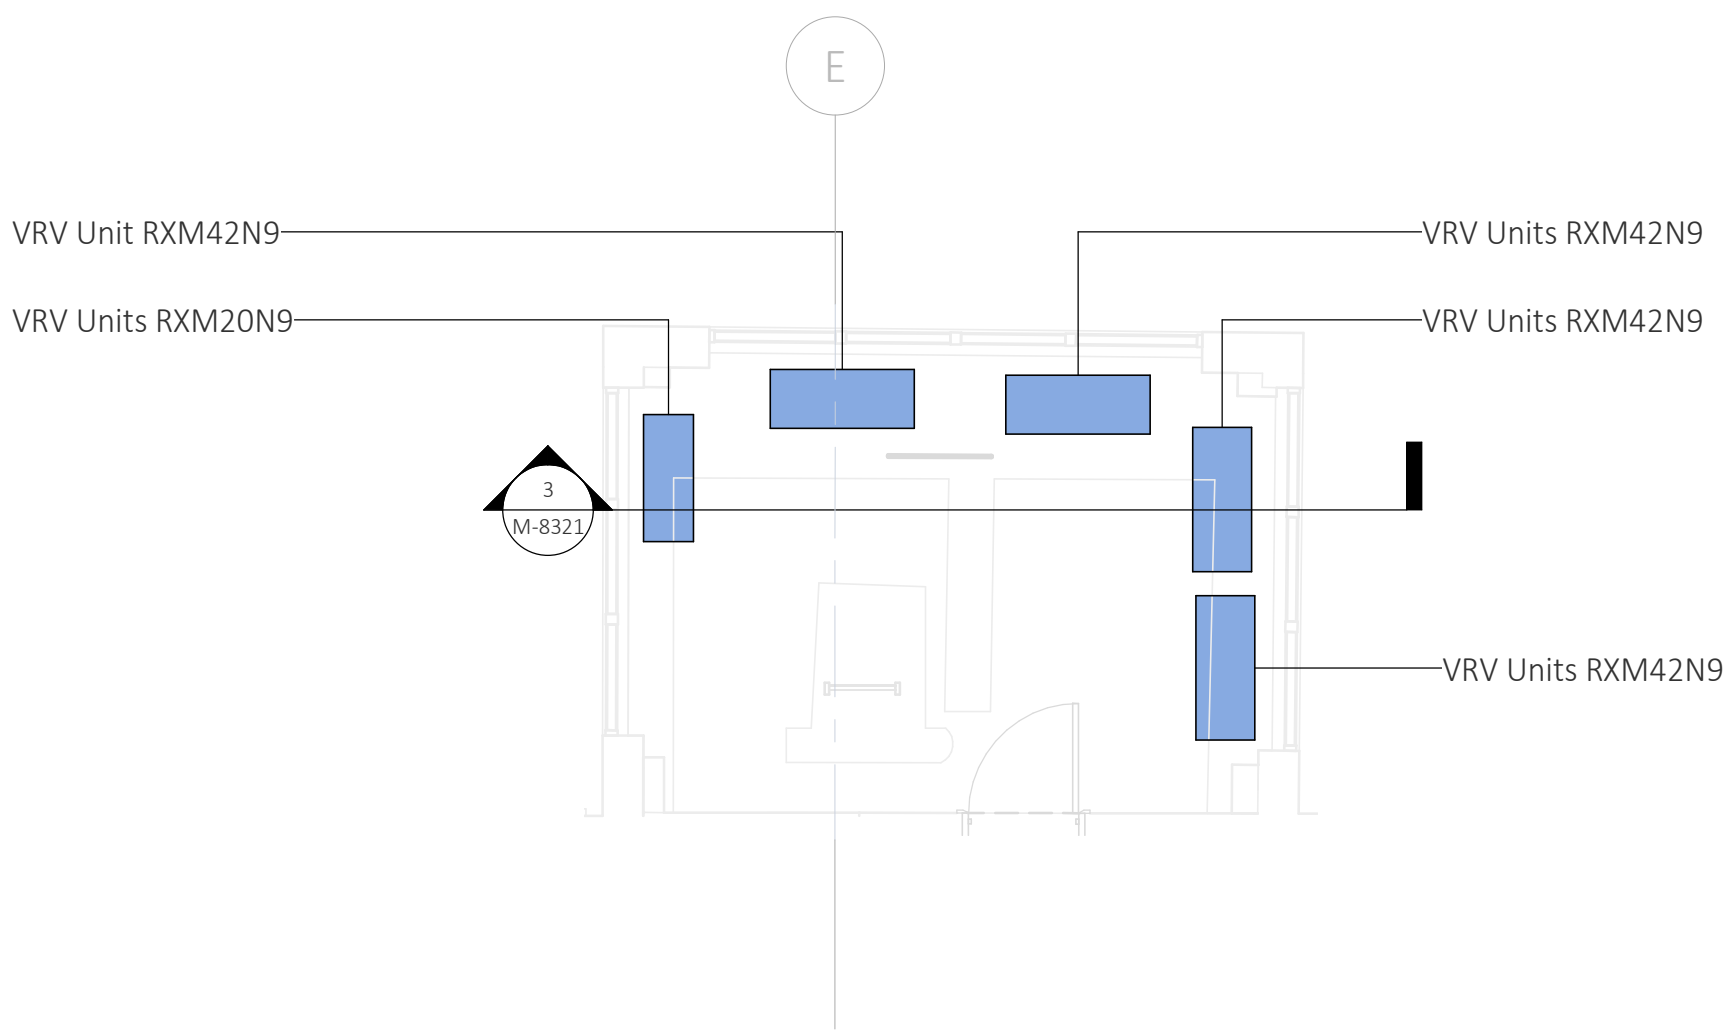

1 Level 02 - VRV Cooling Tower
1 : 50

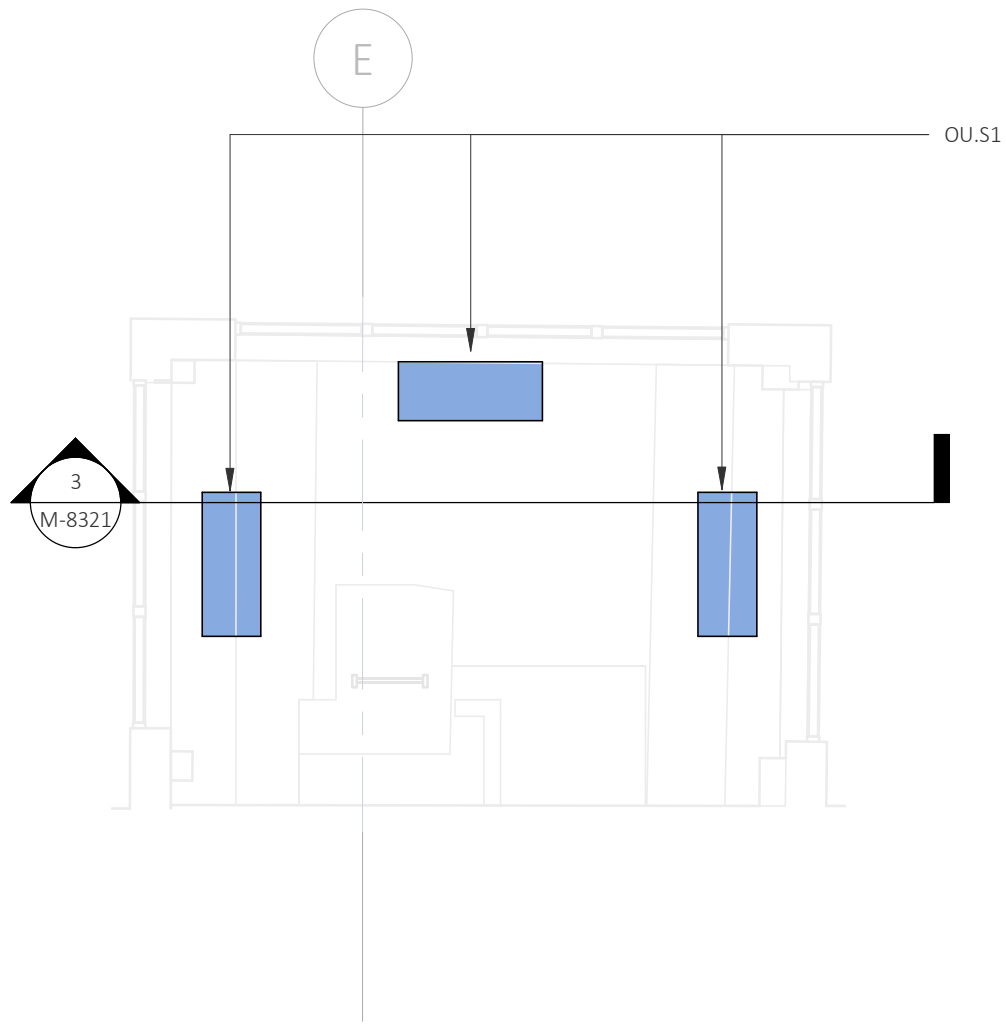

2 Level 03 - VRV Cooling Tower
1 : 50

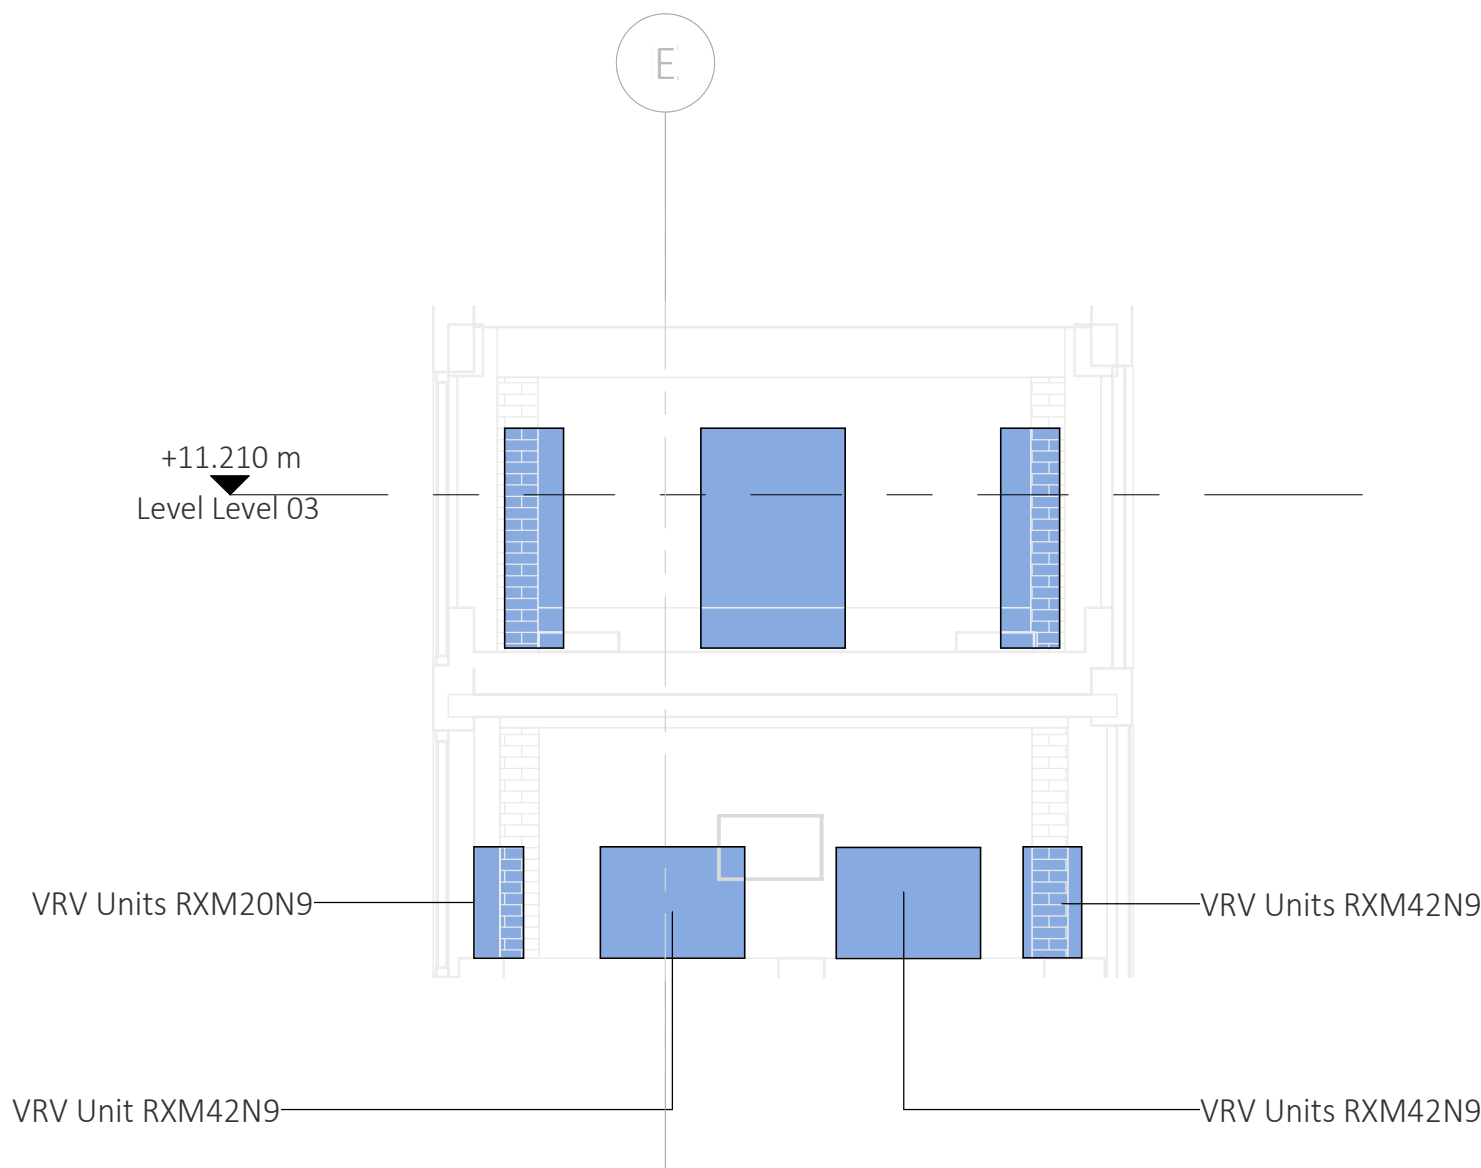

3 Cooling Tower Plantroom Section
1 : 50

KEY PLAN					
NOTES					
1. All dimensions are to be checked on site before the commencement of works. Any discrepancies are to be reported to the Architect & Engineer for verification. Figured dimensions only are to be taken from this drawing.					
2. This drawing is to be read in conjunction with all relevant engineers' and service engineers' drawings and specifications. This drawing is copyright.					
3. Discharge of units to be ducted directly to louvre to minimise discharge for recirculation.					
4. Louvres to be replaced with large pitched external louvres to maximise available free area.					
REVISIONS					
PO3 SUITABLE FOR INFORMATION					
S2	AB	03/11/21	MH	03/11/21	MH
PO2 SUITABLE FOR INFORMATION					
S2	IF	22/05/20	MH	22/05/20	MH
PO1 SUITABLE FOR INFORMATION					
S2	JT	07/05/20	AB	07/05/20	MH
REV REVISION NOTES/COMMENTS					
STA.	DRAWN BY	DATE	CHECKED BY	DATE	APPROVED BY
<div><div></div><div>5-7 Tanner Street London SE1 3LE t: +44(0)203 846 8456 e: london@hydrock.com</div></div>					
CLIENT					
Birkbeck					
PROJECT					
Birkbeck, Gordon Square					
TITLE					
Mechanical Services Cooling Tower Plantroom Drawing Second Floor -					
HYDROCK PROJECT NO. C-14299				SCALE @ A1 1 : 20	
STATUS DESCRIPTION SUITABLE FOR INFORMATION					STATUS S2
DRAWING NO. 14299-HYD-XX-02-DR-M-8321					REVISION P03