

**Report VA3909.211123.NIA**

**37-41 Gower Street, London**

Noise Impact Assessment

**23 November 2021**

**Taylor Project Services  
No1 Cornhill  
London  
EC3V 3ND**

01962 461016  
0203 8650332  
[mail@ventaacoustics.com](mailto:mail@ventaacoustics.com)

registered company no. 10139494

**Contents**

**1. Introduction..... 1**

**2. Design Criterion and Assessment Methodology ..... 1**

    2.1 Camden Council Requirements.....1

    2.2 BS8233:2014 .....2

**3. Site Description..... 2**

**4. Environmental Noise Survey ..... 3**

    4.1 Survey Procedure & Equipment .....3

    4.2 Results .....3

    4.3 Plant Noise Emission Limits .....4

**5. Predicted Noise Impact ..... 4**

    5.1 Proposed plant.....4

    5.2 Recommended Mitigation Measures .....4

    5.3 Predicted noise levels.....5

    5.4 Comparison to NR35 Curve .....5

    5.5 Comparison to BS8233:2014 Criteria.....6

**6. Conclusion ..... 6**

**Attachments**

VA3909/SP1	Indicative Site Plan
VA3909/TH1-TH2	Environmental Noise Time Histories
Appendix A	Acoustic Terminology
Appendix B	Acoustic Calculations

# 1. Introduction

As part of the refurbishment of 37-41 Gower Street, London, new condensers are to be installed to the front and rear of the building.

Venta Acoustics has been commissioned by Taylor Project Services to undertake an assessment of the potential noise impact of these proposals in support of an application for planning permission.

An environmental noise survey has been undertaken to determine the background noise levels at the most affected noise sensitive receptors. These levels are used to undertake an assessment of the likely impact with reference to the planning requirements of Camden Council.

# 2. Design Criterion and Assessment Methodology

## 2.1 Camden Council Requirements

Camden Council’s Local Plan (adopted June 2017), Appendix 3, provides the following guidance regarding noise from Industrial and Commercial Noise Sources

*A relevant standard or guidance document should be referenced when determining values for LOAEL and SOAEL for non-anonymous noise. Where appropriate and within the scope of the document it is expected that British Standard 4142:2014 ‘Methods for rating and assessing industrial and commercial sound’ (BS 4142) will be used. For such cases a ‘Rating Level’ of 10 dB below background (15dB if tonal components are present) should be considered as the design criterion).*

Existing Noise sensitive receiver	Assessment Location	Design Period	LOAEL (Green)	LOAEL to SOAEL (Amber)	SOAL (Red)
Dwellings**	Garden used for main amenity (free field) and Outside living or dining or bedroom window (façade)	Day	‘Rating level’ 10dB* below background	‘Rating level’ between 9dB below and 5dB above background	‘Rating level’ greater than 5dB above background
Dwellings**	Outside bedroom window (façade)	Night	‘Rating level’ 10dB* below background and no events exceeding 57dB <sub>L<sub>Amax</sub></sub>	‘Rating level’ between 9dB below and 5dB above background or noise events between 57dB and 88dB L <sub>Amax</sub>	‘Rating level’ greater than 5dB above background and/or events exceeding 88dB <sub>L<sub>Amax</sub></sub>

*\*10dB should be increased to 15dB if the noise contains audible tonal elements. (day and night). However, if it can be demonstrated that there is no significant difference in the character of the residual background noise and the specific noise from the proposed development then this reduction may not be required.*

*In addition, a frequency analysis (to include, the use of Noise Rating (NR) curves or other criteria curves) for the assessment of tonal or low frequency noise may be required.*

*\*\*levels given are for dwellings, however, levels are use specific and different levels will apply dependent on the use of the premises.*

*The periods in Table C correspond to 0700 hours to 2300 hours for the day and 2300 hours to 0700 hours for the night. The Council will take into account the likely times of occupation for types of development and will be amended according to the times of operation of the establishment under consideration.*

*There are certain smaller pieces of equipment on commercial premises, such as extract ventilation, air conditioning units and condensers, where achievement of the rating levels (ordinarily determined by a BS:4142 assessment) may not afford the necessary protection. In these cases, the Council will generally also require a NR curve specification of NR35 or below, dependant on the room (based upon measured or predicted  $L_{eq,5mins}$  noise levels in octave bands) 1 metre from the façade of affected premises, where the noise sensitive premise is located in a quiet background area.*

## 2.2 BS8233:2014

BS8233 *Guidance on sound insulation and noise reduction for buildings* provides guidance as to suitable internal noise levels for different areas within residential buildings.

The relevant section of the standard is shown below in Table 2.1.

Activity	Location	07:00 to 23:00	23:00 to 07:00
Resting	Living Room	35 dB $L_{Aeq, 16 \text{ hour}}$	-
Dining	Dining Room	40 dB $L_{Aeq, 16 \text{ hour}}$	-
Sleeping (daytime resting)	Bedroom	35 dB $L_{Aeq, 16 \text{ hour}}$	30 dB $L_{Aeq, 8 \text{ hour}}$

Table 2.1 - Excerpt from BS8233: 2014

[dB ref. 20µPa]

## 3. Site Description

As illustrated on attached site plan VA3909/SP1, the building is located to the west of Gower Street.

The most affected noise sensitive receivers are expected to be the new apartments in 37-41 Gower Street which will overlook the plant to the rear. The front condenser is to be located in the front vaults, beneath the pavement.

## 4. Environmental Noise Survey

### 4.1 Survey Procedure & Equipment

In order to establish the existing background noise levels at the site, a noise survey was carried out between Monday 15<sup>th</sup> and Wednesday 17<sup>th</sup> November at the location shown in site plan VA3909/SP1. This location was chosen to be representative of the background noise level at the most affected noise sensitive receivers.

Continuous 5-minute samples of the  $L_{Aeq}$ ,  $L_{Amax}$ ,  $L_{A10}$  and  $L_{A90}$  sound pressure levels were undertaken at the measurement location.

The weather during the survey period was generally dry with light winds. The background noise data is not considered to have been compromised by these conditions.

Measurements were made generally in accordance with ISO 1996 2:2017 *Acoustics - Description, measurement and assessment of environmental noise – Part 2: Determination of sound pressure levels*.

The following equipment was used in the course of the survey:

Manufacturer	Model Type	Serial No	Calibration	
			Certificate No.	Date
NTi Class 1 Integrating SLM	XL2	A2A-11586-E0	UCRT20/1565	29/6/20
Larson Davis calibrator	CAL200	13049	UCRT21/1385	22/3/21

**Table 4.1 – Equipment used for the tests**

The calibration of the sound level meter was verified before and after use with no significant calibration drift observed.

### 4.2 Results

The measured sound levels are shown as time-history plots on the attached charts VA3909/TH1-2.

The background noise level is determined by road traffic in the surrounding area.

The monitor was located to the rear of the building, where it was screened from road traffic noise to the front, on Gower Street. Noise levels to the rear of the building would be lower than at the front, and so the use of this background noise level for the setting of the plant noise limit to the front of the building is considered robust and pessimistic.

The typical background noise levels measured were:

Monitoring Period	Typical <sup>1</sup> L <sub>A90,5min</sub>
07:00 – 23:00 hours	44 dB
23:00 – 07:00 hours	39 dB

**Table 4.2 – Typical background noise levels** [dB ref. 20 µPa]

<sup>1</sup>The typical L<sub>A90</sub> value is taken as the 10<sup>th</sup> percentile of all L<sub>A90</sub> values measured during the relevant period.

### 4.3 Plant Noise Emission Limits

On the basis of the measured noise levels and the planning requirements of the Local Authority, and considering that it is not expected that tonal noise will be generated by the proposed plant units, the following plant specific sound levels should not be exceeded at the most affected noise sensitive receivers:

Monitoring Period	Design Criterion (L <sub>Aeq</sub> )
07:00 – 23:00 hours	34 dB
23:00 – 07:00 hours	29 dB

**Table 4.3 – Specific sound pressure levels not to be exceeded at most affected noise sensitive receivers**

## 5. Predicted Noise Impact

### 5.1 Proposed plant

The following plant is proposed for installation with four units to the rear in the garden, configured with two units in two separate locations, and another unit located in the front under pavement vaults. at the locations indicated on site plan VA3909/SP1.

Plant Item	Quantity	Proposed Model	Notes
Condensers	5	Daikin EPRA16DV3	Unit at front to operate in low noise mode 2 during night-time period

**Table 5.1 – Indicative plant selections assumed for this assessment.**

Consulting the manufacturer’s datasheets, the following noise emissions levels are attributed to the proposed plant items, which are based upon the cooling function which is the loudest of the operational modes.

Plant Item	Octave Band Centre Frequency (Hz)								dB(A)
	Sound Pressure, L <sub>p</sub> @1m (dB)								
	63	125	250	500	1k	2k	4k	8k	
Daikin EPRA16DV3	52	54	51	52	46	42	36	26	52
Daikin EPRA16DV3 (low noise 2)	49	46	46	44	37	33	25	20	44

**Table 5.2 – Advised plant noise data used for the assessment.**

### 5.2 Recommended Mitigation Measures

The units in the rear garden will need to be installed within acoustic enclosures providing the minimum insertion losses shown in Table 5.3.

The access door to the front vault housing the single unit will need to have an acoustic louvre providing the minimum insertion loss shown in Table 5.3.

Attenuation Component	Octave Band Centre Frequency (Hz)							
	Insertion Loss (dB)							
	63	125	250	500	1k	2k	4k	8k
Rear Units Enclosures	6	6	8	10	14	18	16	15
Vault louvre	6	6	8	10	14	18	16	15

**Table 5.3 – Recommended attenuation to ventilation openings.**

All plant and ductwork should be fitted with anti-vibration mounts in accordance with the manufacturer guidelines. This is expected to control structureborne noise to the building to acceptable levels.

Please note that the above recommendations relate to acoustic issues only. It is recommended that professional advice confirming the suitability of these measures be sought from others with regards to issues such as airflow, structural stability and visual impact.

### 5.3 Predicted noise levels

The cumulative noise level at the most affected noise sensitive receivers, has been calculated on the basis of the above information and assuming the recommended mitigation measures, with reference to the guidelines set out in ISO 9613-2:1996 *Attenuation of sound during propagation outdoors - Part 2: General method of calculation*.

A summary of the calculations are shown in Appendix B.

Description	Daytime	Night-time
Plant noise criterion	34 dB	29 dB
L <sub>p</sub> 1m from receiver – Rear	28 dB	28 dB
L <sub>p</sub> 1m from receiver - Front	34 dB	26 dB

**Table 5.4 – Predicted noise and level and design criteria at noise sensitive location**

### 5.4 Comparison to NR35 Curve

As can be seen from the following comparison in Table 5.5, the predicted noise levels at 1m from the most affected receiver are comfortably below the NR35 curve.

Frequency (Hz)	63	125	250	500	1k	2k	4k	8k
NR35	63	52	45	39	35	35	30	28
Rear	33	35	30	29	19	11	7	-2
Front (Daytime)	38	40	35	34	24	16	12	3
Front (Night-time)	35	32	30	26	15	7	1	-3

**Table 5.5 – Comparison of predicted noise levels against the NR35 criterion**

## 5.5 Comparison to BS8233:2014 Criteria

BS8233 assumes a loss of approximately 15dB for a partially open window. The external noise level shown in Table 5.5 would result in internal noise levels that achieve the guidelines shown in Table 2.1.

## 6. Conclusion

A baseline noise survey has been undertaken by Venta Acoustics to establish the background noise climate in the locality of 37-41 Gower Street, London in support of a planning application for the proposed introduction of new building services plant.

This has enabled noise emission limits to be set at the most affected noise sensitive receiver such that the proposed installation meets the requirements of Camden Council .

The cumulative noise emission levels from the proposed plant have been assessed to be compliant with the plant noise emission limits, with necessary mitigation measures specified.

The proposed scheme is not expected to have a significant adverse noise impact and the relevant plant noise requirements have been shown to be met.


**Jamie Duncan MIOA**





37-41 Gower Street, London  
Environmental Noise Time History: 1


Figure VA3909/TH1

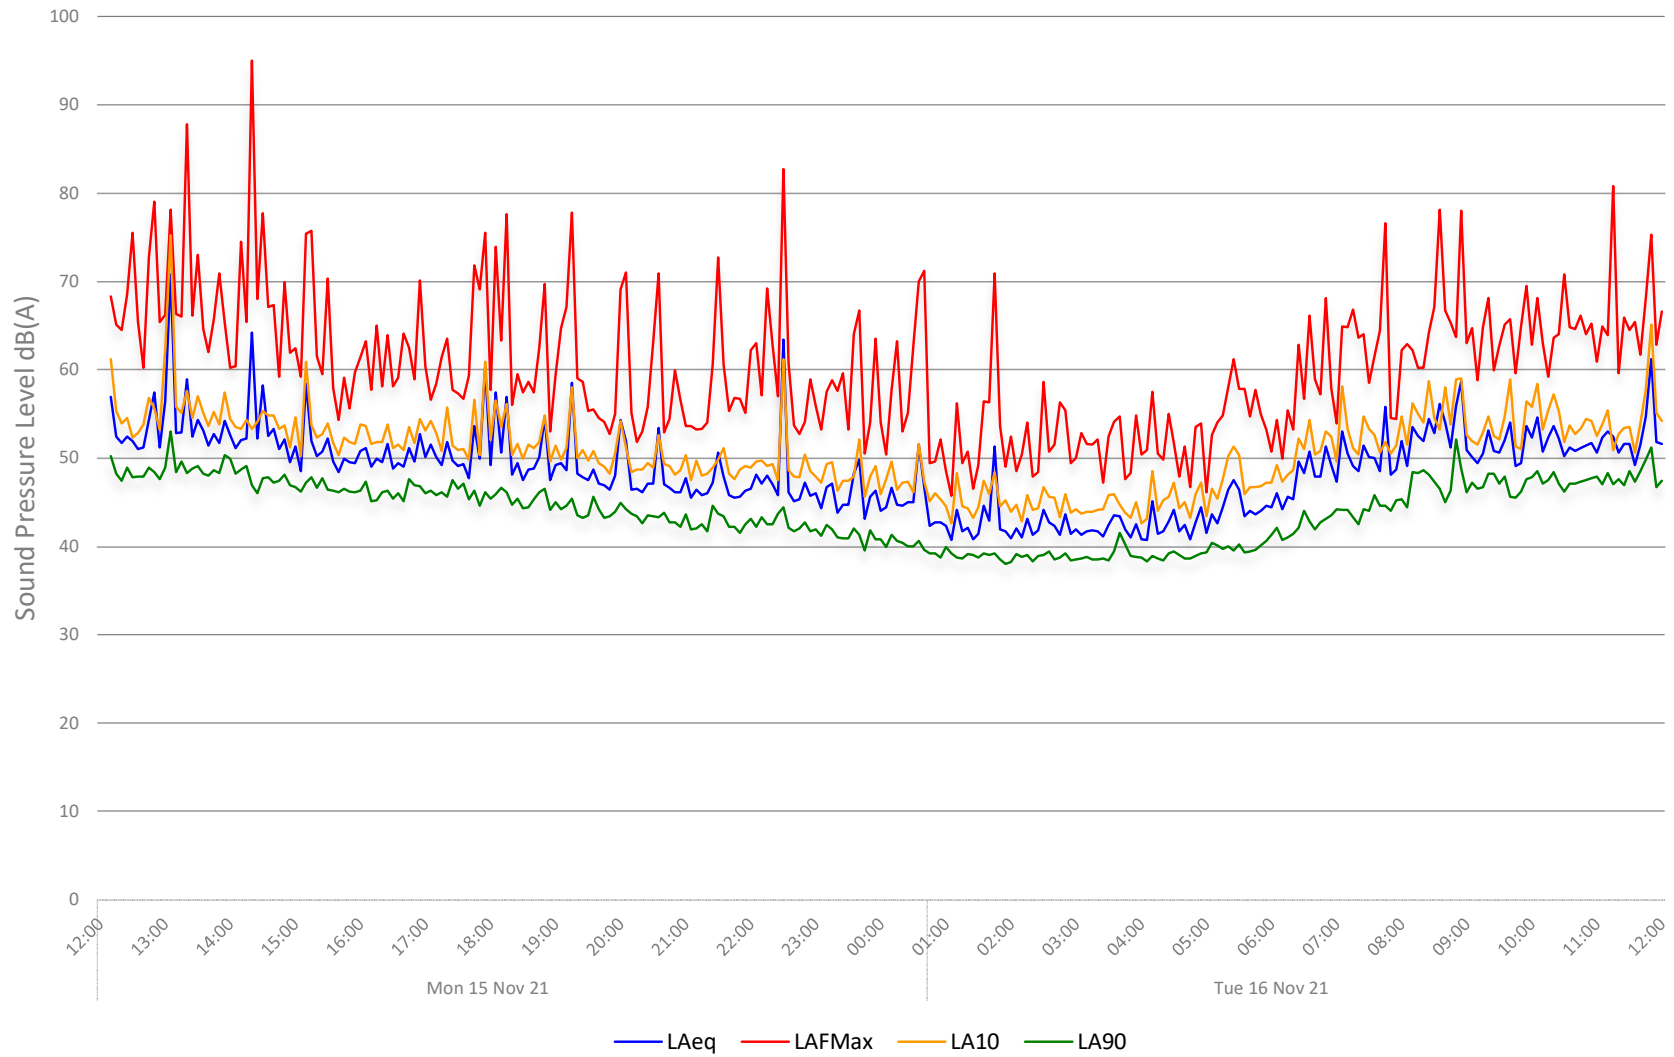

37-41 Gower Street, London  
Environmental Noise Time History: 2



Figure VA3909/TH2

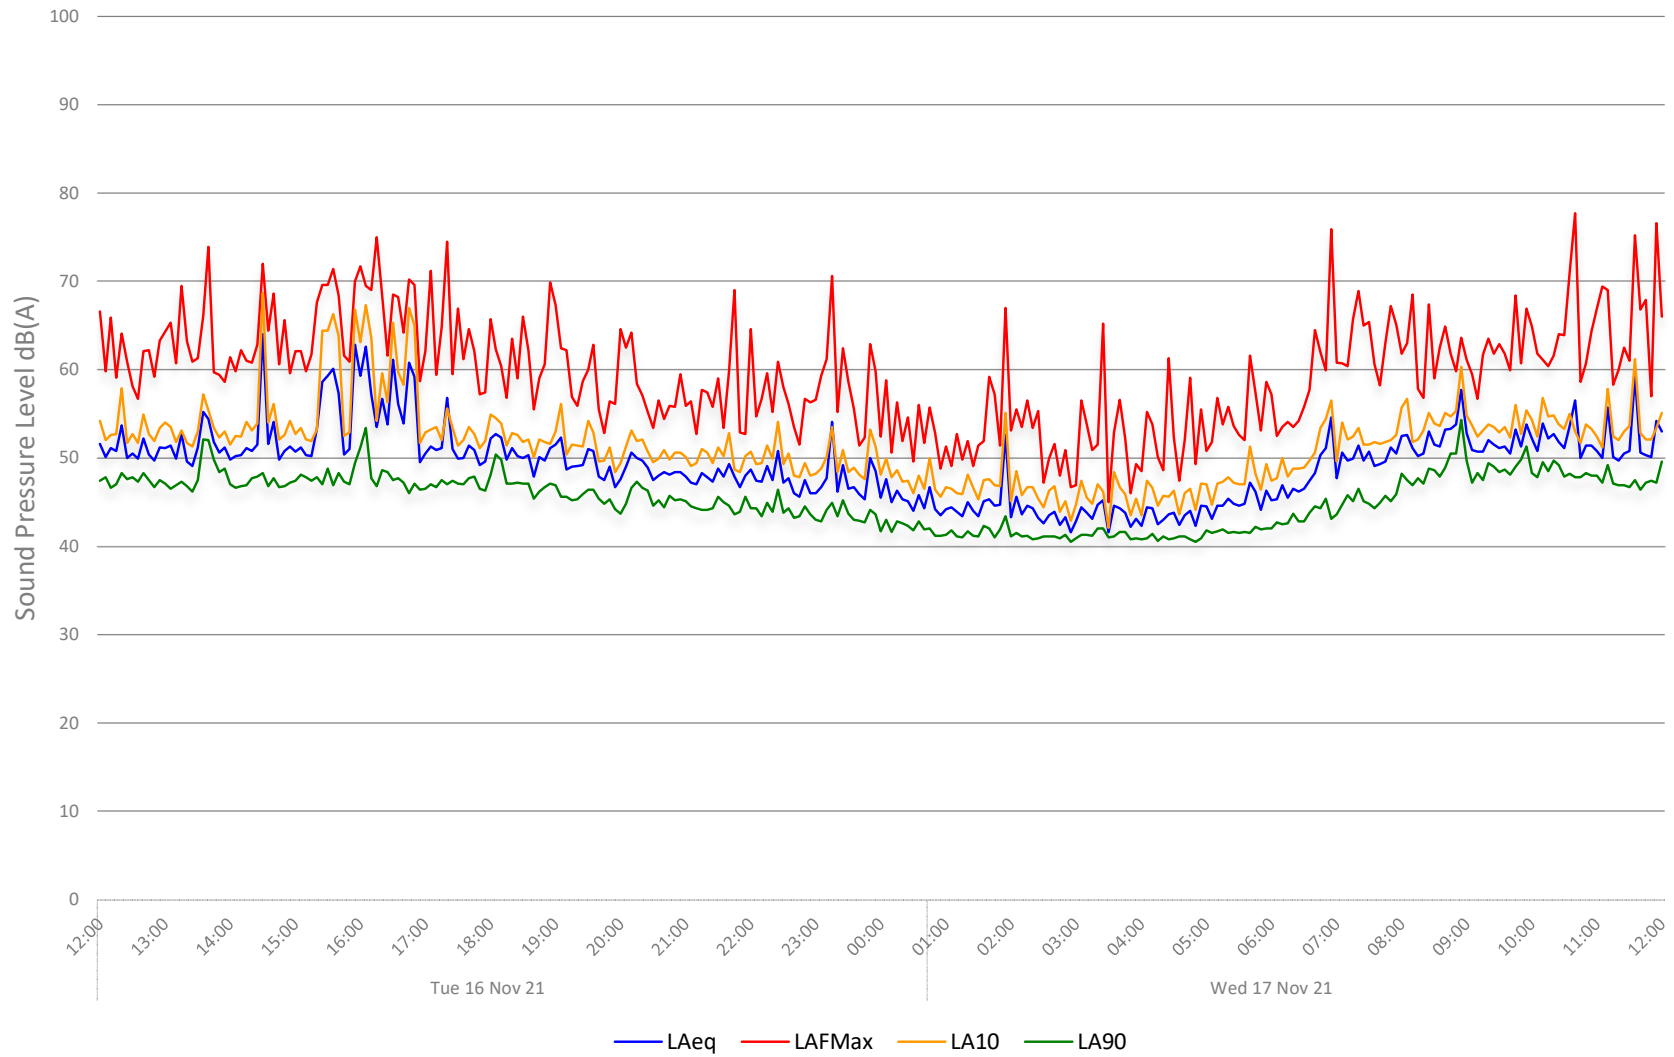

# APPENDIX A

## Acoustic Terminology & Human Response to Broadband Sound

---

### 1.1 Acoustic Terminology

The human impact of sounds is dependent upon many complex interrelated factors such as 'loudness', its frequency (or pitch) and variation in level. In order to have some objective measure of the annoyance, scales have been derived to allow for these subjective factors.

<b>Sound</b>	Vibrations propagating through a medium (air, water, etc.) that are detectable by the auditory system.
<b>Noise</b>	Sound that is unwanted by or disturbing to the perceiver.
<b>Frequency</b>	The rate per second of vibration constituting a wave, measured in Hertz (Hz), where 1Hz = 1 vibration cycle per second. The human hearing can generally detect sound having frequencies in the range 20Hz to 20kHz. Frequency corresponds to the perception of 'pitch', with low frequencies producing low 'notes' and higher frequencies producing high 'notes'.
<b>dB(A):</b>	Human hearing is more susceptible to mid-frequency sounds than those at high and low frequencies. To take account of this in measurements and predictions, the 'A' weighting scale is used so that the level of sound corresponds roughly to the level as it is typically discerned by humans. The measured or calculated 'A' weighted sound level is designated as dB(A) or $L_A$ . A notional steady sound level which, over a stated period of time, would contain the same amount of acoustical energy as the actual, fluctuating sound measured over that period (e.g. 8 hour, 1 hour, etc).
<b><math>L_{eq}</math> :</b>	The concept of $L_{eq}$ (equivalent continuous sound level) has primarily been used in assessing noise from industry, although its use is becoming more widespread in defining many other types of sounds, such as from amplified music and environmental sources such as aircraft and construction. Because $L_{eq}$ is effectively a summation of a number of events, it does not in itself limit the magnitude of any individual event, and this is frequently used in conjunction with an absolute sound limit.
<b><math>L_{10}</math> &amp; <math>L_{90}</math> :</b>	Statistical $L_n$ indices are used to describe the level and the degree of fluctuation of non-steady sound. The term refers to the level exceeded for n% of the time. Hence, $L_{10}$ is the level exceeded for 10% of the time and as such can be regarded as a typical maximum level. Similarly, $L_{90}$ is the typical minimum level and is often used to describe background noise. It is common practice to use the $L_{10}$ index to describe noise from traffic as, being a high average, it takes into account the increased annoyance that results from the non-steady nature of traffic flow.
<b>R</b>	<i>Sound Reduction Index</i> . Effectively the <i>Level Difference</i> of a building element when measured in an accredited laboratory test suite in accordance with the procedures laid down in BS EN ISO 10140-2:2010 and corrected for its size and the reverberant characteristics of the receive room.

### 1.2 Octave Band Frequencies

In order to determine the way in which the energy of sound is distributed across the frequency range, the International Standards Organisation has agreed on "preferred" bands of frequency for sound measurement and analysis. The widest and most commonly used band for frequency measurement and analysis is the Octave Band. In these bands, the upper frequency limit is twice the lower frequency limit, with the band being described by its "centre frequency" which is the average (geometric mean) of the upper and lower limits, e.g. 250 Hz octave band extends from 176 Hz to 353 Hz. The most commonly used octave bands are:

Octave Band Centre Frequency Hz | 63 | 125 | 250 | 500 | 1000 | 2000 | 4000 | 8000

### 1.3 Human Perception of Broadband Noise

# APPENDIX A

## Acoustic Terminology & Human Response to Broadband Sound

---

Because of the logarithmic nature of the decibel scale, it should be borne in mind that sound levels in dB(A) do not have a simple linear relationship. For example, 100dB(A) sound level is not twice as loud as 50dB(A). It has been found experimentally that changes in the average level of fluctuating sound, such as from traffic, need to be of the order of 3dB before becoming definitely perceptible to the human ear. Data from other experiments have indicated that a change in sound level of 10dB is perceived by the average listener as a doubling or halving of loudness. Using this information, a guide to the subjective interpretation of changes in environmental sound level can be given.

Change in Sound Level dB	Subjective Impression	Human Response
0 to 2	Imperceptible change in loudness	Marginal
3 to 5	Perceptible change in loudness	Noticeable
6 to 10	Up to a doubling or halving of loudness	Significant
11 to 15	More than a doubling or halving of loudness	Substantial
16 to 20	Up to a quadrupling or quartering of loudness	Substantial
21 or more	More than a quadrupling or quartering of loudness	Very Substantial

## APPENDIX B

### VA3909 - 37-41 Gower Street, London

#### Noise Impact Assessment - Rear

Rear Garden (North)		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Daikin EPRA16	Lp @ 1m	52	54	51	52	46	42	36	26	<b>52</b>
Enclosure loss		-6	-6	-8	-10	-14	-18	-16	-15	
Number of Plant	2	3	3	3	3	3	3	3	3	
Distance Loss	To 18m	-25	-25	-25	-25	-25	-25	-25	-25	
<b>Level at receiver</b>		<b>24</b>	<b>26</b>	<b>21</b>	<b>20</b>	<b>10</b>	<b>2</b>	<b>-2</b>	<b>-11</b>	<b>19</b>

Rear Garden (South)		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Daikin EPRA16	Lp @ 1m	52	54	51	52	46	42	36	26	<b>52</b>
Enclosure loss		-6	-6	-8	-10	-14	-18	-16	-15	
Number of Plant	2	3	3	3	3	3	3	3	3	
Distance Loss	To 7m	-17	-17	-17	-17	-17	-17	-17	-17	
<b>Level at receiver</b>		<b>32</b>	<b>34</b>	<b>29</b>	<b>28</b>	<b>18</b>	<b>10</b>	<b>6</b>	<b>-3</b>	<b>28</b>

Cumulative noise level at receiver 28 dBA()

#### Noise Impact Assessment - Front

Front Vault - Daytime		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Daikin EPRA16	Lp @ 1m	52	54	51	52	46	42	36	26	<b>52</b>
Louvre Loss		-6	-6	-8	-10	-14	-18	-16	-15	
Number of Plant	1	0	0	0	0	0	0	0	0	
Distance Loss	To 2.5m	-8	-8	-8	-8	-8	-8	-8	-8	
<b>Level at receiver</b>		<b>38</b>	<b>40</b>	<b>35</b>	<b>34</b>	<b>24</b>	<b>16</b>	<b>12</b>	<b>3</b>	<b>34</b>

Front Vault - Night-time		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Daikin EPRA16 (low noise 2)	Lp @ 1m	49	46	46	44	37	33	25	20	<b>44</b>
Louvre Loss		-6	-6	-8	-10	-14	-18	-16	-15	
Number of Plant	1	0	0	0	0	0	0	0	0	
Distance Loss	To 2.5m	-8	-8	-8	-8	-8	-8	-8	-8	
<b>Level at receiver</b>		<b>35</b>	<b>32</b>	<b>30</b>	<b>26</b>	<b>15</b>	<b>7</b>	<b>1</b>	<b>-3</b>	<b>26</b>