




EXISTING ELEVATION




PROPOSED ELEVATION


- LEGEND
- B.E. - BLANK END
 - C.E. - CAP END
 - F.D.T. - FLAT ON TOP
 - F.D.B. - FLAT ON BOTTOM
 - C.T. - CENTRAL TAPER
 - R.H.B. - RE-HEAT BATTERY
 - V.C.D. - VOLUME CONTROL DAMPER
 - F.D. - FIRE DAMPER
 - A.P. - ACCESS PANEL
 - T.H. - TEST HOLE
 - C.O.S. - CAP ON SITE
 - L.O. - FLANGE LOOSE TO SITE
 - S.B.D. - SINGLE BLADE DAMPER
 - M.D. - MOTORISED DAMPER
 - N.T.S. - NOT TO SCALE

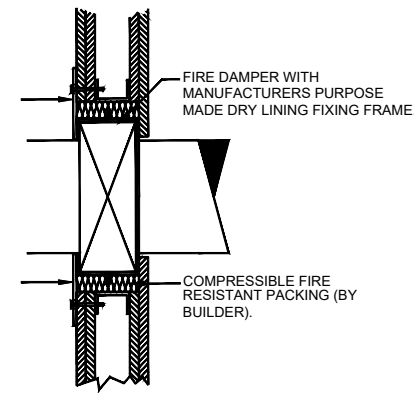


INSTALLATION OF FIRE DAMPER WITHIN DRY STUD PARTITION

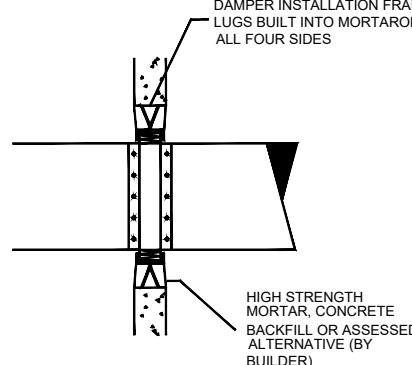


INSTALLATION OF FIRE DAMPER WITHIN BLOCK/MASONARY/CONCRETE WALL

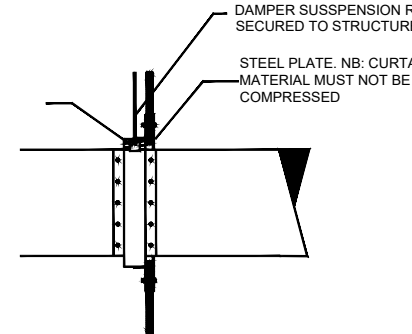

INSTALLATION OF FIRE DAMPER WITHIN CEILING VOID FIRE CURTAIN

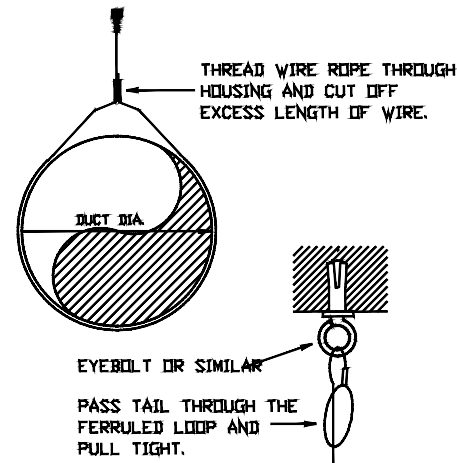

CIRCULAR SUPPORT DETAIL

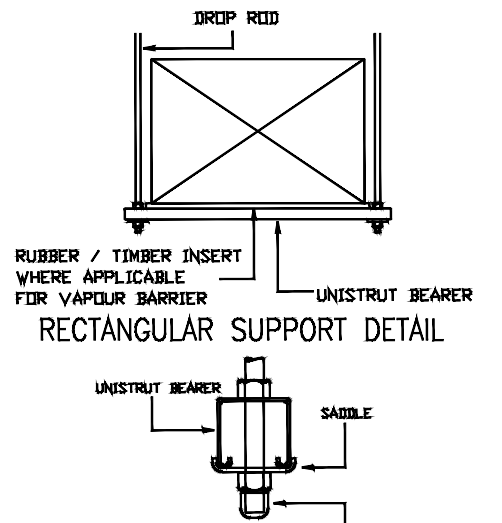

CROSS SECTION ON BEARER

CLIENT
QIMA COFFEE

CONTRACT
WARREN STREET
KITCHEN VENTILATION

TITLE
PROPOSED POOL
VENTILATION SYSTEM

DRG.No. DF00137/01/P1


REFERENCE DRAWINGS	REVISION	DATE
REV -	*	*
	*	*

NOTES
IL 3270 CL 3520
DENOTES LEVEL FROM U/S OF RECTANGULAR DUCT AND CENTRELINE OF CIRCULAR DUCT ABOVE F.F.L.
* DUCTWORK TO BE FINISHED IN MATT BLACK
DO NOT SCALE IF IN DOUBT ASK

ISSUED FOR APPROVAL	DATE	APPROVED DATE	SCALE
ORIGINAL P1	*		1:50@A1
REV			
REV			
REV			
REV			

SITE ADDRESS
WARREN STREET LONDON

DRAWING STATUS
PRELIMINARY

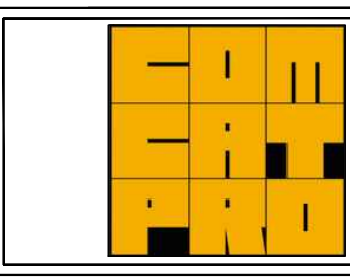

282 Leigh Rd
Southend-on-sea
Leigh-On-Sea
SS9 1BW
0800 334 5221