

LEE MARLEY BRICKWORK. 185 VICOUNT WAY WOODLEY, READING BERKS.RG5 4DZ Tel: 01 628 825 929	Job Description: EXTERNAL ACCESS AT No 10 PARK VILLAGE EAST				Job Ref: C-LMB-3917-1	
	Scaffolding Contractor:				Sheet No: Page 1 of 6	
	Calc. by: I.MARTINS	Date: 28-10-21	Chck'd. By: T.WARREN	Date: 28-10-21	Revision:	Date:

MATERIALS

STANDARD SCAFFOLD IN ACCORDANCE WITH EN-12811 PT.1 & TG20:21.
(TECHNICAL GUIDANCE ON THE USE OF BS EN 12811-1)
FITTINGS IN ACCORDANCE WITH TG20:21
ALL TUBE WILL BE TAKEN AS NEW IN ACCORDANCE WITH BS 1139-1:1982



PROPERTIES OF TUBE

OUTSIDE DIAMETER	=	48.3MM	I	=	13.80CM4
WEIGHT	=	4.37KG/M	r	=	1.57CM
Z	=	5.70CM3	Pbc	=	139N/MM2
AREA	=	5.57CM2			
ALLOWABLE SHEAR STRESS	=	93N/MM2			

ALLOWABLE TUBE STRUT LOADS (TG20-21 TABLE D.1 APPENDIX D AS NEW (BS 1139-1:1982))

LENGTH (MM)	LOAD(KN)	LENGTH(MM)	LOAD(KN)
1000	54.0KN	2600	18.90
1200	48.40	2800	16.80
1400	42.70	3000	14.90
1600	37.30	3200	13.40
1800	32.50	3400	12.0
2000	28.20	3600	10.90
2200	24.60	3800	9.90
2400	21.50	4000	9.0

ALLOWABLE FITTING LOADS (TG20:21)

FITTING TYPE	LOAD TYPE	S.W.L (KN)
RIGHT ANGLE CLASS A	SLIP	6.10
RIGHT ANGLE CLASS B	SLIP	9.10
SWIVEL CLASS A	SLIP	6.10
SWIVEL CLASS B	SLIP	9.10
SLEEVE	TENSION	3.0
ADJ. BASE / FORKHEAD	AXIAL	30.0

ALLOWABLE B.M & SHEAR FOR SCAFFOLDING BEAMS

TYPE OF BEAM	ALLOWABLE B.M KNM	MAX SHEAR FORCE
450 HAKI BEAM	15.70KNM	12.70KN
780 UBIX BEAM	36.50	30.0KN
LADDER BEAM	13.50KNM	18.0KN
SCAFFOLD TUBE	1.10KNM	25.0KN
UNIT BEAM	27.70KNM (BOLT SHEAR)	18.0KN

LEE MARLEY BRICKWORK. 185 VICOUNT WAY WOODLEY, READING BERKS.RG5 4DZ Tel: 01 628 825 929	Job Description: <p style="text-align: center;">EXTERNAL ACCESS AT No 10 PARK VILLAGE EAST</p>				Job Ref: <p style="text-align: center;">C-LMB-3917-1</p>	
	Scaffolding Contractor:				Sheet No: <p style="text-align: center;">Page 2 of 6</p>	
	Calc. by: I.MARTINS	Date: 28-10-21	Chck'd. By: T.WARREN	Date: 28-10-21	Revision:	Date:

DESIGN RISK ASSESSMENT

Hazard Ref	Hazard Source	Risk Category		Residual Risk		
1	Scaffold Requirements	MEDIUM RISK	Have Meeting or be provided with the scaffold requirements in the form of Design request Form	LOW RISK		
2	Scaffold Leg Loadings and	HIGH RISK	Drawing and Calculations will be Submitted and approved by the client prior to starting the work (Indicating Leg Load and Tie loads)	LOW RISK		
3	Vehicular Collision with S	HIGH RISK	Traffic management system utilised by Main Contractor including the use of trained banksman and protective barrier.	LOW RISK		
4	Working at Height	HIGH RISK	Scaffolders must comply with procedures in NASC guidance SG4:15 & its revisions as a minimum precaution.	LOW RISK		
5	Competence	HIGH RISK	Only competent, trained persons should erect scaffold materials, this falls under the scaffold contractors area of responsibility.	LOW RISK		
6	Manual Handling	MEDIUM RISK	The manual handling regulations should be adhered to at all times by scaffolders, including correct lifting & lifting aid procedures.	LOW RISK		
7	Erection/Dismantling/Altering	HIGH RISK	Only competent, trained persons should erect, Dismantle & Alter scaffold materials, this falls under the scaffold contractors area of responsibility.	LOW RISK		
8	Electricity[man made/natural]	HIGH RISK	Only trained/competent persons are to install, use & maintain electrical equipment. The installation of earthing is also to be carried out by suitably qualified persons.	LOW RISK		
9	Environmental Conditions	HIGH RISK	The scaffold contractor should make his own site specific risk assessment with the client as to if the scaffold can be used during periods of inclement weather, [wind, rain & snow].	LOW RISK		
10	Fire Exposure	HIGH RISK	Ensure all personnel at site are aware of evacuation procedures/routes off the scaffold, clearly sign the fire escape route, consider erection of emergency stair tower ext.	LOW RISK		
11	General Use/Loading	HIGH RISK	The design drawings will clearly indicate the loading limitations of the specific scaffold which should be adhered to at all times, any deviation must be at the consent of the scaffold contractor.	LOW RISK		
12	Materials	HIGH RISK	All materials must be checked prior to installation and should meet the requirements of TG20:13.	LOW RISK		
13	Obstructions	HIGH RISK	A min. width of 600mm should be maintained on the working platform, free of obstacles & in accordance with BSEN 12811-1.	LOW RISK		
14	Stability Issues	HIGH RISK	Attention must be given to anchor & kentledge details shown on the design drawings. Inspection of these two areas must be detailed ensuring correct installation & testing.	LOW RISK		
15	Miscellaneous/Public	HIGH RISK	Miscellaneous - written appropriately to the particular site. Public - sites are to be securely fenced off & appropriately protected to best prohibit access by the public to site.	LOW RISK		
16	Welfare/First Aid	MEDIUM RISK	All aspects of Health & Safety should be addressed by the main contractor in accordance with the Health & Safety Act. Site should always have first aiders & kit on site at all times.	LOW RISK		
 <p>The Following symbol is used on Design Drawings to identify where residual risks remain in the scaffold design.</p>			HIGH RISK ACTION TO BE TAKEN TO MITIGATE RISK	MEDIUM RISK RISK TO BE NOTED WITHIN DESIGN	LOW RISK NO ACTION REQUIRED	

LEE MARLEY BRICKWORK. 185 VICOUNT WAY WOODLEY, READING BERKS.RG5 4DZ Tel: 01 628 825 929	Job Description: EXTERNAL ACCESS AT No 10 PARK VILLAGE EAST				Job Ref: C-LMB-3917-1	
	Scaffolding Contractor:				Sheet No: Page 3 of 6	
	Calc. by: I.MARTINS	Date: 28-10-21	Chck'd. By: T.WARREN	Date: 28-10-21	Revision:	Date:

CHECK TUBE S/WT PER LIFT

OUTSIDE STND	TUBE	FIT'GS
STANDARD =	3.10M	
LEDGERS = 1.80M X 4 =	7.20M	4
TRANSOMS = 0.70M X 3 =	2.10M	3
FACE BRCG = 2.20M X 1 =	2.20M	1
TOTAL	15.0M X 4.37KG/M = 65.60KG	9 FIT'GS X 1.80KG = 16.20KG
COMBINED LOAD PER LIFT = 82.0KG / 102 = 0.80KN / LIFT OUTSIDE LEG		

INSIDE STND	TUBE	FIT'GS
STANDARD =	3.10M	
LEDGERS = 1.80M X 1 =	1.80M	1
TRANSOMS = 1.30M X 3 =	3.90M	3
TOTAL	8.80M X 4.37KG/M = 38.50KG	4 FIT'GS X 1.80KG = 7.20KG
COMBINED LOAD PER LIFT = 45.70KG / 102 = 0.45KN / LIFT INSIDE LEG		

CHECK LEG LOAD AT BASE LEVEL FOR OUTSIDE STANDARDS


TUBE S/WT = 0.80KN/ LIFT X 3 = **2.40KN/ STND**
 BRDS S/WT = 0.25KN/M2 X 1.0 X 2.0 X 3 LVLS = **1.50KN/ STND**
 LIVE LOADING = 1.50KN/M2 X 0.80 X 2.0 X 1NO LIFT = **2.40KN/ STND**
 LIVE LOADING = 0.75KN/M2 X 0.80 X 2.0 X 1NO LIFT = **1.20KN/ STND**
 COMBINED LOAD = 5.50KN PER OUTER STND SAY 7.0KN
 ALLOWABLE STRUTT LOAD FOR 3.10M TUBE = 14.0KN > 7.0KN :- OK
 ALLOWABLE STRUTT LOAD FOR ADJUSTABLE BASEPLATE = 30.0KN > 7.0KN :- OK

CHECK LEG LOAD AT BASE LEVEL FOR INSIDE STANDARDS

TUBE S/WT = 0.45KN/ LIFT X 3 = **1.50KN/ STND**
 BRDS S/WT = 0.25KN/M2 X 0.80 X 2.0 X 3 LVLS = **1.20KN/ STND**
 2No INSIDE BRDS S/WT (WITH CANT'LVR) = 0.25KN/M2 X 0.45 X 2.0 X 1 LVL = 0.20KN/ STND
 0.20KN X 1.70 / 1.50 = 0.24KN PER LIFT X 3No = **0.80KN / STND**
 LIVE LOADING = 1.50KN/M2 X 0.80 X 2.0 X 1NO LIFT = **2.40KN/ STND**
 LIVE LOADING = 0.75KN/M2 X 0.80 X 2.0 X 1NO LIFT = **1.20KN/ STND**
 LIVE LOADING (2No INSIDE BRDS) = 0.75KN/M2 X 2.0 X 0.45 X 1NO LIFT = 0.70KN/ STND
 WITH CANTILEVER = 0.70KN X 1.70 / 1.50 = 0.80KN PER LIFT X 2No = **1.60KN / STND**
 COMBINED LOAD PER INSIDE STND = 8.70KN SAY 10.0KN
 ALLOWABLE STRUTT LOAD FOR 3.10M TUBE = 14.0KN > 10.0KN :- OK
 ALLOWABLE STRUTT LOAD FOR ADJUSTABLE BASEPLATE = 30.0KN > 10.0KN :- OK

LEE MARLEY BRICKWORK. 185 VICOUNT WAY WOODLEY, READING BERKS.RG5 4DZ Tel: 01 628 825 929	Job Description: EXTERNAL ACCESS AT No 10 PARK VILLAGE EAST				Job Ref: C-LMB-3917-1	
	Scaffolding Contractor:				Sheet No: Page 5 of 6	
	Calc. by: I.MARTINS	Date: 28-10-21	Chck'd. By: T.WARREN	Date: 28-10-21	Revision:	Date:

Wind Assessment to BS EN 1991-1- 4

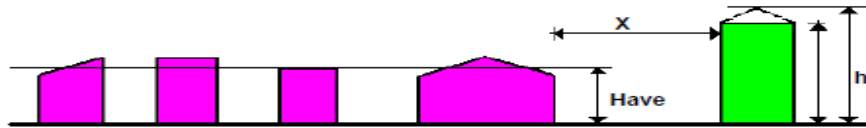


Have = Obstruction Height or average height of roof tops upwind of building under consideration
h = Maximum height of building (REFERENCE HEIGHT)
X = Distance to obstruction

Terrain Data

Wind Direction (deg)	0	30	60	90	120	150	180	210	240	270	300	330
Smallest Obstruction Height Have(m)	6	6	6	6	6	6	0	6	6	0	6	6
Distance to Obstruction X(m)	20	20	20	20	20	20	0	20	20	0	20	20
Upwind Distance to Sea (km)	200	174	150	70	100	86	80	130	200	200	200	200
Upwind Distance from Edge of Town(km)	13.5	12.5	16.5	14.5	22.5	20.5	0.0	20.5	19.9	0.0	15.5	8.5

UK Grid Reference Finder

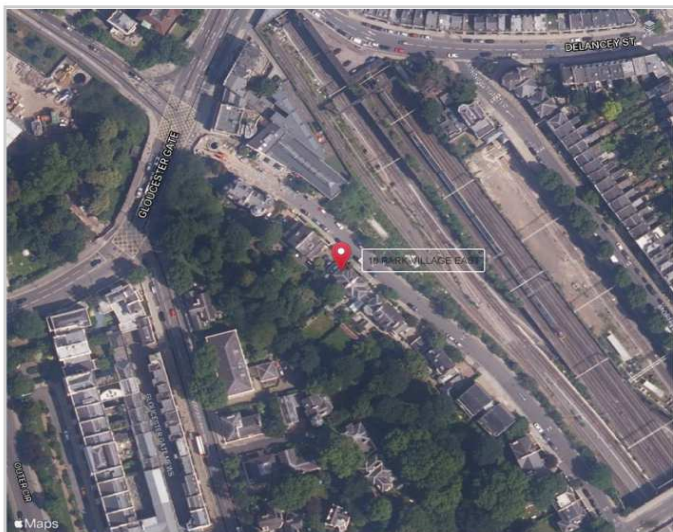

Grid Reference	X (Easings)	Y (Northings)	Latitude	Longitude	Description (Click to Edit)	Address	Postcode
TQ 28707 83482	528707	183482	51.535398	-0.1457038	10 PARK VILLAGE EAST	NW1 7PX	NW1 7PX

PEAK WIND PRESSURE

$Q_p = 0.51 \text{KN/m}^2$

LEE MARLEY BRICKWORK. 185 VICOUNT WAY WOODLEY, READING BERKS.RG5 4DZ Tel: 01 628 825 929	Job Description: EXTERNAL ACCESS AT No 10 PARK VILLAGE EAST				Job Ref: C-LMB-3917-1	
	Scaffolding Contractor:				Sheet No: Page 6 of 6	
	Calc. by: I.MARTINS	Date: 28-10-21	Chck'd. By: T.WARREN	Date: 28-10-21	Revision:	Date:

CHECK EXTERNAL PRESSURE COEFFICIENT (Cpe TABLE 7.1)

SCAFFOLD NOT SHEETED ASSUME 30% SOLID

Cf ZONE A = $-0.30p \times 0.50\text{KN/M}^2 = 0.15\text{KN/M}^2$

Cf BRICKGUARDS = $-0.18p \times 0.51\text{KN/M}^2 = 0.15\text{KN/M}^2$ SAY 0.10KN/M^2

COMBINED Cf = 0.25KN/M^2

CHECK TIE LOADS FOR ACCESS SCAFFOLD

$2.0\text{M BAY} \times 3.20\text{M HIGH} \times 0.25\text{KN/M}^2 = 1.60\text{KN}$ SAY 2.0KN

TIE TUBE CONNECTED TO SCAFFOLD WITH LOAD BEARING COUPLERS + CHECK FITTING

FITTING CAPACITY = $6.10\text{KN} \times 2 = 12.20\text{KN}$ CAPACITY > 2.0KN THEREFORE OK

TIES TESTED ON SITE TO $2.0\text{KN} \times 25\% = 1.50\text{KN}$ SAY $3.0\text{KN} / 2\text{No ANCHORS} = 1.50\text{KN}$

CHECK LEDGER RESTRAINING INSIDE MIDDLE STANDARD AT GROUND LEVEL

LEG LOAD = $10.0\text{KN} \times 2.5\% = 0.25\text{KN}$

WIND LOAD = $2.0\text{M BAY} \times 2.40\text{M HIGH} \times 0.25\text{KN/M}^2 = 1.20\text{KN} / 2 = 0.60\text{KN}$

COMBINED LOAD = 0.85KN

MR = $WL/4 = 0.85\text{KN} \times 3.80\text{M} / 4 = 0.80\text{KNM}$

ALLOWABLE MR = $1.10\text{KNM} > 0.80\text{KNM} :-\text{OK}$