


KEY PLAN

NOTES


THIS DRAWING MUST NOT BE SCALED.  
 ALL DIMENSIONS ARE TO BE VERIFIED AND CHECKED ON SITE. ANY DISCREPANCIES THAT ARE, OR BECOME APPARENT SHOULD BE REPORTED TO CHAPMAN TAYLOR.  
 AREAS INDICATED ARE APPROXIMATE GROSS INTERNAL AREA. THEY RELATE TO THE LIKELY AREAS OF THE BUILDING AT THE CURRENT STAGE OF DESIGN. ANY DECISIONS TO BE MADE ON THE BASIS OF THESE PREDICTIONS, WHETHER AS TO PROJECT VIABILITY, PRE-LETTING, LEASE AGREEMENTS, OR THE LIKE, SHOULD INCLUDE DUE ALLOWANCE FOR THE INCREASES AND DECREASES INHERENT IN THE DESIGN DEVELOPMENT AND BUILDING PROCESS.  
 © COPYRIGHT CHAPMAN TAYLOR 2020

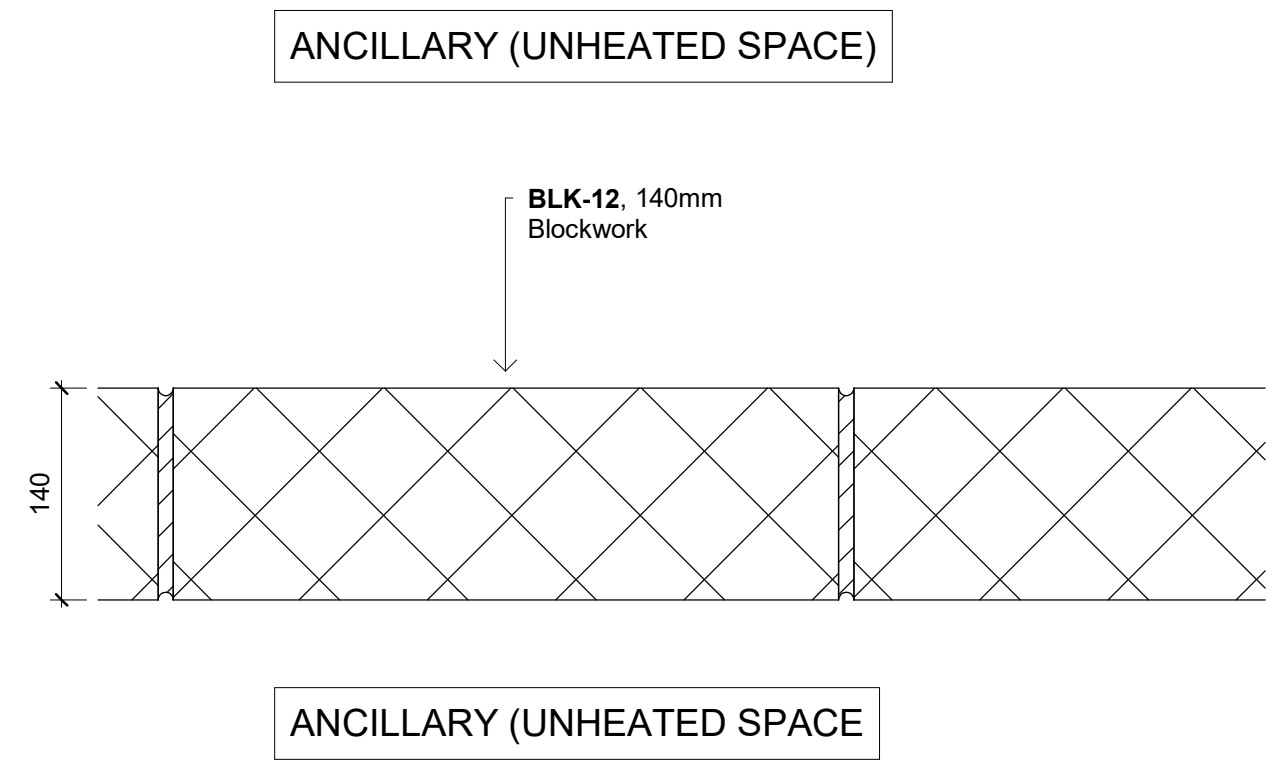

**1 IWS-20, SINGLE SKIN BLOCK WALL**  
1:5

SEPARATING WALL BETWEEN TWO ANCILLARY SPACES:


1 x 140mm **BLK-12** high density Blockwork  
 Fire Rating: 60 min. to be achieved  
 Acoustic Criteria: N/A  
 Target U value: N/A  
 Windpost location to SE advice

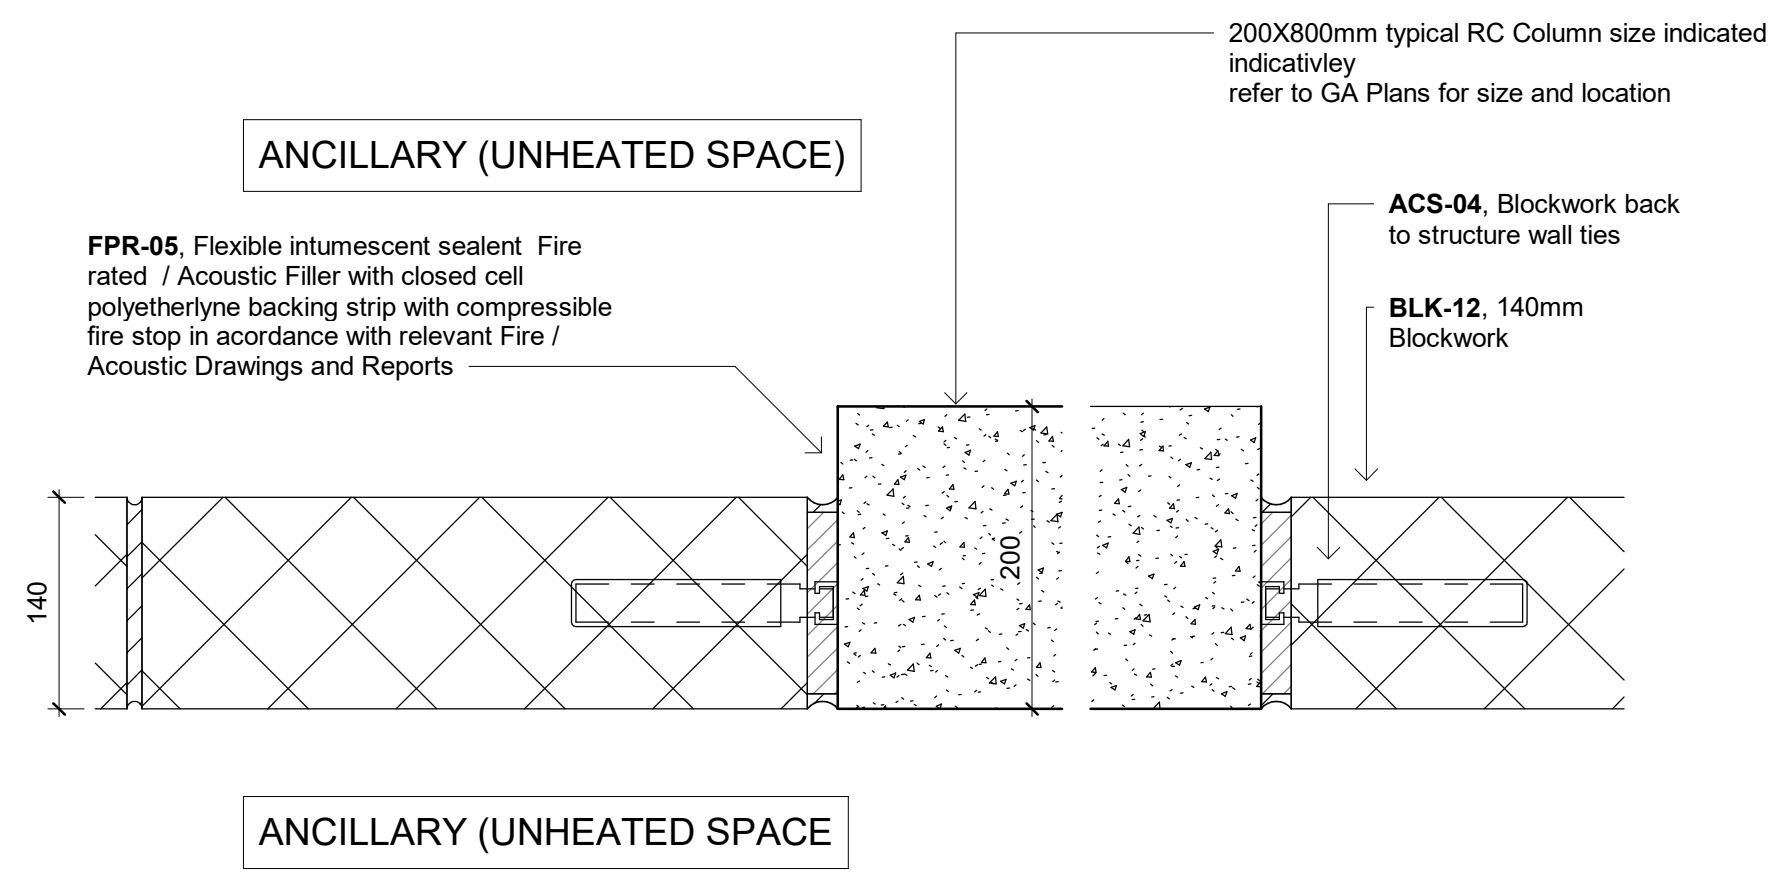

**2 IWS-20A, SINGLE SKIN BLOCK WALL (WITH COLUMN)**  
1:5

SEPARATING WALL BETWEEN TWO ANCILLARY SPACES:


1 x 140mm **BLK-12** high density Blockwork  
 Fire Rating: 60 min. to be achieved  
 Acoustic Criteria: N/A  
 Target U value: N/A

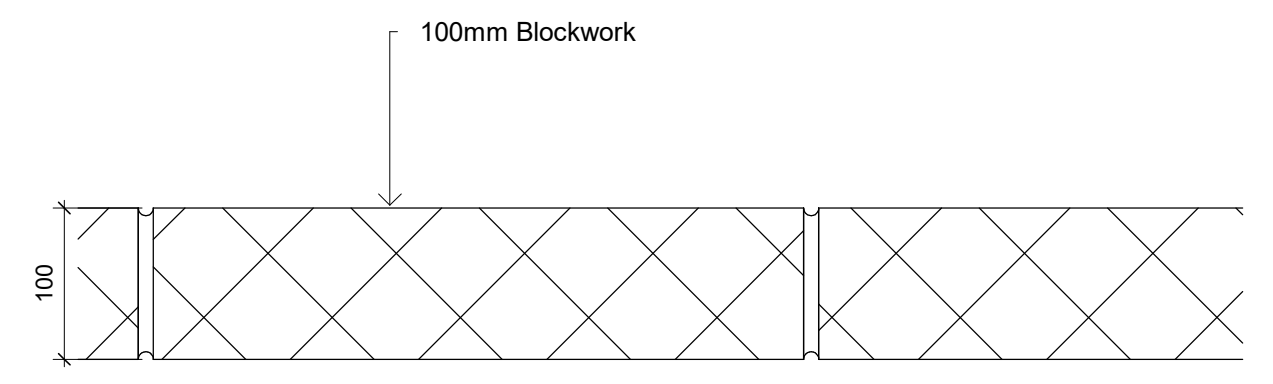

**3 IWS-20B, SINGLE SKIN BLOCK WALL**  
1:5

SEPARATING WALL BETWEEN TWO ANCILLARY SPACES:

1 x 100mm medium density Blockwork  
 Fire Rating: xx min. to be achieved  
 Acoustic Criteria: N/A  
 Target U value: N/A  
 Windpost location to SE advice

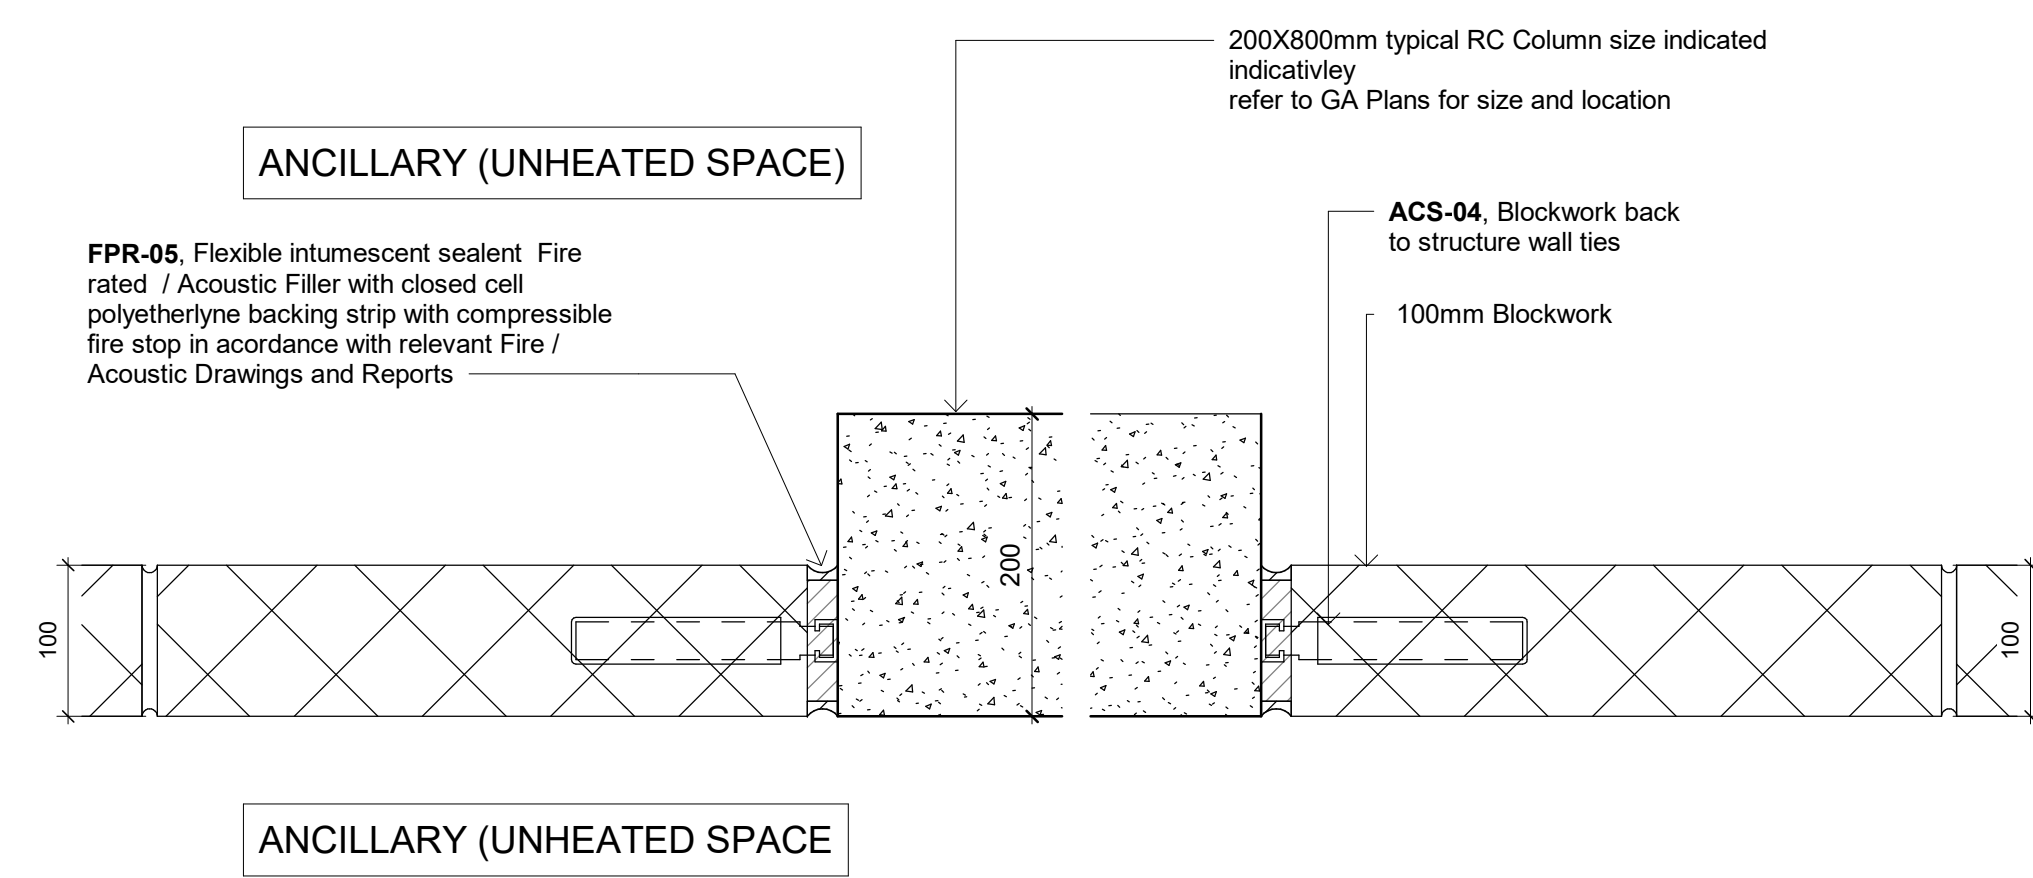

**4 IWS-20C, SINGLE SKIN BLOCK WALL (WITH COLUMN)**  
1:5


SEPARATING WALL BETWEEN TWO ANCILLARY SPACES:

1 x 100mm medium density Blockwork  
 Fire Rating: 60 min. to be achieved  
 Acoustic Criteria: N/A  
 Target U value: N/A

REV	DATE	BY	DESCRIPTION	CHKD



PROJECT  
**156 WEST END LANE**

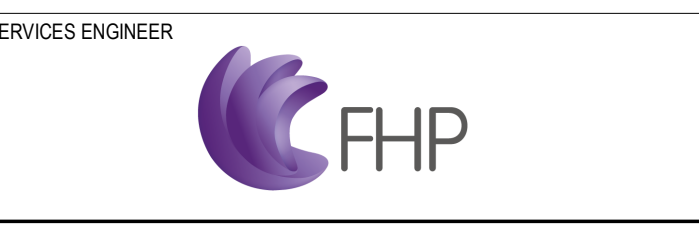

DRAWING TITLE  
**SITOWIDE SHEET 5 OF 7**  
**INTERNAL WALL TYPES**  
 Scale: 1:100

INTERNAL JOB NO	ISSUE DATE	STATUS	DRAWN BY	CHECKED BY
C340WEL	23/09/21	STAGE 4	JC	SS

PROJECT NUMBER	ROLE	ORIGINATOR	TYPE	SERIES	LEVEL	SERIAL	REVISION
0001	A	CTA	DRG	30	ZZ	0005	P01