





Condensing Unit Schedule			
Model No.	Unit Dimensions W x H x D (mm)	Unit Weight (kg)	Electrical Supply
REYQ52U comprising:			
REYQ18U	1240 x 1685 x 765	317	400v / 3ph / 50Hz
REYQ18U	1240 x 1685 x 765	317	400v / 3ph / 50Hz
REYQ18U	1240 x 1685 x 765	317	400v / 3ph / 50Hz
REYQ16U	1240 x 1685 x 765	314	400v / 3ph / 50Hz


Notes:

1. Condensing units to be selected at an outdoor ambient of 35°C (cooling mode); -4°C (heating mode).

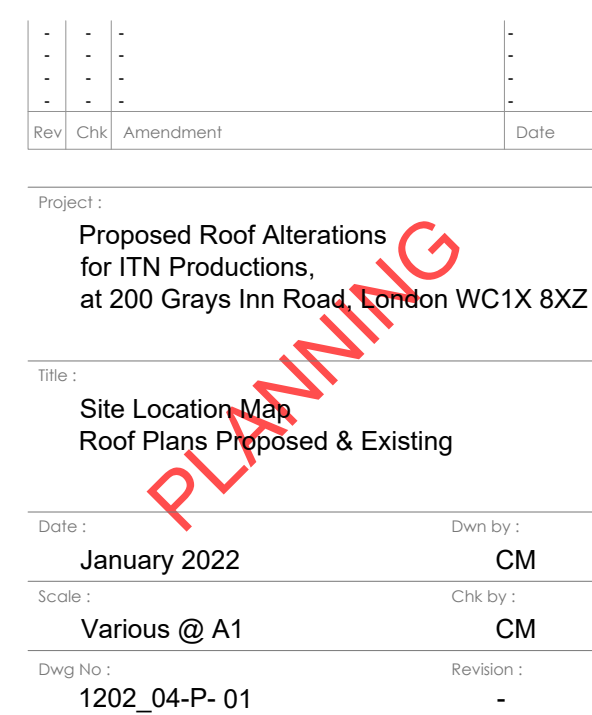


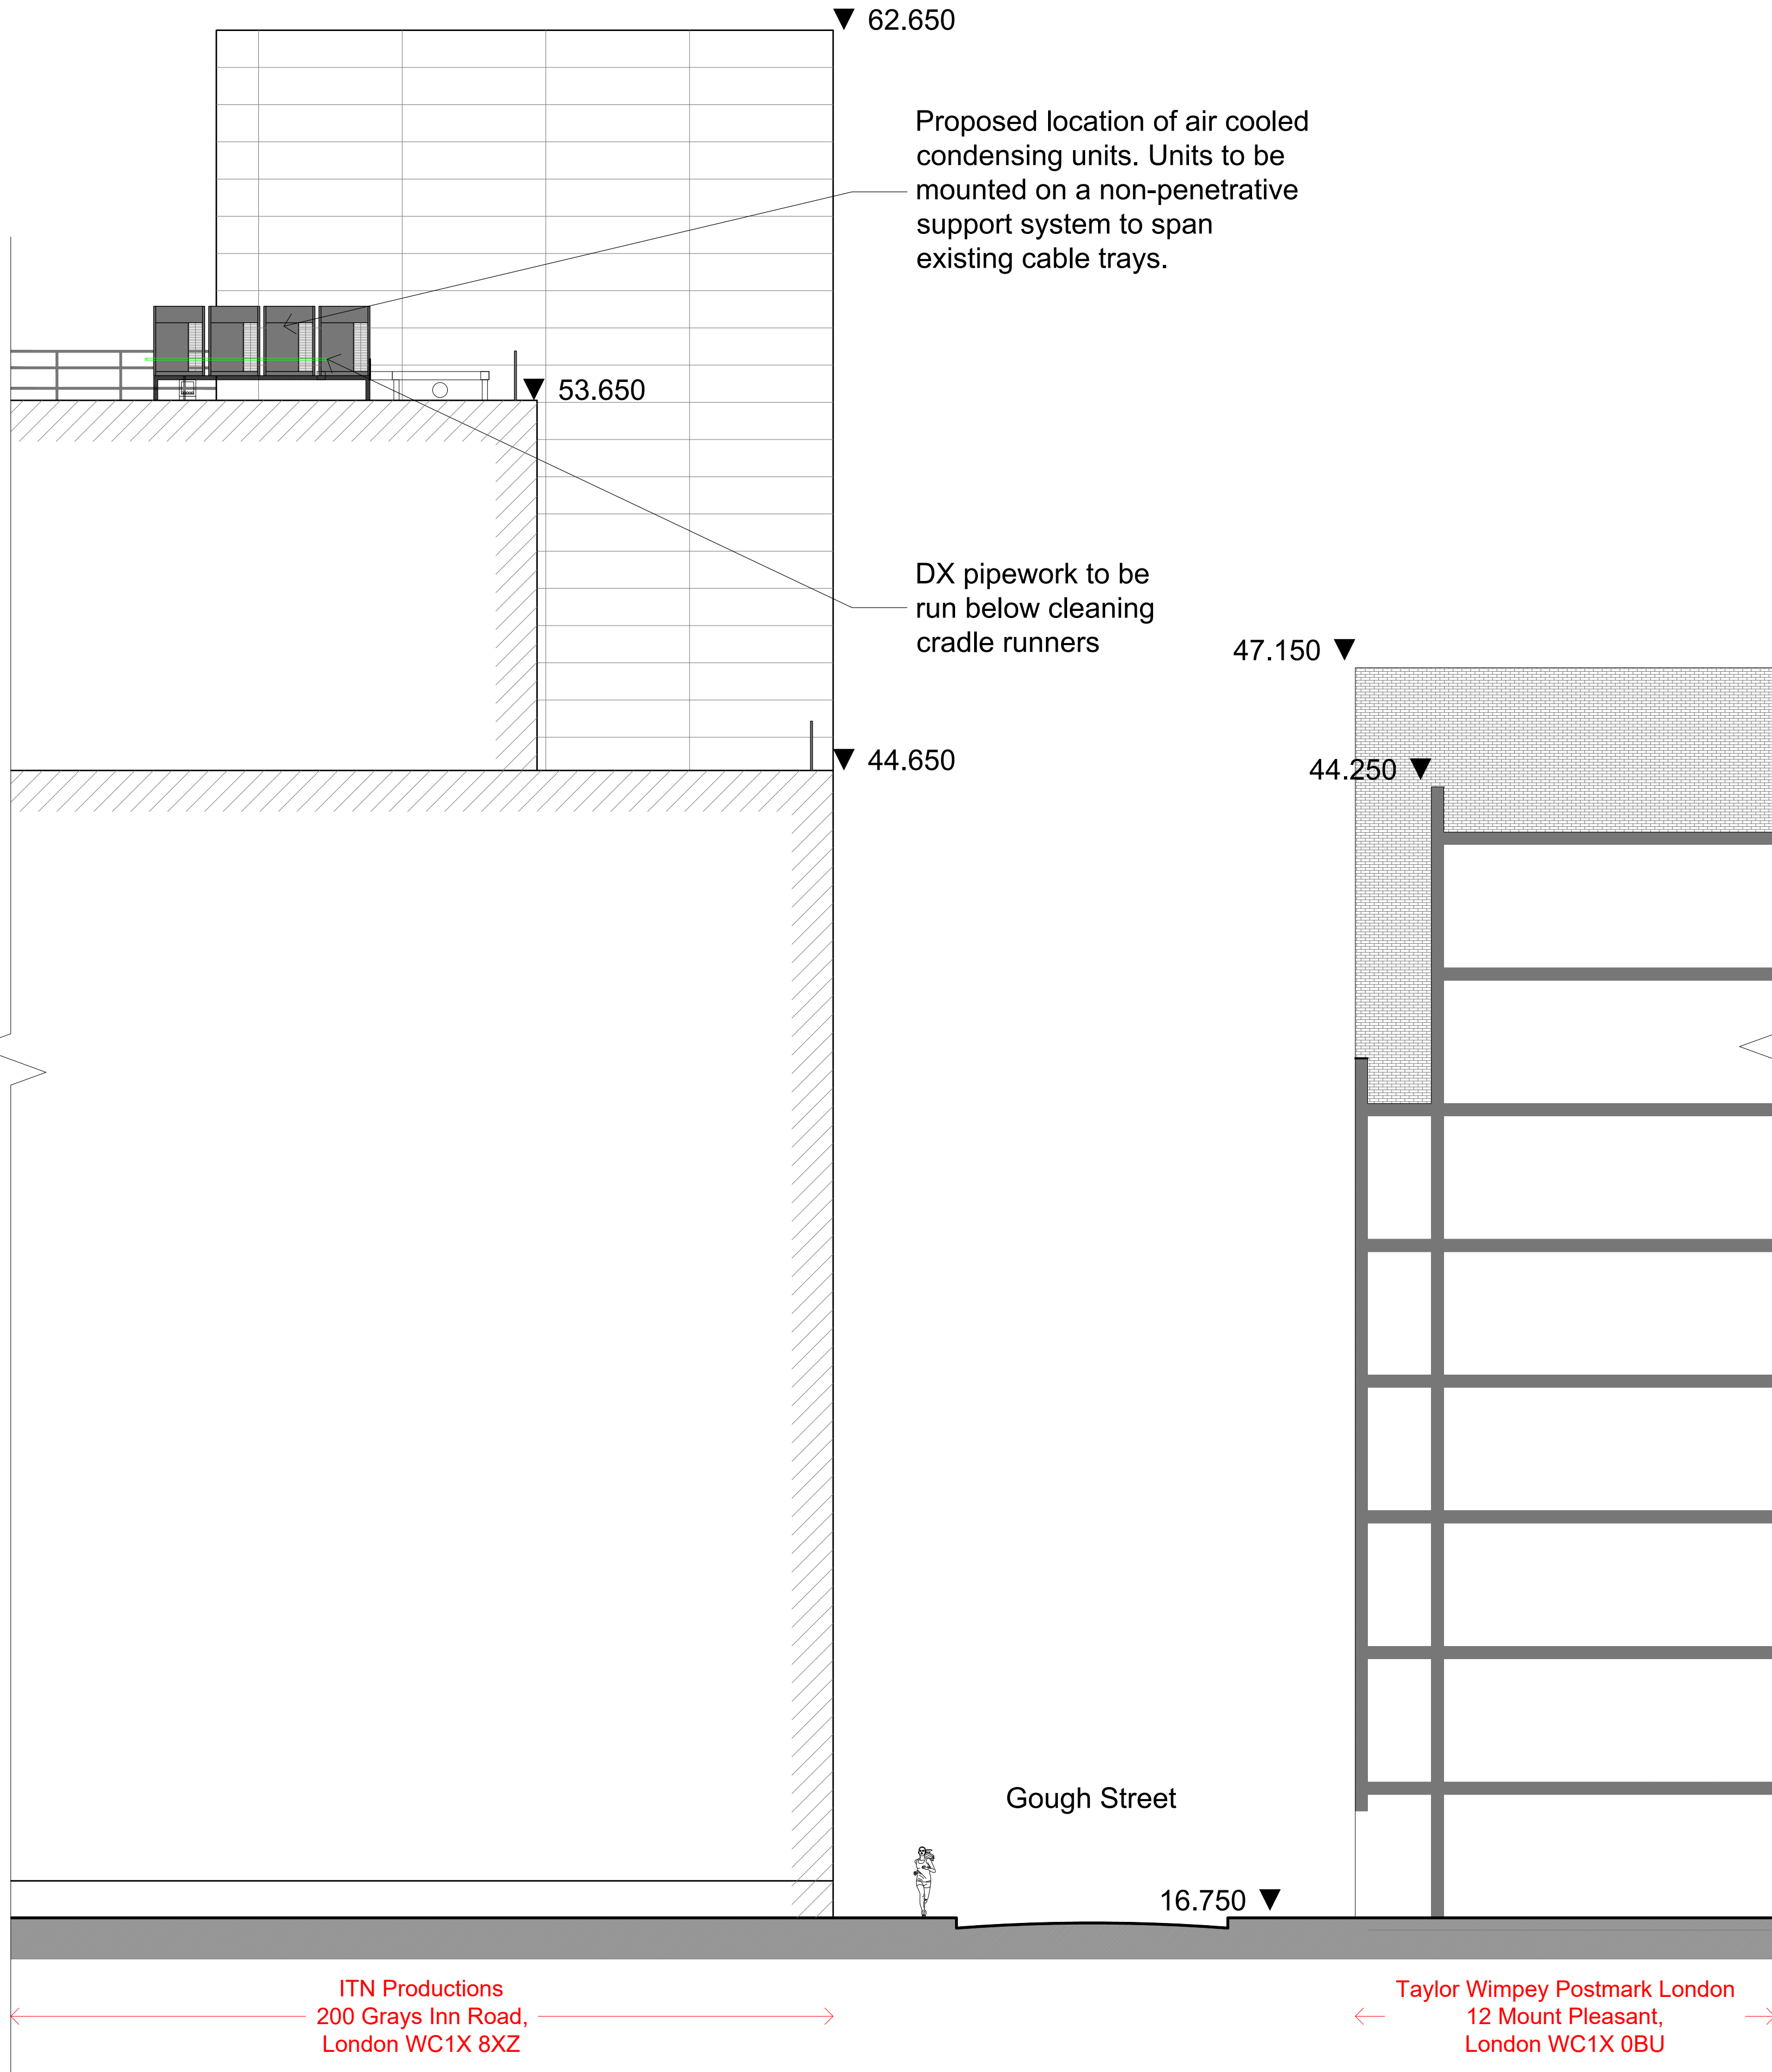


North Elevation
1:100

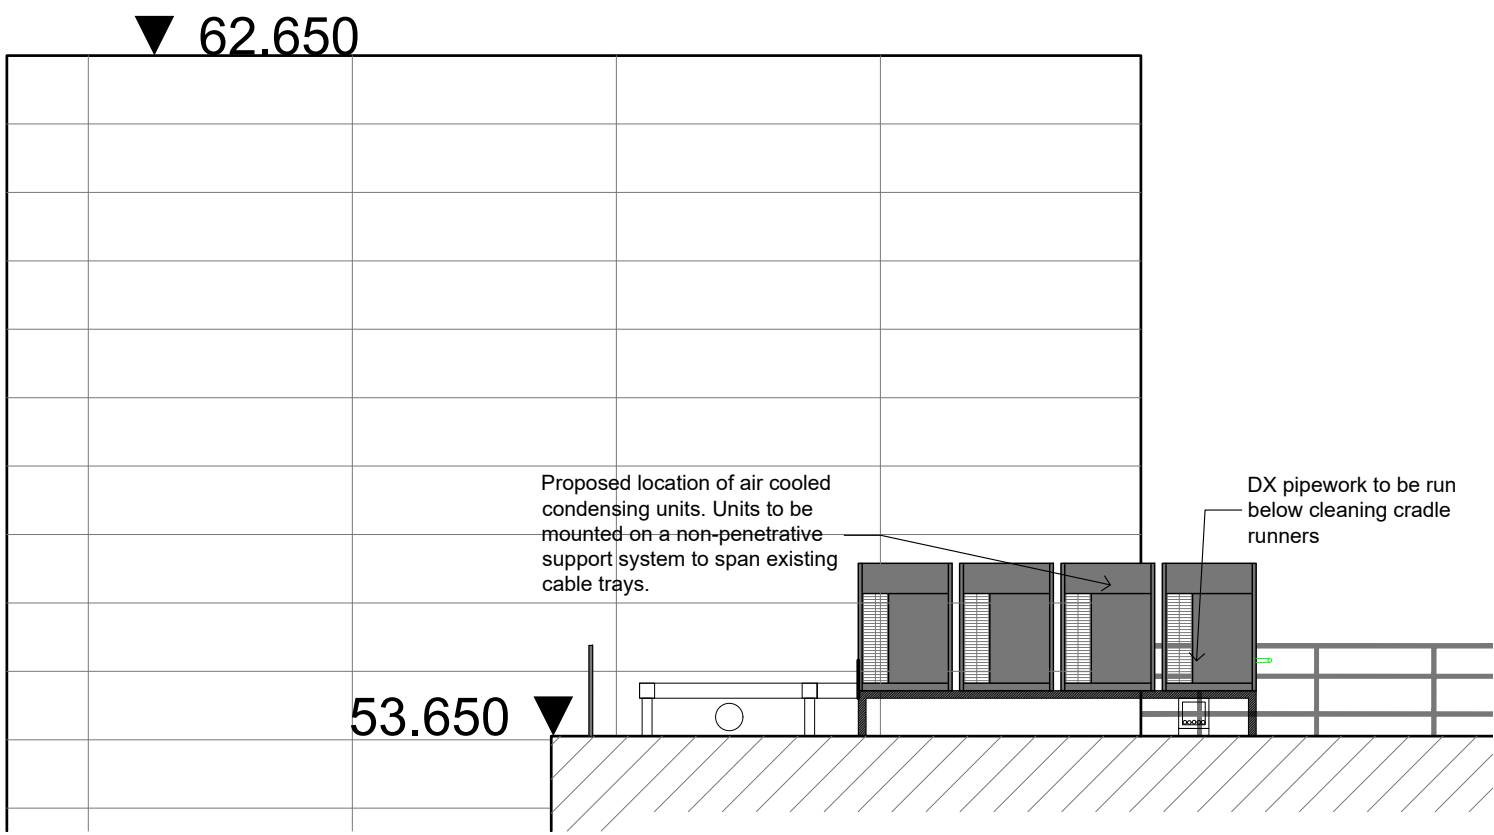





South Elevation
1:100

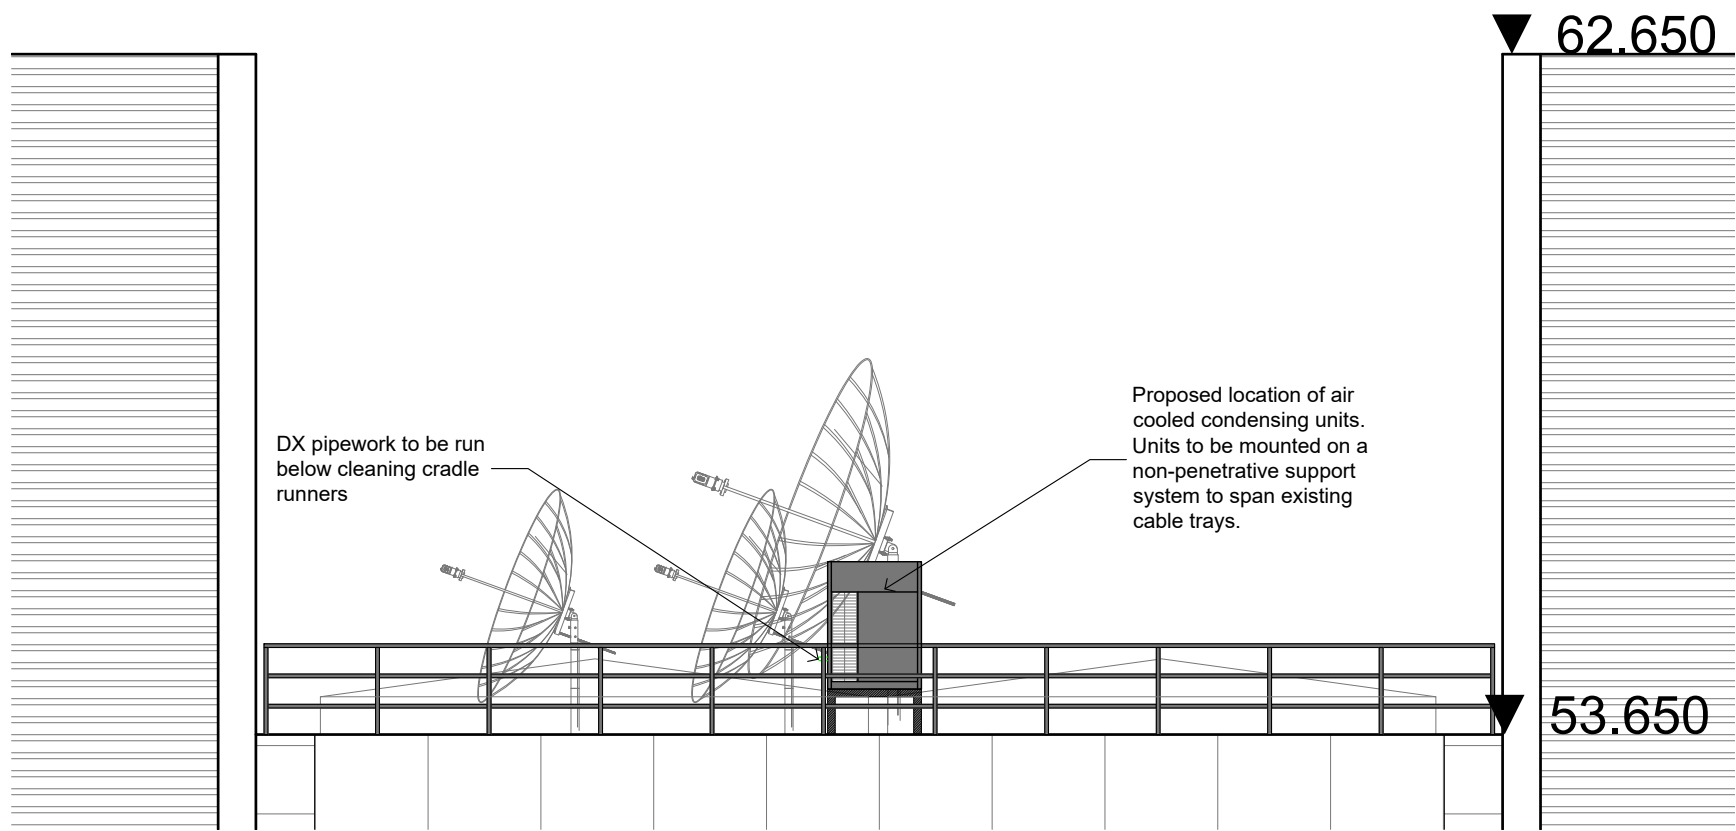

West Elevation
1:100

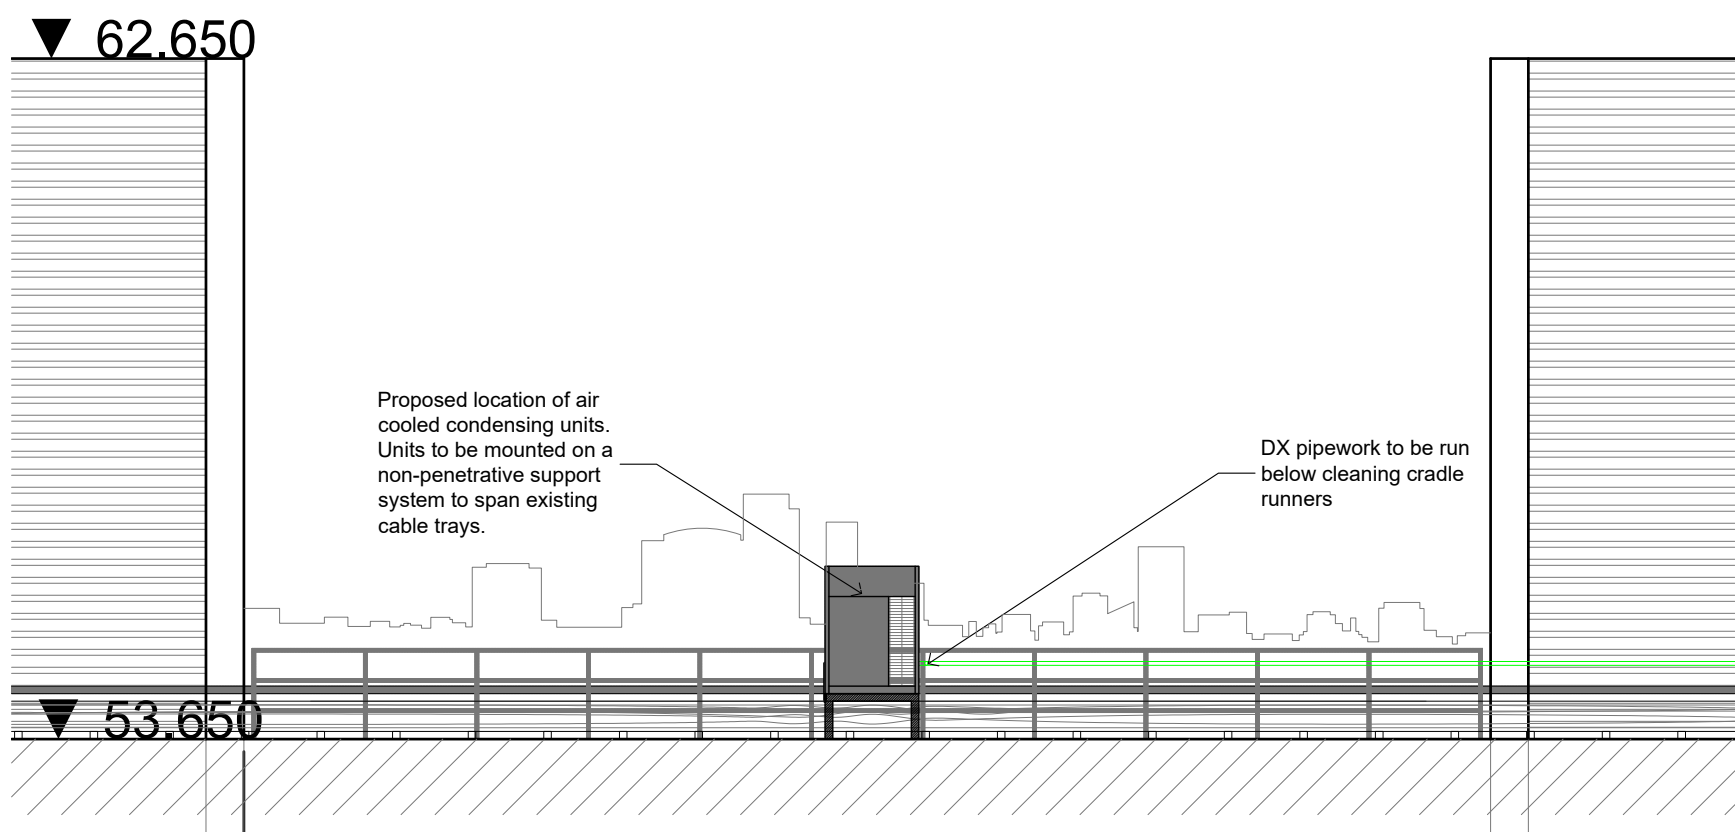

East Elevation
1:100

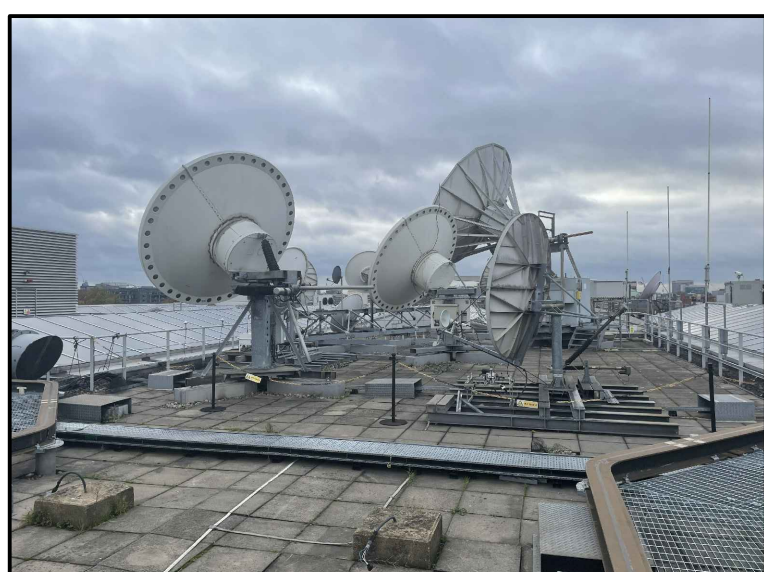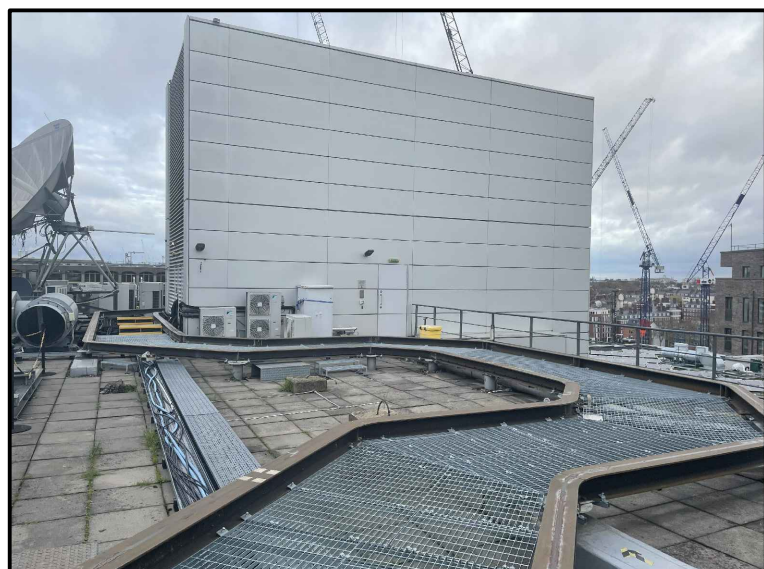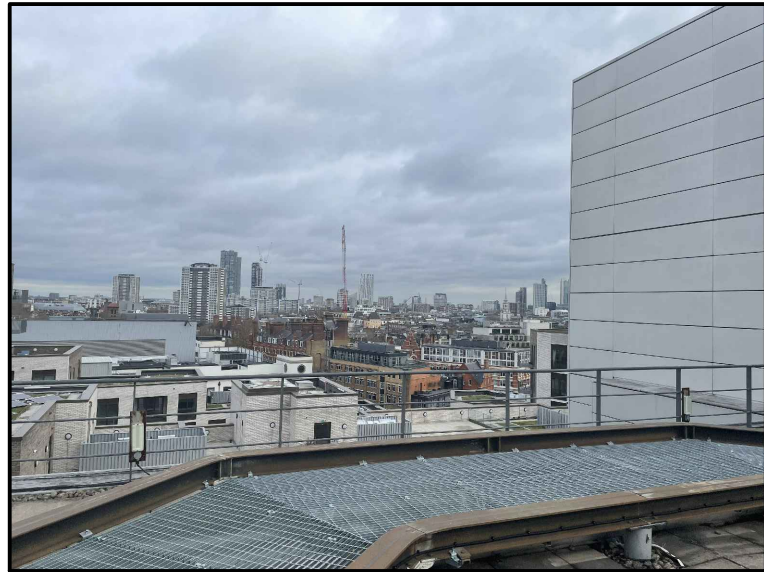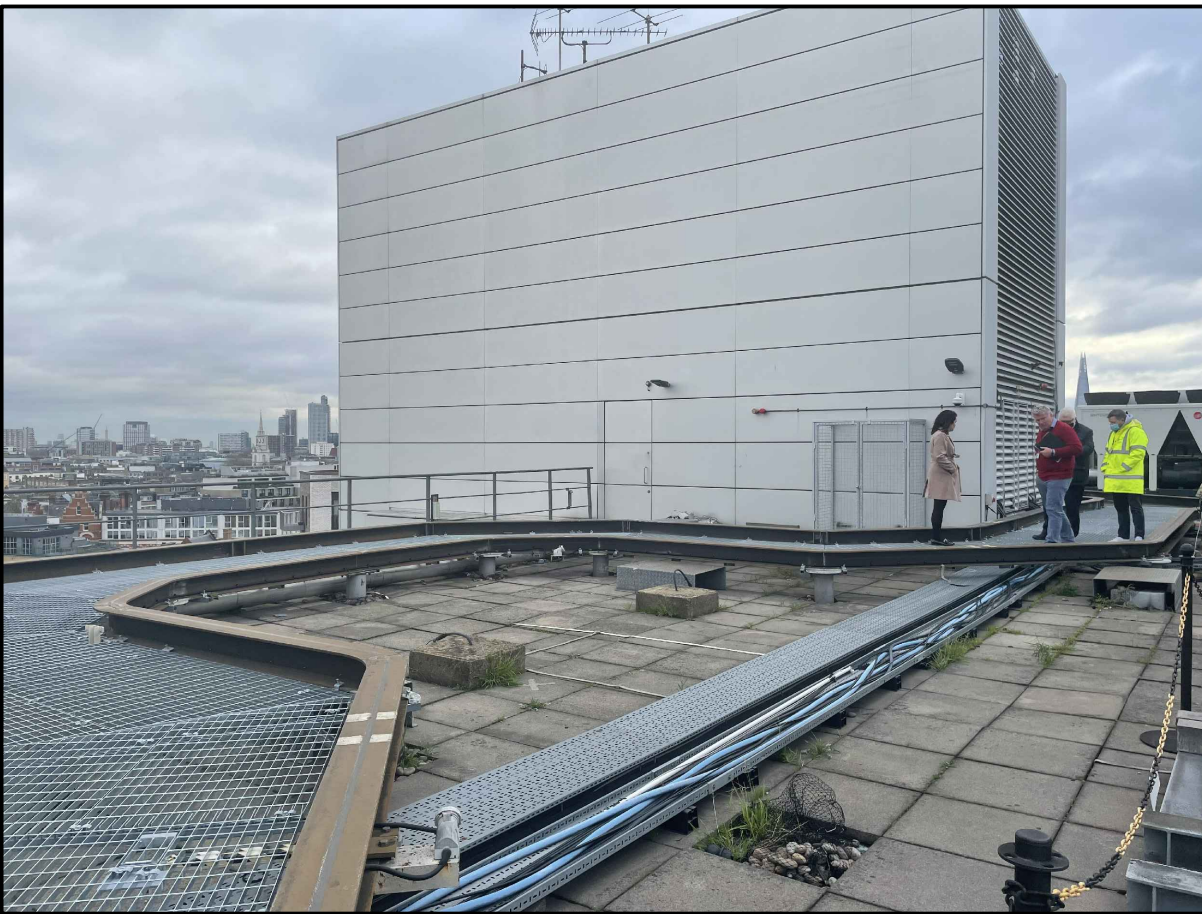

Rev	Chk	Amendment	Date

Project :
Proposed Roof Alterations
for ITN Productions,
at 200 Grays Inn Road, London WC1X 8XZ

Title :
Proposed Elevations

Date :	January 2022	Drawn by :	CM
Scale :	Various @ A1	Chk by :	CM
Dwg No :	1202_04-P-02	Revision :	-

TATE
STEVENSON
ARCHITECTS LTD
STAZ
FILE
VENA

ARCHITECTURE
INTERIORS
DEVELOPMENT CONSULTANCY

Unit 1 Rowdon Court
Maidenhead
SL6 6LQ

Tel: +44 (0)28 9261 1222
Fax: +44 (0)28 9261 3834
Email: studio@tatestevenson.com

© Tate Stevenson 2016