


LEGEND		LEGEND	
TYPE	DESCRIPTION	TYPE	DESCRIPTION
EM2	Emergency integrated non maintained downlight	ex-PR15	Exterior rated suspended profile used in conjunction with ex-LIN2A and ex-LIN2F
LIN2C	Opal linear LED tube 930mm length	ex-PR16	Exterior rated suspended profile used in conjunction with ex-LIN2A and ex-EM2
ex-LIN2A	Opal linear LED tube 1230mm length - exterior rated	S1	Illuminated signage on the facade
ex-LIN2F	Opal linear LED tube 500mm length - exterior rated	SR2	Integrated sensor
PR14	Suspended profile used in conjunction with LIN2C, SR2, EM2	ex-EM2	Emergency integrated non maintained downlight IP rated

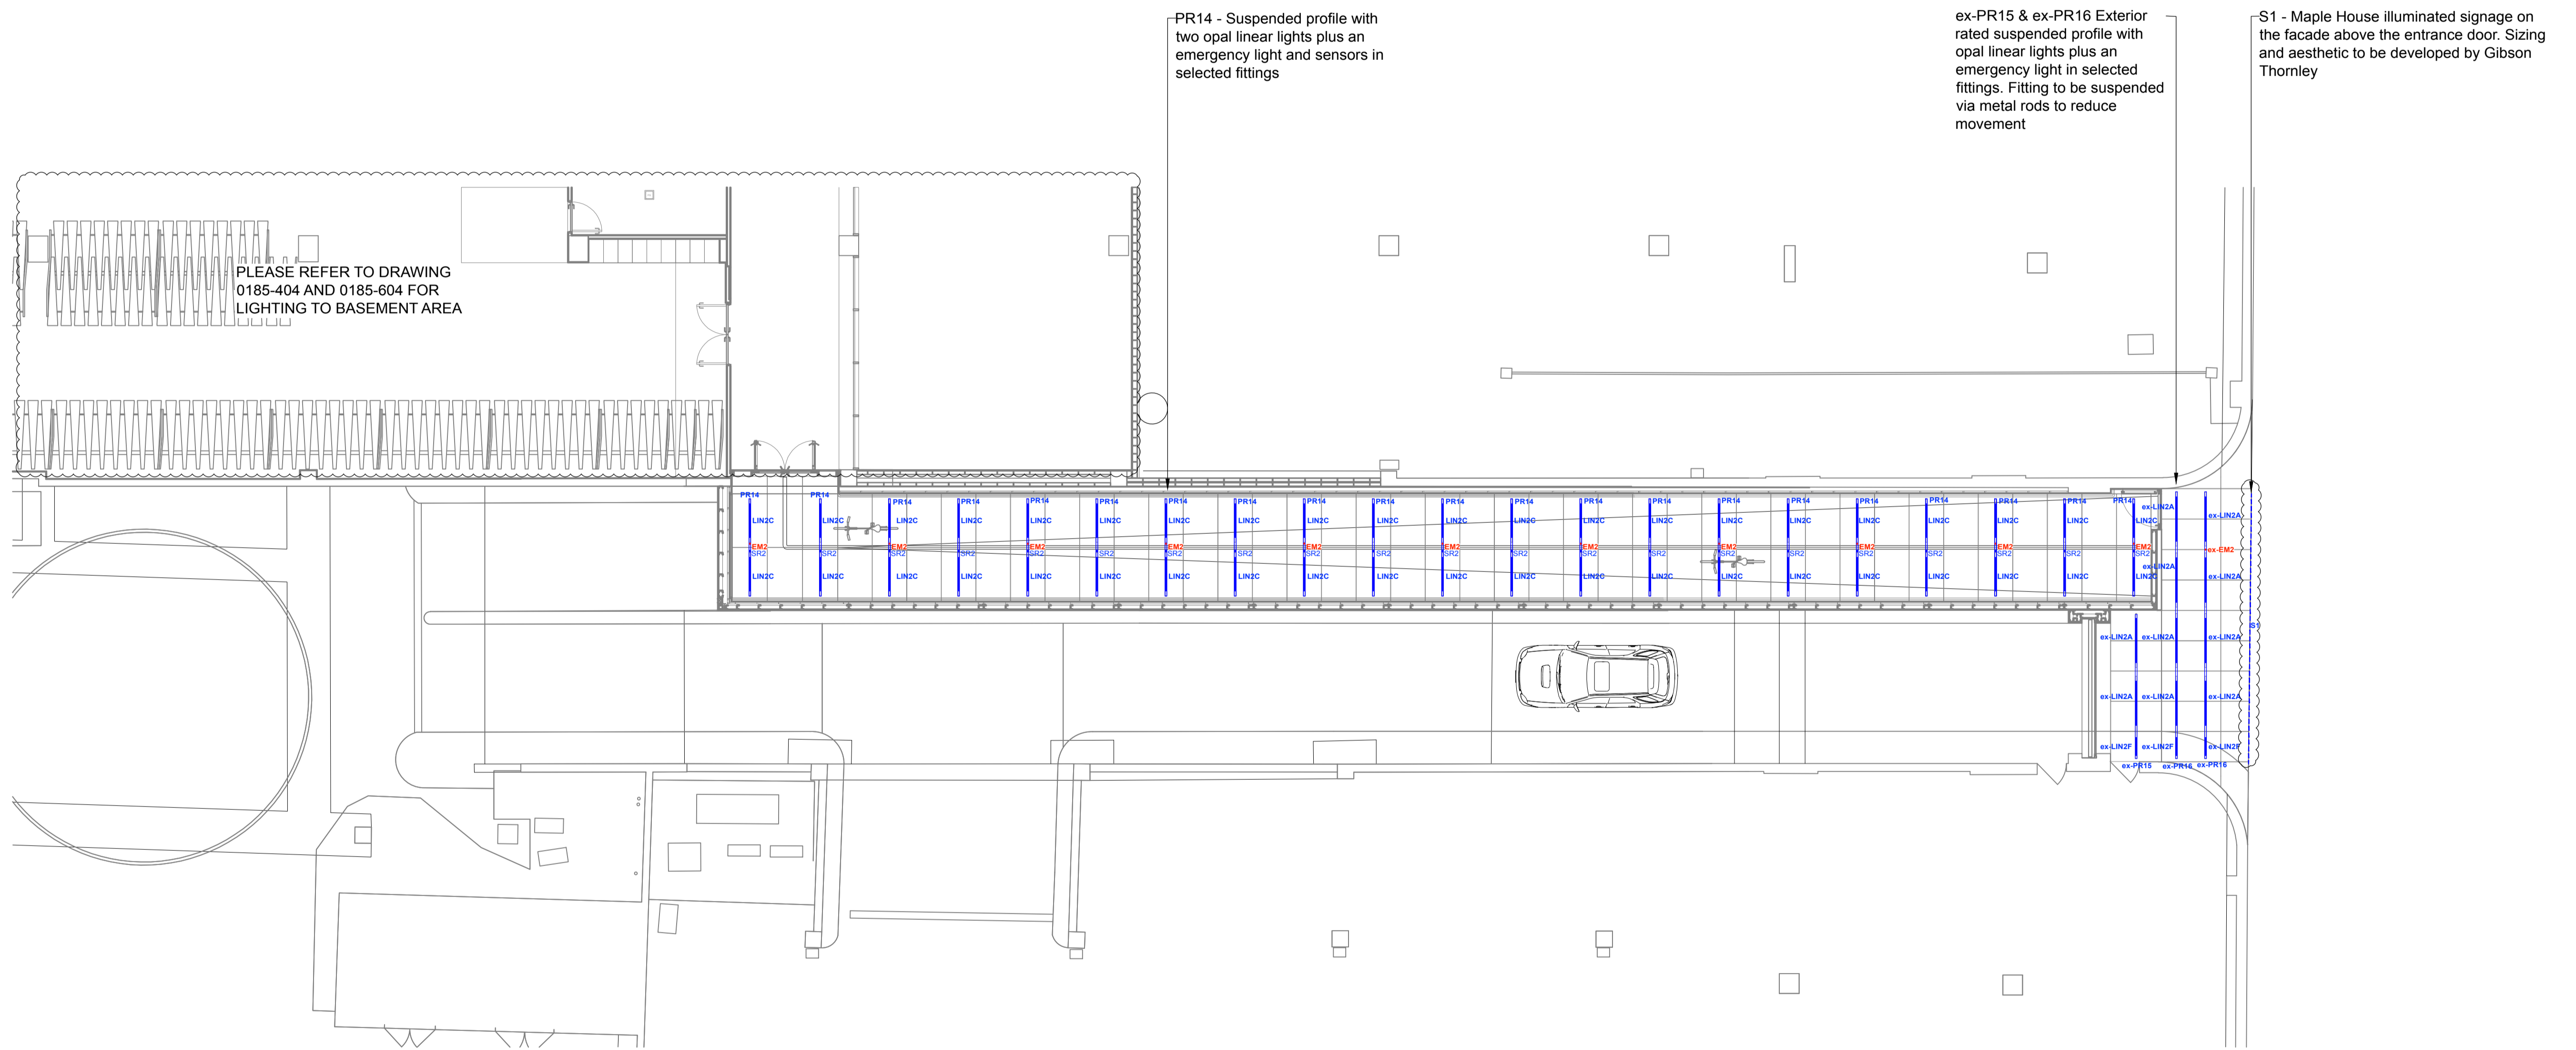

Studio 29 Lighting Design
47 Landford Road, London SW15 1AQ
t: 020 8780 9006 w: studio29lighting.com

Date	Rev	Description
25.02.22	A	Architectural layout and lighting updated to suit
18.02.22	-	First issue as WIP draft

Notes

Location and quantity of SR2 sensors to be confirmed following testing by manufacturer

Important Note

Where Dimensions are not given, drawings must not be scaled.

For complete luminaire breakdown refer to schedules

In the event of conflict between this drawing and lead consultants drawing the matter must be referred prior to proceeding

CLIENT	Lazari Investments	PROJECT NO.	0185
PROJECT	Maple House		
STATUS	Stage 4		
SCALE	1:100 @ A1	DATE	18/02/2022
	1:200 @ A3		
TITLE	Basement Tunnel Lighting RCP		
DRAWING NO.	0185-412	REVISION	A