

KEY:

Boundary of premises

Escape routes

Denotes area to be used for licensable activities

60 min fire rating

60 min fire rating

90 min fire rating

120 min fire rating

Fire & smoke curtain

Area covered by emergency lighting (to BS5266)

Fire Exit Internally Illuminated

Directional Arrow (green)

Internally Illuminated

Sprinkler

Smoke detector

Smoke detector and sounder

Smoke detector, sounder, beacon and speaker

CP Call point

FANP Fire alarm panel

Water extinguisher

CO2 extinguisher

Foam extinguisher

Fire blanket


REFERS TO APPROVED BUILDING REGULATION DOCUMENTATION FOR DETAILS OF:

- Sprinkler locations in line with building control and fire brigade requirements
- Smoke detection in accordance with building regulations
- Emergency lighting in accordance with building regulations

NOTES:

- ALL INTERNAL LAYOUTS SUBJECT TO CHANGE
- ALL SMOKE DETECTION, FIRE RATED ELEMENTS, ESCAPE ROUTES AND SIGNAGE ARE INDICATIVE ONLY AND TO BE CONFIRMED BY THE DRAWINGS TO BE USED FOR LICENSING PURPOSES ONLY

LICENSING	
Client: /	
Project: 4TH floor restaurant & bar, 1& 2 St Giles Square	
Title: Grnd. Floor Licensing Plan	
Drawing No: SMA/300/002	
Scale: 1:100	Size: A1
Date: Oct 2020	Rev:

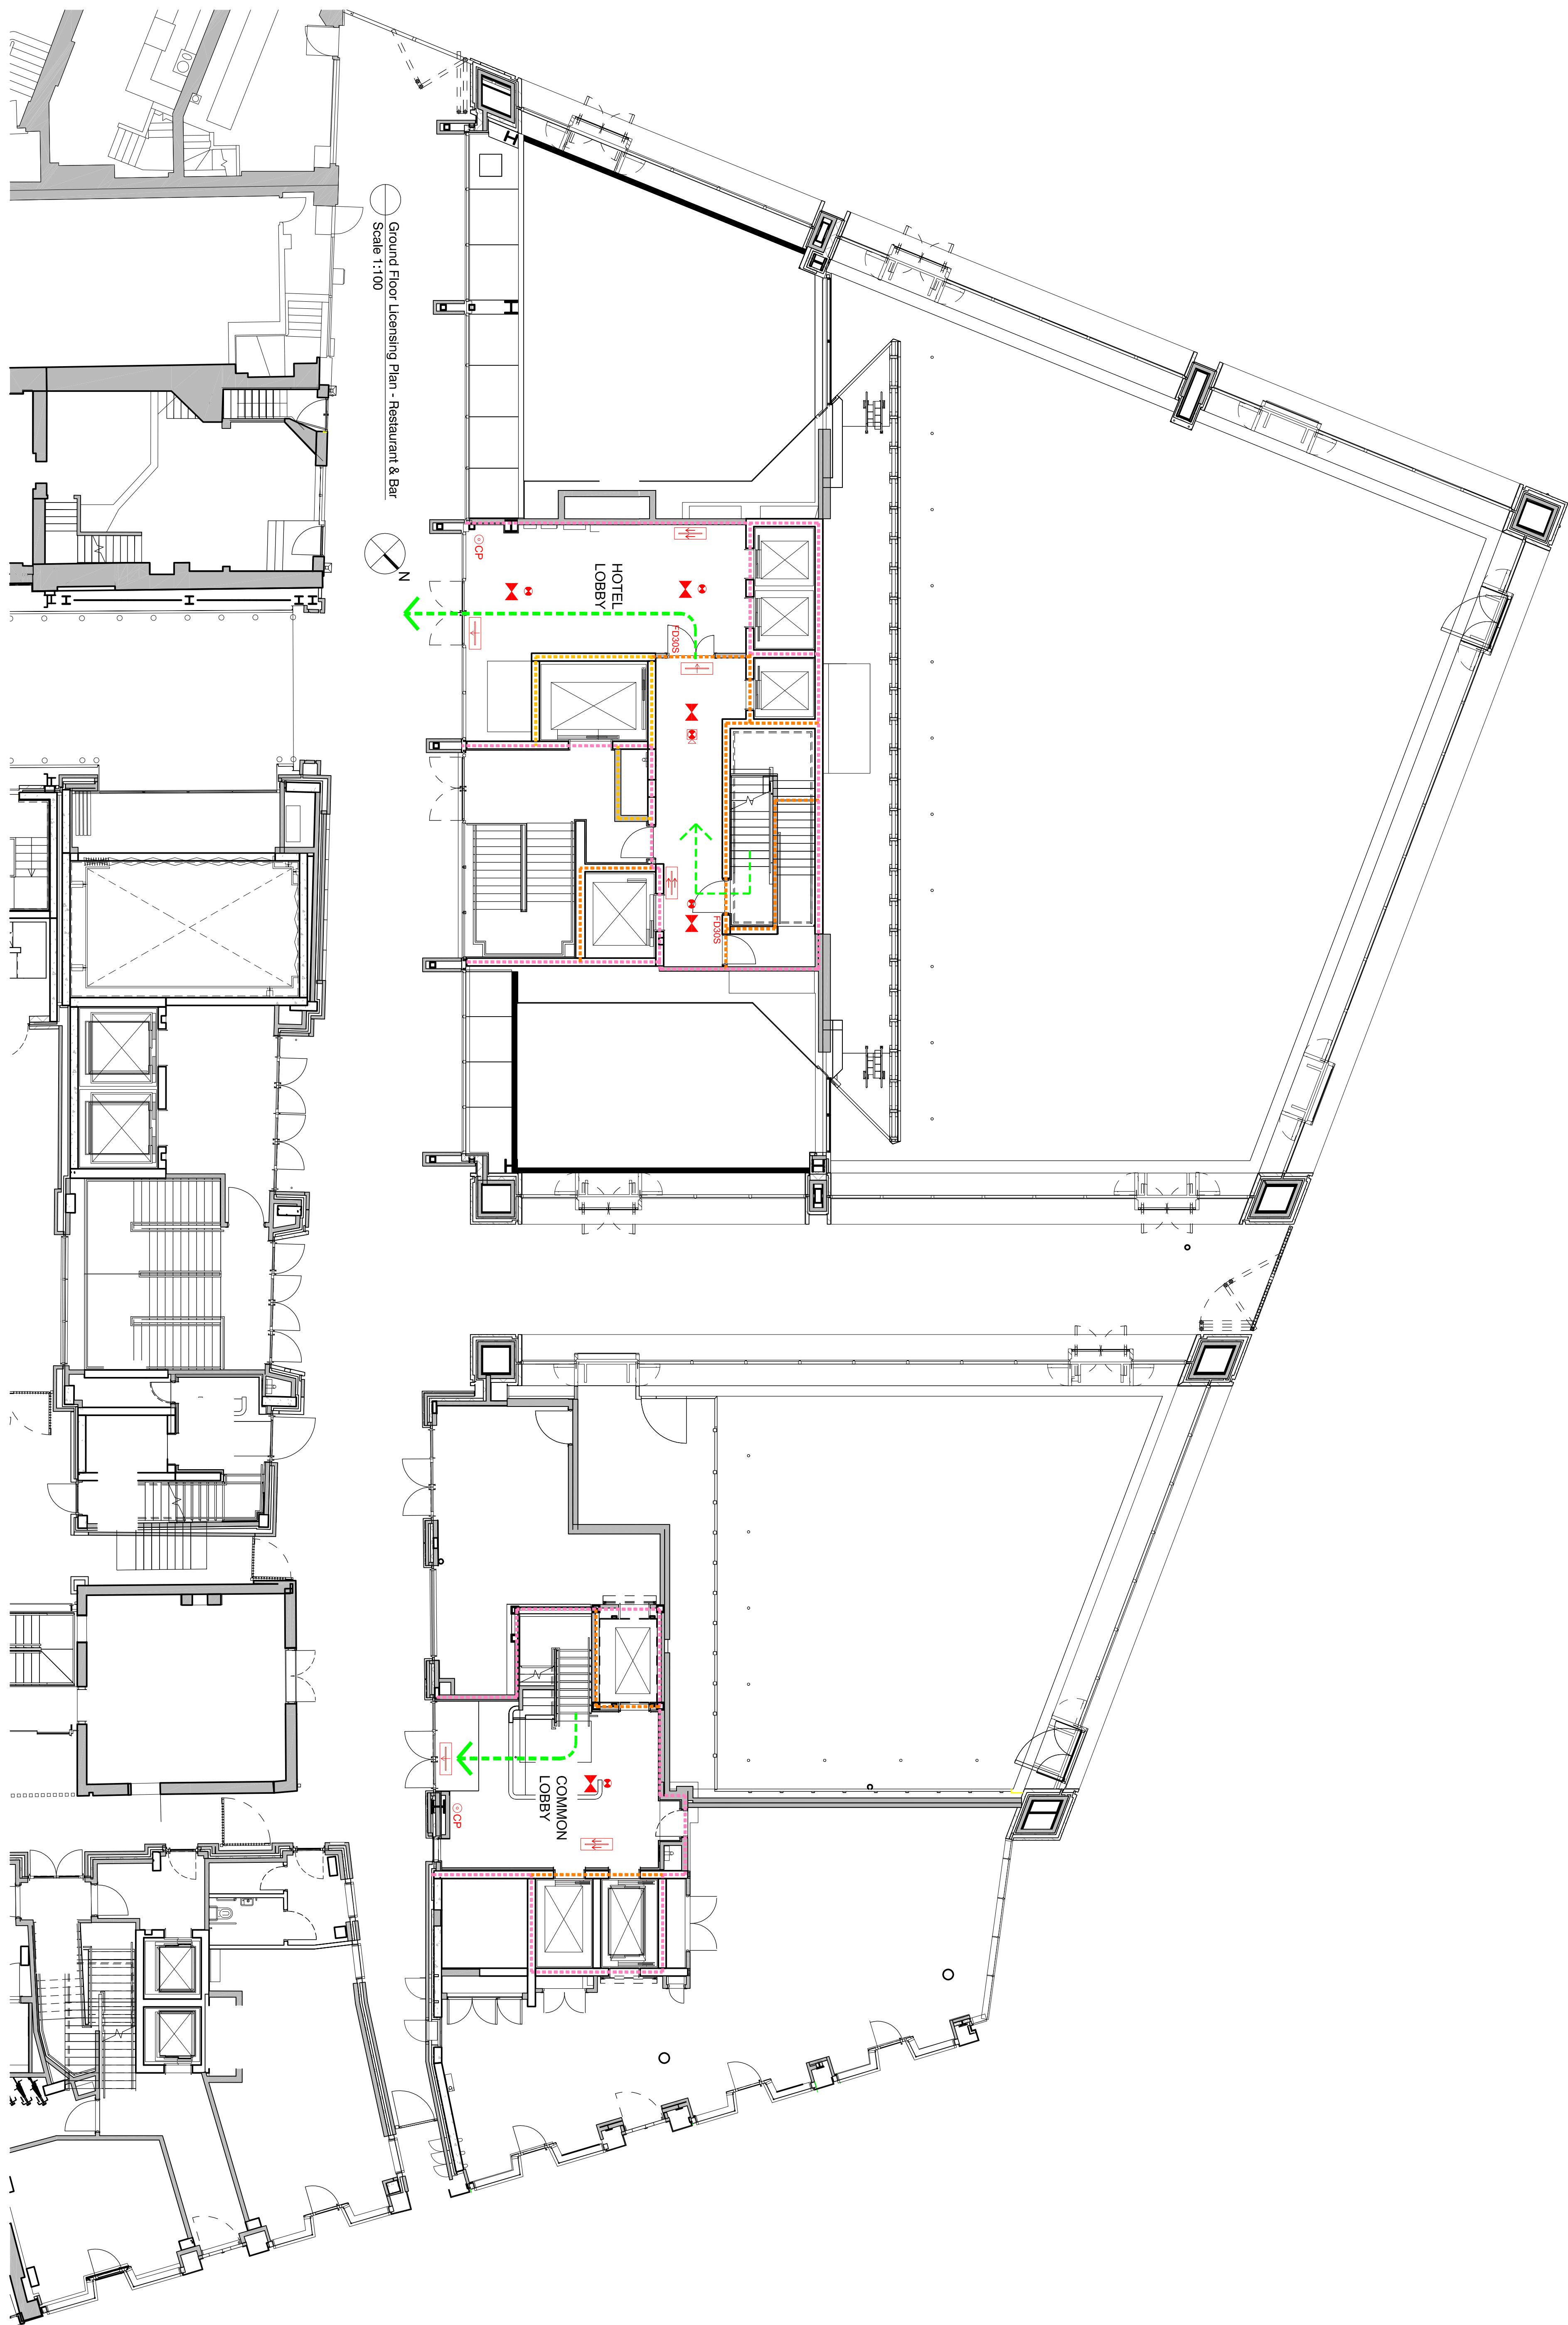

Ground Floor Licensing Plan - Restaurant & Bar

Scale 1:100