


notes

1. DO NOT SCALE FROM THIS DRAWING
2. THIS DRAWING TO BE READ IN CONJUNCTION WITH RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS, OTHER SERVICES DRAWINGS AND SPECIFICATIONS
3. ALL EXTERNAL CWS AND PCW PIPEWORK TO BE TRACE HEATED.

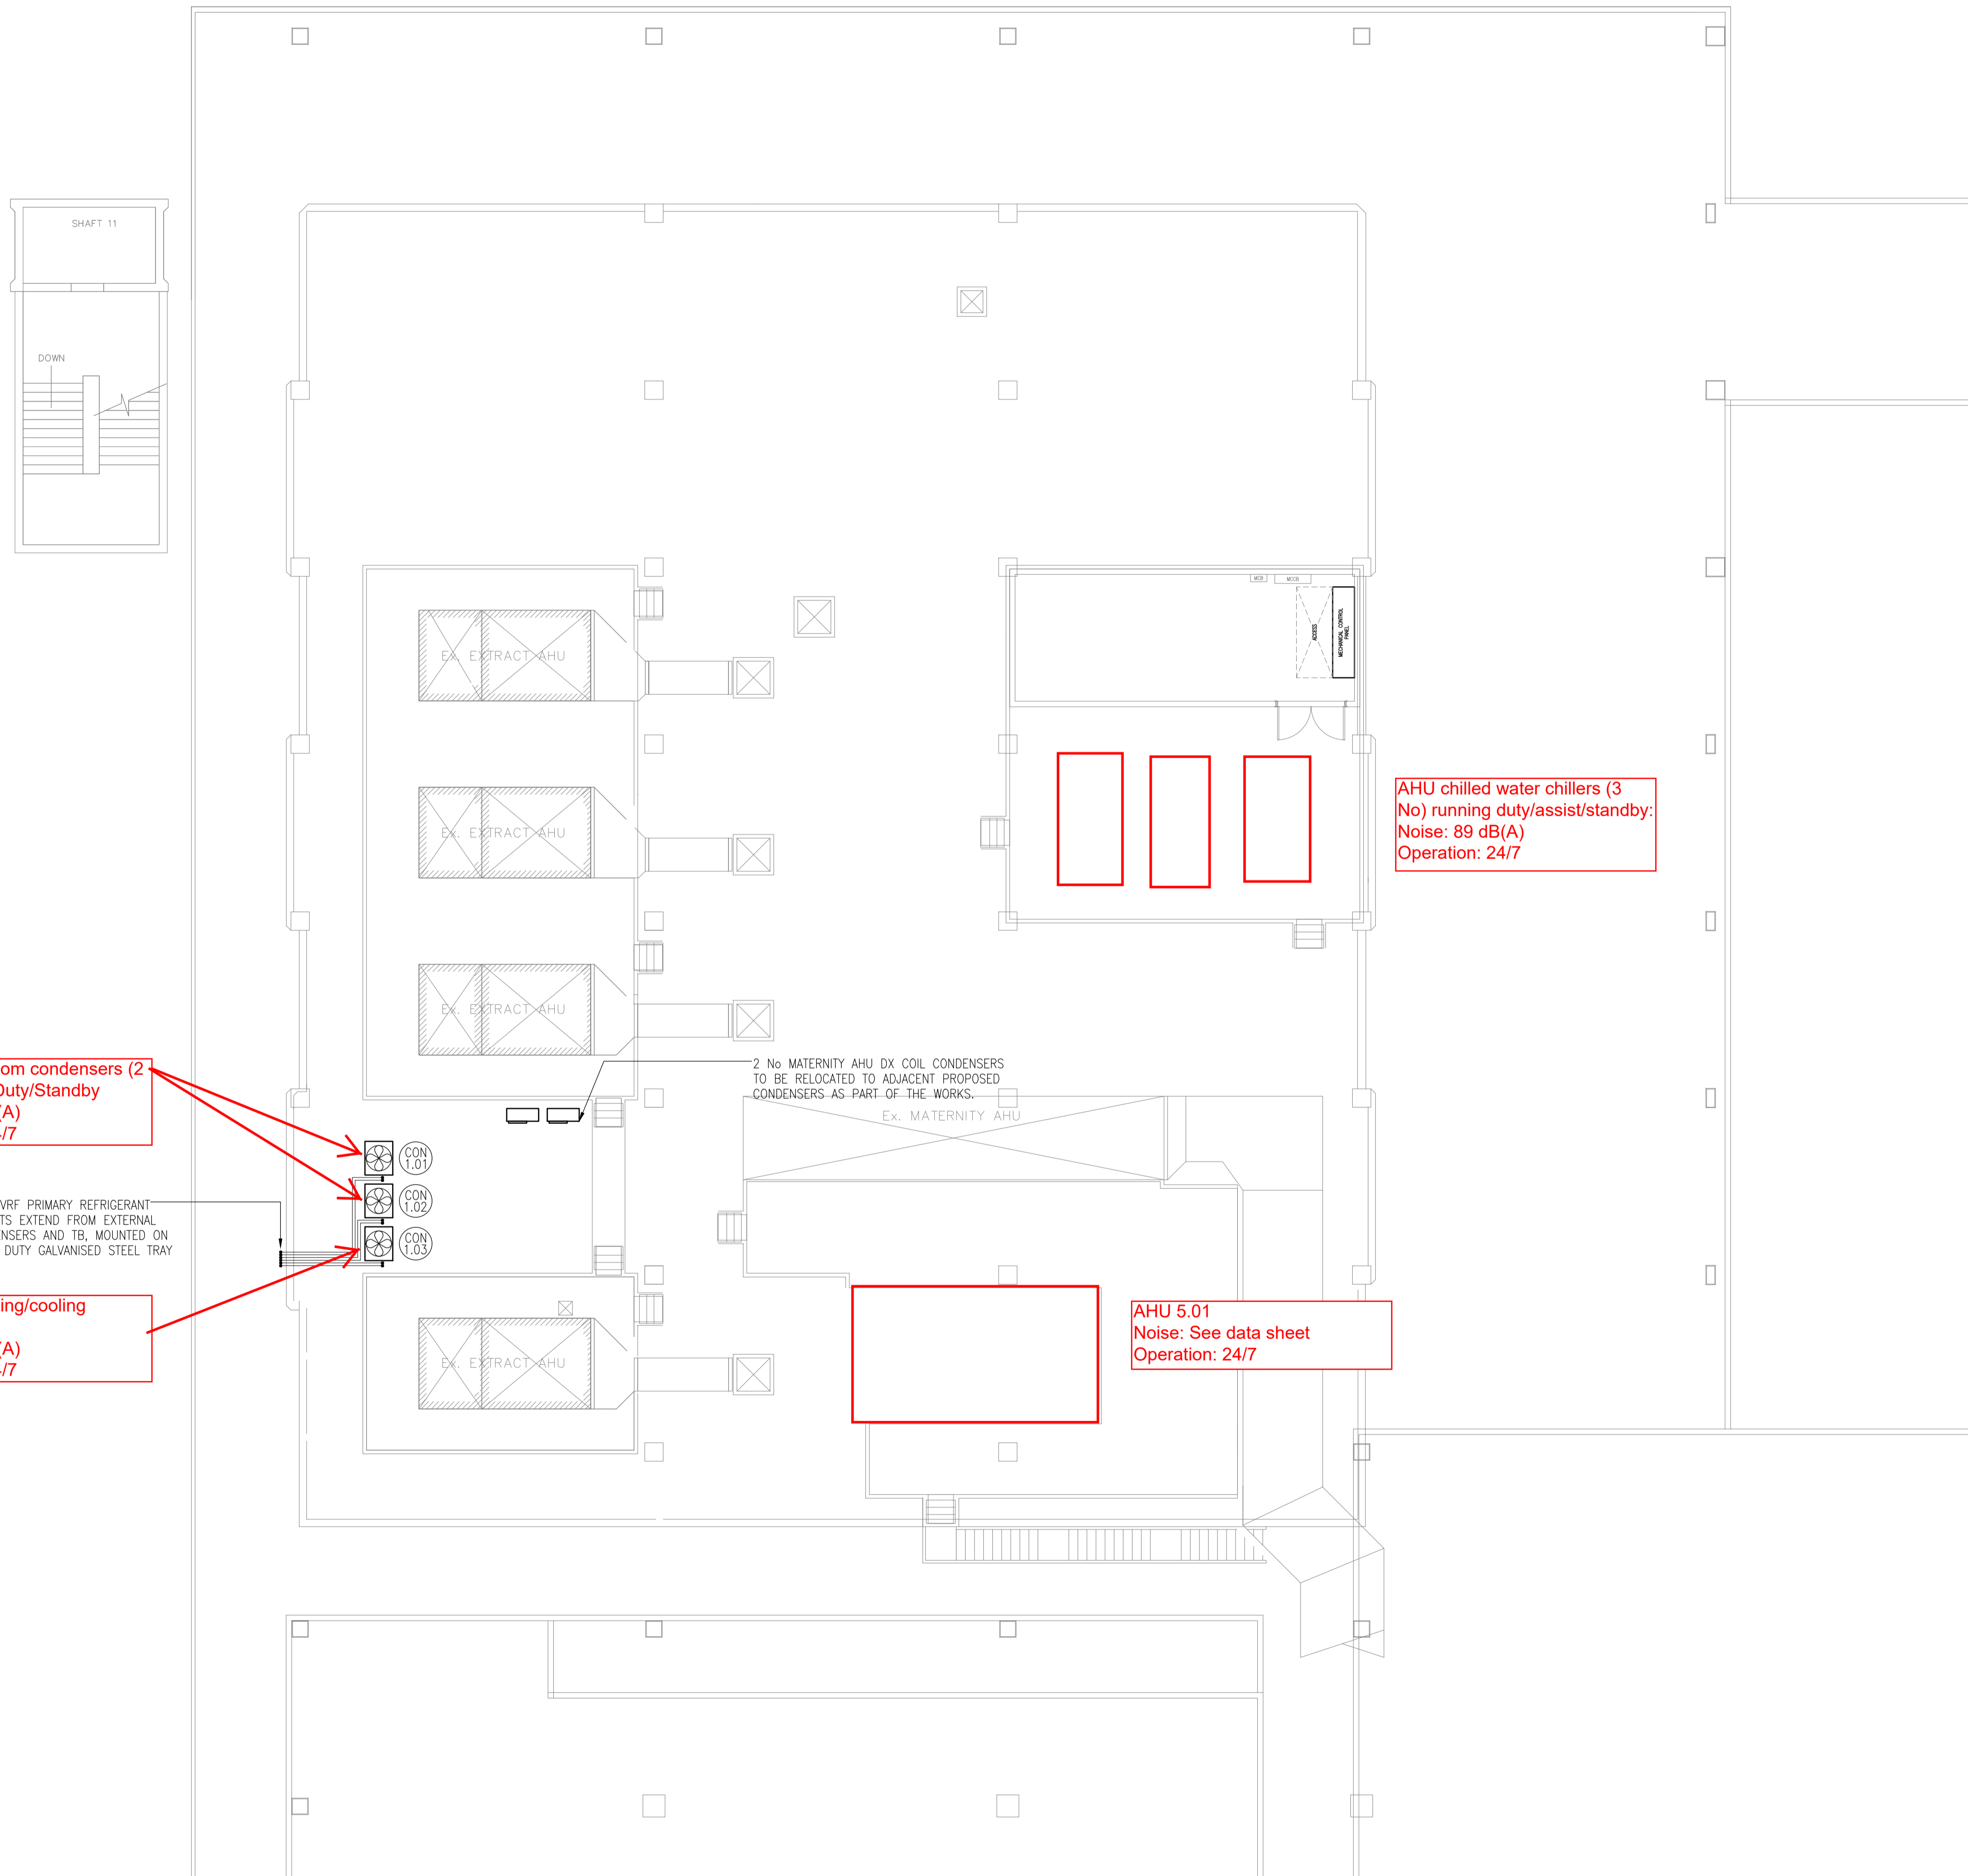

Equipment room condensers (2 No) running Duty/Standby
Noise: 61 dB(A)
Operation: 24/7

General Heating/cooling condenser
Noise: 59 dB(A)
Operation: 24/7

AHU chilled water chillers (3 No) running duty/assist/standby:
Noise: 89 dB(A)
Operation: 24/7

AHU 5.01
Noise: See data sheet
Operation: 24/7

2 No MATERNITY AHU DX COIL CONDENSERS TO BE RELOCATED TO ADJACENT PROPOSED CONDENSERS AS PART OF THE WORKS.


3 No VRF PRIMARY REFRIGERANT CIRCUITS EXTEND FROM EXTERNAL CONDENSERS AND TB, MOUNTED ON HEAVY DUTY GALVANISED STEEL TRAY

T1	18.03.22	TENDER ISSUE	LR	SVC
rev	date	description	dm	chk

The Richard Stephens Partnership Limited
Consulting Engineers

Mill Court
Mill Hill
Edenbridge
Kent TN8 5DB

Tel: 01732 782300
Fax: 01732 782340
E-mail: mail@theRSP.co.uk
Website: www.theRSP.co.uk



client
ROYAL FREE LONDON
NHS FOUNDATION TRUST

architect
ANSELL & BAILEY

project
ROYAL FREE HOSPITAL,
LONDON
IMAGING REFURBISHMENT

title
FIFTH FLOOR
COMFORT COOLING SERVICES LAYOUT

date	DEC 2021	scale	1:100 @ A1
designed	LR	cad	RSP
checked	SVC	approved	

TENDER DRAWING	
drawing no.	rev
2345-RSP-XX-05-DR-M-02051	T1