

160 Camden Road, London, NW1 9HJ  
Subsidence Management Services

GEOTECHNICAL

# GEOTECHNICAL

## for Subsidence Management Services

160 Camden Road, London, NW1 9HJ

Client: Subsidence Management Services


Client Contact: Peter Moore

Client Ref: [REDACTED]

Report Date: 20 January 2016

Our Ref: [REDACTED]


### Site Plan

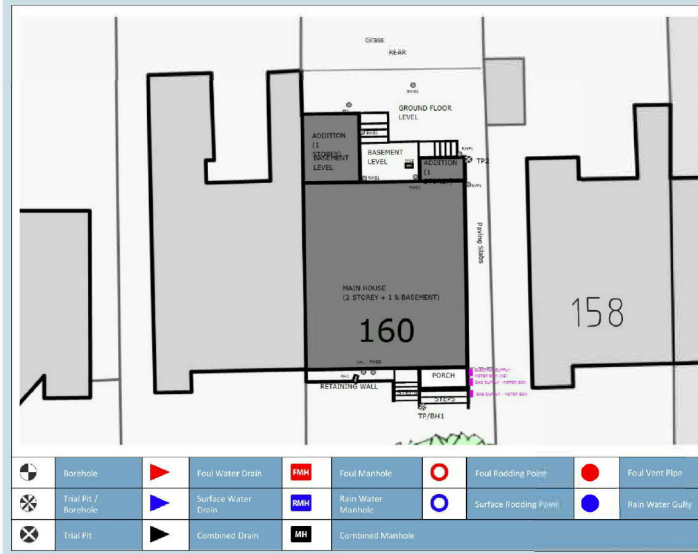


160 Camden Road, London, NW1 9HJ  
Subsidence Management Services

GEOTECHNICAL

## Site Plan

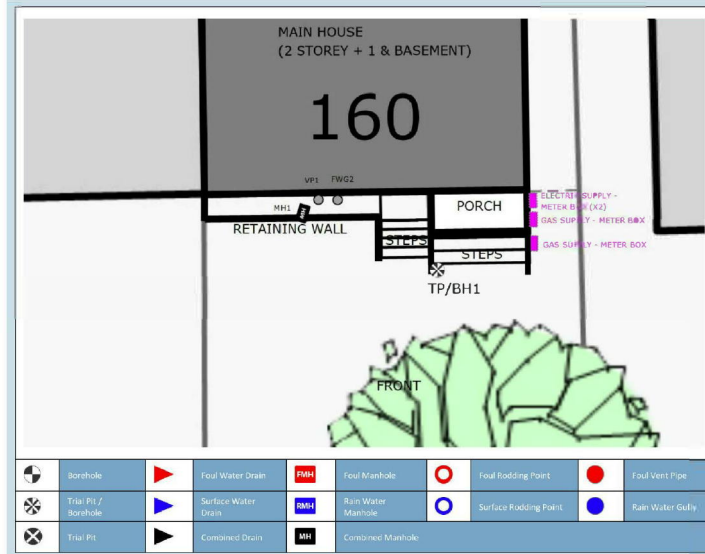

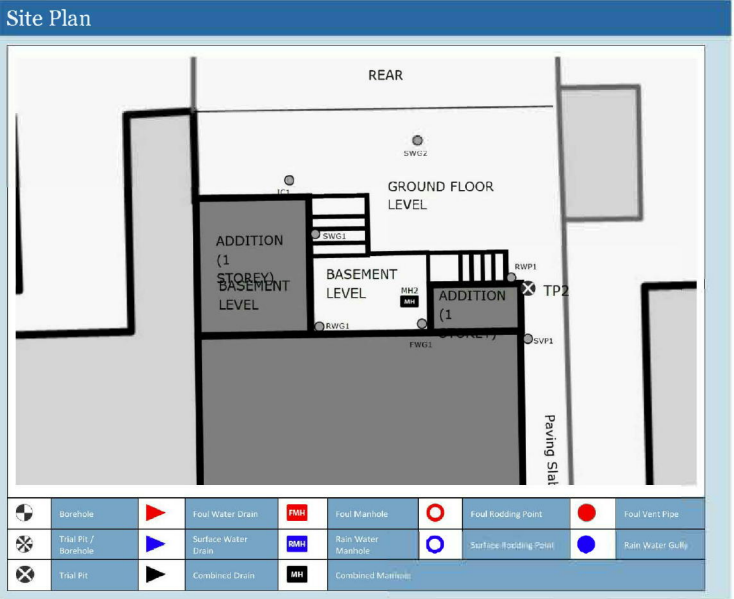



### Foundation Detail

-- End of borehole at 1.20m --  
 Trial pit excavated to 1.20m bgl. Trial pit completed by hand held percussive window sampler. Root  
 encountered to 1.20m bgl. Groundwater strikes not encountered.

## Site Observations

### GENERAL:

Site Investigation works (TP/BH1) undertaken on 3 November 2015 during dry weather (i.e. no rain).  
Site Investigation works (TP2) undertaken on 23 November 2015 during dry weather (i.e. no rain).

### HEALTH AND SAFETY:

Negative signal obtained in Power and Radio mode on the Cable Avoidance Tool (CAT) at TP/BH1 and TP2.

Blue unidentified type of plastic pipe (90mm dia) running parallel to wall (0.10m from wall) at 0.15m bgl in TP2. Suspected water supply pipe.

Grey unidentified type of metal pipe (30mm dia) running parallel to wall (0.35m from wall) at 0.40m bgl in TP2. Suspected electricity supply.

### DRAINAGE:

The rainwater downpipe (RWP1) was encountered not connected to the sub-surface drainage system and discharging to ground surface.

### FOUNDATIONS:

Excavation did not expose the underside of the Porch/ Steps foundation. The underside of foundation (USF) was estimated to be 2.20m bgl in TP/BH1. The underside of the foundation was not exposed or confirmed due to being unable to safely extend trial pit to the underside of foundation (USF).

Addition foundation was partially exposed to 1.20m bgl but the underside of foundation (USF) was unable to be confirmed or checked in TP/2. The foundation was not exposed or underside confirmed due to buried services within the trial pit.

### BOREHOLE:

Hand Held Percussive Window Sampler refusal at 3.50m bgl due to soil stiffness within the clay in TP/BH1. Borehole terminated. No further works undertaken.

### SOILS:

Made Ground deposits were encountered below the estimated underside of foundations extending to a depth of 2.90m bgl in TP/BH1.

### ROOTS:

Roots encountered to 2.90m and 1.20m bgl in TP/BH1 and TP/2.

### INSITU TESTING:

Hand Penetrometer (PEN) not undertaken from 2.20m to 2.90m bgl in TP/BH 1 due to the soils granular content. Hand Penetrometer (PEN) undertaken at 3.20m bgl and 3.50m bgl within the window sampler only in TP/BH1.

Mackintosh Probe (MP) test undertaken at 2.20m bgl within the hand auger borehole and thereafter in the window sample borehole at 3.10m and 3.50m bgl only in TP/BH1.

### WATER STRIKES:

No water strike/s (NWS) encountered in TP/BH1 and TP/2.

The groundwater observations do not necessarily indicate equilibrium conditions. It should be appreciated that groundwater levels are subject to both seasonal and weather induced variations. Other effects such as construction activities may also change groundwater levels.

## ROOT IDENTIFICATION

for Subsidence Management Services

160 Camden Road, London, NW1 9HJ

Client: Subsidence Management Services  
Client Contact: Peter Moore  
Claim Number: [REDACTED]  
Client Reference: [REDACTED]

Report Date: 6 November 2015  
Our Ref: [REDACTED]



Inter: [REDACTED]

Sub Sample	Species Identified	Root Diameter	Starch
<b>TP/BH1:</b>			
2.2-2.9m	<i>Platanus</i> spp.	1	2 mm Moderate

**Comments:**

1 - Plus 4 others also identified as *Platanus* spp.

*Platanus* spp. include London plane and Oriental plane.

**Signed:** M D Mitchell

Unless we are otherwise instructed in writing, the above sample material will normally be disposed of 6 years after the date of this report.



# SOIL ANALYSIS

## for Subsidence Management Services

**160 Camden Road, London, NW1 9HJ**

Client: Subsidence Management Services

Client Contact: Peter Moore

Claim Number:

Report Date: 20 November 2015

Our Ref:

Compiled By:

Checked By:

Test Commenced: 13 November 2015

Test Completed: 20 November 2015


Days in Contact: 7



**Note**


Where appropriate moisture contents have been corrected to demonstrate the equivalent moisture content following the sample being passed through a .425 mm sieve for comparison with the Liquid & Plastic Limit. Where this is not available, uncorrected moisture contents have been used in the graph on the following page.

Lab Ref	Depth (m)	MC (%)	Corr MC (%)	LL (%)	PL (%)	PI (%)	% Passing .425mm
Samples from TP/BH1							
001	2.20	27	28	60	23	37	96
002	2.70	28					
003	2.90	13	13	54	27	27	97
004	3.20	24	24	58	25	33	99

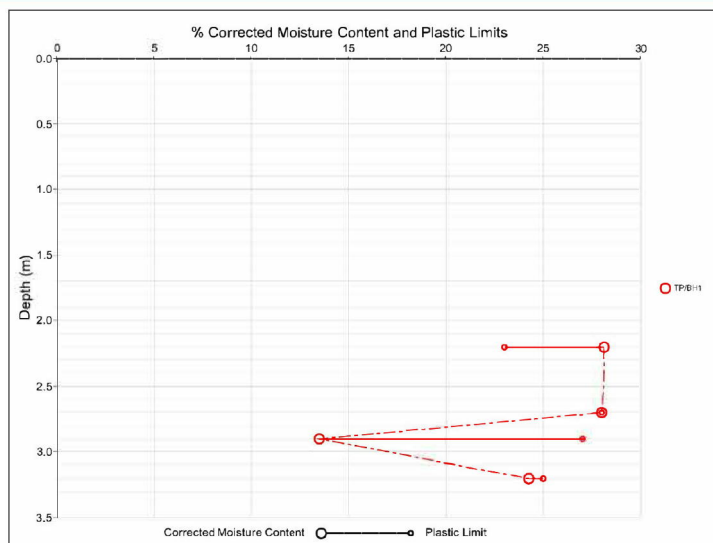**Corrected Moisture Content and Plastic Limits Graph**


Lab Ref	Depth (m)	Description	BS:5930	NHBC Chapter 4.2
Samples from TP/BH1				
001	2.20	Brown CLAY with rare sand and fine gravel including brick fragments and clinker	CH	Medium
002	2.70	Brown CLAY with occasional sand and fine gravel including brick fragments and clinker		
003	2.90	Brown slightly sandy CLAY with occasional fine to medium gravel including flint	CH	Medium
004	3.20	Brown CLAY with rare sand and fine gravel	CH	Medium

Plasticity Chart for Casagrande Classification

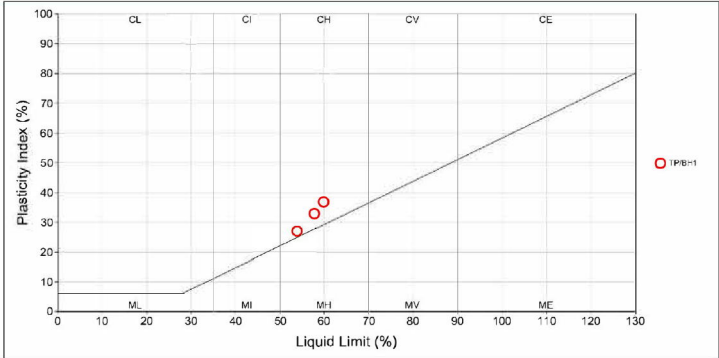


Lab Ref	Depth (m)	Filter Paper	Bag Weight (g)	Bag + Wet Filter (g)	Bag + Dry Filter (g)	Oven Dry Filter (g)	Water Content (%)	Suction (kPa)	Average (kPa)
Samples from TP/DH1									
001	2.20	Top	1.238	1.492	1.417	0.179	41.709	176.088	190.865
		Middle	1.235	1.362	1.324	0.090	42.346	160.715	
		Bottom	1.207	1.453	1.383	0.176	39.670	235.794	
002	2.70	Top	1.227	1.344	1.310	0.084	40.719	202.911	237.357
		Middle	1.234	1.360	1.324	0.090	40.535	208.330	
		Bottom	1.238	1.363	1.329	0.091	37.969	300.831	
003	2.90	Top	1.246	1.373	1.343	0.097	31.405	770.214	807.851
		Middle	1.251	1.365	1.339	0.087	30.355	895.185	
		Bottom	1.194	1.303	1.277	0.083	31.515	758.154	
004	3.20	Top	1.207	1.452	1.385	0.178	37.929	302.559	324.058
		Middle	1.264	1.384	1.352	0.088	36.591	366.476	
		Bottom	1.239	1.363	1.329	0.090	37.916	303.138	

## Average Suction

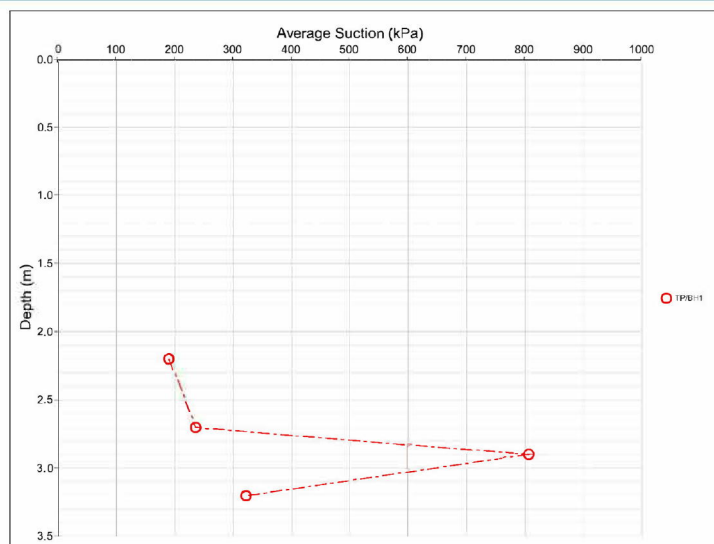

Average Water Content

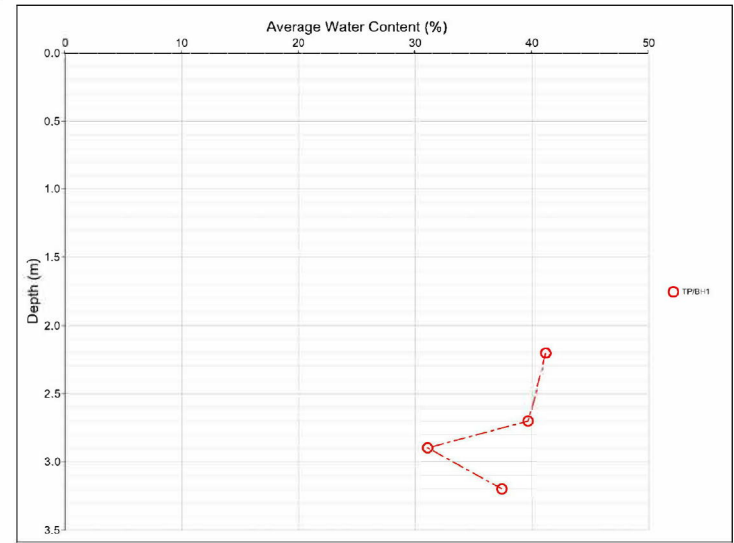

## Drainage Investigation Report

For Subsidence Management Services


**Risk Address:** 160 Camden Road, London, NW1 9HJ

**Visit Date:** 28/09/2015







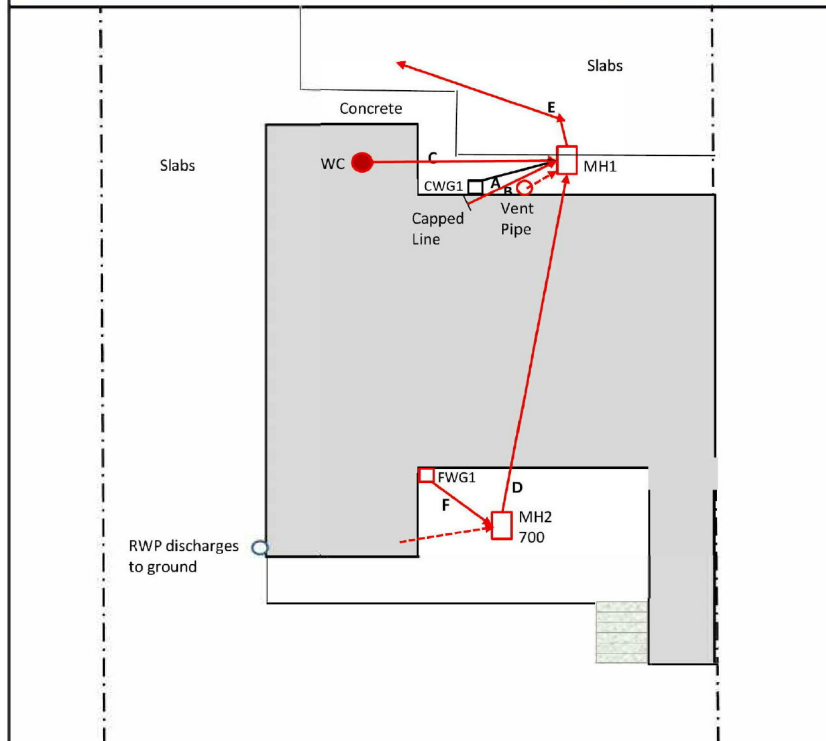













**Report Date:** 06/10/2015

**Report Content:** Front Page  
Site Plan  
CCTV Coding  
Drain Overview  
Quote



## Key

	Tree		Building		Combined Drains		Unsurveyed Drains
	Shrubs		Water Supply		Foul Drains		Excavation
	Bushes		Launch Pit		Storm Drains		Area of Concern
	Boundary		Stop Valve		WC		
			Soak-Away		Exploratory Hole		
					Bore Hole		

Notes:

Address:

160 Camden Road, London, NW1 9HJ

SubsNetUK		CCTV Survey		SubsNetUK	
RUN A	Start From :	MH1	Finish at :	CWG1	Pipe Ø: 100mm
	Invert Level (m):	1.1	Invert Level (m):	N/A	Material: Plastic
COMBINED	Condition grade:	A	Direction:	Upstream	Shared: NO
Distance	Code	Remarks			
0.00	SN	Start Node from MH1			
0.00	WL	Water Level 0%			
0.60	FN	Finish Node at CWG1			
Hydraulic Pressure Test		From	To	Result	Comments
		MH1	CWG1	PASS	
RUN B	Start From :	MH1	Finish at :	Capped Line	Pipe Ø: 100mm
	Invert Level (m):	1.1	Invert Level (m):	N/A	Material: Clay
FOUL	Condition grade:	C	Direction:	Upstream	Shared: NO
Distance	Code	Remarks			
0.00	SN	Start Node from MH1			
0.00	WL	Water Level 0%			
0.30	JDL	Joint Displaced (Large)			
0.50	LU	Line of drain deviates up 90°			
0.90	FN	Finish Node at Capped Line			
RUN C	Start From :	MH1	Finish at :	WC	Pipe Ø: 100mm
	Invert Level (m):	1.1	Invert Level (m):	N/A	Material: Clay
FOUL	Condition grade:	B	Direction:	Upstream	Shared: NO
Distance	Code	Remarks			
0.00	SN	Start Node from MH1			
0.00	WL	Water Level 0%			
0.80	JDM	Joint Displaced (Medium)			
2.50	LR	Line of drain deviates right 45°			
4.50	MC	Material of drain changes at this point to Liner			
4.80	LU	Line of drain deviates up 90°			
5.20	FN	Finish Node at WC			
RUN D	Start From :	MH1	Finish at :	MH2	Pipe Ø: 100mm
	Invert Level (m):	1.1	Invert Level (m):	0.7	Material: Clay
FOUL	Condition grade:	B	Direction:	Upstream	Shared: NO
Distance	Code	Remarks			
0.00	SN	Start Node from MH1			
0.00	WL	Water Level 0%			
0.00	DEE	Attached Deposits (encrustation) 10%			
9.90	FN	Finish Node at MH2			
Hydraulic Pressure Test		From	To	Result	Comments
		MH1	MH2	FAIL	
Address: 160 Camden Road, London, NW1 9HJ					

**Address:** 160 Camden Road, London, NW1 9HJ



Following the receipt of your instruction, we attended site to carry out a CCTV survey.

The CCTV survey was undertaken in general accordance with the Manual of Sewer Classification and the WRC Drain Repair Book.

All runs were cleaned by high pressure water jetting prior to the CCTV survey.

The following presents a summary of the findings with recommendations to repair and/ or return the drains to a serviceable state, where necessary.

**Drain Run A:** CMH1MH1 upstream CWG1

**Pipe Diameter:** 100mm

**Responsibility:** Home Owner

**Hydraulic Pressure Test:** PASS

**CCTV Survey Result:** No Structural Damage

**Recommended Repair:** No repairs required as line is in a serviceable condition at this time.

**Drain Run B:** MH1 upstream to capped Line

**Pipe Diameter:** 100mm

**Responsibility:** Home Owner

**Hydraulic Pressure Test:** Unable to test

**CCTV Survey Result:** Structural Damage

**Recommended Repair:** Cap off line within MH1 using C20P concrete

**Drain Run C:** MH1 upstream to WC

**Pipe Diameter:** 100mm

**Responsibility:** Home Owner

**Hydraulic Pressure Test:** PASS / FAIL

**CCTV Survey Result:** Structural Damage

**Recommended Repair:** Clean and survey in preparation of lining. reline from MH1 U/S for a distance of 4.2m. Insert a patch liner on U/S section of liner to seal

**Drain Run D:** MH1 downstream to MH2

**Pipe Diameter:** 100mm

**Responsibility:** Home Owner

**Hydraulic Pressure Test:** FAIL

**CCTV Survey Result:** Structural Damage

**Recommended Repair:** Remove all encrustation from line. Clean and survey in preparation of lining. Reline from MH1 D/S MH2 a distance of up to 10m

**Address:**

160 Camden Road, London, NW1 9HJ

**Drain Run E:** MH1 downstream to Beyond Area of Concern

**Pipe Diameter:** 100mm

**Responsibility:** Home Owner

**Hydraulic Pressure Test:** Not Tested

**CCTV Survey Result:** Structural Damage

**Recommended Repair:** Clean and survey in preparation of lining. Insert a patch liner at 2.9m D/S of MH1

**Drain Run F:** MH2 upstream to FWG1

**Pipe Diameter:** 100mm

**Responsibility:** Home Owner

**Hydraulic Pressure Test:** Not Tested

**CCTV Survey Result:** No Structural Damage

**Recommended Repair:** No repairs required as line is in a serviceable condition at this time

A visual inspection of the manholes revealed them to be in a good condition.

Water Main Test	From	To	Result	Notes
	ESV	Outside Tap	PASS	Held 4 Bar for 20 minutes

**Address:**

160 Camden Road, London, NW1 9HJ

## RUN/ LOCATION: Van Pack

Repair item	Description	Unit	Rate (£)	Quantity	Amount (£)
UK1133	Van pack HPWJ & CCTV in preparation of lining	nr			

## RUN/ LOCATION: RUN B

Repair item	Description	Unit	Rate (£)	Quantity	Amount (£)
UK0025	Protection Temporary works to floors, 1000 gauge polythene.	m2			
UK5066504	In-situ concrete plain prescribed mix C20P Foundations over.	m3			

## RUN/ LOCATION: RUN C

Repair item	Description	Unit	Rate (£)	Quantity	Amount (£)
UK0025	Protection Temporary works to floors, 1000 gauge polythene.	m2			
UK1135	■rain Lining - Initial Set-Up Fee (0-3.0m)	nr			
UK1140	■rain Lining - 100mm. Install Structural liner into existing 100mm underground drain. 3mm Wall thickness.	m			
UK1180	Patch Lining. Up to 2 m x 100mm diameter	nr			
TOTAL					

## RUN/ LOCATION: RUN D

Repair item	Description	Unit	Rate (£)	Quantity	Amount (£)
UK0525	High Pressure Water Jetting - up to 1 hour on site.	hr			
UK0025	Protection Temporary works to floors, 1000 gauge polythene.	m2			
UK1140	Drain Lining - 100mm. Install Structural liner into existing 100mm underground drain. 3mm Wall thickness.	m			

Address:

160 Camden Road, London, NW1 9HJ

## RUN/ LOCATION: RUN E

Repair item	Description	Unit	
UK0025	Protection Temporary works to floors, 1000 gauge polythene.	m2	
UK1100	Patch Lining. Up to 2 m x 100mm diameter	nr	

## REPAIR ESTIMATE TOTALS:

Run/ Location	
Van Pack	
RUN B	
RUN C	
RUN D	
RUN E	

CONTINGENCY SUM: - To allow for additional works found to be required whilst undertaking repairs on-site. Permission will be sought from the Client/ Clients representative prior to carrying out these works. This sum will be adjusted according to actual repairs carried out.

Address:

160 Camden Road, London, NW1 9HJ