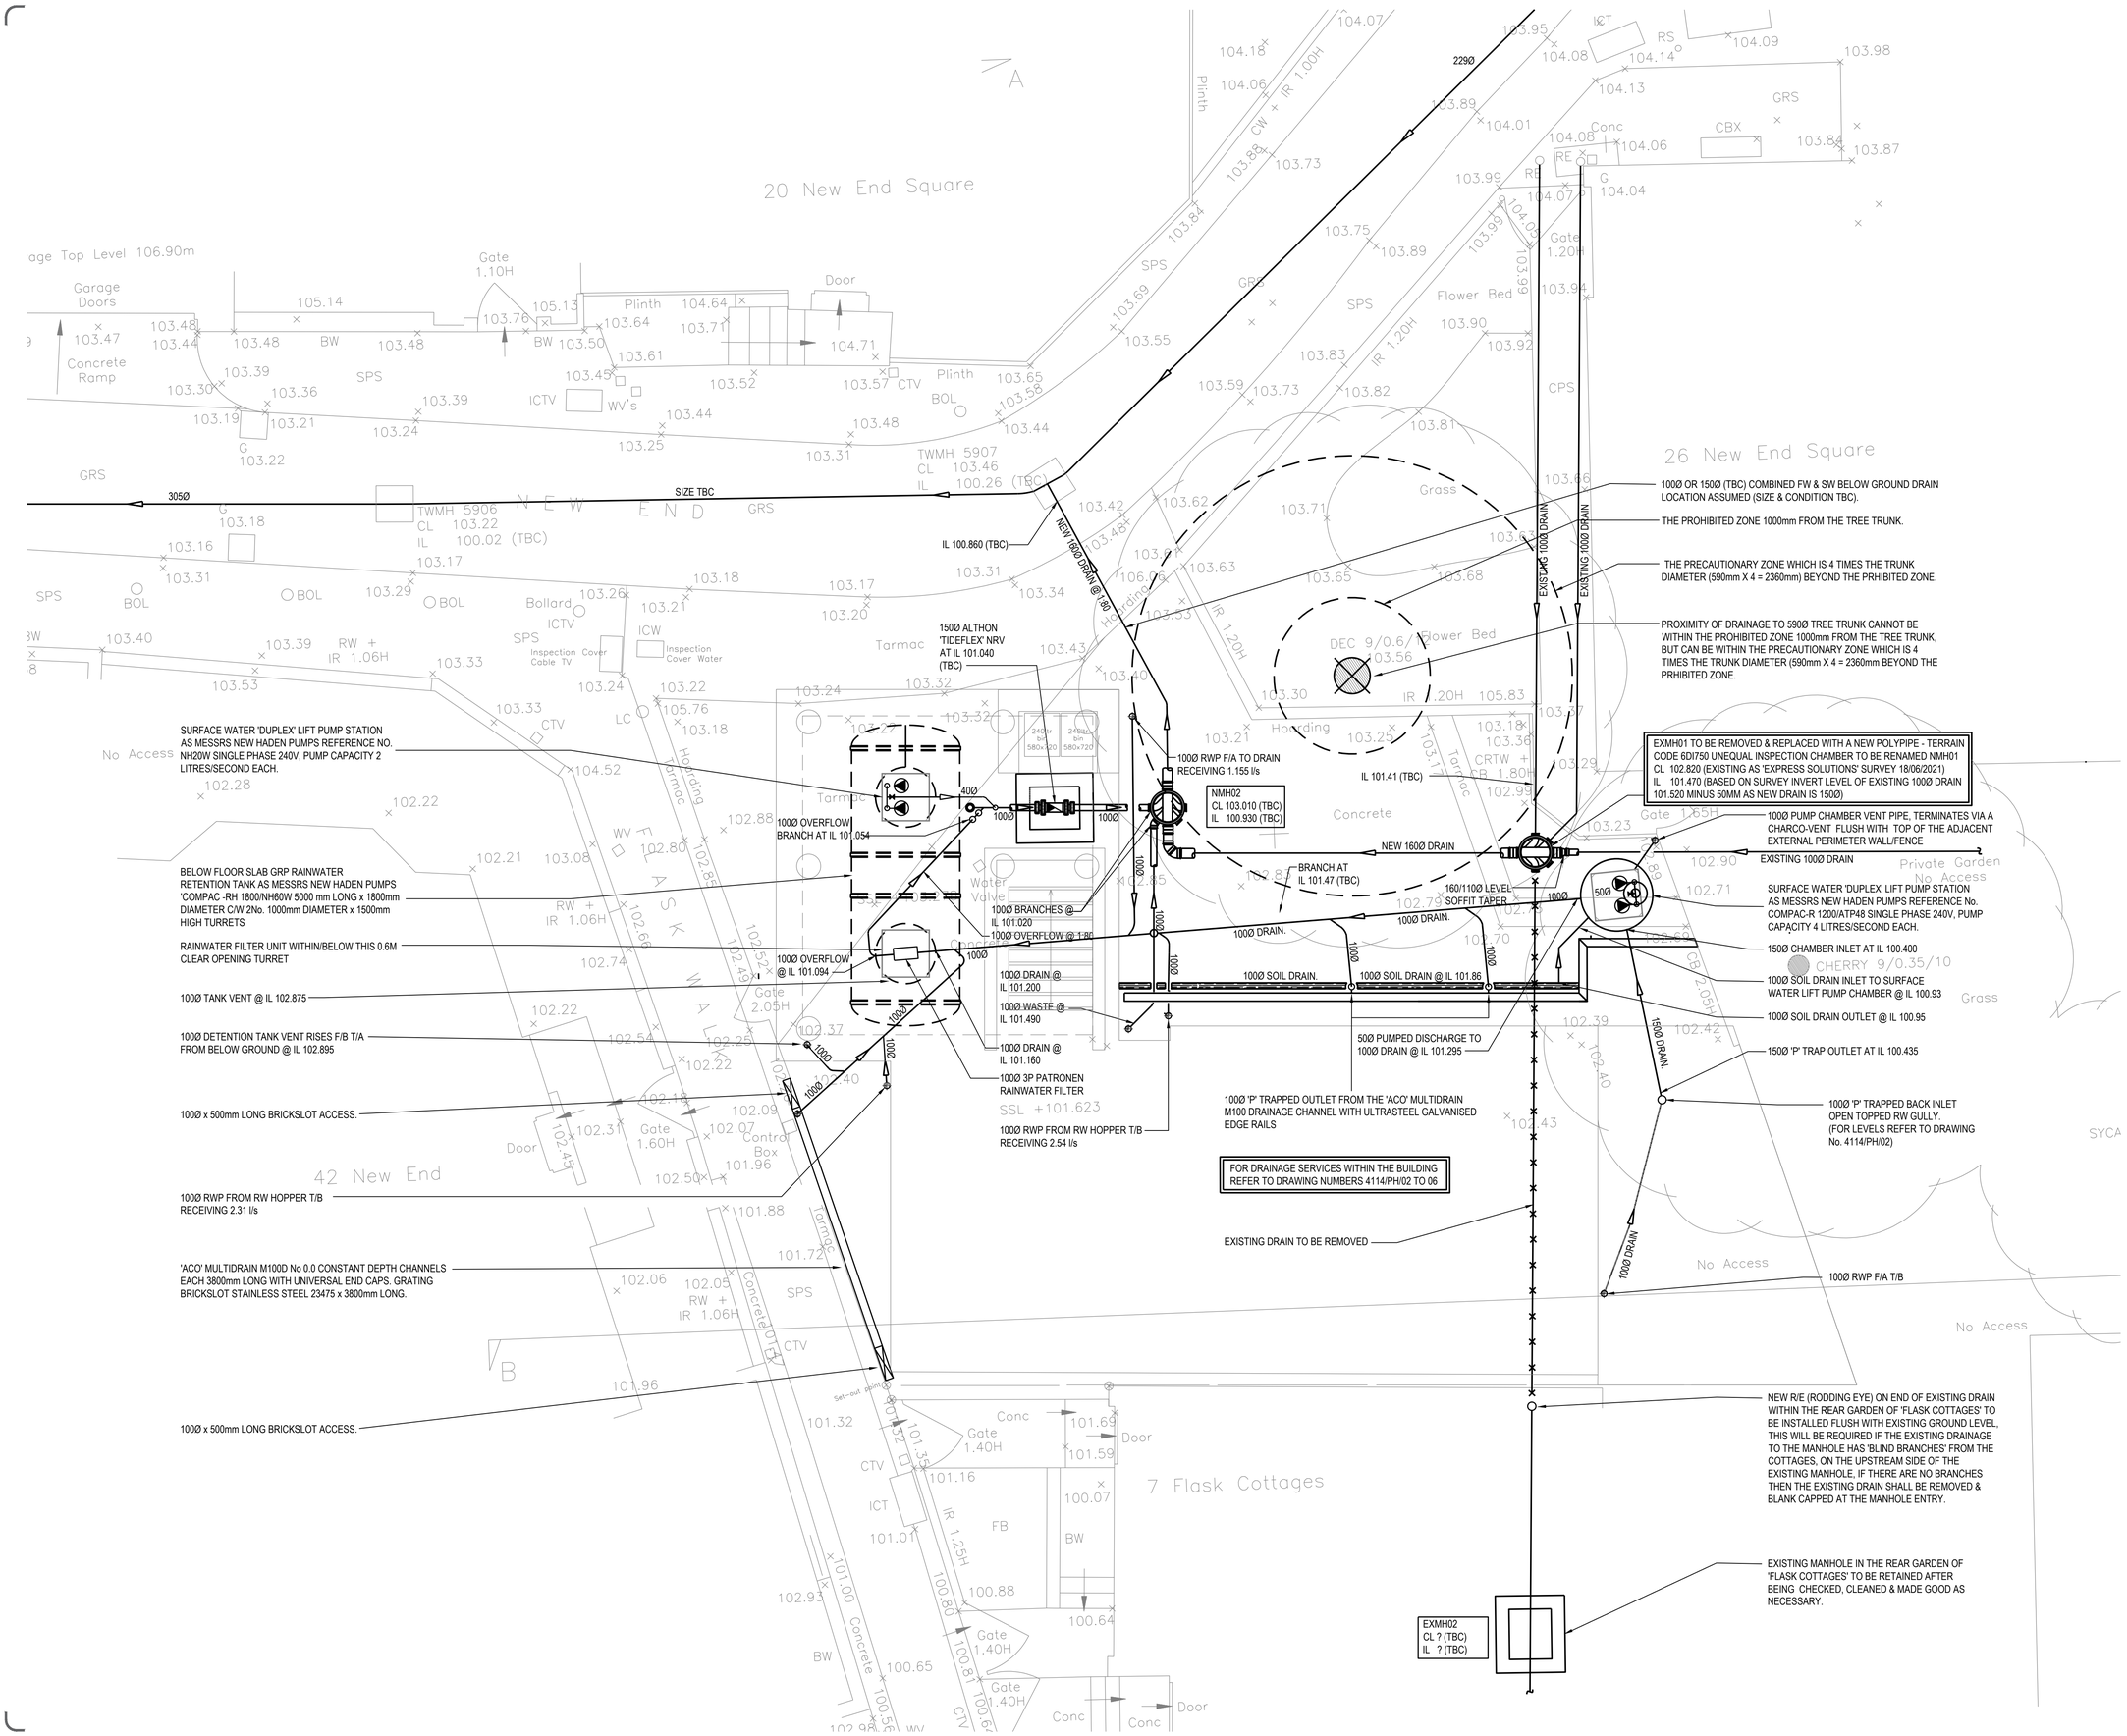

NOTES

1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE SPECIFICATION FOR PUBLIC HEALTH SERVICES INSTALLATION AND ALL ASSOCIATED PUBLIC HEALTH DRAWINGS LISTED THEREIN.
2. ALL PUBLIC HEALTH SERVICES DRAWINGS SHALL BE READ IN CONJUNCTION WITH ALL ASSOCIATED ARCHITECTURAL,STRUCTURAL, MECHANICAL AND ELECTRICAL SERVICES DRAWINGS.
3. THE CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS ON SITE PRIOR TO COMMENCING CONSTRUCTION.
4. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH DRAWING NO. 3898/PH/01 (IN PARTICULAR).
5. DRAINAGE WITHIN THE TREE CANOPY/ROOT AREA SHALL BE ENCASED WITHIN 150mm THICK STRUCTURAL CONCRETE (TO STRUCTURAL ENGINEERS SPECIFICATION) TO PREVENT THE FUTURE INGRESS OF THE TREE ROOTS INTO THE DRAINAGE SYSTEM AT THE PIPE JOINTS.
6. NEW SERVICES WITHIN THE EXISTING TREE CANOPY/ROOT SYSTEMS SHALL BE CAREFULLY INSTALLED VIA HAND EXCAVATION TO NEGATE/MINIMISE POTENTIAL DAMAGE TO THE EXISTING TREE ROOT SYSTEMS, ALL AS REQUIRED BY THE CURRENT ISSUE OF VOLUME 4 THE NJUG GUIDELINES.

REV.	DATE	DESCRIPTION
P2	05/05/22	ARCHITECTS COMMENTS INCORPORATED
P1	04/04/22	PRELIMINARY ISSUE

ENVIRONMENTAL ENGINEERING PARTNERSHIP
CONSULTING ENGINEERS
www.eep.co.uk
01494 464 544

CLIENT: TIM DAVID PROPERTIES LTD

PROJECT: NEW END, HAMPSTEAD VILAGE LONDON

TITLE: BELOW GROUND DRAINAGE TO SEWER LAYOUT

DRAWN	SCALE
CF	1:50 @ A1
CHECKED	DATE
NR	APRIL 2022
DRAWING No.	REVISION
4114/PH/01	P2