




LEVEL MONITORING - RELATIVE SURVEY READINGS

| | | | | | | | |
|---------------------------|------------|-----------------------|---------------|--|---------------------|--------------------|--|
| Provider Details | | Client Details | | | Risk Address | | |
| Name: | MHN Ltd | Insurance Co.: | Allianz | | Occupier: | Deltamist Ltd | |
| Date of Issue: | 1/9/22 | Client Name: | Crawford & Co | | Address: | Flats 1 - 9 | |
| | | Contact: | | | Address: | 8 Compayne Gardens | |
| | | Email: | | | Town: | | |
| | | Client Ref: | | | County: | | |
| | | Address: | | | Post Code: | NW6 3DH | |
| Monitoring Details | | Address: | | | Tel Home: | | |
| Instruction Date: | 5/5/21 | Town: | | | Tel Work: | | |
| First Reading Date: | 27/05/2021 | County: | | | Mobile: | | |
| Maximum No Visits: | 8 | Post Code: | | | Other: | | |
| Anticipated Expiry Date: | Sep 2022 | Other Email: | | | | | |
| Monitoring Int: | 2 Monthly | | | | | | |

| | | Target Date: | | | | | | | | | | | | | | |
|---------|------------|---------------|---------------|---------|---------|---------|---------|---------|---------|---------|---------|---|----|----|----|--|
| | | Reading Date: | | 27/5/21 | 1/8/21 | 3/10/21 | 2/12/21 | 9/3/22 | 3/5/22 | 13/7/22 | 31/8/22 | | | | | |
| | | Issue Date: | | 28/5/21 | 2/8/21 | 4/10/21 | 6/12/21 | 10/3/22 | 4/5/22 | 21/7/22 | 1/9/22 | | | | | |
| Row No. | Point Name | X Co-ordinate | Y Co-ordinate | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | |
| 1 | | 0.00 | 0.00 | | | | | | | | | | | | | |
| 2 | 1 | -5.00 | 0.00 | 10.0000 | 10.0000 | 10.0000 | 10.0000 | 10.0000 | 10.0000 | 10.0000 | 10.0000 | | | | | |
| 3 | 2 | -10.50 | 0.00 | 9.8050 | 9.8050 | 9.8051 | 9.8056 | 9.8052 | 9.8055 | 9.8052 | 9.8057 | | | | | |
| 4 | 3 | -10.50 | -9.00 | 9.8372 | 9.8366 | 9.8353 | 9.8370 | 9.8371 | 9.8377 | 9.8361 | 9.8356 | | | | | |
| 5 | | -8.50 | -9.00 | | | | | | | | | | | | | |
| 6 | 4 | -8.50 | -10.00 | 9.8850 | 9.8847 | 9.8836 | 9.8844 | 9.8855 | 9.8857 | 9.8819 | 9.8786 | | | | | |
| 7 | 5 | -8.50 | -14.00 | 9.8115 | 9.8105 | 9.8075 | 9.8099 | 9.8119 | 9.8111 | 9.8055 | 9.8015 | | | | | |
| 8 | | -7.50 | -14.00 | | | | | | | | | | | | | |
| 9 | 6 | -6.50 | -15.00 | 9.8596 | 9.8589 | 9.8564 | 9.8590 | 9.8605 | 9.8599 | 9.8551 | 9.8512 | | | | | |
| 10 | 7 | -4.00 | -15.00 | 9.8800 | 9.8791 | 9.8778 | 9.8797 | 9.8799 | 9.8798 | 9.8775 | 9.8743 | | | | | |
| 11 | | -3.00 | -14.00 | | | | | | | | | | | | | |
| 12 | 8 | 0.00 | -14.00 | 9.9267 | 9.9267 | 9.9253 | 9.9268 | 9.9274 | 9.9267 | 9.9257 | 9.9238 | | | | | |
| 13 | | | | | | | | | | | | | | | | |
| 14 | | | | | | | | | | | | | | | | |
| 15 | | | | | | | | | | | | | | | | |
| 16 | | | | | | | | | | | | | | | | |
| 17 | | | | | | | | | | | | | | | | |
| 18 | | | | | | | | | | | | | | | | |
| 19 | | | | | | | | | | | | | | | | |
| 20 | | | | | | | | | | | | | | | | |
| 21 | | | | | | | | | | | | | | | | |
| 22 | | | | | | | | | | | | | | | | |
| 23 | | | | | | | | | | | | | | | | |
| 24 | | | | | | | | | | | | | | | | |
| 25 | | | | | | | | | | | | | | | | |
| 26 | | | | | | | | | | | | | | | | |
| 27 | | | | | | | | | | | | | | | | |
| 28 | | | | | | | | | | | | | | | | |
| 29 | | | | | | | | | | | | | | | | |
| 30 | | | | | | | | | | | | | | | | |
| 31 | | | | | | | | | | | | | | | | |
| 32 | | | | | | | | | | | | | | | | |
| 33 | | | | | | | | | | | | | | | | |
| 34 | | | | | | | | | | | | | | | | |
| 35 | | | | | | | | | | | | | | | | |
| 36 | | | | | | | | | | | | | | | | |
| 37 | | | | | | | | | | | | | | | | |
| 38 | | | | | | | | | | | | | | | | |
| 39 | | | | | | | | | | | | | | | | |
| 40 | | | | | | | | | | | | | | | | |
| 41 | | | | | | | | | | | | | | | | |
| 42 | | | | | | | | | | | | | | | | |
| 43 | | | | | | | | | | | | | | | | |
| 44 | | | | | | | | | | | | | | | | |




- 21/07/2022
 - No new concerns raised at time of visit.
- It was not possible to install all stations within a common brickcourse. Therefore initial readings cannot be interpreted as

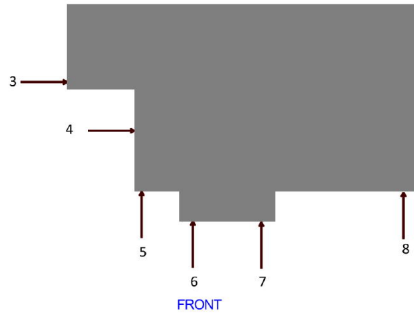

Initial readings cannot be interpreted as Distortion Data.

- Readings have been made relative to Point 1. It has an assumed value of 10.0000m. If this is not appropriate, please advise if a deep datum is required?
- No further readings to be taken.

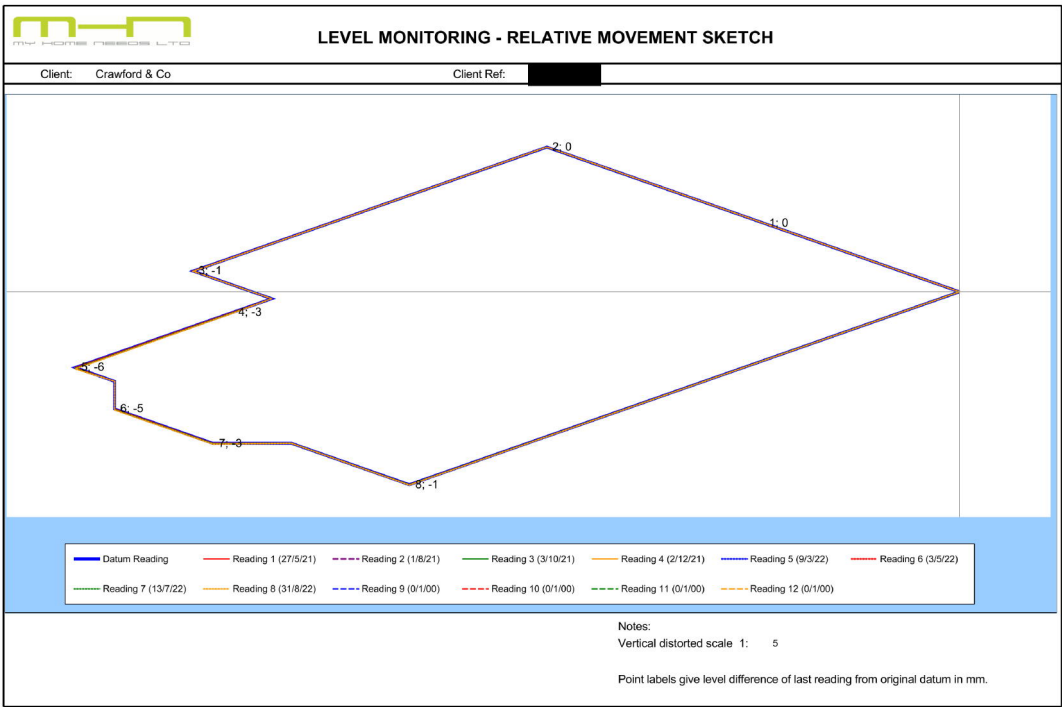






LEVEL MONITORING - RELATIVE SURVEY READINGS

Client: Crawford & Co

Client Ref: [REDACTED]

Chart Scale 1:1000

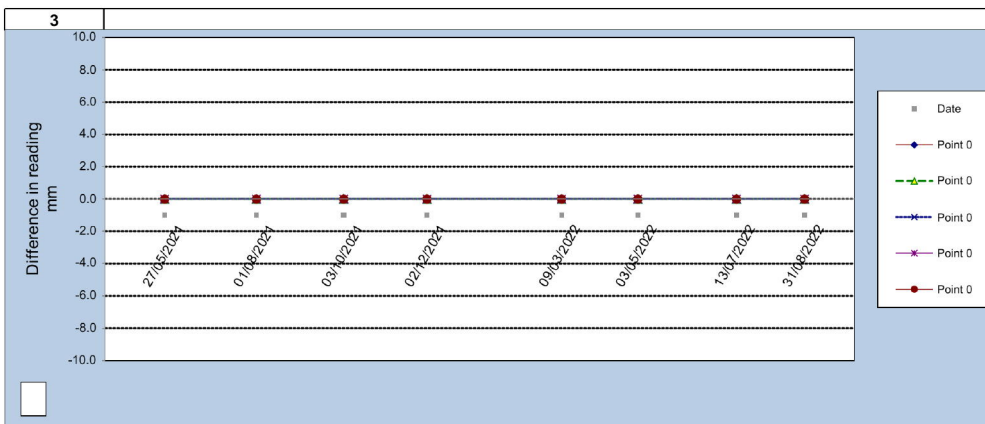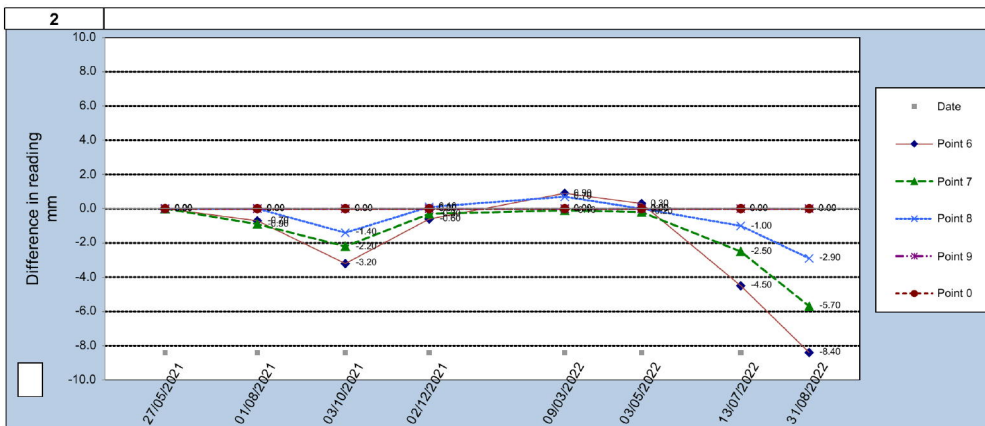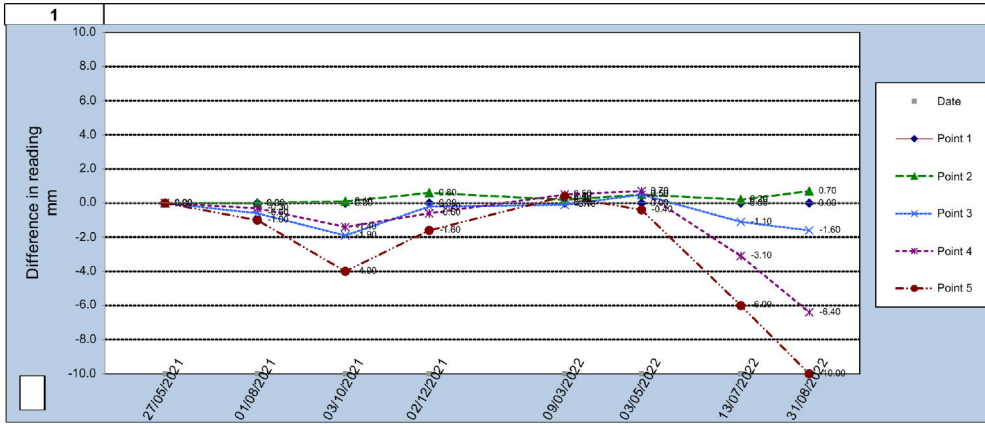

Standard Comments for selection in Readings and Sketch Worksheets
User may edit these as appropriate

| Standard Comments | |
|--------------------|--|
| No Comment | |
| Standard Comment 1 | The Occupier expressed concerns |
| Standard Comment 2 | The Occupier expressed no new concerns |
| Standard Comment 3 | Standard Comment 3 |
| Standard Comment 4 | Standard Comment 4 |
| Standard Comment 5 | |

| Standard Bullet |
|-----------------|
| ● |