



**11D Arkwright Road, London NW3 6AA**

**Daylight, Sunlight, and Overshadowing  
Assessment for Surrounding Properties**

## Document Issue Record

This document has been revised and issued as below:

Issue	Date	Comments
1	15.09.2022	Original

### Disclaimer

This report has been prepared by EEABS (Elmstead Energy Assessments & Building Services) in accordance with the instructions of their client, for their sole and specific use. Any other persons who use any information contained herein do so at their own risk.

Calculations are based on the drawings and information provided to us, which have been accepted in good faith as being accurate and valid. The accuracy of this information may have an impact on the daylight, sunlight, and overshadowing assessments.

We have used our best endeavours to ensure that all relevant windows within the neighbouring properties and that all external amenity spaces have been identified.

We can make no guarantee as to the status (successful/unsuccessful) of the planning application following the submission of our report.

EEABS does not accept any liability in negligence for any matters arising outside of the agreed scope of works. Unless otherwise agreed, the copyright of this document and all other Intellectual Property Rights always remain the property of EEABS.

## Contents

<b>1.0</b>	<b>Executive Summary</b> .....	<b>4</b>
<b>2.0</b>	<b>Introduction</b> .....	<b>5</b>
2.1	The Site and Development Proposal.....	6
2.2	Planning Policy and Guidance .....	9
2.3	Methodology.....	11
2.3.1	Daylight .....	11
2.3.2	Sunlight .....	11
2.3.3	Overshadowing .....	11
<b>3.0</b>	<b>Dynamic Simulation Modelling</b> .....	<b>12</b>
<b>4.0</b>	<b>Daylight Assessment</b> .....	<b>13</b>
4.1	Vertical Sky Component (VSC) .....	13
<b>5.0</b>	<b>Sunlight Assessment</b> .....	<b>14</b>
5.1	Annual and Winter Probable Sunlight Hours.....	14
<b>6.0</b>	<b>Overshadowing Assessment</b> .....	<b>15</b>

## Figures

Figure 1 - Site Plan of 11D Arkwright Road, London.....	6
Figure 2 - Existing Floor Plans and Elevations of 11D Arkwright Road .....	7
Figure 3 - Proposed Floor Plans and Elevations of 11D Arkwright Road .....	8
Figure 4 - BRE: Site Layout Planning for Daylight and Sunlight - A Guide to Good Practice.....	9
Figure 5 - EDSL TAS Computer Model of the Existing Site .....	12
Figure 6 - EDSL TAS Computer Model of the Proposed Site .....	12

## Appendices

Appendix A - Drawing Register

Appendix B - Window Reference Diagrams

Appendix C - Overshadowing Assessment Shadow Castings

## 1.0 Executive Summary

A daylight, sunlight, and overshadowing assessment has been carried out for the surrounding properties to the proposed extensions at 11D Arkwright Road, London. The properties investigated under this assessment were:

- 11C Arkwright Road
- 11E Arkwright Road

This report outlines the results of the assessment in order to assist with the developments planning application.

Calculations have been based on the drawings and information provided to us by the client / architect, internet and OS mapping sources, and publicly available planning records, which have been accepted in good faith as being accurate and valid. The accuracy of this information may have an impact on the daylight, sunlight, and overshadowing assessment.

The methodology used for this assessment follows the most recognised guidance document for daylight and sunlight within dwellings and is titled 'Site Layout Planning for Daylight and Sunlight - A Guide to Good Practice' *Third Edition 2022* and is published by the Building Research Establishment.

This report has investigated the changes in natural light received between the existing and proposed plans. The following daylight, sunlight, and overshadowing assessments have been carried out with the use of computer modelling software in order to provide the most accurate results possible.

- Vertical Sky Component (VSC)
- Annual and Winter Probable Sunlight Hours
- Overshadowing Assessment

The VSC results show that the surrounding windows within 11C and 11E Arkwright Road would all only receive a negligible impact. This is because their VSC ratios under the proposed scheme are both greater than 27% and greater than 0.80 times their former values. As a result, the BRE Guidelines with respect to natural daylight would be comfortably satisfied.

The sunlight results show that there would only be a negligible impact to the amount of annual and winter sunlight hours the surrounding windows receive under the proposed scheme. This is because each of the windows under the proposed scheme will still be receiving significantly greater than 25% annual and 5% winter sunlight hours, the majority of the windows ratios are also above 0.8 times their former values. The BRE Guidelines in regard to direct sunlight will therefore also be satisfied.

The overshadowing results show that the proposed extensions at 11D Arkwright Road will have negligible impact on the amount of overshadowing experienced by the rear garden areas of 11C and 11E Arkwright Road, therefore the BRE guidelines would be satisfied in this regard.

For these reasons we believe that the proposed extensions at 11D Arkwright Road, London NW3 6AA should be considered as acceptable overall in regard to its neighbourly impact on daylight, sunlight, and overshadowing.

## 2.0 Introduction

EEABS (Elmstead Energy Assessments & Building Services) have been instructed to undertake a daylight, sunlight, and overshadowing assessment for the surrounding properties to the proposed extensions at 11D Arkwright Road, London.

The client wished to determine the effect that the proposed development may have on the daylight and sunlight received by the surrounding windows, as well as the amount of overshadowing that could occur within surrounding garden amenity spaces.


Therefore, this report will investigate the changes in natural daylight and sunlight received between the existing and proposed plans.

The key elements of this report are:

- To review the relevant guidance and methodology with respect to daylight, sunlight, and overshadowing that relate to the development.
- Calculate the surrounding properties levels of daylight, sunlight and overshadowing for the existing scheme in accordance with standard methodology.
- Calculate the surrounding properties levels of daylight, sunlight and overshadowing for the proposed scheme in accordance with standard methodology.
- To summarise and compare the findings against regulation guidelines for daylight and sunlight of neighbouring buildings, and the overshadowing of amenity spaces.

## 2.1 The Site and Development Proposal

The site is located at 11D Arkwright Road, London and can be seen outlined in red on the Site Plan below. The surrounding properties that have had their levels of daylight, sunlight, and overshadowing evaluated within this assessment can also be seen, these were 11C and 11E Arkwright Road.

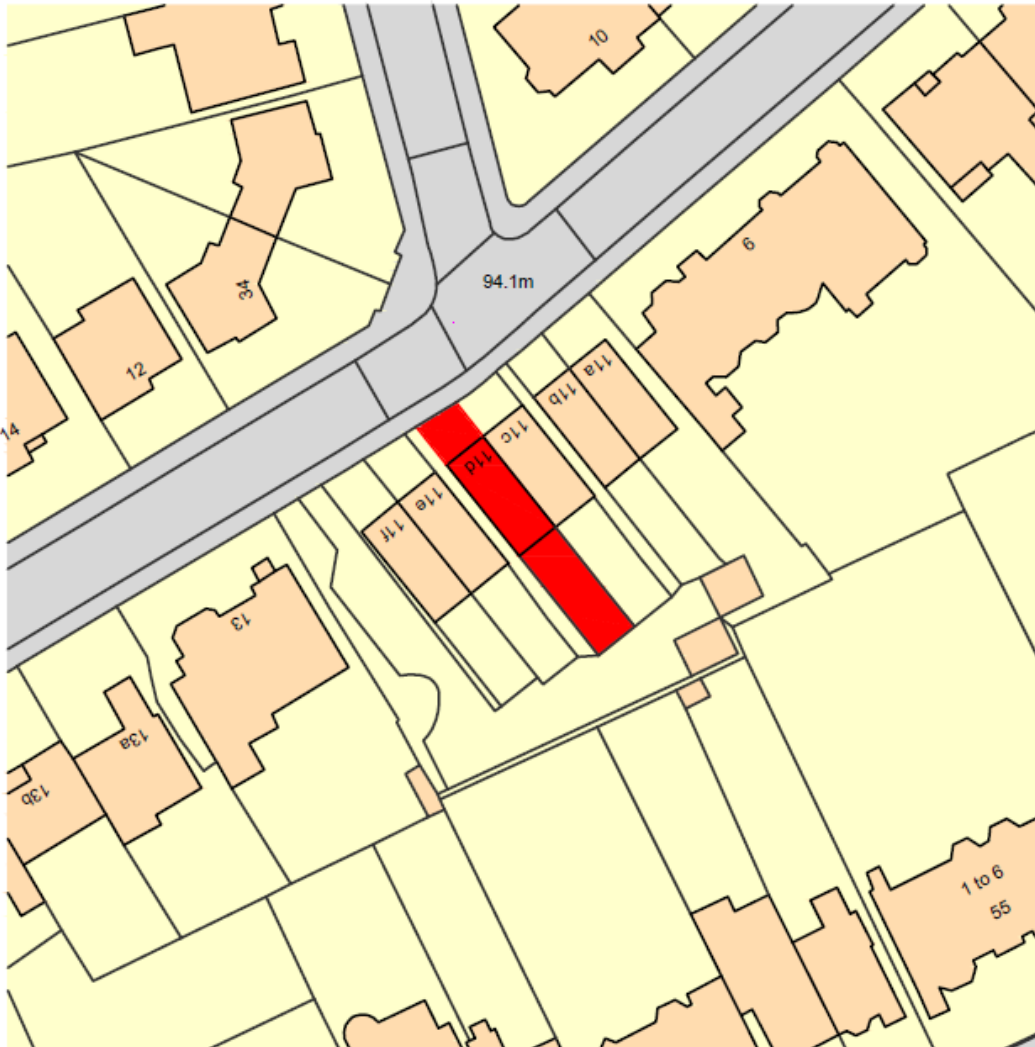

Ordnance Survey, (c) Crown Copyright 2021. All rights reserved. Licence number 100022432

**Figure 1 - Site Plan of 11D Arkwright Road, London**

The proposal is for lower ground floor and second floor rear extensions.

Existing and Proposed floor plans and elevations can be seen in Figure 2 and 3 respectively.

This assessment has been based on the drawings and information provided to us by the client / architect, internet and OS mapping sources, and publicly available planning records. A drawing register can be found within Appendix A.



Figure 2 - Existing Floor Plans and Elevations of 11D Arkwright Road



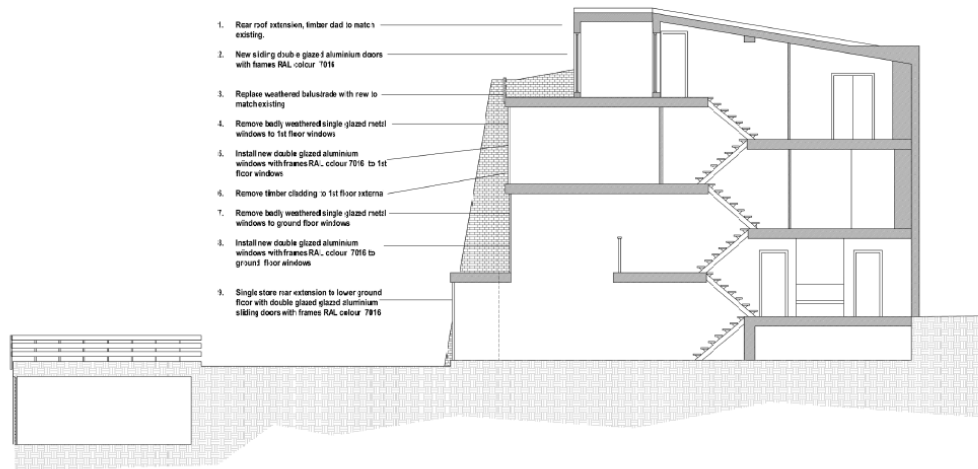


Figure 3 - Proposed Floor Plans and Elevations of 11D Arkwright Road

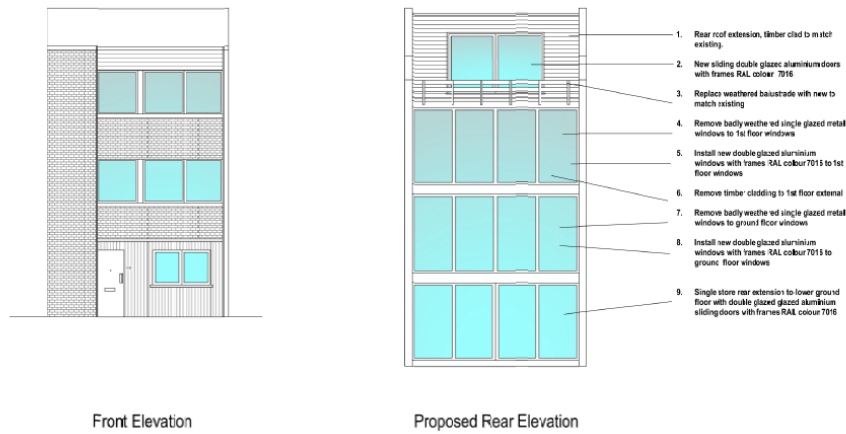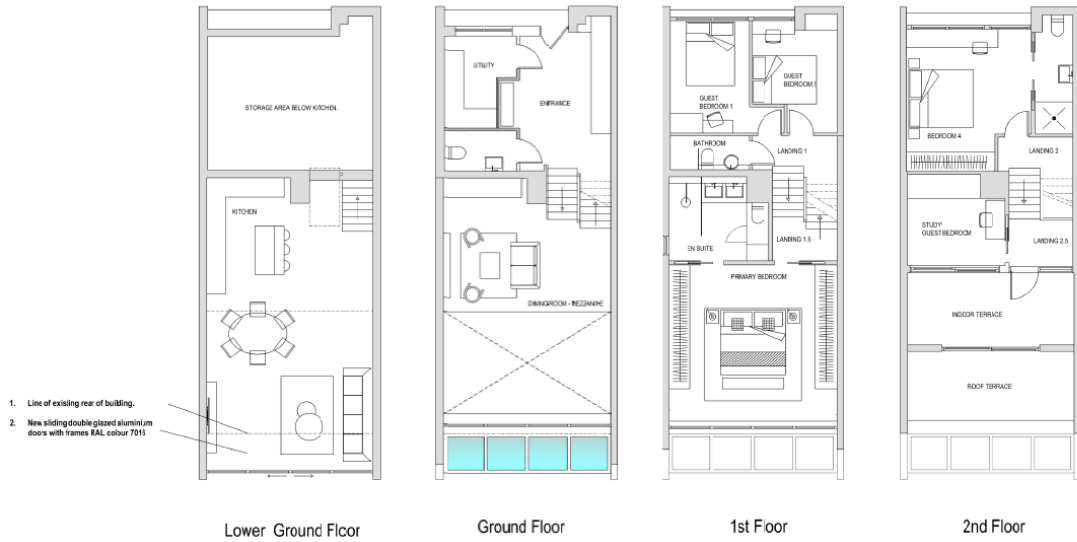

## 2.2 Planning Policy and Guidance

The most recognised guidance document for natural light within dwellings is titled 'Site Layout Planning for Daylight and Sunlight - A Guide to Good Practice' *Third Edition 2022* and is published by the Building Research Establishment.



Figure 4 - BRE: Site Layout Planning for Daylight and Sunlight - A Guide to Good Practice

Although the BRE guide clearly states that its recommendations are not mandatory and the document should not be considered as an instrument of planning policy, it can be used in conjunction with the British Standard BS EN 17037.

While the BRE Guidelines are the most recognised document for natural light within dwellings they also do state that:

*"The guide is intended for building designers and their clients, consultants and planning officials. The advice given here is not mandatory and the guide should not be seen as an instrument of planning policy; its aim is to help rather than constrain the designer. Although it gives numerical guidelines, these should be interpreted flexibly since natural lighting is only one of many factors in site layout design. In special circumstances the developer or planning authority may wish to use different target values."*

As the numerical values within the BRE guide are purely advisable, Appendix H of the guide provides further assistance on how to assess the impact to daylight and sunlight of the surrounding properties.

Criteria	Impact
Where the loss of skylight or sunlight fully meets the guidelines and only a small number of windows or limited area of open space lose light.	Negligible
Where the loss of skylight or sunlight is only just within the guidelines and a large number of windows or open spaces are affected.  Where the loss of skylight or sunlight does not meet the guidelines but one or more of the following applies: <ul style="list-style-type: none"> <li>• Only a small number of windows or limited area of open spaces are affected.</li> <li>• The loss of light is only just outside the guidelines.</li> <li>• The affected room has other sources of light.</li> <li>• The affected building/room or open space has a low requirement for light.</li> </ul>	Minor Adverse
Where the loss of skylight or sunlight does not meet the guidelines and one or more of the following applies: <ul style="list-style-type: none"> <li>• A large number of windows or large area of open space are affected.</li> <li>• The loss of light is substantially outside the guidelines.</li> <li>• All windows within a particular property are affected.</li> <li>• The affected indoor or outdoor spaces have a particularly strong requirement for skylight or sunlight.</li> </ul>	Major Adverse

The methodology and target benchmarks set out within the BRE guide have been used to assess the surrounding properties under the existing and proposed schemes.

A value greater than 0.80 times its former value will be determined to have a Negligible impact, values lower than this will be determined as either minor or major adverse dependent on the which factors apply as described in the table above. (We also generally determine values of between 0.80 and 0.50 to be minor adverse, and values less than 0.50 to be major adverse).

The BRE Guide states that these guidelines “are intended for rooms in adjoining properties where daylight is required, including living rooms, kitchens, and bedrooms. Windows to bathrooms, toilets, storerooms, circulation areas and garages need not be analysed.”

Any trees located close to proposed development have been excluded from the model as recommended by the BRE Guide, which states: “Where the effect of a new building on existing buildings nearby is being analysed, it is usual to ignore the effect of existing trees.”

## 2.3 Methodology

The following methodology and calculations set out within the BRE Guide 'Site Layout Planning for Daylight and Sunlight - A Guide to Good Practice' *Third Edition 2022* were used to carry out the daylight, sunlight, and overshadowing assessment for the surrounding properties of 11D Arkwright Road.

### 2.3.1 Daylight

#### Vertical Sky Component (VSC)

The Vertical Sky Component (VSC) is a ratio (expressed as a percentage) of the direct sky illuminance falling on the outside mid-point of a window, to the horizontal illuminance under a standard CIE overcast sky. For example, a window looking across an unobstructed field would achieve the highest possible value of just under 40% (39.6%).

For a window to be considered as receiving a good level of daylight, a VSC value of 27% should be achieved. However, for existing windows if the VSC value is less than 27%, then a window is still said to achieve a good level of daylight provided its VSC is within 0.8 times of its former value.

### 2.3.2 Sunlight

#### Annual and Winter Probable Sunlight Hours

To determine if an adequate amount of sunlight is achieved within a room the following criteria needs to be met. At least one main window wall should face within 90° of due south and at least one window should receive at least 25% of annual probable sunlight hours, including at least 5% of annual probable sunlight hours in the winter months between 21<sup>st</sup> September and 21<sup>st</sup> March.

The term Annual probable sunlight hours means the total amount of hours during a year in which direct sunlight will reach the ground. The winter annual probable sunlight hours are the same thing but only during 21<sup>st</sup> September to 21<sup>st</sup> March.

If any of the surrounding windows that face within 90° of due south fail to meet the 25% of annual probable sunlight hours and 5% of winter sunlight hours, then they can still be said to receive a good amount of sunlight providing they are within 0.8 times of their former value and the reduction in sunlight received over the whole year is not greater than 4%.

The BRE guide states that the above guidance is to be applied for living room windows only.

### 2.3.3 Overshadowing

To be determined as adequately sunlit throughout the year, at least half of a garden and other similar amenity spaces should receive at least two hours of sunlight on 21<sup>st</sup> March (the Equinox).

For the existing garden or amenity spaces being calculated due to the proposed development, the results should be no less than 0.8 times of former values in order for a loss of light to not be noticeable.

### 3.0 Dynamic Simulation Modelling

EDSL TAS Dynamic Simulation Modelling software was used to carry out the daylight, sunlight, and overshadowing calculations, as this can provide a more accurate means of assessment over the 'by hand' indicator methods outlined within the BRE guide.

The daylight calculations are carried out under a standard CIE overcast sky. For the sunlight and overshadowing calculations, the computer model uses actual hourly weather data for the proposed location, in this instance current CIBSE London TRY weather data was used.

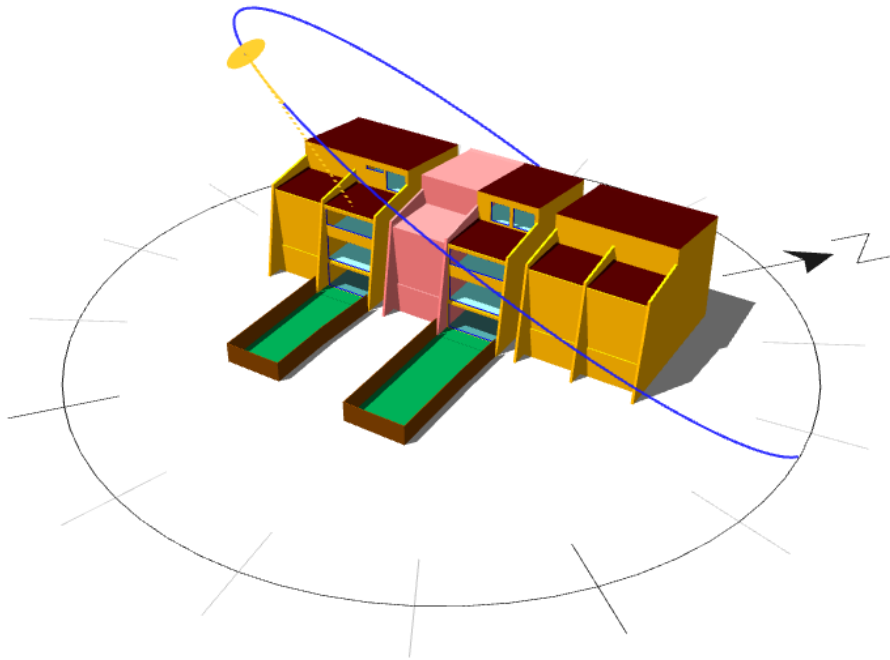


Figure 5 - EDSL TAS Computer Model of the Existing Site

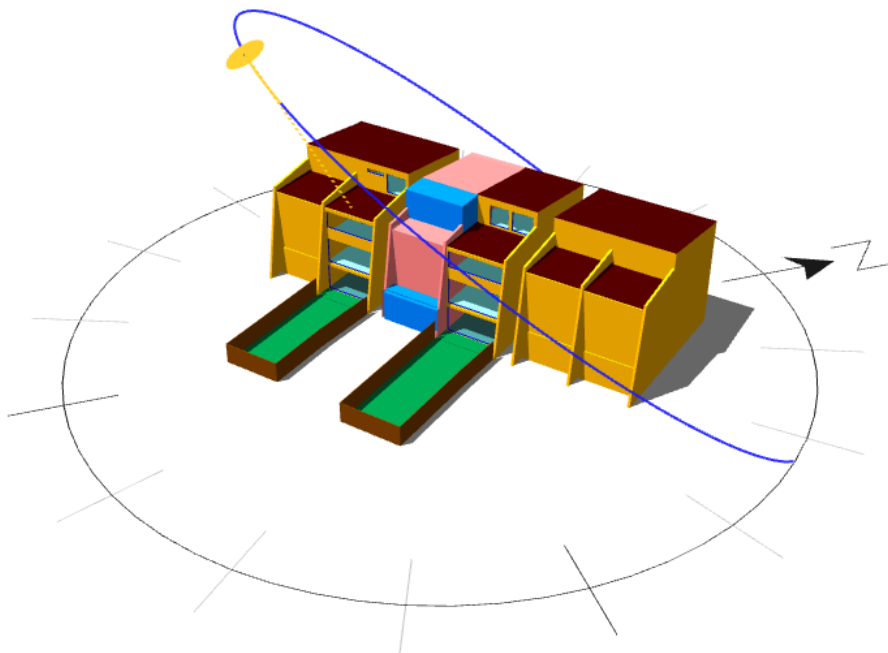


Figure 6 - EDSL TAS Computer Model of the Proposed Site

## 4.0 Daylight Assessment

The windows that were most likely to be affected by the proposed extension have undergone the following calculations and can be found in Appendix B - Window Reference Diagrams.

### 4.1 Vertical Sky Component (VSC)

The VSC results calculated for the surrounding windows can be found in the table below.

Property	Win Ref	Orientation (°)	VSC Existing (%)	VSC Proposed (%)	Ratio	Overall Impact
11C Arkwright Road	W1	141	34.83	34.59	0.99	Negligible
	W2	141	38.08	38.08	1.00	Negligible
	W3	141	38.84	38.84	1.00	Negligible
	W4	141	38.86	35.45	0.91	Negligible
	W5	141	38.65	37.99	0.98	Negligible
11E Arkwright Road	W1	141	34.53	34.53	1.00	Negligible
	W2	141	37.97	37.97	1.00	Negligible
	W3	141	38.84	38.84	1.00	Negligible
	W4	141	38.93	38.65	0.99	Negligible
	W5	141	38.59	36.79	0.95	Negligible

The VSC results show that the surrounding windows within 11C and 11E Arkwright Road would all only receive a negligible impact. This is because their VSC ratios under the proposed scheme are both greater than 27% and greater than 0.80 times their former values. As a result, the BRE Guidelines with respect to natural daylight would be comfortably satisfied.

## 5.0 Sunlight Assessment

### 5.1 Annual and Winter Probable Sunlight Hours

Only living room windows within 90° of due south need to have the amount of sunlight they can receive assessed (Due south is taken as 180°, therefore a windows orientation should be between 90° and 270° to be assessed). The orientation of each of the windows can be seen within the VSC results.

To provide a comprehensive assessment all windows that face within 90° of due south have had their level of direct sunlight received assessed, whether they serve a main living room or not.

Property	Win Ref	APSH Ext (%)	APSH Pro (%)	Ratio	WPSH Ext (%)	WPSH Pro (%)	Ratio	Overall Impact
11C Arkwright Road	W1	63	62	0.98	24	23	0.96	Negligible
	W2	71	71	1.00	28	28	1.00	Negligible
	W3	79	79	1.00	28	28	1.00	Negligible
	W4	79	70	0.89	29	21	0.72	Negligible
	W5	77	74	0.96	29	26	0.90	Negligible
11E Arkwright Road	W1	63	63	1.00	24	24	1.00	Negligible
	W2	69	69	1.00	27	27	1.00	Negligible
	W3	79	79	1.00	28	28	1.00	Negligible
	W4	79	76	0.96	29	29	1.00	Negligible
	W5	76	69	0.91	29	29	1.00	Negligible

The sunlight results show that there would only be a negligible impact to the amount of annual and winter sunlight hours the surrounding windows receive under the proposed scheme. This is because each of the windows under the proposed scheme will still be receiving significantly greater than 25% annual and 5% winter sunlight hours, the majority of the windows ratios are also above 0.8 times their former values. The BRE Guidelines in regard to direct sunlight will therefore also be satisfied.

## 6.0 Overshadowing Assessment

The rear garden areas to the surrounding properties have also had their levels of overshadowing assessed. The lit area is the area of the zone that receives at least 2 hours of sunlight on the 21st of March.

Amenity Space	Area (m <sup>2</sup> )	Lit Area - Existing (m <sup>2</sup> )	Lit Area - Proposed (m <sup>2</sup> )	Ratio	Overall Impact
11C Arkwright Road - Rear Garden	72.80	63.29	63.29	1.00	Negligible
11E Arkwright Road - Rear Garden	61.39	51.92	51.92	1.00	Negligible

The overshadowing results show that the proposed extensions at 11D Arkwright Road will have negligible impact on the amount of overshadowing experienced by the rear garden areas of 11C and 11E Arkwright Road, therefore the BRE guidelines would be satisfied in this regard.

Shadow cast images for the existing and proposed schemes for various times in the day on the Spring Equinox, March 21<sup>st</sup>, can be found within Appendix C.

## Appendix A - Drawing Register

Drawing No.	Drawing Title/Information Received
-	Location Plan
1556 101	Existing Floor Plans
1556 102	Existing Elevations
1556 103	Existing Section
1556 104	Existing Side Elevation
1556 301	Proposed Floor Plans
1556 302	Proposed Elevations
1556 303	Proposed Section
1556 304	Proposed Side Elevation



**Appendix B - Window Reference Diagrams**

11C Arkwright Road - Window References




11E Arkwright Road - Window References




## Appendix C - Overshadowing Assessment Shadow Castings


Existing Site - 09:00 March 21<sup>st</sup>

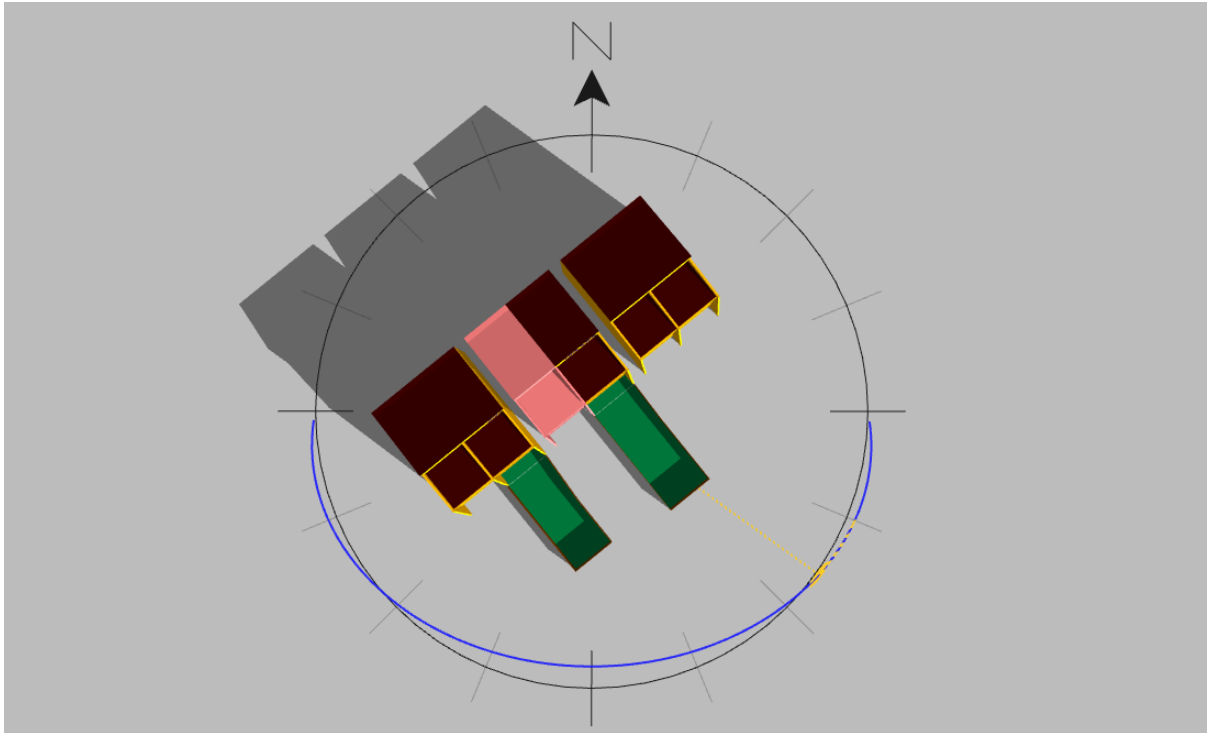


Proposed Site - 09:00 March 21<sup>st</sup>

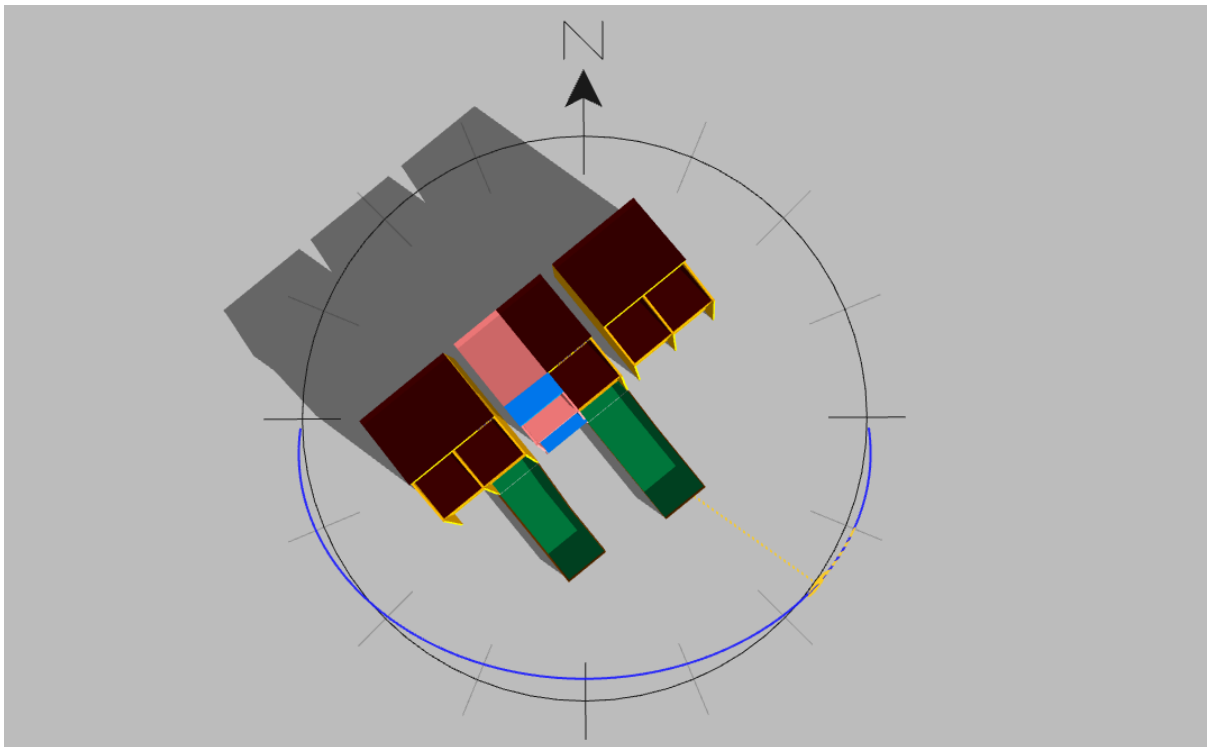


Existing Site - 12:00 March 21<sup>st</sup>

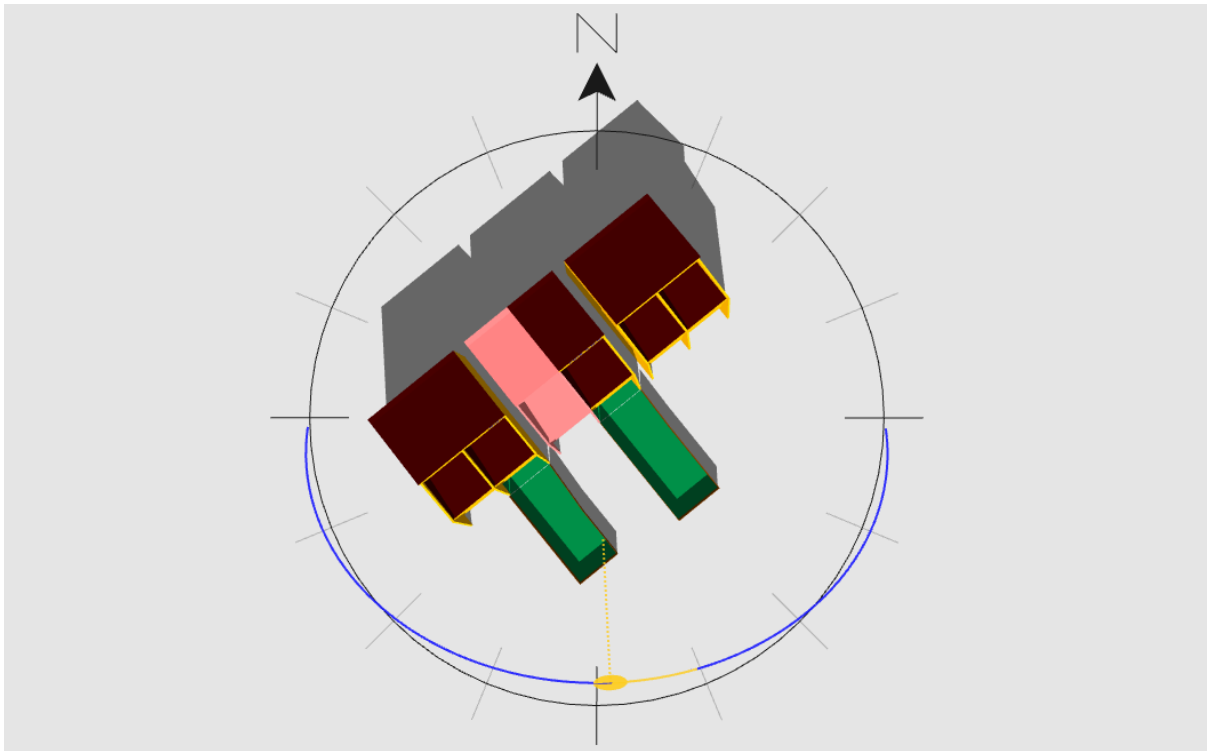

Proposed Site - 12:00 March 21<sup>st</sup>

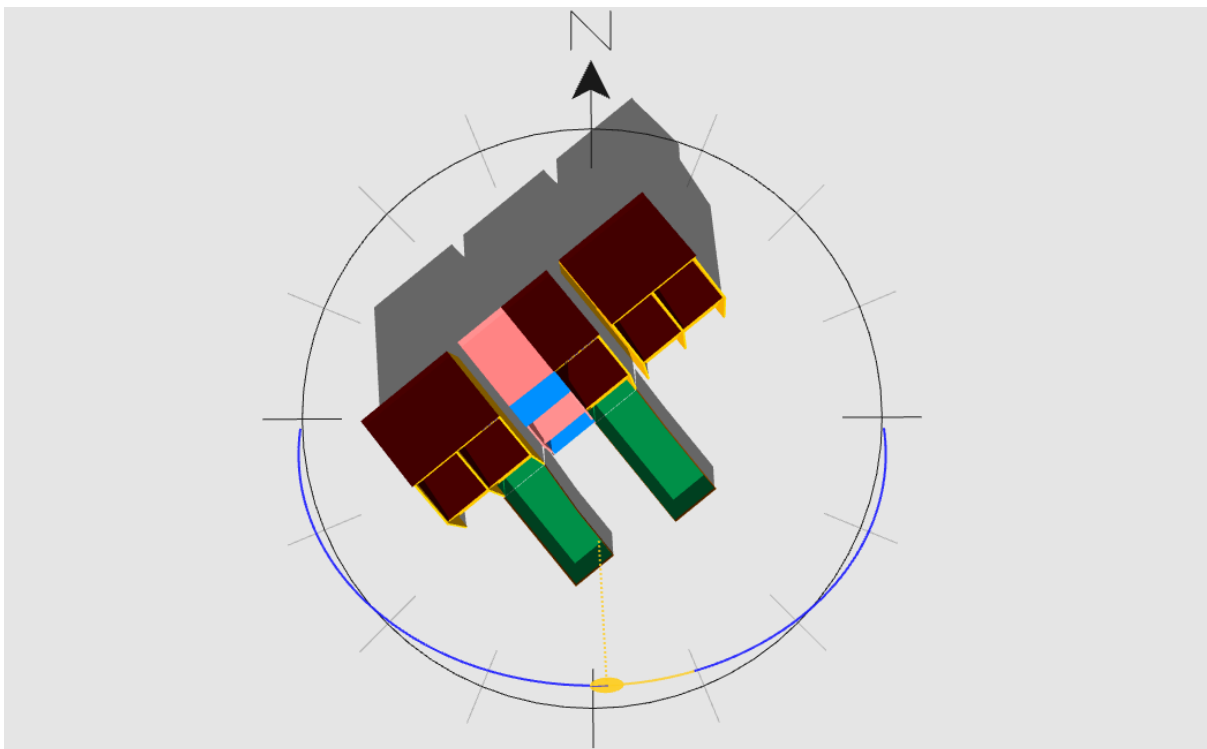

Existing Site - 15:00 March 21<sup>st</sup>

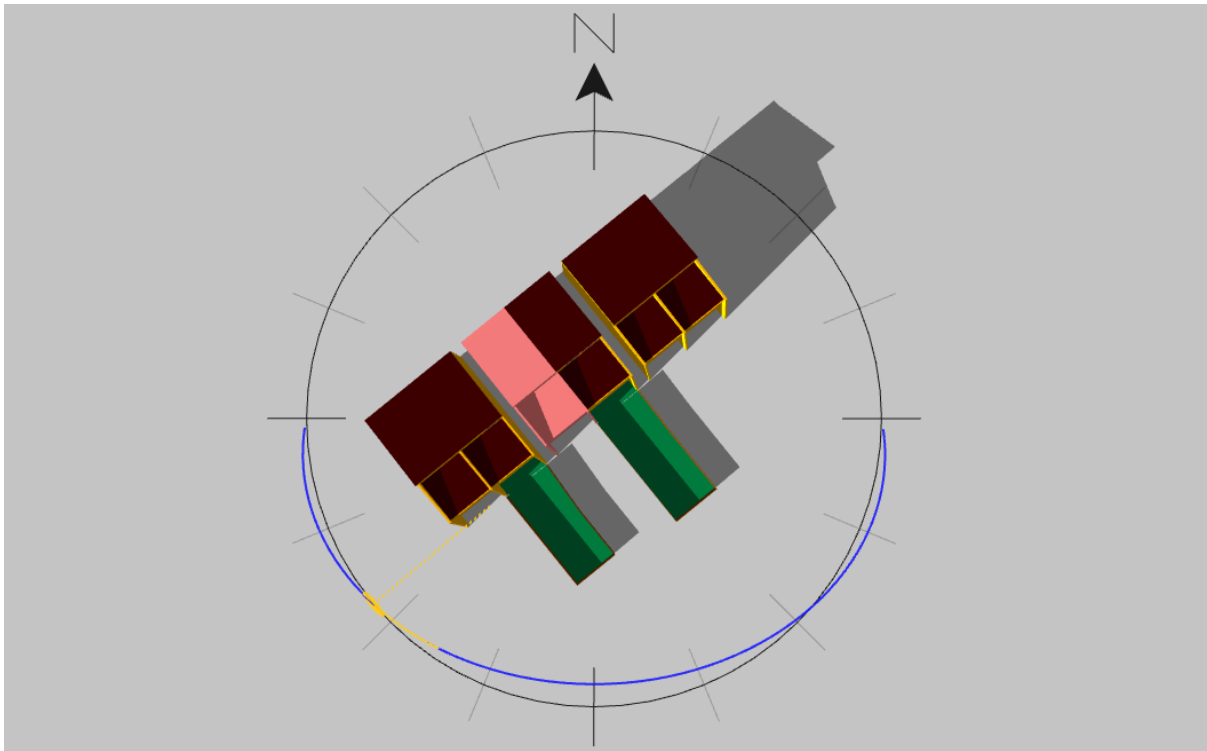

Proposed Site - 15:00 March 21<sup>st</sup>

